





Section Dimension Table


<u>Street Classification</u>	<u>(A) R/W</u>	<u>(2xC) F-F</u>	<u>Min. C&S</u>	<u>Cross Section</u>	<u>Structural Section</u>
Minor Residential	50'	34'	5.5' Rolled	1	A
Minor Residential	50'	30'	4.0' sidewalk SW w/ 0.5' Vertical curb	2	A
Standard Residential	55'	39'	5.5' Rolled	1	A
Standard Residential	55'	35'	4.0' sidewalk SW w/ 0.5' Vertical curb	2	A
Minor Collector	60'	44'	5.5' Vertical	1	B
Major Collector	68'	52'	5.5' Vertical	1	B
Industrial (Local)	66'	52'	4.5' Vertical	1	B
Secondary Arterial	80'	64'	5.5' Vertical	1	B
Four-Lane Undivided					
Minor Arterial	94'	78'	5.5' Vertical	1	B
Four-Lane Divided					
Major Arterial	118'	102'	5.5' Vertical	1	B
Six-Lane Divided					
Minor Arterial w/ RW frontage wall	108'	78'	4.0' meandering SW w/ 0.5' Vertical curb	3	B

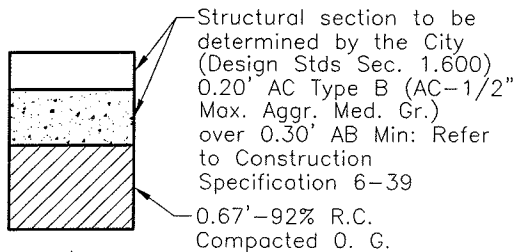

A

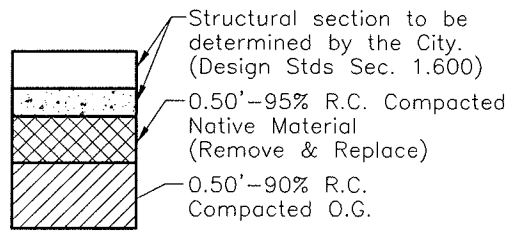

B



Paving Detail at TOE

Structural Section

Notes:

1. See City Public Improvement Design Stds. Sec. 1 for general design requirements.
2. Widening at intersections to provide additional lanes may be required.
3. See Std. Plans 135 and 136 for Vertical and Rolled C,G&S respectively.
4. The area between the R/W and back of sidewalk and between face of walk and back of curb shall be graded to 0.02' per ft. Where wider sidewalk is required (ie. commercial areas, around hydrants, poles etc) sidewalk specifications apply.
5. Private use of the R/W subject to Encroachment Permit requirements and Design Standards Sections 1.400 & 1.500.
6. See Design Stds. Section 1.500 for curb & gutter type criteria.

Dr. KT	No.	Date	Revision	Appr.	Approved By:		STD PLAN
	1	2/05	ADDED MEANDERING WALK		<i>F. Wally Sandelin</i>	2/2/05	101
Ch. WS					F. Wally Sandelin City Engineer R.C.E. 39895	Date	
Date 7/08							