





CITY OF LODI

PUBLIC WORKS DEPARTMENT

TYPE 2 HANDICAP RAMPS

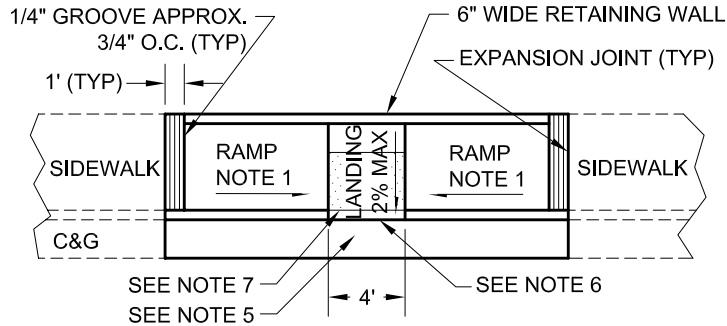

MIDBLOCK - TYPE 2

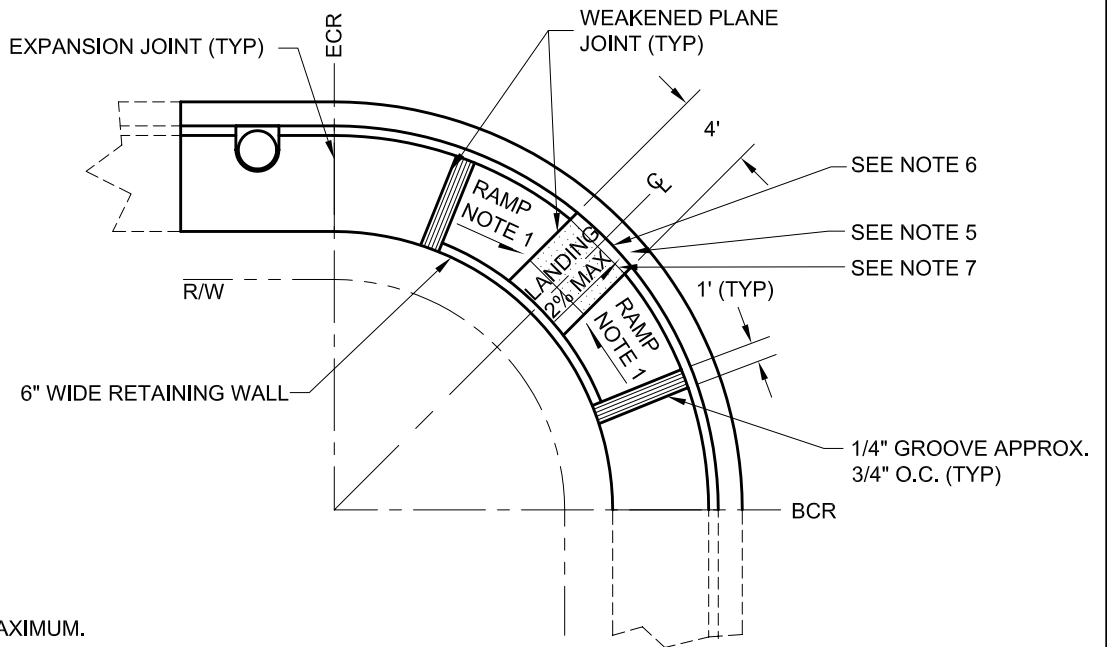

NOTES:

1. RAMP SLOPE 1:12 MAXIMUM.
2. TRANSITION SLOPE 1:10 MAXIMUM.
3. CENTER RAMP ON MIDPOINT OF CURB RETURN.
4. THE CONCRETE FINISH OF THE RAMP SHALL HAVE A TRANSVERSE BROOMED SURFACE TEXTURE ROUGHER THAN THE SURROUNDING SIDEWALK.
5. THE GUTTER PAN ACROSS THE ROUTE OF TRAVEL, FROM THE RAMP TO THE STREET, SHALL HAVE A MAXIMUM SLOPE OF 5%.
6. ALL HANDICAP RAMPS SHALL HAVE NO LIP AND 1/4" DEEP SCORE LINE ACROSS THE RAMP AT GUTTER FLOWLINE.
7. DETECTABLE WARNING SURFACE TO BE INSTALLED 6" TO 8" FROM GUTTER FLOWLINE AND EXTEND 36 INCHES MINIMUM IN THE DIRECTION OF TRAVEL AND THE FULL WIDTH OF THE LANDING.
8. REFER TO CALTRANS STANDARD PLAN A88A FOR RAISED TRUNCATED DOME DETAILS.

CORNER - TYPE 2

Dr. LP	No.	Date	Revision	Appr.	Approved By:	 F. Wally Sandelin City Engineer R.C.E. 39895	STD PLAN
Ch. WS					3/15/05		132B
Date 3/10/05					Date		