

## TYPE 3 HANDICAP RAMP

PARKWAY

RAMP MOTE?

RAMP

NOTE 1

LANDING


2% MAX

SIDEWALK

RETAINING WALL

**GRASS** 

SIDEWALK

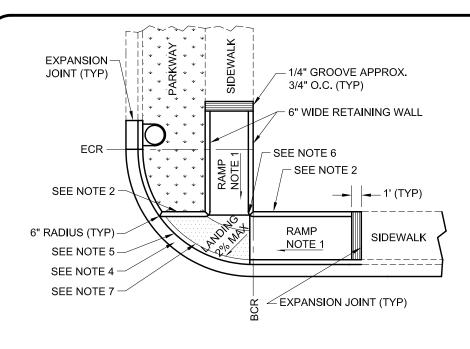

## NOTES:

- RAMP SLOPE 1:12 MAXIMUM.
- 2. BACK OF CURB SHALL BE IN LINE WITH BACK OF WALK.
- THE CONCRETE FINISH OF THE RAMP SHALL HAVE A TRANSVERSE BROOMED SURFACE TEXTURE ROUGHER THAN THE SURROUNDING SIDEWALK.
- THE GUTTER PAN ACROSS THE ROUTE OF TRAVEL, FROM THE RAMP TO THE STREET, SHALL HAVE A MAXIMUM SLOPE OF 5%.
- ALL HANDICAP RAMPS SHALL HAVE NO LIP AND 1/4" DEEP SCORE LINE ACROSS THE RAMP AT GUTTER FLOWLINE.
- RETAINING WALL AT BACK OF RAMP SHALL BE CONSTRUCTED WITH A 6" RADIUS AT THE CORNER AND MAINTAIN EXISTING BACK OF WALK ELEVATIONS.
- DETECTABLE WARNING SURFACE TO BE INSTALLED 6" TO 8" FROM GUTTER FLOWLINE AND EXTEND 36 INCHES MINIMUM IN THE DIRECTION OF TRAVEL AND FULL WIDTH OF LANDING.
- REFER TO CALTRANS STANDARD PLAN A88A FOR RAISED TRUNCATED DOME DETAILS.

Dr.	ΙD	No.	Date	Revision	Appr.	Approved By: /	STD PLAN
	LF						
Ch.	ws					F. Wally Sandelly 3/15/05	1220
Date						F. Wally Sandelin 3/15/05 City Engineer Date	
3	/10/05					R.C.E. 39895	