



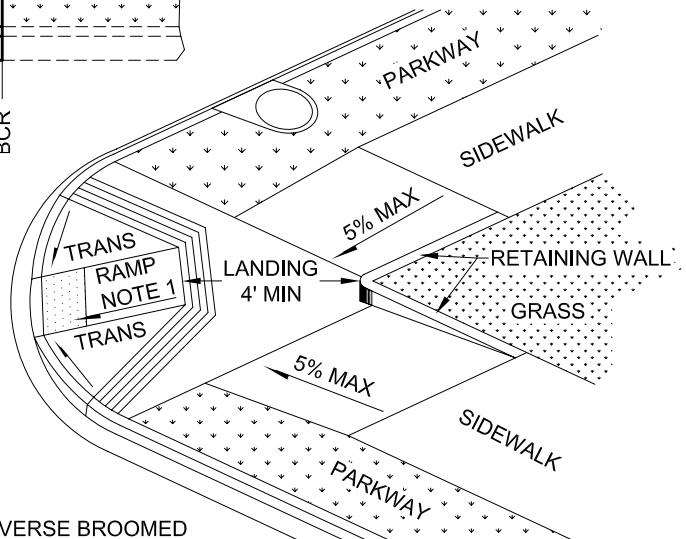

CITY OF LODI

PUBLIC WORKS DEPARTMENT

TYPE 4 HANDICAP RAMP

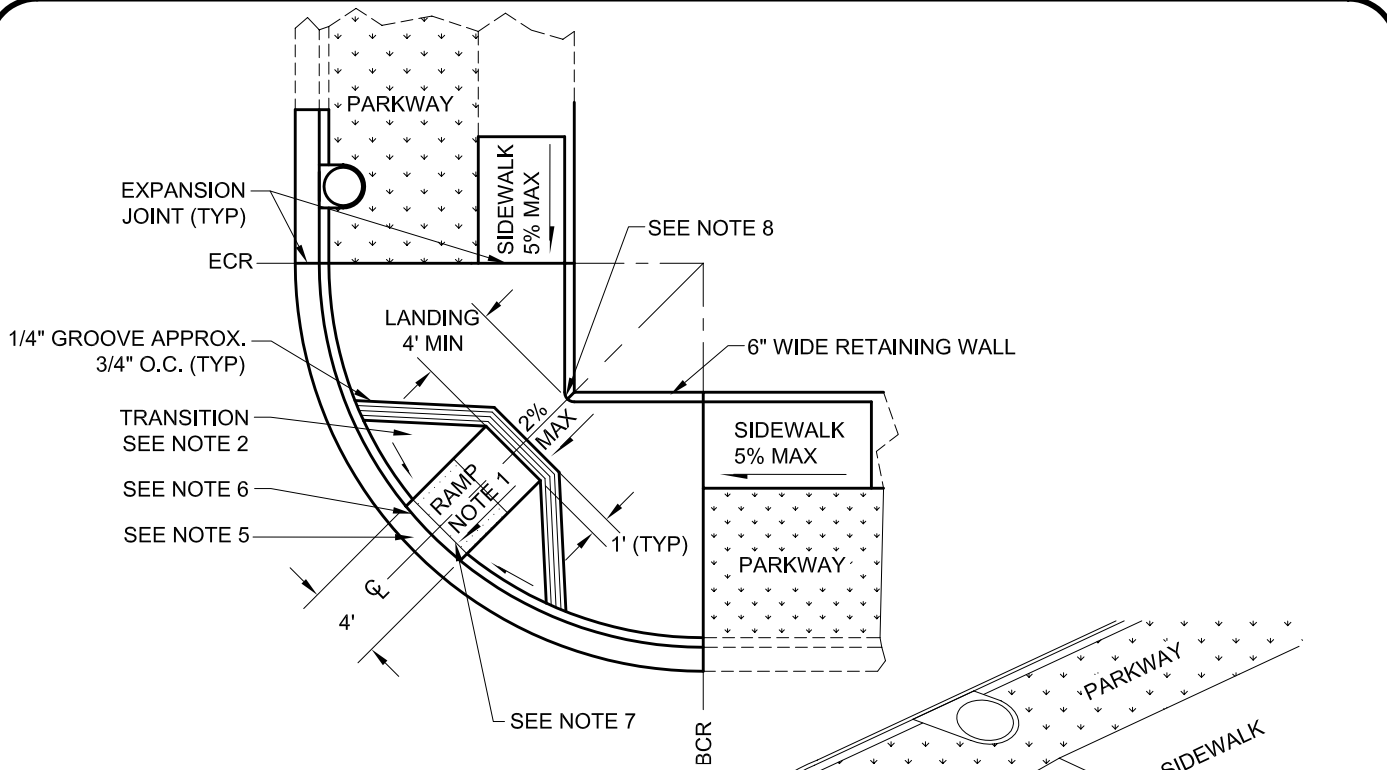

NOTES:

1. RAMP SLOPE FROM 1:12 MAXIMUM TO 1:15 MINIMUM.
2. TRANSITION SLOPE 1:10 MAXIMUM.
3. CENTER RAMP ON MIDPOINT OF CURB RETURN.
4. THE CONCRETE FINISH OF THE RAMP SHALL HAVE A TRANSVERSE BROOMED SURFACE TEXTURE ROUGHER THAN THE SURROUNDING SIDEWALK.
5. THE GUTTER PAN ACROSS THE ROUTE OF TRAVEL, FROM THE RAMP TO THE STREET, SHALL HAVE A MAXIMUM SLOPE OF 5%.
6. ALL HANDICAP RAMPS SHALL HAVE NO LIP AND 1/4" DEEP SCORE LINE ACROSS THE RAMP AT GUTTER FLOWLINE.
7. DETECTABLE WARNING SURFACE TO BE INSTALLED 6" TO 8" FROM GUTTER FLOWLINE AND EXTEND 36 INCHES MINIMUM IN THE DIRECTION OF TRAVEL AND THE FULL WIDTH OF THE CURB RAMP.
8. RETAINING WALL AT BACK OF RAMP SHALL BE CONSTRUCTED WITH A 6" RADIUS AT THE CORNER AND MAINTAIN EXISTING BACK OF WALK ELEVATIONS.
9. REFER TO CALTRANS STANDARD PLAN A88A FOR RAISED TRUNCATED DOME DETAILS.

| | | | | | | | |
|-----------------|-----|------|----------|-------|--------------|--|----------|
| Dr. LP | No. | Date | Revision | Appr. | Approved By: | F. Wally Sandelin City Engineer R.C.E. 39895 | STD PLAN |
| Ch. WS | | | | | 3/15/05 | | 132D |
| Date 3/10/05 | | | | | Date | | |