

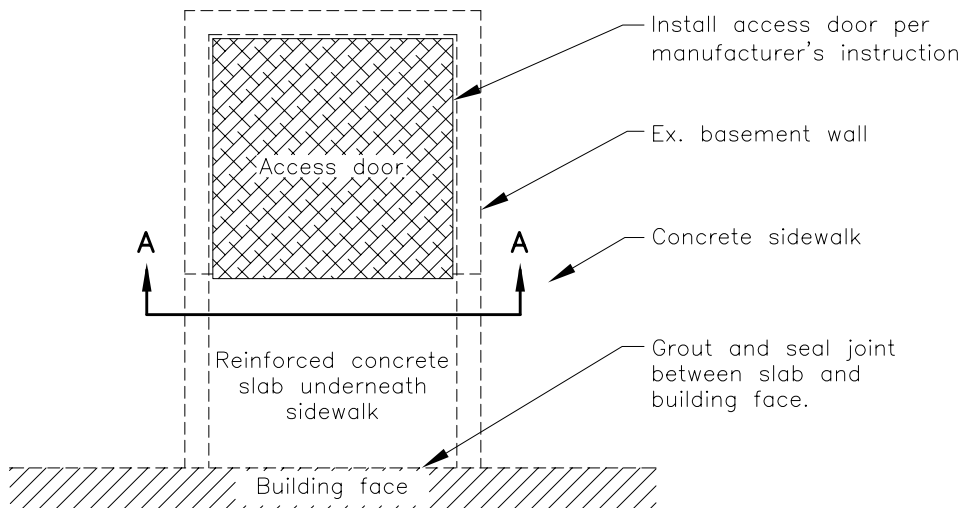




CITY OF LODI
PUBLIC WORKS DEPARTMENT

**Concrete Slab
for Basement Access
Spanning Detail**

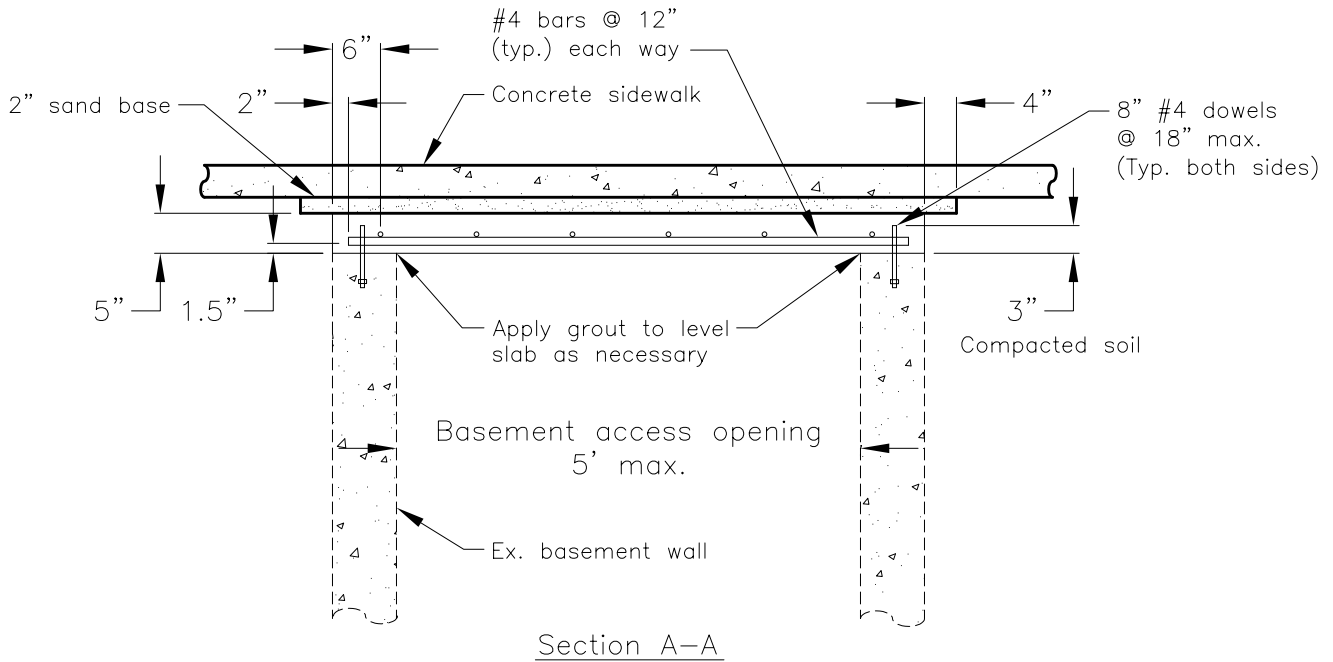

Notes:

1. All steel reinforcements shall be Grade 40 minimum.
2. All concrete shall have a minimum strength of 2,500 psi @ 28 days.

Dr. KT	No.	Date	Revision	Appr.	Approved By:	 F. Wally Sandelin City Engineer R.C.E. 39895	12/28/00 Date	STD PLAN
Ch. WS					143			
Date								
12/00								