




CITY OF LODI

PUBLIC WORKS DEPARTMENT

24" Riser

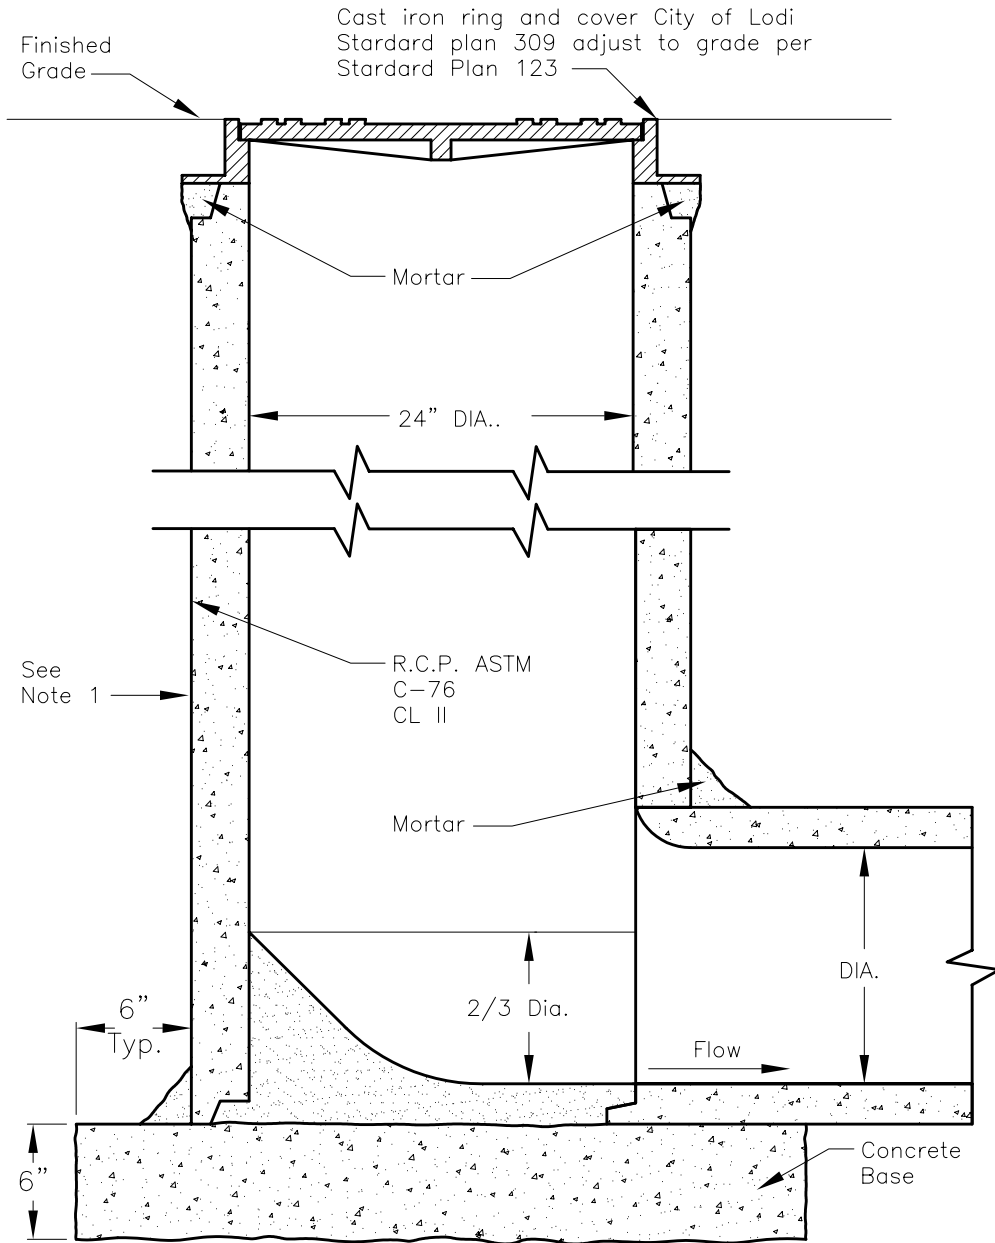

Notes:

1. Backfill around riser shall be a minimum of 92% R.C.
2. Concrete:
 - A. 2500 psi @ 28 days
 - B. 4" slump maximum.
 - C. Class B per Section 90 of Standard Specifications. 1-1/2" max. agg.
3. For depth over 60", use 48" manhole, Standard Plan 301.
4. For trench backfill requirements, See Standard Plan 501.

Dr. KT	No.	Date	Revision	Appr.	Approved By:	F. Wally Sandelin City Engineer R.C.E. 39895	12/28/00 Date	STD PLAN	
Ch. WS									310
Date									
12/00									