


2" Fire Sprinkler Service

Establish for use of Copper Tubing Type K or G.I.P.

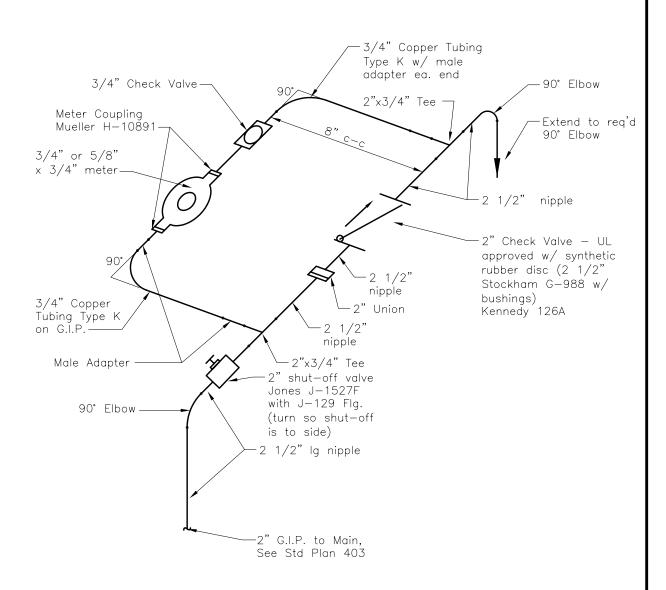

Notes:

- 1. Use Christy B—48 box with traffic lid per Std Plan 403. Center over fittings.
- 2. City service responsibility is from main to shut-off valve.
- 3. Meter to be Sensus SR. Support w/ brick.
- 4. Where Sprinkler system contains chemical additives or other possible contamination exists, Check Valves shown shall be replaced with Double Check Valve Assemblies per Std Plan 411.

ı	Dr.	KT	No.	Date	Revision	Appr.	Approved By:/	STD PLAN
⊩							11.	
1	Ch.	WS					J Wally Sandelin 12/28/00	1 116
t	Date				·		F. Wally Sandelin Date	1 4 1 0 ,
-	12	2/00					R.C.E. 39895	