

NISTIR 7068

**Deposition Rates of Fine and Coarse
Particles in Residential Buildings:
Literature Review and Measurements
in an Occupied Townhouse**

Cynthia Howard-Reed
Lance Wallace
Steven J. Emmerich

NIST

National Institute of Standards and Technology
Technology Administration, U.S. Department of Commerce

NISTIR 7068

Deposition Rates of Fine and Coarse Particles in Residential Buildings: Literature Review and Measurements in an Occupied Townhouse

Cynthia Howard-Reed
Steven J. Emmerich
*Building Environment Division
Building and Fire Research Laboratory
National Institute of Standards and Technology*

Lance Wallace
*National Exposure Research Laboratory
U.S. Environmental Protection Agency*

October 2003



U.S. Department of Commerce
Donald L. Evans, *Secretary*
Technology Administration

Phillip J. Bond, Undersecretary of Commerce for Technology
National Institute of Standards and Technology
Arden L. Bement, Jr., *Director*

Acknowledgements and Disclaimer

We thank Andrew Persily of NIST and Tracy Thatcher of the Lawrence Berkeley National Laboratory for reading the entire paper and supplying helpful comments. This study was partially funded by an EPA Internal Grant to the second author. It has been reviewed and cleared for publication. Certain commercial equipment, instruments, or materials are identified in this paper in order to specify the experimental procedure adequately. Such identification is not intended to imply recommendation or endorsement by the National Institute of Standards and Technology, nor is it intended to imply that the materials or equipment identified are necessarily the best available for the purpose.

Abstract

Several studies have shown the importance of particle losses in real homes due to deposition and filtration; however, none have quantitatively shown the impact of using a central forced air fan and in-duct filter on particle loss rates. In an attempt to provide such data, we measured the deposition of fine and coarse particles following specific source events in an occupied townhouse and also in an unoccupied test house. Experiments were run with three different sources (cooking with a gas stove, citronella candle, pouring kitty litter), with the central heating and air conditioning (HAC) fan on or off, and with two different types of in-duct filters (electrostatic precipitator and ordinary furnace filter). These tests resulted in a database of deposition rates for particles ranging from 0.3 μm to 10 μm under a wide range of occupancy conditions. Particle size, HAC fan operation, and the electrostatic precipitator had significant effects on particle loss rates. The standard furnace filter had no effect on loss rates. Surprisingly, the type of source (combustion vs. mechanical generation) and the type of furnishings (fully furnished including carpet vs. largely unfurnished including mostly bare floor) also had no measurable effect on the deposition rates of particles of comparable size. With the HAC fan off, average deposition rates varied from 0.3 h^{-1} for the smallest particle range (0.3 μm to 0.5 μm) to 5.2 h^{-1} for particles greater than 10 μm . Operation of the central HAC fan approximately doubled these rates for particles $< 5 \mu\text{m}$, and increased rates by 2 h^{-1} for the larger particles. An in-duct electrostatic precipitator increased the loss rates compared to the fan-off condition by factors of 5 to 10 for particles $< 2.5 \mu\text{m}$, and by a factor of 3 for the larger particles.

Keywords: fine particles, coarse particles, deposition, filtration, residential indoor air quality

Table of Contents

Acknowledgements and Disclaimer	i
Abstract	ii
1 Introduction	1
2 Experimental methodology	2
2.1 Deposition Calculation	3
<i>Figure 1. Example calculation of decay rate for kitty litter event.</i>	5
<i>Figure 2. Concentration of 0.5 μm to 1.0 μm particles following candle burned in basement with central fan off.</i>	6
3 Results and discussion	7
<i>Figure 3. Comparison of deposition rates for different particle sizes and sources with HAC fan off</i>	7
<i>Table 1. Deposition rates for cooking source events.</i>	8
<i>Table 2. Deposition rates for citronella candle source events.</i>	9
<i>Table 3. Deposition rates for kitty litter source events in sealed basement.</i>	12
<i>Figure 4. Comparison of particle deposition rates for different HAC configurations.</i>	14
<i>Figure 5. Comparison of average deposition rates for particles from a citronella candle in two locations</i>	15
<i>Table 4. Effect of HAC fan and in-duct filters on particle deposition rates (h^{-1}).</i>	16
3.2 Other Studies	18
<i>Table 5. Characteristics of previous studies of deposition rates for particles $> 0.3 \mu\text{m}$</i>	18
<i>Figure 6. Measured deposition rates in previous studies and this study.</i>	20
<i>Figure 7. Decay rates in this study by source type and fan-filter combination.</i>	21
<i>Table 6. Effect of HAC fan and in-duct filters on the fraction of outdoor particles penetrating indoors.</i>	22
4 Conclusion	23
5 References	24

1 Introduction

There have been numerous studies documenting the contribution of indoor sources (*e.g.*, smoking and cooking) to elevated concentrations of particles indoors (Özkaynak *et al.*, 1996; Wallace, 1996). Indoor sources such as combustion tend to elevate ultrafine and fine particle concentrations whereas mechanically generated sources (sweeping, dusting, resuspension from clothes and carpets) tend to elevate concentrations in the coarse fraction. Following the generation of particles indoors, concentration levels may be reduced through several mechanisms including exfiltration through air change, filtration using portable or in-duct air cleaners, and deposition. Of these mechanisms, exfiltration losses are relatively easy to quantify for a given space, based on the air change rate, and these losses apply equally to all particle sizes. The other loss rates, however, are dependent on several factors including particle size, shape, composition, concentration, room air velocity, room surface characteristics, and volume flow of air through filters and duct work (Nazaroff and Cass, 1989). Coagulation is another important mechanism that affects particle concentrations in a specific size range. However, Xu *et al.* (1994) estimated coagulation loss rates for environmental tobacco smoke in a room-size chamber and determined it only affected the concentration of particles less than 0.5 μm in diameter and for concentrations greater than 8000 particles cm^{-3} , a very high concentration for typical residential environments. Thus, the more significant loss mechanisms for residential particle concentrations in need of further study are filtration and deposition. To date, there are only a few studies quantifying size-dependent particle loss rates in occupied homes due to deposition (Thatcher *et al.*, 2002; Long *et al.*, 2001; Vette *et al.*, 2001; Abt *et al.*, 2000; Fogh *et al.*, 1997; Wallace, 1997; Thatcher and Layton, 1995), none of which also examine the loss due to operation of the ventilation system or use of air filtration devices.

We conducted a multi-year monitoring study in an occupied three-story townhouse to increase the existing database of particle deposition rates for indoor sources representing a wide range of particle sizes. The study included real-time monitoring of tracer gas concentrations and indoor and outdoor concentrations of particles ranging from 0.3 μm to 10 μm . Following the peak concentration of an indoor particle source, the decay rate was calculated allowing for the determination of deposition and filtration particle losses. The heating and air conditioning (HAC) configuration was varied between off, on with no filter, and on with either a typical furnace filter or an electrostatic precipitator (ESP). The extended duration of this study allowed for determination of deposition and filtration rates for numerous indoor particle sources.

The use of a single house normalized the impact of different surface characteristics on deposition losses. Thus, the relative importance of deposition as a loss mechanism may be determined between different types of sources. Additional decay experiments were completed in a second uninhabited house with the same source, thereby allowing another comparison of decay rates.

2 Experimental methodology

The determination of decay rates for indoor particle sources is part of a larger monitoring study that has been described elsewhere (Wallace and Howard-Reed, 2002; Wallace *et al.*, 2002). In summary, a three-story townhouse located in Reston, VA (approximately 35 km NW of Washington, D.C.) was equipped with several instruments to continuously monitor air change rates and indoor and outdoor particle concentrations. The end unit townhouse consists of three levels including a partial basement with recreation room, utility room, and bathroom on the bottom level; a kitchen/dining room, living room, and bathroom on the middle level; and four bedrooms and two bathrooms on the top level. The overall volume of the townhouse is approximately 400 m³ with a floor area of approximately 50 m² per level. The house's primary heating system is a gas furnace and the cooling system includes central air conditioning and a temperature-actuated attic fan to vent the attic on hot days. The HAC system uses 100 % recirculated air and its ductwork does not enter the attic, resulting in minimal duct leakage to the outdoors. For the source decay rates described in this paper, the HAC system was either turned off, operated with no filter, or operated with either a typical panel furnace filter or an electrostatic precipitator (ESP). The ESP positively charges particles with ionizing wires at 6200 V. The charged particles are then removed by ground collector plates. The ESP required frequent cleaning to maintain high removal efficiencies.

The house's infiltration rate was measured using the tracer decay method as described in ASTM Standard E741 (ASTM, 2001) with sulfur hexafluoride (SF₆) as the tracer gas and a gas chromatograph with electron capture detector (GC-ECD) detection system. The system was automated to inject SF₆ every 2 h to 4 h into the HAC system where it was distributed to the rest of the house. The GC-ECD measured tracer gas concentrations sequentially every minute from 10 locations in the house: two locations in the lower level, the central return of the HAC system, three locations on the middle level, three locations on the top level, and the attic. The GC-ECD was calibrated to measure SF₆ concentrations between 30 µg/m³ and 900 µg/m³ (5 ppb(v) and 150 ppb(v)) with an accuracy of approximately ± 2 %. We observed that with the central HAC fan operating, it normally took about 30 min following injection to achieve relatively uniform concentrations in all rooms. Therefore, hourly air change rates were calculated from 30 min past the hour to 30 min past the next hour, for all hours in which no injection took place. This allowed a calculated air change rate for about 4500 h out of 8760 possible hours in the year 2000. Air change rates were estimated by linear regression of the natural logarithm of SF₆ concentration versus time. The uncertainty of the calculated air change rates was approximately ± 10 %.

The duct velocity in the HAC system was measured every 5 min with a hot wire anemometer that had an accuracy of approximately ± 2.5 %. The duct velocity was converted to a volumetric airflow rate of approximately 5 h⁻¹ when the central fan was operating.

Particle concentrations were integrated over a 1 min time period every 5 min with a Climet (Climet Instruments Model 500-I, Redwood City, CA) optical scattering instrument that counts particles in the following six size ranges (modified to include one boundary at 2.5 µm) : 0.3 µm to 0.5 µm, 0.5 µm to 1.0 µm, 1.0 µm to 2.5 µm, 2.5 µm to 5.0 µm, 5.0 µm to 10 µm, and > 10

µm. Four Climets were used in this study, including one for counting outdoor particle concentrations. Limitations of this instrument have been discussed elsewhere (Wallace and Howard-Reed, 2002). All samples were collected directly by the Climet without tubing attached to the inlet. The precision of the Climet varies according to the size range considered, with the best precision at the smallest size ranges (which have the largest number of particles). Precision varies from a few percent at these small size ranges to much higher values at the largest size ranges, which may have less than 10 particles collected over a 1 min sampling period at typical indoor concentrations.

Indoor and outdoor environmental conditions were also continuously monitored. Temperature was measured sequentially every minute in 10 indoor locations (same locations as SF₆ samples) and outdoors with thermistors (accuracy of approximately ± 0.4 °C). Relative humidity (RH) was measured every 5 min in four indoor locations, the attic, and outdoors using bulk polymer resistance sensors with an accuracy of ± 3 % RH. Wind speed and direction were measured with a sonic anemometer (Climatronics, Inc.) mounted 2 m above the townhouse roof. The anemometer was capable of measuring wind speeds from 0 m s⁻¹ to 50 m s⁻¹ (± 5 %) with a resolution of 0.1 m s⁻¹. For wind speeds above 4.5 m s⁻¹, the wind direction had an accuracy of ± 5 % with no stated accuracy for lower wind speeds. Since the attic fan came on automatically when attic temperatures reached a certain point, the times it turned on or off were recorded electronically and transmitted to a computer.

Finally, a detailed record of activities was kept by the home's two non-smoking adult occupants. Specifically, all cooked meals, cleaning events, and combustion activities were recorded as well as ventilation status (*e.g.*, windows open or closed, central fan off, patio door open, *etc.*). Sources causing substantial increases in indoor particle concentrations suitable for calculating decay rates included burning a citronella candle, pouring kitty litter, frying tortillas, and other cooking events.

2.1 Deposition Calculations

The following mass balance equation was used to estimate particle decay rates due to infiltration, deposition, and filtration following a source event (assuming no particle generation or coagulation during decay):

$$\frac{dC_p}{dt} = P_p a C_{out,p} - a C_p - k_p C_p - k_{p,HAC} C_p - k_{p,ac} C_p \quad (1)$$

where,

- C_p = indoor particle concentration for specific particle size p (particles m⁻³)
- P_p = penetration coefficient for specific particle size p (-)
- a = air change rate (h⁻¹)
- $C_{out,p}$ = outdoor particle concentration for specific particle size p (particles m⁻³)
- k_p = deposition loss rate coefficient for specific particle size p describing losses to room surfaces (h⁻¹)
- $k_{p,HAC}$ = deposition loss rate coefficient for specific particle size p describing losses during HAC operation (h⁻¹)

$k_{p,ac}$ = equivalent loss rate coefficient for air cleaner, where $k_{p,ff}$ corresponds to typical furnace filter and $k_{p,ESP}$ corresponds to electrostatic precipitator (h^{-1}).

Assuming P_p , $C_{out,p}$, a , k_p , $k_{p,HAC}$, and $k_{p,ac}$ are constant, the solution to Equation 1 is:

$$C_p = \frac{P_p a C_{out,p}}{a + k_p + k_{p,HAC} + k_{p,ac}} \left(1 - \exp\left[-(a + k_p + k_{p,HAC} + k_{p,ac})t\right]\right) + C_{p,0} \exp\left[-(a + k_p + k_{p,HAC} + k_{p,ac})t\right] \quad (2)$$

where,

$C_{p,0}$ = indoor particle concentration for specific particle size p at time = 0 (particles m^{-3}).

At steady-state conditions, the solution to Equation 1 becomes:

$$C_{p,SS} = \frac{P_p a C_{out,p}}{a + k_p + k_{p,HAC} + k_{p,ac}} \quad (3)$$

where,

$C_{p,SS}$ = indoor particle concentration for specific particle size p at steady-state conditions (particles m^{-3}).

Equation 3 may be used to approximate particle concentrations during relatively stable ambient conditions with no indoor sources. This equation was used as an estimator of background particle concentrations in the townhouse. Using the background concentration and substituting Equation 3 into Equation 2 results in:

$$\begin{aligned} C_p &= C_{p,SS} \left(1 - \exp\left[-(a + k_p + k_{p,HAC} + k_{p,ac})t\right]\right) + C_{p,0} \exp\left[-(a + k_p + k_{p,HAC} + k_{p,ac})t\right] \\ (C_p - C_{p,SS}) &= (C_{p,0} - C_{p,SS}) \exp\left[-(a + k_p + k_{p,HAC} + k_{p,ac})t\right] \\ \ln(C_p - C_{p,SS}) &= \left[-(a + k_p + k_{p,HAC} + k_{p,ac})t\right] + \ln(C_{p,0} - C_{p,SS}) \end{aligned} \quad (4)$$

The negative of the slope of the best-fit line of $\ln(C_p - C_{p,SS})$ versus time is the value $a + k_p + k_{p,HAC} + k_{p,ac}$. Subtracting the independently measured air change rate from the total decay results in an estimate of the loss rate due to deposition and filtration. An example plot of a decay rate for 2.5 μm to 5.0 μm particles generated by pouring kitty litter with the fan off is shown in Figure 1.

Several criteria were established to minimize the error associated with applying Equation 4 to calculate decay rates. First, the indoor source of interest must produce particle concentrations substantially higher than (e.g., 10 times) background levels. No other known indoor particle sources should be active and the outdoor concentration must be relatively constant during the decay calculation period. There also needed to be evidence of mixing of both the SF_6 injection

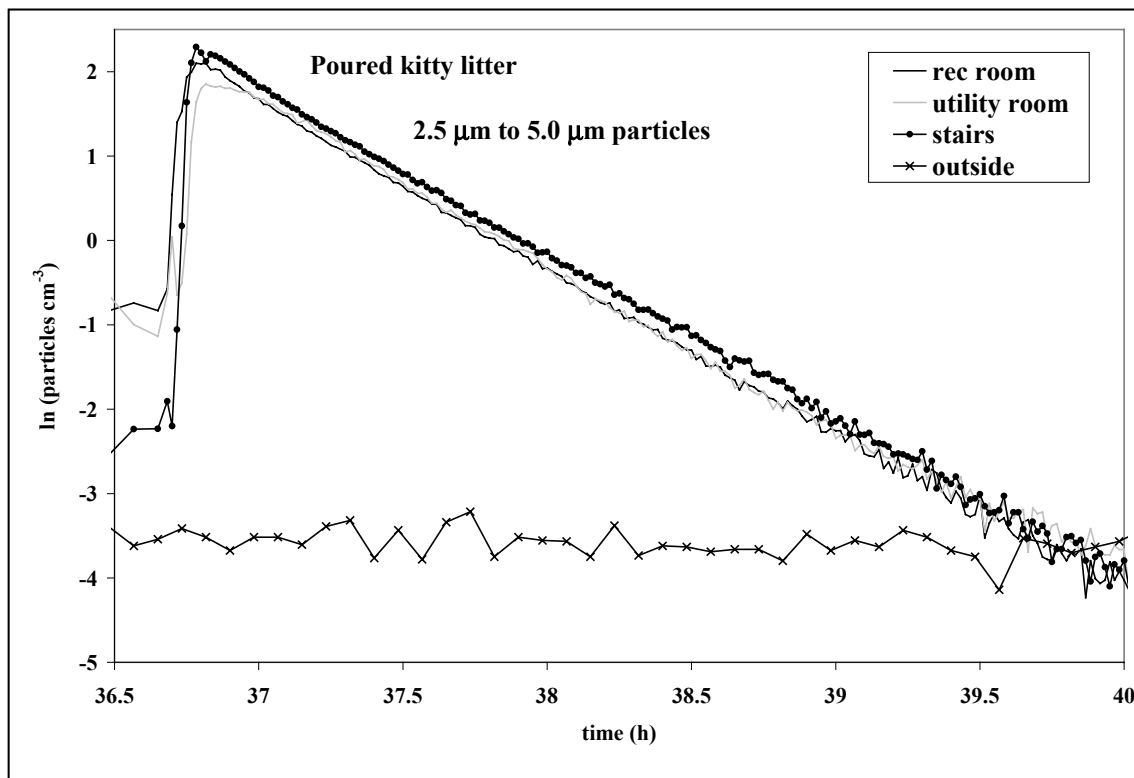


Figure 1. Example calculation of decay rate for kitty litter event. Rec Room: $a + k_p = 1.26 \text{ h}^{-1}$ ($R^2 = 0.995$). Utility room: $a + k_p = 1.41 \text{ h}^{-1}$ ($R^2 = 0.99$). Stairs: $a + k_p = 1.24 \text{ h}^{-1}$ ($R^2 = 0.99$).

and particle emissions into all rooms or floors of the house. Figure 2 shows the concentration of $0.5 \mu\text{m}$ to $1.0 \mu\text{m}$ particles resulting from a candle burned in the basement. For this case, the fan was not on, thereby showing the maximum time it takes to reach a relatively uniform concentration in the house. All calculations of deposition rates were made after complete mixing had occurred. Figure 2 also illustrates the order of magnitude increase in particle concentration above background and the relatively low and constant outdoor concentration. If particle concentrations were not measured on every floor, then the decay rate was not calculated until the fan had been on for at least 10 min (except for kitty litter experiments conducted in the basement which was purposely closed off from rest of house). In addition, the R^2 for the decay of a given particle size needed to be greater than 0.9. Also the air change rates for all rooms were required to be similar (i.e., having a relative standard deviation (RSD) $<15\%$). Although there were hundreds of particle source events in the townhouse, only 15 cooking events, 18 candle burns, and 12 kitty litter pours met all of the criteria and are presented in this paper.

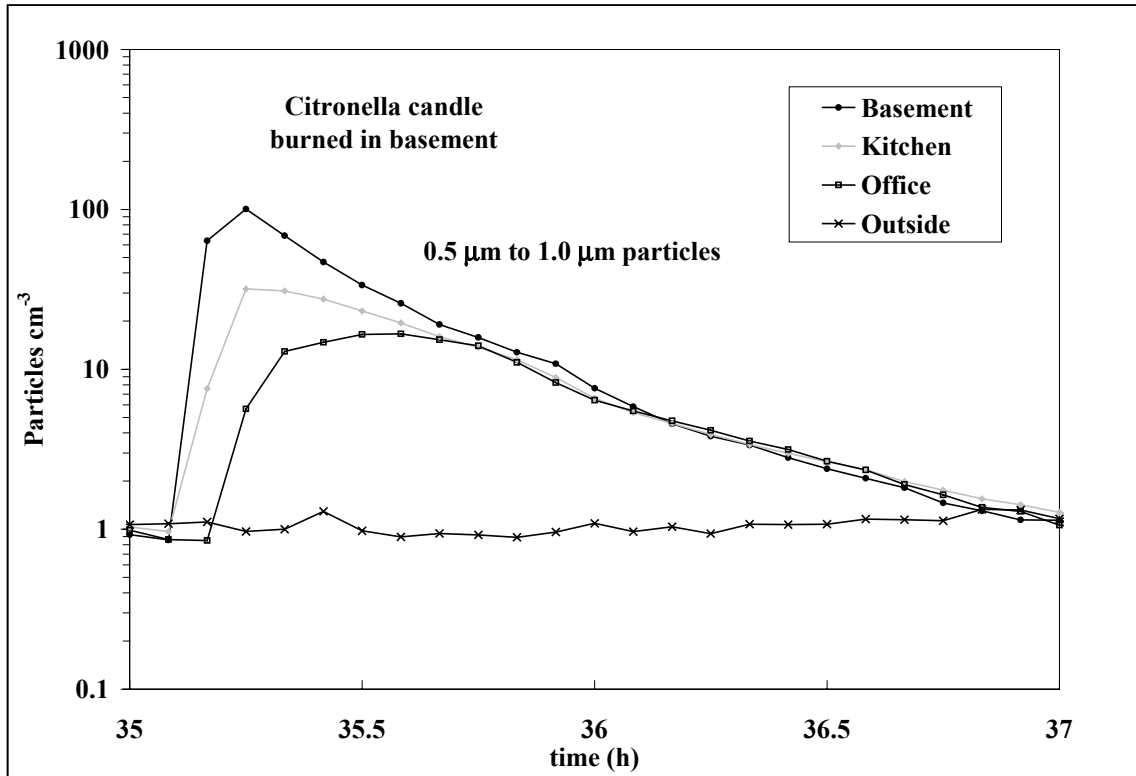


Figure 2. Concentration of 0.5 μm to 1.0 μm particles following candle burned in basement with central fan off.

3 Results and discussion

Results from the 45 applicable tests are listed in Tables 1 – 3. Each table includes a single source type, within which results are organized by particle size, sampling location, and HAC fan/air cleaner status. Figure 3 shows average deposition rates for each source type as a function of particle size for all cases when the central fan was off. As expected, deposition for each source increased with increasing size. This effect was most dramatic once the particle size was greater than 2.5 μm .

In addition, Figure 3 also illustrates the lack of influence of source type on deposition rates for a given particle size. The types of particles generated by the sources included cooking oil droplets, combustion particles, and coarse particles. Although the particle characteristics between the sources are dissimilar, this difference did not appear to significantly impact deposition rates. For example, the average deposition rates for 0.5 μm to 1.0 μm particles were 0.41 h^{-1} (SD $\pm 0.10 \text{ h}^{-1}$) for cooking, 0.41 h^{-1} (SD $\pm 0.24 \text{ h}^{-1}$) for kitty litter, and 0.47 h^{-1} (SD $\pm 0.12 \text{ h}^{-1}$) for the citronella candle (HAC fan off). In fact, for each size range, decay rates for the three sources (cooking, citronella candle, kitty litter) were not significantly different whether the fan was off, on, or on with a filter present. This finding allowed us to combine results from all sources in considering the effect of the central fan and the various air filtration devices.

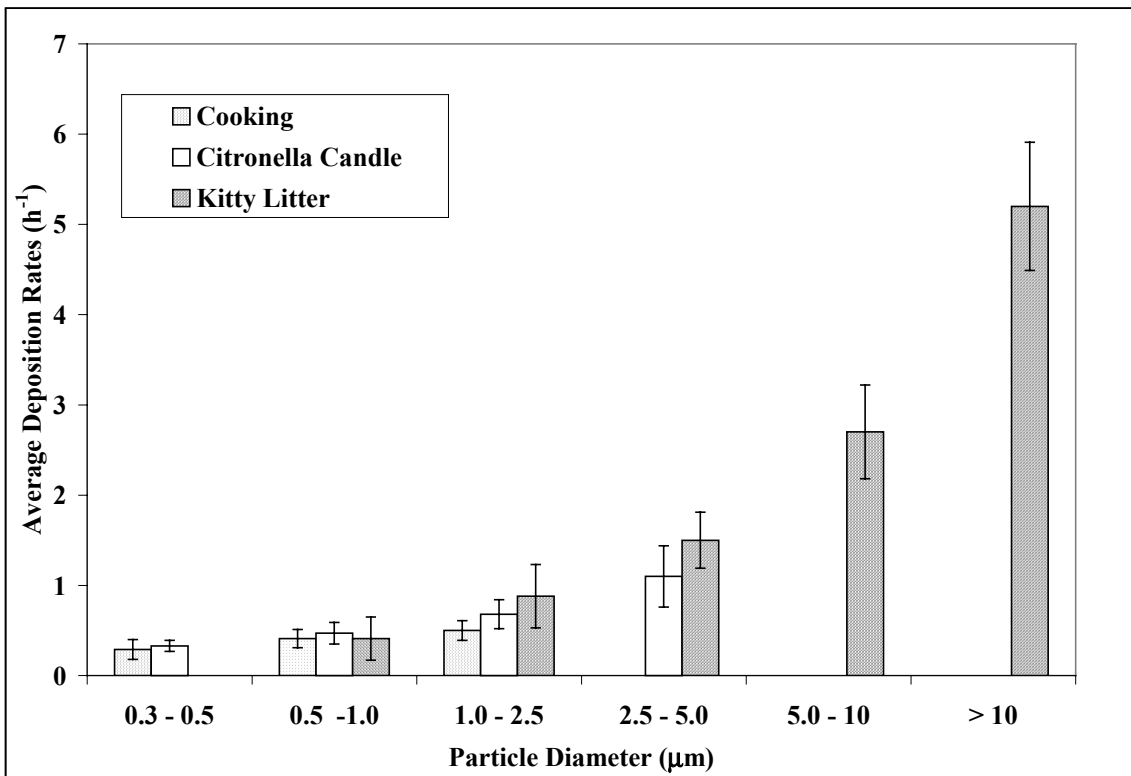


Figure 3. Comparison of deposition rates for different particle sizes and sources with HAC fan off. Error bars are \pm one standard deviation.

Table 1. Deposition rates for cooking source events.

Date	Source	Measurement Location	Air Change	Particle Size		
			Rate	0.3 μm to 0.5 μm	0.5 μm to 1.0 μm	1.0 μm to 2.5 μm
Fan Off			a (h^{-1})	k_p (h^{-1})	k_p (h^{-1})	k_p (h^{-1})
3/10/00	Tortillas	Basement	0.29	0.47	0.61	0.61
		Kitchen	0.39	0.39	0.49	0.62
3/24/00	Tortillas	Kitchen	0.37	0.27	0.42	-
		Upstairs	0.44	0.13	0.30	0.45
5/30/00	Tortillas	Basement	0.29	0.31	0.32	0.39
		Kitchen	0.27	0.30	0.33	0.60
4/4/00	Fritata	Basement	0.23	0.32	0.48	0.55
		Kitchen	0.52	0.21	0.38	0.43
		Upstairs	0.54	0.18	0.34	0.36
AVERAGE:				0.29	0.41	0.50
STANDARD DEVIATION:				0.11	0.10	0.11
Fan On			a (h^{-1})	$k_p+k_{p,HAC}$ (h^{-1})	$k_p+k_{p,HAC}$ (h^{-1})	$k_p+k_{p,HAC}$ (h^{-1})
4/8/00	Tortillas	Basement	0.79	1.2	0.88	1.3
		Living Room	0.81	1.5	1.1	0.88
		Upstairs	0.83	0.97	0.61	1.0
4/14/00	Tortillas	Basement	0.40	0.90	0.85	1.0
		Living Room	0.37	0.86	0.85	1.0
		Upstairs	0.31	0.93	0.89	1.1
5/12/00	Tortillas	Cent. Return	0.17	1.4	1.0	-
		Kitchen	0.17	1.6	1.2	-
		Upstairs	0.14	1.0	0.69	0.67
3/24/00	Fried eggs	Basement	0.52	0.56	1.0	1.4
		Kitchen	0.51	0.49	0.88	1.2
		Upstairs	0.57	0.60	1.1	1.5
2/17/00	Sautéed Clam Sauce	Upstream	0.60	0.90	1.2	1.7
		Downstream	0.60	1.0	1.2	1.6
		Kitchen	0.58	1.0	1.4	1.8

5/8/00	Stir-fry	Basement	0.32	0.27	0.62	1.4
		Living Room	0.32	0.35	0.59	1.2
		Upstairs	0.34	0.28	0.50	1.1
AVERAGE:			0.88		0.92	1.2
STANDARD DEVIATION:			0.40		0.25	0.31
Fan On and ESP On			a (h^{-1})	$k_p+k_{p,HAC}+k_{p,ESP}$ (h^{-1})	$k_p+k_{p,HAC}+k_{p,ESP}$ (h^{-1})	$k_p+k_{p,HAC}+k_{p,ESP}$ (h^{-1})
3/31/00	Tortillas	Basement	0.64	4.6	5.0	5.9
4/8/00	Tortillas	Basement	0.79	3.8	4.1	-
		Living Room	0.81	4.3	4.9	-
		Upstairs	0.83	4.1	4.1	4.4
4/14/00	Tortillas	Basement	0.44	2.2	2.5	2.9
		Living Room	0.43	2.3	2.6	3.6
		Upstairs	0.35	2.3	2.7	3.0
5/12/00	Tortillas	Cent. Return	0.17	4.9	8.6	-
		Kitchen	0.17	5.8	8.3	-
		Upstairs	0.14	4.4	5.1	6.6
5/30/00	Tortillas	Basement	0.29	2.6	2.9	-
		Kitchen	0.27	3.0	6.3	-
AVERAGE:			3.7		4.8	4.4
STANDARD DEVIATION:			1.2		2.1	1.6

Table 2. Deposition rates for citronella candle source events.

Date	Source Location	Measurement Location	Air Change Rate	0.3 μm to 0.5 μm	0.5 μm to 1.0 μm	1.0 μm to 2.5 μm	2.5 μm to 5.0 μm
			a (h^{-1})	k_p (h^{-1})	k_p (h^{-1})	k_p (h^{-1})	k_p (h^{-1})
2/24/99	Kitchen	Basement	0.42	0.37	0.45	0.36	-
		Kitchen	0.42	0.43	0.66	0.78	0.89
		Office	0.42	0.26	0.41	0.61	0.57
4/3/00	Kitchen	Basement	0.18	0.29	0.47	0.75	-
		Living Room	0.18	0.32	0.39	0.63	1.4
		Upstairs	0.18	0.31	0.38	0.61	1.0
5/22/00	Basement	Basement	0.29	-	0.66	0.92	1.6

		Kitchen	0.29	-	0.35	0.77	1.1
		Upstairs	0.29	-	0.35	0.67	0.96
AVERAGE:			0.33	0.47	0.68	1.1	
STANDARD DEVIATION:			0.06	0.12	0.16	0.34	
Fan On w/o Furnace Filter			a (h⁻¹)	$k_p+k_{p,HAC}$ (h⁻¹)	$k_p+k_{p,HAC}$ (h⁻¹)	$k_p+k_{p,HAC}$ (h⁻¹)	$k_p+k_{p,HAC}$ (h⁻¹)
3/2/99	Kitchen	Basement	0.41	0.83	1.4	2.0	3.4
		Kitchen	0.41	0.85	1.3	2.0	3.8
		Upstairs	0.41	0.83	1.3	2.6	3.3
3/3/99	Kitchen	Basement	0.29	1.0	1.6	2.4	4.5
		Kitchen	0.29	0.97	1.5	2.5	5.1
		Upstairs	0.29	0.74	1.3	2.4	1.7
2/25/00	Basement	Basement	0.35	0.34	0.75	1.7	2.8
		Bathroom	0.35	0.39	0.69	1.7	2.8
		Kitchen	0.36	0.34	0.69	1.7	2.9
		Upstairs	0.32	0.44	0.74	1.6	3.0
3/15/00	Upstairs	Basement	0.24	0.68	1.1	1.9	-
		Kitchen	0.25	0.72	1.1	2.0	3.8
		Upstairs	0.26	0.69	1.1	1.8	4.3
4/14/00	Kitchen	Basement	0.38	0.43	0.78	1.6	2.6
		Living Room	0.43	0.36	0.65	1.2	2.5
		Upstairs	0.28	0.41	0.73	1.3	2.5
6/6/00	Kitchen	Kitchen	0.40	0.93	1.0	1.3	-
		Upstairs	0.29	1.0	1.1	1.4	2.4
AVERAGE:			0.66	1.0	1.8	3.2	
STANDARD DEVIATION:			0.25	0.31	0.43	0.89	
Fan On w/Furnace Filter			a (h⁻¹)	$k_p+k_{p,HAC}+k_{p,ff}$ (h⁻¹)	$k_p+k_{p,HAC}+k_{p,ff}$ (h⁻¹)	$k_p+k_{p,HAC}+k_{p,ff}$ (h⁻¹)	$k_p+k_{p,HAC}+k_{p,ff}$ (h⁻¹)
12/31/98	Kitchen	Basement	0.82	0.34	1.1	1.9	3.6
		Kitchen	0.82	0.40	1.3	1.7	2.4
		Office	0.82	0.34	1.1	1.8	2.5
1/1/99	Basement	Basement	0.71	1.0	1.4	2.2	3.8
		Kitchen	0.71	1.3	1.5	2.4	2.7
		Upstairs	0.71	1.2	1.4	1.8	2.4

2/26/99	Kitchen	Basement	0.53	0.73	1.3	1.9	2.2
		Kitchen	0.53	1.0	1.7	2.4	3.6
		Upstairs	0.53	0.94	1.5	2.2	3.9
AVERAGE:			0.81	1.4	2.0	3.0	
STANDARD DEVIATION:			0.37	0.19	0.27	0.70	
Fan On and ESP On			a	$k_p+k_{p,HAC}+k_{p,ESP}$	$k_p+k_{p,HAC}+k_{p,ESP}$	$k_p+k_{p,HAC}+k_{p,ESP}$	$k_p+k_{p,HAC}+k_{p,ESP}$
			(h⁻¹)	(h⁻¹)	(h⁻¹)	(h⁻¹)	(h⁻¹)
3/28/00	Basement	Basement	0.33	2.0	4.1	4.7	6.0
4/14/00	Kitchen	Basement	0.43	2.4	2.2	3.2	4.9
		Living Room	0.33	2.6	2.6	3.2	3.2
		Upstairs	0.34	2.4	2.3	2.8	3.3
4/19/00	Basement	Basement	0.56	2.2	2.1	4.2	5.3
		Living Room	0.59	1.8	2.0	3.1	4.2
		Upstairs	0.55	2.0	2.3	3.9	5.2
5/18/00	Basement	Basement	0.30	1.9	3.1	4.0	4.9
		Kitchen	0.51	1.9	3.0	3.3	4.1
		Upstairs	0.45	2.2	3.3	4.3	4.5
5/31/00	Basement	Basement	0.25	2.3	3.1	3.6	4.9
		Kitchen	0.23	2.3	3.1	3.7	4.1
		Upstairs	0.20	2.2	2.9	3.2	4.5
6/5/00	Kitchen	Kitchen	0.30	3.5	4.2	5.3	5.8
		Upstairs	0.33	3.4	4.8	5.3	-
AVERAGE:			2.3	3.0	3.9	4.6	
STANDARD DEVIATION:			0.50	0.83	0.78	0.82	

Table 3. Deposition rates for kitty litter source events in sealed basement.

Date	Source Location	Measurement Location	Air Change Rate	0.5 μm to 1.0 μm	1.0 μm to 2.5 μm	2.5 μm to 5.0 μm	5.0 μm to 10 μm	> 10 μm
Fan Off			a (h^{-1})	k_p (h^{-1})	k_p (h^{-1})	k_p (h^{-1})	k_p (h^{-1})	k_p (h^{-1})
2/21/00	Basement	Rec Room	0.53	0.32	1.3	1.7	3.1	5.4
		Utility Room	0.49	0.29	1.5	1.7	3.1	5.2
		Stairs	0.51	0.17	1.1	1.6	2.9	5.1
2/28/00	Basement	Rec Room	0.70	-	0.63	1.2	2.7	5.3
		Utility Room	0.70	-	0.53	1.2	2.6	4.7
		Stairs	0.70	-	0.70	1.2	2.7	4.7
3/19/00	Basement	Rec Room	0.60	0.89	1.3	1.8	3.1	5.7
		Stairs	0.56	0.68	1.6	2.2	3.5	5.4
		Rec Room	0.60	0.51	1.2	1.5	2.8	5.2
		Utility Room	0.51	0.57	1.3	1.9	3.0	4.5
3/27/00	Basement	Rec Room	0.58	-	1.1	1.7	3.1	5.9
		Stairs	0.50	-	1.4	2.1	3.5	5.5
		Utility Room	0.42	-	1.4	1.9	3.2	5.4
		Utility Room	0.42	-	0.91	1.2	2.5	4.5
4/3/00	Basement	Rec Room	0.69	0.25	0.64	1.3	2.6	6.3
		Rec Room	0.69	0.29	0.71	1.4	2.6	5.7
		Utility Room	0.69	0.13	0.57	1.3	2.6	4.7
		Stairs	0.69	0.23	0.72	1.5	2.7	5.7
4/15/00	Basement	Rec Room	0.86	-	0.34	1.1	2.1	6.3
		Utility Room	0.70	-	0.47	1.1	2.5	4.7
		Rec Room	0.86	-	0.37	0.98	2.1	5.0
		Stairs	0.78	-	0.48	1.1	2.3	5.2
5/20/00	Basement	Rec Floor	0.65	-	0.76	1.6	3.2	5.9
		Stairs	0.64	-	0.85	1.6	3.1	5.5
		Rec Table	0.65	-	0.96	1.5	3.0	5.5
		Utility Room	0.62	-	0.82	1.7	3.0	5.5

5/29/00	Basement	Rec Room	0.75	0.62	0.76	1.5	2.5	5.0
		Utility Room	0.74	0.64	0.75	1.5	2.5	4.0
		Stairs	0.75	0.53	0.69	1.4	2.5	4.0
6/19/00	Basement	Rec Room	0.31	-	-	1.3	2.2	7.2
		Utility Room	0.31	-	-	1.1	1.7	4.6
7/7/00	Basement	Rec Room	0.65	0.36	0.96	1.5	1.9	5.1
		Utility Room	0.89	0	0.55	1.1	1.0	3.8
AVERAGE:				0.41	0.88	1.5	2.7	5.2
STANDARD DEVIATION:				0.24	0.35	0.31	0.52	0.71
Fan On w/o Filter				$k_p+k_{p,HAC}$ (h ⁻¹)	$k_p+k_{p,HAC}$ (h ⁻¹)	$k_p+k_{p,HAC}$ (h ⁻¹)	$k_p+k_{p,HAC}$ (h ⁻¹)	$k_p+k_{p,HAC}$ (h ⁻¹)
12/20/99	Basement	Rec Room	0.56	0.60	1.4	2.4	4.2	6.6
		Rec Room	0.56	1.1	2.0	2.9	5.0	7.2
		Rec Room	0.56	0.74	1.5	2.6	4.1	6.3
2/19/00	Basement	Rec Room	0.53	-	1.4	3.6	5.1	8.8
		Utility Room	0.59	-	1.3	3.6	5.5	9.2
		Kitchen	0.56	-	1.0	3.0	4.9	4.5
AVERAGE:				0.80	1.4	3.0	4.8	7.1

With the HAC fan off, deposition of particles is confined to room surfaces. As expected, this test condition consistently resulted in the lowest deposition rate. Once the HAC fan was turned on, even without a filter present, particle deposition rates increased (see Figure 4). For example, for 1.0 μm to 2.5 μm particles, the average deposition rate doubled when the fan was turned on. Possible reasons for this increase include the additional surface area of the HAC ducts and other system components (*e.g.*, heat exchanger, fan blades, *etc.*), as well as the increase in room air velocity and turbulent kinetic energy with the fan system on. As noted earlier, approximately 5 house volumes of air pass through the ducts each hour. Although an HAC system was not used, an increase in particle deposition due to use of room mixing fans has been reported by other researchers (Xu *et al.*, 1994; Mosley *et al.*, 2001; Thatcher *et al.*, 2002). We also investigated the possibility that increased air change rate alone might lead to increased particle deposition rates because of increased air velocity and turbulent energy. However, no increase in deposition rate with increasing air change rates was noted for any of the six particle sizes studied under the fan-off condition. Interestingly, the addition of a standard furnace filter had no observable effect on deposition rates (beyond the HAC system effect) for particles less than 5 μm , whereas the use of an electronic air cleaner had a significant impact on particle removal rates. It should be noted that the furnace filter and ESP were only used during events that generate smaller particles (*i.e.*, cooking and candle burns). Thus, measurable decay rates were not available for particles $> 5 \mu\text{m}$. The effectiveness of these different types of air cleaners will be explored in more detail in a future report.

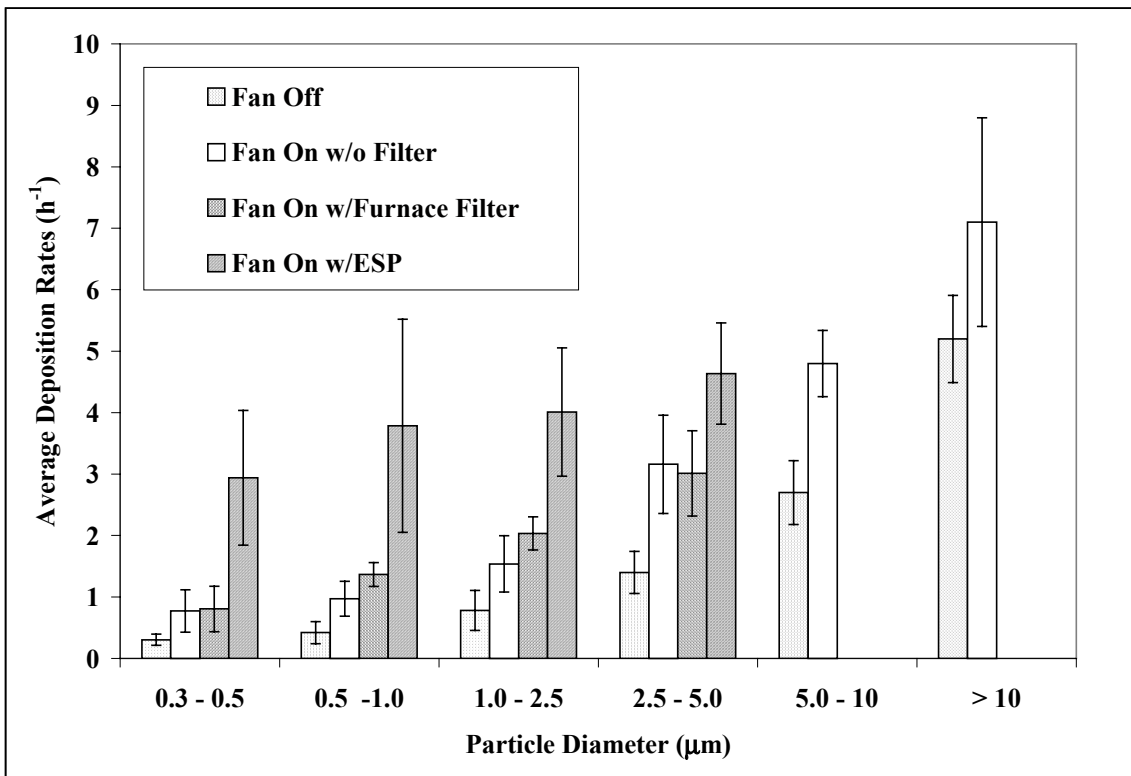


Figure 4. Comparison of particle deposition rates for different HAC configurations. Error bars are \pm one standard deviation.

To investigate the potential impact of room surface area and types of furnishings, similar deposition tests were completed in a second house. For these tests, the same citronella candle was burned in a single room unfurnished test house in Gaithersburg, MD. As shown in Figure 5, in cases with the HAC fan on and off, there was no significant difference in particle deposition rate between the two locations. The ratio of floor surface area to volume for the two houses was very similar with a value of approximately 0.38 m^{-1} per floor for the townhouse and 0.44 m^{-1} for the test house. However, if wall surfaces and room furnishings were to also be included, the townhouse surface area to volume ratio would be far greater than that of the unfurnished test house, indicating a lack of importance of increased surface material for a given space on most particle deposition rates. Thatcher *et al.* (2002) investigated the effect of room furnishings on particle deposition and found a more significant impact on particles $\leq 1.0 \mu\text{m}$, which is also indicated in Figure 5. As the authors point out, this result follows deposition theory where loss of larger particles is dominated by gravitational settling, thereby being less affected by room furnishings. The ratio of volumetric flow through the HAC system to room volume was slightly higher for the test house with a value of 7.2 h^{-1} , whereas the townhouse was 5 h^{-1} . This difference in flow rate through the duct system was apparently not enough to cause a noticeable difference in deposition rates.

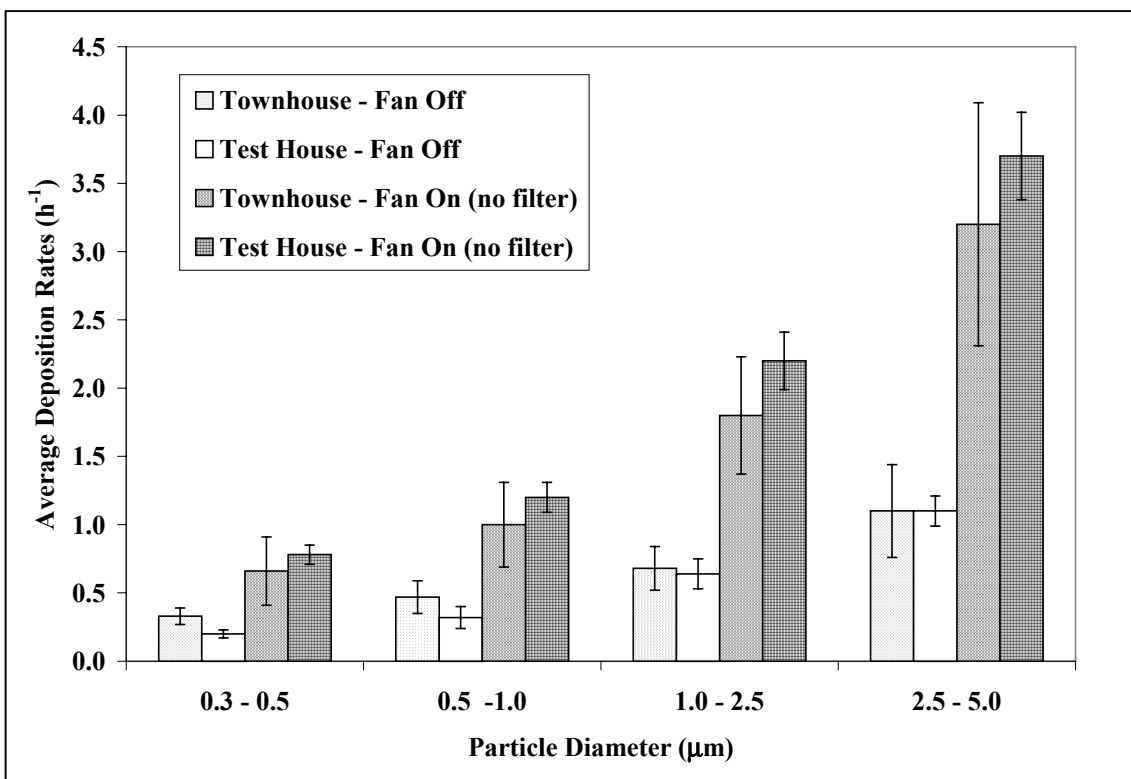


Figure 5. Comparison of average deposition rates for particles from a citronella candle in two locations. Error bars are \pm one standard deviation.

The effect of having the central fan on and using an in-duct filter is summarized in Table 4. Using the central fan increased the deposition rate by between 0.5 h^{-1} and 2 h^{-1} . Adding the in-duct electrostatic precipitator increased the loss rate by an additional 1.4 h^{-1} to 2.8 h^{-1} .

Table 4. Effect of HAC fan and in-duct filters on particle deposition rates (h^{-1}).

Ventilation/ Filtration Setting	Particle Size Range (μm)																	
	0.3 to 0.5			0.5 to 1			1 to 2.5			2.5 to 5			5 to 10			>10		
	Mean	SD	N	Mean	SD	N	Mean	SD	N	Mean	SD	N	Mean	SD	N	Mean	SD	N
HAC Fan Off (k_p) (h^{-1})	0.30	0.09	15	0.42	0.18	34	0.78	0.37	48	1.4	0.34	40	2.7	0.52	33	5.2	0.71	33
HAC Fan On (h^{-1})	0.77	0.34	36	0.97	0.28	39	1.5	0.46	40	3.2	0.80	22	4.8	0.54	6	7.1	1.7	6
Air Cleaner (ESP) on (h^{-1})	2.9	1.1	27	3.8	1.7	27	4.0	1.0	21	4.6	0.82	14	-	-	-	-	-	-
$k_{p,HAC}$ (h^{-1})	0.47	0.36	*	0.55	0.33	*	0.72	0.56	*	1.8	0.87	*	2.1	0.75	*	1.9	1.8	*
$k_{p,ac}$ (h^{-1})	2.1	1.2	*	2.8	1.7	*	2.5	1.1	*	1.4	1.1	*	-	-	-	-	-	-

*: Deposition rate based on difference of mean values above. Standard deviation is the square root of the sum of the squares of the associated standard deviations.

3.2 Other studies

Over 20 previous studies have determined deposition rates for particles $> 0.3 \mu\text{m}$ in diameter. Lai (2002) provides an extensive summary of 12 studies completed in experimental chambers. Other tests have been conducted either in controlled test houses (Offermann *et al.*, 1985; Xu *et al.* 1994; Thatcher *et al.*, 2002; Emmerich and Nabinger, 2001) or in occupied or unoccupied houses (Thatcher and Layton 1995; Wallace *et al.*, 1997; Fogh *et al.*, 1997; Abt *et al.*, 2000; Long *et al.*, 2001; Vette *et al.*, 2001). A summary of these 10 studies is provided in Table 5.

Test houses

Offermann *et al.* (1985) measured the performance of several portable air cleaners using cigarette smoke in one room of a three-room test house. In order to estimate the effectiveness of each air cleaner, particle deposition was measured during a period without the air cleaners operating. The resulting deposition rates were at a minimum of 0.05 h^{-1} for $0.3 \mu\text{m}$ particles and reached 0.38 h^{-1} for $1.5 \mu\text{m}$ particles.

Xu *et al.* (1994) also employed machine-smoked cigarettes in one room of an experimental house. An LAS-X monitor was used to count particles in 16 bins ranging from $0.09 \mu\text{m}$ to $> 3 \mu\text{m}$. However, only eight calculated deposition rates were reported between $0.3 \mu\text{m}$ and about $1.5 \mu\text{m}$. The range of deposition rates was from 0.1 h^{-1} to 1.2 h^{-1} for the fan-off case and from 0.4 h^{-1} to 2.3 h^{-1} for the fan-on case.

Thatcher *et al.* (2002) measured polydisperse olive oil particles between $0.5 \mu\text{m}$ and $20 \mu\text{m}$ in a small experimental room. Three different levels of furnishing and four fan speeds were employed. Increased furnishing and higher fan speeds generally led to higher deposition rates, although for large particles the bare room had higher deposition rates than when it was fully furnished. Deposition rates varied from 0.10 h^{-1} for $0.55 \mu\text{m}$ particles to greater than 10 h^{-1} for $8.66 \mu\text{m}$ particles.

As part of a study to determine the impact of using different particle air cleaners in a single room unfurnished test house, Emmerich and Nabinger (2001) measured the decay rates of $0.3 \mu\text{m}$ to $5 \mu\text{m}$ particles. Average deposition rates ranged from 0.4 h^{-1} to 1.0 h^{-1} for cases with the HAC fan off, and 0.74 h^{-1} to 2.0 h^{-1} for cases with the HAC fan on. The deposition and filtration removal rates for an electronic air cleaner similar to the one used in this study ranged from 6.2 h^{-1} to 7.7 h^{-1} . They also investigated the effect of a mechanical air cleaner and found its removal rate to range from 0.54 h^{-1} to 2.1 h^{-1} .

Homes

Thatcher and Layton (1995) measured particles in a residence using Climets (Climet Instruments, Redlands CA), optical scattering devices. The Climet 208 collects particles in 100 size ranges between $0.5 \mu\text{m}$ and $6 \mu\text{m}$ and the Climet 500-CI in six size ranges from $0.3 \mu\text{m}$ to $0.5 \mu\text{m}$, $0.5 \mu\text{m}$ to $1 \mu\text{m}$, $1 \mu\text{m}$ to $5 \mu\text{m}$, $5 \mu\text{m}$ to $10 \mu\text{m}$, $10 \mu\text{m}$ to $25 \mu\text{m}$, and $> 25 \mu\text{m}$. Data from only three days were presented, with deposition rates varying from 0.27 h^{-1} to 1.3 h^{-1} for size ranges between $1.5 \mu\text{m}$ and $7 \mu\text{m}$.

Table 5. Characteristics of previous studies of deposition rates for particles > 0.3 μm .

Reference	Site Type	Occupied/ Unoccupied	# sites	Aerosol ^a	Source	Fan	Exhaust Fan ^b	Duct Filter ^b	Particle Monitor ^c
Offermann <i>et al.</i> (1985)	Test house	Unoccupied	1	Poly	Cigarette	Off	N/A	N/A	EC/CNC, OPC
Xu <i>et al.</i> (1994)	Test house	Unoccupied	1	Poly	Cigarette	On/off	N/A	N/A	LAS-X
Thatcher <i>et al.</i> (2002)	Test house	Unoccupied	1	Poly	Generator	Off/On (3 speeds)	N/A	N/A	APS
Emmerich and Nabinger (2001)	Test house	Unoccupied	1	Mono and Poly	Generator, Various	On/off	N/A	On/Off	OPC
Thatcher and Layton (1995)	House	Occupied	1	Poly	Various	Off	No	No	OPC
Wallace <i>et al.</i> (1997)	House	Occupied	1	Poly	Cooking oil, candle, kitty litter	On/off	On/off	No	OPC
Fogh <i>et al.</i> (1997)	House	Occupied	4	Mono (5 sizes)	Generator	Off	No	No	APS
Abt <i>et al.</i> (2000)	House	Occupied	3	Poly	Various	Mixed	No	No	APS
Long <i>et al.</i> (2001)	House	Occupied	9	Poly	Various	Mixed	No	No	APS
Vette <i>et al.</i> (2001)	House	Occupied	1	Poly	Various	Off	No	No	APS
This study (2003)	House	Occupied	1	Poly	Cooking oil, candle, kitty litter	On/off	On/off	On/off	OPC

a: Mono = monodisperse; Poly = polydisperse

b: N/A = not applicable

c: APS = aerodynamic particle sizer; EC/CNC = electrostatic classifier with condensation nucleus counter; OPC = optical particle counter; LAS-X = laser aerosol spectrometer.

Wallace *et al.* (1997) measured particles in an occupied home using the Climet 500-CI with modified size ranges: 0.3 μm to 0.5 μm , 0.5 μm to 1 μm , 1 μm to 2.5 μm , 2.5 μm to 5 μm , 5 μm to 10 μm , and $> 10 \mu\text{m}$. Data from 27 days were presented, with average deposition rates varying from 0.20 h^{-1} to 2.8 h^{-1} for size ranges between 0.4 μm and $>10 \mu\text{m}$.

Fogh *et al.* (1997) investigated four houses, some occupied, using a particle generator to create monodisperse particles at 0.5 μm , 2.5 μm , 3.0 μm , 4.5 μm , and 5.5 μm diameter. Particle numbers were counted using an aerodynamic particle sizer (APS). Houses were measured with and without furniture. Average measured deposition rates in the unfurnished case ranged from 0.33 h^{-1} to 1.77 h^{-1} , with slightly higher values of 0.47 h^{-1} to 1.88 h^{-1} for the furnished case.

Abt *et al.* (2000) investigated four Boston homes using an APS switched every hour between indoor (45 min) and outdoor (15 min) measurements. Overnight measurements, when there were few or no indoor sources, were used to calculate values of the penetration coefficient P and the deposition rate k . It was not possible to determine these coefficients separately for each home, but an average deposition rate was determined for the sizes from 0.35 μm to 10 μm . The deposition rate varied from 0.7 h^{-1} to 3.0 h^{-1} .

Long *et al.* (2001) used the same sampling methods and equipment as Abt *et al.* (2000) to sample nine homes in the Boston area. Once again only an average deposition rate could be determined for the nine homes. The rates varied from 0.15 h^{-1} to 0.72 h^{-1} , considerably lower than the rates found in Abt *et al.* (2000). A puzzling result was the observed decline of the deposition rate for particles 4.5 μm and larger. Armendariz and Leith (2000) found the APS to mix particles in this size range with smaller particles, which would lead to a reduced apparent deposition rate. This effect was also observed by Wallace *et al.* (2002).

Vette *et al.* (2001) studied an unoccupied detached residence using a laser aerosol spectrometer (LAS-X) for particle sizes from 0.1 μm to 2.5 μm . The author states that only a few measurements of deposition rates for particles $>1 \mu\text{m}$ were made and that the particle numbers were also very low, which reduced the reliability of the counting statistics of the LAS-X. The HAC system was turned off during the measurements. Observed deposition rates were 0.45 to 0.6 h^{-1} for particles between 0.3 μm and 0.6 μm , rising to 1.3 h^{-1} between 0.75 μm and 0.85 μm . For particles $>1 \mu\text{m}$, very large uncertainties were reported; the average deposition rates ranged from 2.4 (± 1.0) h^{-1} to 2.95 (± 2.2) h^{-1} for 1 μm to 2 μm particles, rising to 3.9 (± 1.4) h^{-1} for 2.5 μm particles.

Findings from all of these studies are compared with our findings in Figure 6. All studies agree in finding increased deposition rates for larger particles. There is also agreement that increased surface area (furnishings) and increased air speeds are associated with higher deposition rates, although the effect of both these parameters is not large compared with the effect of particle size.

However, comparing the controlled chamber/test house studies to the occupied house studies, it is possible to see that the range of deposition rates is larger in the controlled studies. In particular, at the smallest particle sizes of 0.3 μm to 0.7 μm , the deposition rates measured in the controlled studies may be an order of magnitude smaller than those in the occupied house studies. At these particle sizes, the controlled studies agree better with predicted values than the

occupied house studies. For larger particles, both types of studies agree reasonably well with theoretical predictions (Lai and Nazaroff, 2000). The reason for this divergence for smaller particles is not clear.

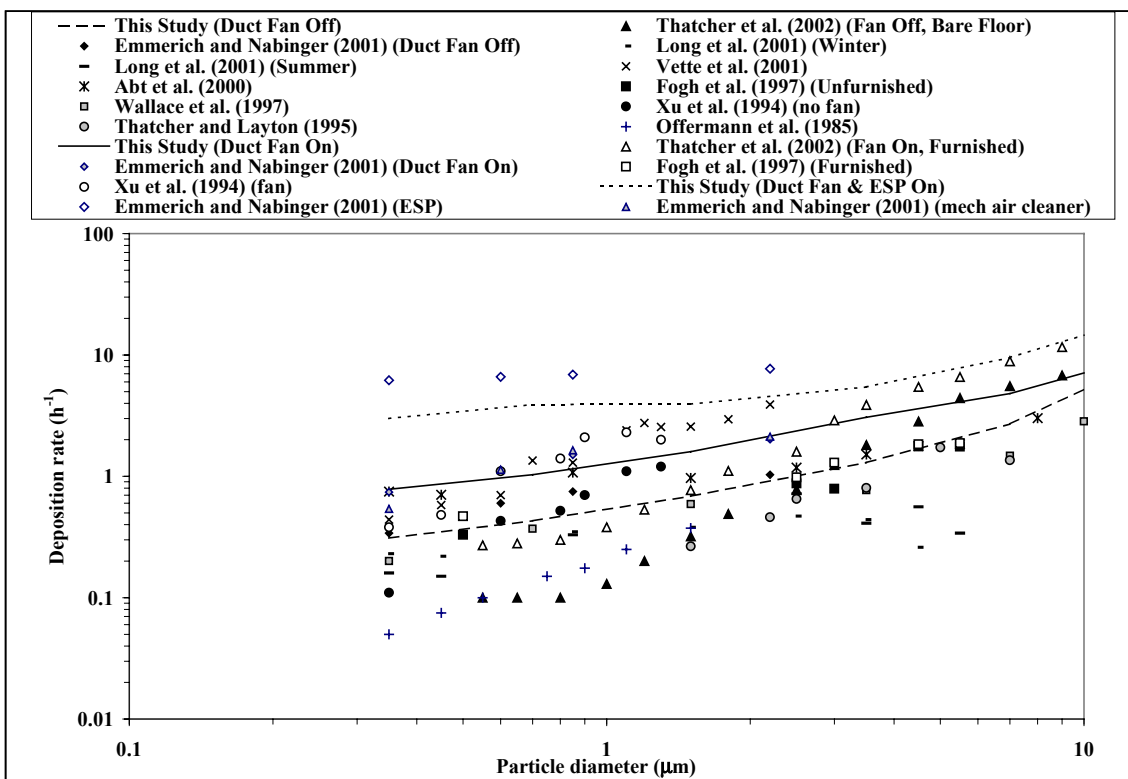


Figure 6. Measured deposition rates in previous studies and this study.

This study is the first to provide quantitative estimates of the decay rates associated with unfiltered and filtered ductwork in an occupied house. Figure 7 shows that the unfiltered duct increased the deposition rate over the fan-off condition for all particle sizes, and that the filtered duct increased the decay rate still further for all particle sizes. These results indicate that for homes with central air, increasing the time that the duct fan is on will reduce the residence time of particles in the home, and installing a high-efficiency in-duct filter will reduce the particle levels still further. For example, use of the HAC fan can reduce particle levels by 23 % to 50 %, and use of an in-duct ESP can reduce the levels by 57 % to 85 % (Table 6). This is comparable to the finding by Fugler and Bowser (2002) that an in-duct ESP reduced particle levels in five homes by 30 % to 70 %, depending on resident activity level. However, a standard furnace filter had no effect on decay rates for particles less than 5 μm beyond the HAC system effect.

Additional implications of these results include the comparison of control strategies to reduce particle concentrations indoors. For example, use of the duct fan and air cleaner will reduce particle concentrations of indoor and outdoor origin both, whereas tightening the house's envelope only reduces the influx of outdoor particles and actually increases the residence time of indoor-generated particles.

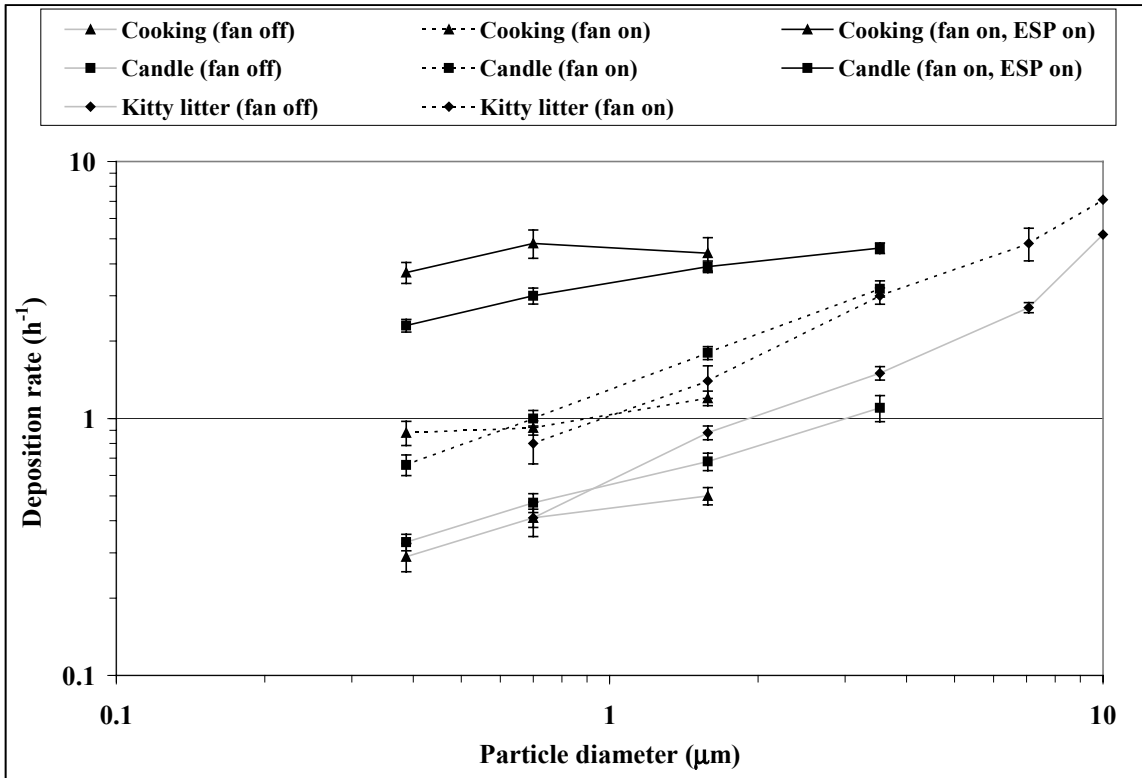


Figure 7. Decay rates in this study by source type and fan-filter combination. The type of source (cooking, candle, pouring kitty litter) has little effect on deposition rate.

Table 6. Effect of HAC fan and in-duct filters on the fraction of outdoor particles penetrating indoors.

Infiltration Factors: Tight House ($a = 0.2 \text{ h}^{-1}$, $P = 1$)						
Ventilation/Filtration Setting	Midpoint of Particle Size Range (μm)					
	0.3-0.5	0.5-1	1-2.5	2.5-5	5-10	>10
HAC Fan Off	0.40	0.32	0.20	0.13	0.07	0.04
HAC Fan On	0.21	0.17	0.12	0.06	0.04	0.03
Air Cleaner On	0.06	0.05	0.05	0.04	-	-
% Reduction (Fan)	48	47	42	53	42	26
% Reduction (Air Cleaner)	84	85	77	67	-	-
Infiltration Factors: Drafty House ($a = 1 \text{ h}^{-1}$, $P = 1$)						
Ventilation/Filtration Setting	Midpoint of Particle Size Range (μm)					
	0.3-0.5	0.5-1	1-2.5	2.5-5	5-10	>10
HAC Fan Off	0.77	0.70	0.56	0.42	0.27	0.16
HAC Fan On	0.56	0.51	0.40	0.24	0.17	0.12
Air Cleaner On	0.26	0.21	0.20	0.18	-	-
% Reduction (Fan)	27	28	29	43	36	23
% Reduction (Air Cleaner)	67	70	64	57	-	-

4 Conclusion

This study has presented some of the first measurements of fine and coarse particle decay rates associated with a central forced-air fan and an in-duct electronic air cleaner under realistic conditions in an occupied home. The effect of each of these actions is generally larger than the deposition rate under fan-off conditions. Since all homes with central forced air heating and air conditioning will employ the central fan on an intermittent basis, and some use the fan constantly to increase air circulation, the effect in these homes will be to reduce concentrations of indoor air particles up to twice as fast as in homes not using a central fan. The standard furnace filter was ineffective at removing particles, while the ESP was able to greatly increase the decay rate of particles.

We also found that the source of the particles appeared to have little if any influence on deposition rates, even though the particles varied from cooking oil droplets to combustion particles to coarse particles. Only the size of the particles and not their composition affected deposition rates within the uncertainty of these tests; but size alone determined about an order of magnitude difference in deposition rates (from $< 0.5 \text{ h}^{-1}$ to $> 10 \text{ h}^{-1}$).

5 References

- Abt, E., Suh, H.H., Catalano, P., Koutrakis, P., 2000. Relative contribution of outdoor and indoor particle sources to indoor concentrations. *Environmental Science and Technology* 34, 3579 – 3587.
- Armendariz, A., Leith, D., 2000. Concentration measurement and counting efficiency for the aerodynamic particle sizer 3320. *Journal of Aerosol Science* 33, 133 – 148.
- ASTM, 2001. Standard Test Method for Determining Air Change in a Single Zone by Means of a Tracer Gas Dilution. E741-00. American Society for Testing and Materials.
- Emmerich, S.J., Nabinger, S.J., 2001. Measurement and simulation of the IAQ impact of particle air cleaners in a single zone building. *Journal of Heating, Ventilation, Air-Conditioning and Refrigeration Research* 7, 223 – 244.
- Fogh, C.L., Byrne, M.A., Roed, J., Goddard, A.J.H., 1997. Size specific indoor aerosol deposition measurements and derived I/O concentrations ratios. *Atmospheric Environment* 31, 2193 – 2203.
- Fugler, D., Bowser, D., 2002. Reducing particulate levels in houses. In: Levin H., ed., *Indoor Air 2002: Proceedings of the 9th International Conference on Indoor Air Quality and Climate*. Monterey, California, June 30-July 5, 2002. Vol. 1, pp. 868-873. *Indoor Air 2002*, Santa Cruz, California.
- Lai, A.C.K., Nazaroff, W.W., 2000. Modeling indoor particle deposition from turbulent flow onto smooth surfaces. *J Aerosol Science* 31:463-476.
- Long, C.M., Suh, H.H., Catalano, P., Koutrakis, P., 2001. Using time- and size-resolved particulate data to quantify indoor penetration and deposition behavior. *Environmental Science and Technology* 35, 2089 – 2099.
- Mosley, R.B., Greenwell, D.J., Sparks, L.E., Guo, Z., Tucker, W.G., Fortmann, R., Whitfield, C., 2001. Penetration of ambient fine particles into the indoor environment. *Aerosol Science and Technology* 34,127-136.
- Nazaroff, W.W., Cass, G.R., 1989. Mathematical modeling of indoor aerosol dynamics. *Environmental Science & Technology* 23, 157 – 166.
- Nazaroff, W.W., Gadgil, A.J., Weschler, C.J., 1993. Critique of the use of deposition velocity in modeling indoor air quality. *Modeling of Indoor Air Quality and Exposure*, ASTM STP 1205, Niren Nagda, Ed., pp. 81 – 104, American Society for Testing and Materials, Philadelphia, 1993.
- Offermann, F.J., Sextro, R.G., Fisk, W.J., Grimsrud, D.T., Nazaroff, W.W., Nero, A.V., Revzan, K.L., Yater, J., 1985. Control of respirable particles in indoor air with portable air cleaners. *Atmospheric Environment* 19, 1761 – 1771.

Özkaynak, H., Xue, J., Weker, R., Butler, D., Koutrakis, P., Spengler, J., 1996. The Particle TEAM (PTEAM) Study: Analysis of the Data. Volume 3. Research Triangle Park, NC, 1996. EPA/600/R-95/098.

Thatcher, T.L., Lai, A.C.K., Moreno-Jackson, M., Sextro, R.G., Nazaroff, W.W., 2002. Effects of room furnishings and air speed on particle deposition rates indoors. *Atmospheric Environment* 36, 1811 – 1819.

Thatcher, T.L., Layton, D.W., 1995. Deposition, resuspension, and penetration of particles within a residence. *Atmospheric Environment* 29, 1487 – 1497.

Vette, A.F., Rea, A.W., Lawless, P.A., Rodes, C.E., Evans, G., Highsmith, V.R., Sheldon, L., 2001. Characterization of indoor-outdoor aerosol concentration relationships during the Fresno PM exposure studies. *Aerosol Science and Technology* 34, 118 – 126.

Wallace, L., 1996. Indoor particles: A review. *Journal of the Air & Waste Management Association* 46, 98 – 126.

Wallace, L.A., Quackenboss, J. Rodes, C., 1997. Continuous measurements of particles, PAH, and CO in an occupied townhouse in Reston, VA. In: *Measurement of Toxic and Related Air Pollutants, Proceedings of EPA-AWMA Symposium on Toxic and Related Compounds*, Research Triangle Park, NC, April 29-May 1, 1997, pp. 860-871. Air & Waste Management Association, Pittsburgh, PA. VIP-74.

Wallace, L., Emmerich, S.J., Howard-Reed, C., 2002. Continuous measurements of air change rates in an occupied house for 1 year: The effect of temperature, wind, fans, and windows. *Journal of Exposure Analysis and Environmental Epidemiology* 12, 296 – 306.

Wallace, L., Howard-Reed, C., 2002. Continuous monitoring of ultrafine, fine, and coarse particles in a residence for 18 months in 1999 – 2000. *Journal of the Air & Waste Management Association* 52, 828 – 844.

Xu, M., Nematollahi, M., Sextro, R.G., and Gadgil, A.J., 1994. Deposition of tobacco smoke particles in a low ventilation room. *Aerosol Science and Technology* 20, 194 – 206.