



3-D View Type A Sidewalk Ramp
Not to Scale

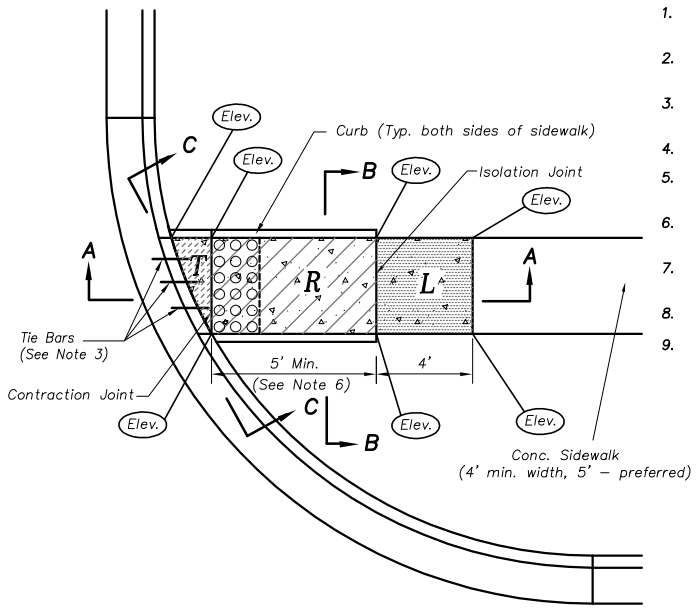


Type A Sidewalk Ramp
Scale: 1/4"=1'-0"

3-D View Type B Sidewalk Ramp
Not to Scale

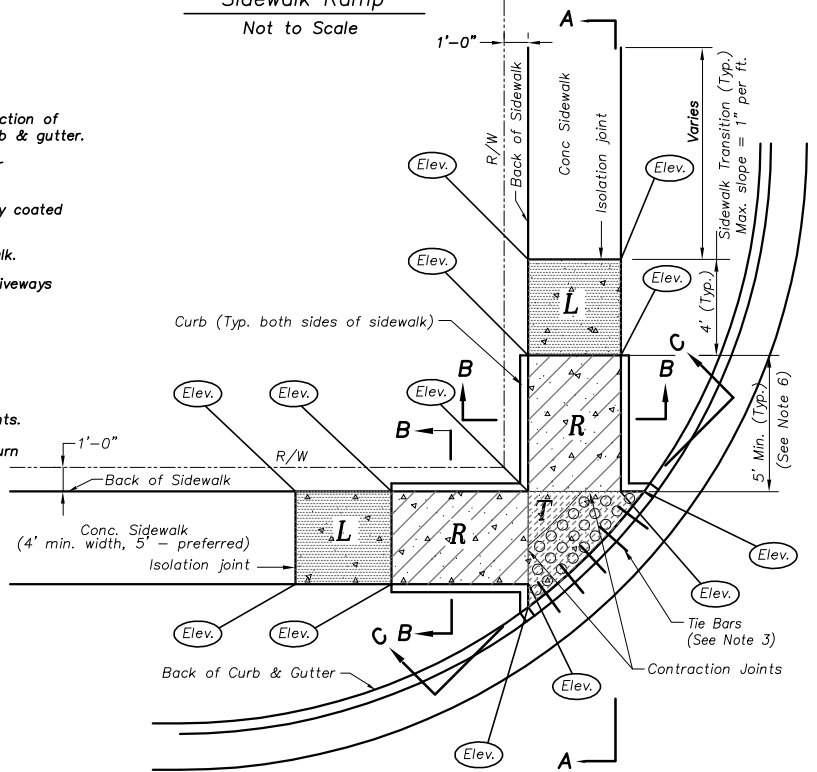

Type B Sidewalk Ramp
Scale: 1/4"=1'-0"

3-D View Type C Sidewalk Ramp
Not to Scale


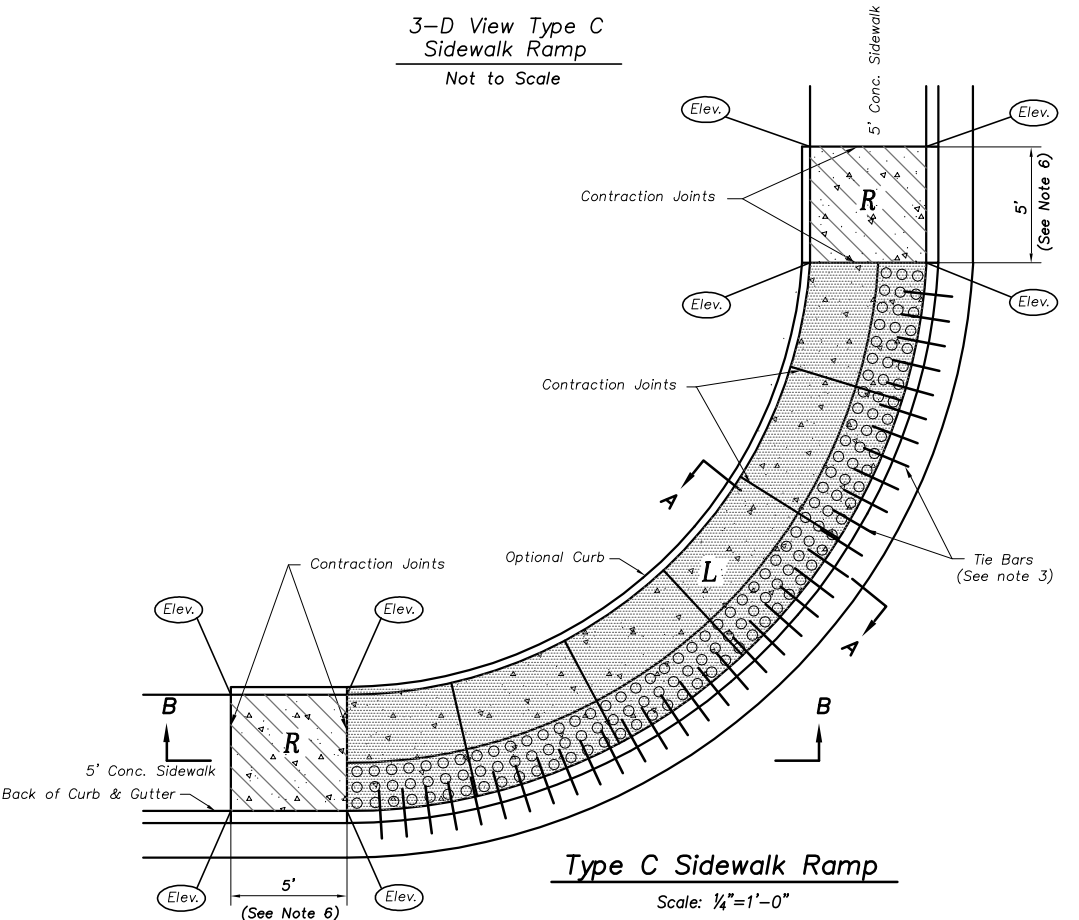


Type C Sidewalk Ramp
Scale: 1/4"=1'-0"


Sidewalk Ramp Notes:

1. Sidewalk ramp location determined from the intersection of the extension of back of sidewalk and back of curb & gutter.
2. Plan drawings shall include a table of elevations for all points labelled as **Elev.**
3. Key all construction joints or use tie bars #4 epoxy coated @ 12" o.c.
4. Longitudinal joint spacing to match width of sidewalk.
5. Isolation joints shall be placed where walk abuts driveways and similar structures, and 250' centers max.
6. Sidewalk Ramp shall be lengthened to provide ADA compliance slope but need not exceed 15'.
7. ADA maximum ramp slope = 1"/Ft. ADA maximum cross slope = 2%.
8. Detectable warnings to comply with ADA requirements.
9. Landing for Type C ramp along the entire curb return is preferred, but may be shortened to minimum ADA compliant dimension.


Legend:

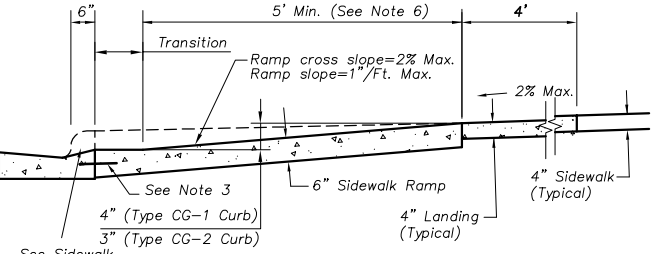


Section A-A
Type A & B Sidewalk Ramp
Scale: 1/2"=1'-0"

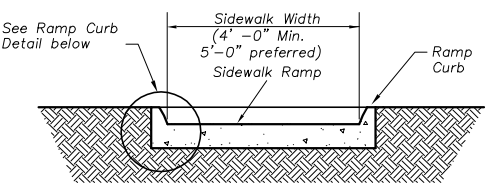


Section B-B
Type A & B Sidewalk Ramp
Scale: 1/2"=1'-0"

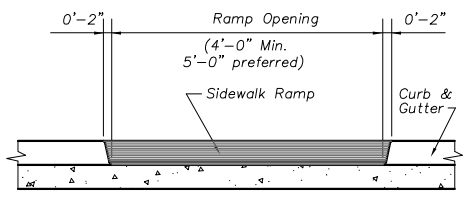


Section C-C
Type A & B Sidewalk Ramp
Scale: 1/2"=1'-0"

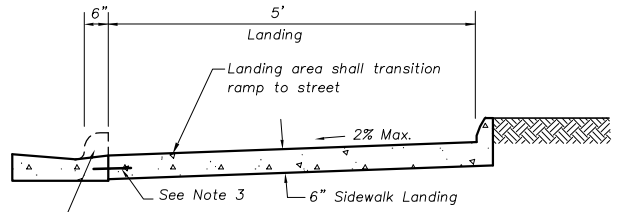


Section A-A
Type C Sidewalk Ramp
Scale: 1/2"=1'-0"

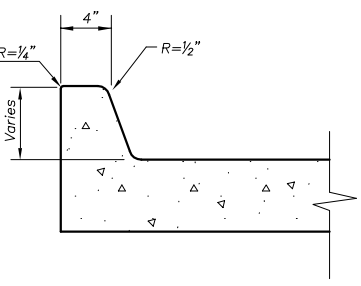


Ramp Curb Detail
Scale: 1 1/2"=1'-0"

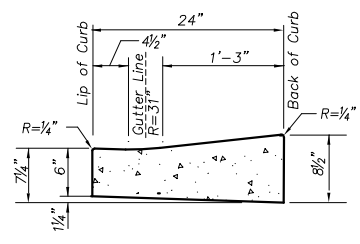


Use With Type CG-2 Curb
Scale: 1"=1'-0"

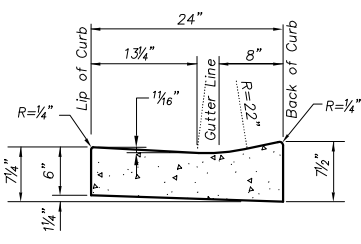


Use With Type CG-1 Curb
Scale: 1"=1'-0"

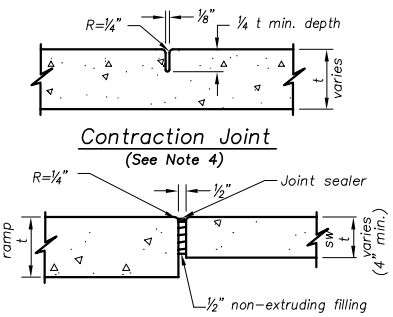

Contraction Joint
(See Note 4)



Detectable Warning
Dome Spacing and Section
Not to Scale

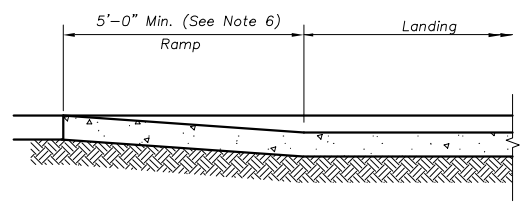

Section B-B
Type C Sidewalk Ramp
Scale: 1/2"=1'-0"

REVISIONS:	
WEB SITE ADDRESS:	

Year 2002 Edition
APWA
STANDARD DETAILS
SIDEWALK RAMP DETAILS