Island of Hawaii
Underground Injection Control Areas

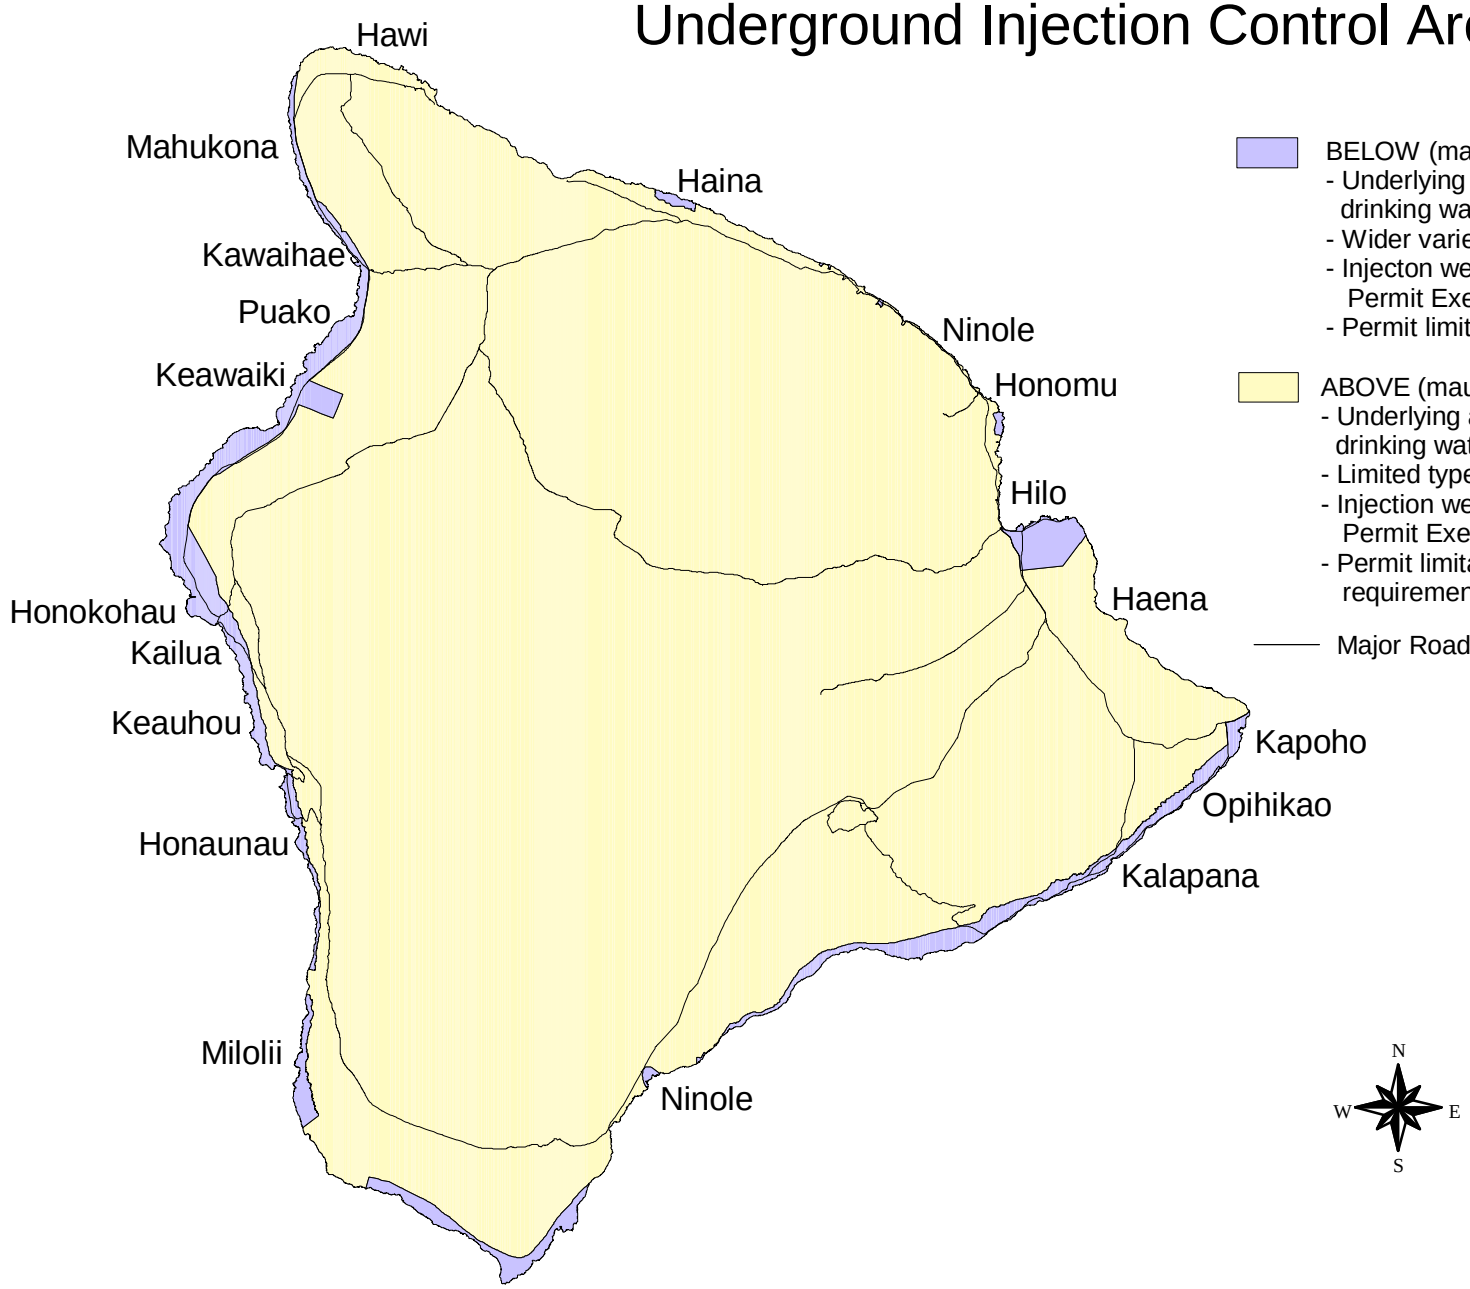

BELOW (makai) UIC LINE
- Underlying aquifer not considered drinking water source
- Wider variety of wells allowed
- Injecton wells need UIC Permit or Permit Exemption
- Permit limitations are imposed

ABOVE (mauka) UIC LINE
- Underlying aquifer considered a drinking water source
- Limited types of injection wells allowed
- Injection wells need UIC Permit or Permit Exemption
- Permit limitations are imposed and requirements are more stringent

Major Roads

0 5 10 15 20 25 Miles

Department of Health EGIS 9/99