

Update: Effective Load-Carrying Capability of Photovoltaics in the United States

Preprint

R. Perez
ASRC, SUNY

R. Margolis
National Renewable Energy Laboratory

M. Kmiecik and M. Schwab
ASRC, University at Albany

M. Perez
University of Rochester

*To be presented at Solar 2006 Conference
Denver, Colorado
July 8–13, 2006*

Conference Paper
NREL/CP-620-40068
June 2006



NOTICE

The submitted manuscript has been offered by an employee of the Midwest Research Institute (MRI), a contractor of the US Government under Contract No. DE-AC36-99GO10337. Accordingly, the US Government and MRI retain a nonexclusive royalty-free license to publish or reproduce the published form of this contribution, or allow others to do so, for US Government purposes.

This report was prepared as an account of work sponsored by an agency of the United States government. Neither the United States government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States government or any agency thereof.

Available electronically at <http://www.osti.gov/bridge>

Available for a processing fee to U.S. Department of Energy and its contractors, in paper, from:

U.S. Department of Energy
Office of Scientific and Technical Information
P.O. Box 62
Oak Ridge, TN 37831-0062
phone: 865.576.8401
fax: 865.576.5728
email: <mailto:reports@adonis.osti.gov>

Available for sale to the public, in paper, from:

U.S. Department of Commerce
National Technical Information Service
5285 Port Royal Road
Springfield, VA 22161
phone: 800.553.6847
fax: 703.605.6900
email: orders@ntis.fedworld.gov
online ordering: <http://www.ntis.gov/ordering.htm>



UPDATE: EFFECTIVE LOAD CARRYING CAPABILITY OF PHOTOVOLTAICS IN THE UNITED STATES

Richard Perez,
ASRC, SUNY
251 Fuller Rd,
Albany, NY 12203

Perez@asrc.cestm.albany.edu

Robert Margolis
NREL
901 D. St, SW Suite 930
Washington, DC 22024

Robert_Margolis@nrel.gov

Marek Kmiecik
And
Michael Schwab
ASRC, Univ. at Albany

Marek@asrc.cestm.albany.edu

Marc Perez
University
of Rochester
Rochester, NY 14627

mp003m@mail.rochester.edu

ABSTRACT

We provide an update on the US distribution of PV's Effective Load Carrying Capability (ELCC) by analyzing recent load data from 39 US utilities and time-coincident output of PV installations simulated from high resolution, time/site-specific satellite data. Results show that overall regional trends identified in the early 1990s remain pertinent today, while noting a significant increase in PV ELCC the Western and Northern US, and a modest decrease in the central and eastern US.

1. BACKGROUND AND RATIONALE

This study is an update and an expansion of the original work of Perez et al. (1993, 1996). In this original work, selected utility loads from the late 1980s and early 1990s were analyzed in conjunction with PV output simulated from low resolution 3-hourly satellite data (Justus et al., 1986). The results from the selected utility sample were extrapolated to all US utilities by modeling ELCC from the robust relationship observed between ELCC and utility summer to winter peak load (SWP) ratio.

The published results of the original study were limited to sun-tracking PV at very low grid penetration.

Using a higher resolution and more accurate satellite model to simulate site/time specific PV output, the emphasis of the present work is placed on reporting state-by-state potential and on assessing the impact of grid penetration and array geometry on ELCC. We consider PV penetrations ranging from 2% to 20%. Selected PV geometries include two-axis tracking (ideal case), horizontal, south-facing 30°-tilt and southwest-facing 30°-tilt.

2. METHODOLOGY

2.1 Effective Load Carrying Capability (ELCC)

The ELCC of a power generator represents its ability to effectively increase the generating capacity available to a utility or a regional power grid without increasing the utility's loss of load risk (Garver, 1966). For instance, a utility with a current peaking capability of 2.5 GW could increase its capability 2.55 GW with the same reliability by adding 100 MW PV, provided the ELCC of the 100 MW PV is 50 MW, or in relative terms, 50%.

Ideally dispatchable generators with no down time have a relative ELCC of 100%. Non-dispatchable generators such as wind or photovoltaics (PVs) are a priori assumed to have no or little ELCC. For PV however, the ELCC can be significant because PV generation may be reliably available at critical demand times (e.g., Perez et al., 2005) and thus may effectively increase the grid's generating capacity.

ELCC may be statistically derived from the analysis of time-coincident series of load demand and power generation data (Garver, 1966). As in the original study, our approach here is to experimentally determine ELCC for a representative sample of utilities, and to project the results to the entire country using observed regional and load shape patterns.

2.2 Experimental Data

Utility Loads: We selected 39 utilities distributed throughout the country (see list in Fig. 1), and acquired two recent years of hourly load data (2002 and 2003) for each (FERC, 2005). Load data obtained from FERC were

corrected for daylight savings time adjustment, as needed in order to be synchronous with PV generation data.

PV generation: PV output was modeled for each selected array configuration. Time/site specific hourly irradiances used as input to the model were obtained from high-resolution satellite observations (Perez et al., 2002, 2004). Time/site-specific wind speed and temperature data were obtained from the National Climatic Data Center (NCDC, 2005).

The first step was to experimentally derive ELCC for the selected utility sample for each selected PV configuration and grid penetration. Utility-specific results are provided in Fig. 1 for the 2-axis-tracking, low penetration case. The values reported are 2002-03 averages and contrasted against 1991 values from the original study for the same utilities.

The second step was to observe and to model the relationship between the reference ELCC – 2-axis tracking at 2% grid penetration – and ELCCs for other PV geometries and grid penetrations. An example of such experimental relationship is shown in Figure 2 between the southwest facing ELCC at 5% penetration and the reference ELCC. These relationships are very well defined and can be easily fitted with a linear approximation. Such linear relationships were defined for each case, resulting in modeled ELCC standard error of 1-4% (see Table 1).

The third step was to investigate whether the relationship between the reference ELCC and the utility SWP Ratio observed in the original study remained valid with the new data points. Fig. 3 compares the original and current trends. These

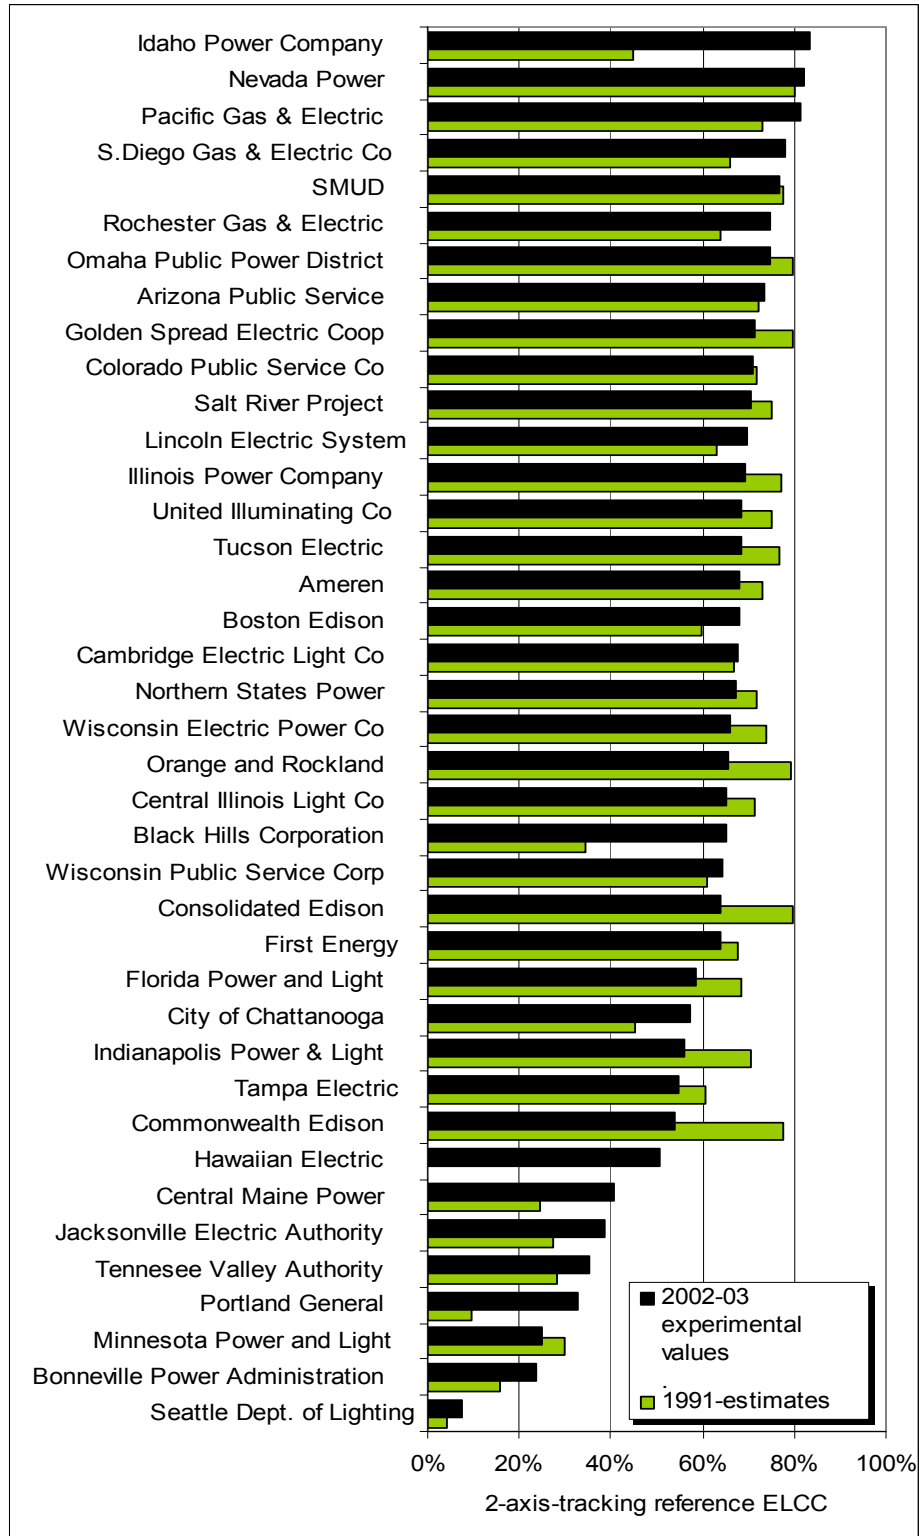


Figure 1: Experimentally derived reference ELCC (2-axis tracking, low grid penetration) compared against earlier estimates from the original study (Perez et al., 1996)

results indicate that the SWP ratio remains a strong predictor of ELCC, justifying following step.

The fourth step consisted of taking the 500+ utility gridded data from the original study and to update the map by layering the 2002-2003 interpolated map of differences between the earlier period and the current period derived for the 39 selected utilities.

Finally, the resulting gridded map was processed into statewide averages. Table 2 summarizes ELCCs observed for each state, and each PV-geometry/Load-penetration scenario. A subset of these results is provided graphically in Fig. 4, while figure 5 provides a state-by-state ranking for each selected geometry at low grid penetration while also providing information on statewide ranges for the reference ELCC.

3. DISCUSSION

The main conclusions reached in the original study remain valid: PV's effective capacity is significant – and considerably higher than PV's capacity factor – for much of the United States.

The utility-specific results presented in Fig. 1 indicate that utilities in the southwestern US exhibit the highest values, followed by Central US utilities and mid-Atlantic utilities. The lowest ELCCs are found in the North Pacific coast, the northern fringes of the Great Lakes and New England, and to a lesser extent, Florida. Overall, the national trends noted in the original study are conserved, but some regional changes are noteworthy. The upper northeast and central northwest exhibit strong ELCC increases – see for instance Idaho Power Company, Rochester Gas and Electric, Central Maine Power and Portland General -- while some erosion is noted in the large eastern metropolitan utilities – such as New York's Consolidated Edison. Although still speculative, the reasons for these changes could include, on the one hand a tendency for the northernmost utilities towards higher summer loads fueled by increased air conditioning deployment and warmer summers, and on the other, the implementation of effective peak load mitigation strategies in places like the New York metro area, offsetting the highest demands indirectly driven by the sun. The use of a more accurate, higher resolution hourly solar resource model (instead of an interpolated 3-

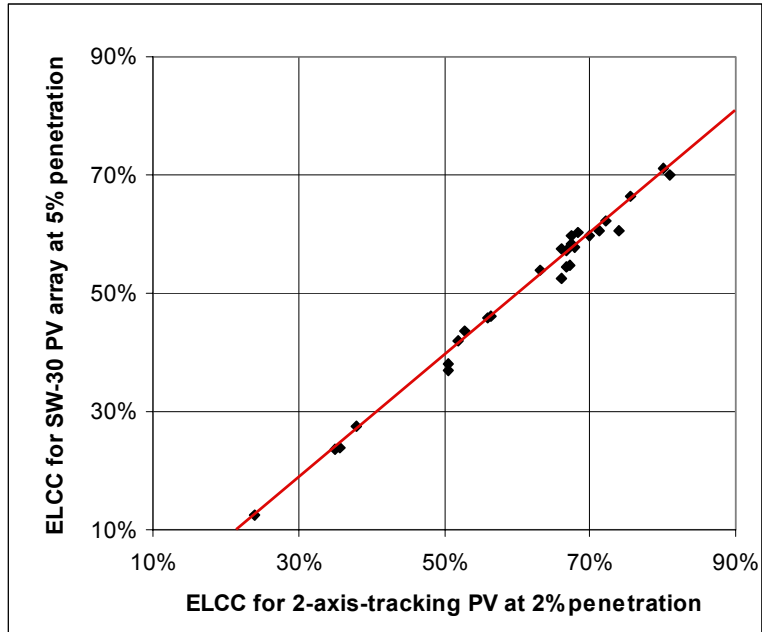


Figure 2: Observed ELCC at 5% penetration for a fixed southwest-facing array vs. reference 2-axis tracking, low penetration ELCC

TABLE 1
Fitted relationships between reference ELCC (2 % penetration, 2-axis tracking) and other ELCCs

penetration - geometry	slope	intercept	R	Std. error
5% - 2axis	1.05	-0.07	1.00	1.2%
10% - 2axis	1.04	-0.13	0.97	2.9%
15% - 2axis	0.95	-0.15	0.95	3.9%
20% - 2axis	0.83	-0.14	0.92	4.2%
2% - horizontal	0.89	-0.08	0.94	3.8%
5% - horizontal	0.88	-0.10	0.95	3.3%
10% - horizontal	0.84	-0.13	0.96	2.9%
15% - horizontal	0.78	-0.14	0.95	2.9%
20% - horizontal	0.70	-0.13	0.94	2.9%
2% - S30	0.86	-0.04	0.93	4.1%
5% - S30	0.86	-0.07	0.94	3.7%
10% - S30	0.81	-0.10	0.94	3.4%
15% - S30	0.73	-0.10	0.94	3.2%
20% - S30	0.64	-0.10	0.93	3.0%
2% - SW30	1.10	-0.14	0.97	3.2%
5% - SW30	1.10	-0.17	0.98	2.5%
10% - SW30	1.05	-0.20	0.98	2.4%
15% - SW30	0.95	-0.20	0.97	2.9%
20% - SW30	0.84	-0.18	0.95	3.2%

hourly model as in the original study) may have also contributed to more conservative results in the eastern climates by better capturing transient cloudiness at critical times.

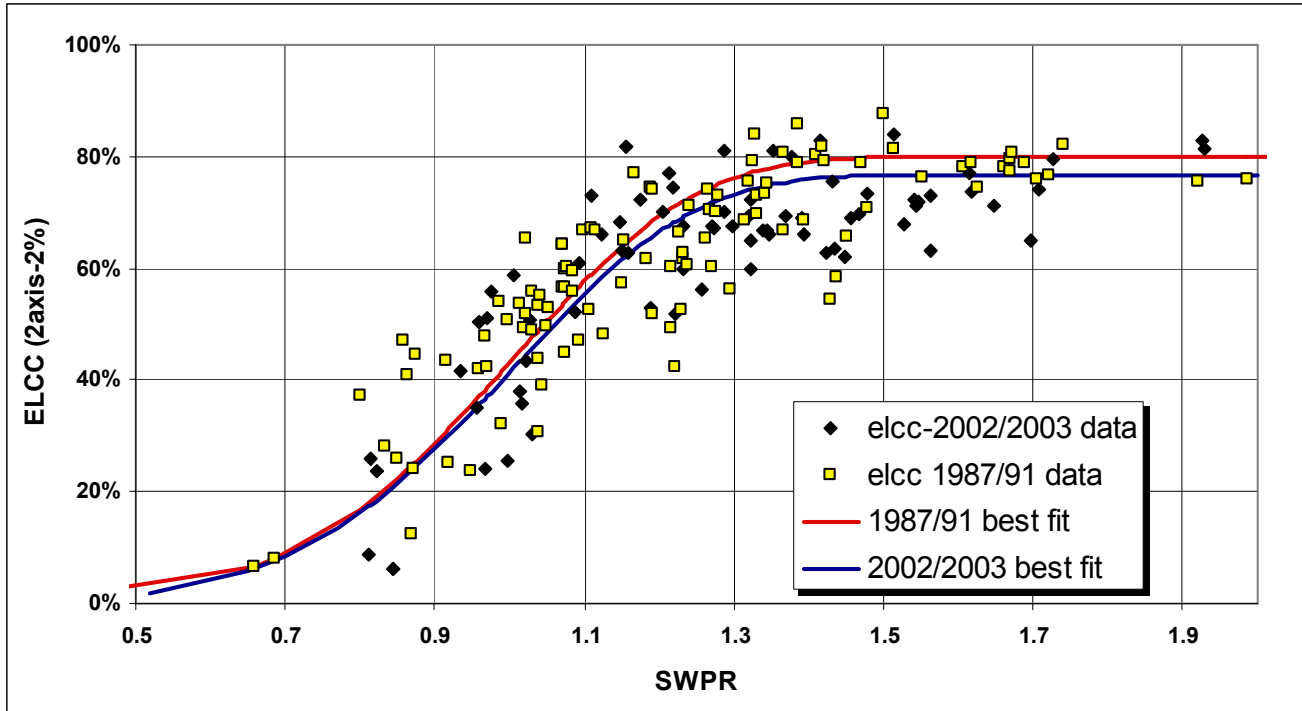


Figure 3: Reference ELCC as a function of Summer-to-Winter Peak Load Ratio

Statewide averages in Table 2 should be considered in the context of sometimes large statewide min-max ranges. High ranges may be characteristic of sparse experimental points – i.e., high statistical uncertainty (e.g., North Dakota), but more often, they represent different trends within a given State. For instance, the 40-70% range in New York State represents the different demand patterns of upstate’s ~ rural utilities which are still nearly winter peaking vs. city utilities (New York City, Rochester) which are strongly summer peaking.

The present study provides considerably more insight on the effects of geometry and penetration. With fixed optimized PV arrays, the national average for ELCC at low penetration is nearly 55%, reaching 65%+ in the best cases. ELCC erodes down to ~ 35% nationwide at 20% penetration reaching 45% in the best cases.

Finally, it is important to remark that ELCCs can be increased to nearly 100% -- i.e., firm power equivalence -- with modest amounts of storage and/or load control, even at significant levels of penetration. Considering New York City’s ConEdison for instance, and considering a 15% load penetration with optimized fixed array, the ELCC of PV could be increased from 40% to 100% with 2.5 hours worth of storage and/or load control capability. The total amount of load control needed year-around to guaranty 100% ELCC

would 23,000 MWh. Accomplishing the same load reduction without the benefit of PV would require nearly six times more load control. The use of load control and storage to provide firm capacity equivalence in the context of demand reduction programs is the focus of a follow-on phase of this work.

4. ACKNOWLEDGEMENT

NREL subcontract # AEK-5-55057-01. Fred Calef III

5. REFERENCE

- Perez, R., R. Seals and R. Stewart, (1993): Assessing the Load Matching Capability of Photovoltaics for US Utilities Based Upon Satellite-Derived Insolation Data, IEEE Transactions, PV Specialists, pp. 1146-1149
- R. Perez, R. Seals and C. Herig, (1998): PV Can Add Capacity to the Grid. NREL Brochure DOE/GO-10096-262, NREL, Golden, CO
http://www.nrel.gov/ncpv/documents/pv_util.html
- Justus, C. G., M.V. Paris and J. D. Tarpley, (1986): Satellite-Measured Insolation Data in the US and Mexico. Remote Sensing Env. 20. pp. 57-83

TABLE 2
Statewide ELCCs

Geometry Penetration	2 axis tracking					Horizontal					South 30° tilt					Southwest 30° tilt				
	2%	5%	10%	15%	20%	2%	5%	10%	15%	20%	2%	5%	10%	15%	20%	2%	5%	10%	15%	20%
Arkansas	71%	68%	61%	53%	45%	55%	52%	47%	42%	37%	57%	54%	47%	41%	36%	65%	61%	55%	48%	41%
Alabama	69%	66%	59%	51%	44%	54%	51%	46%	40%	36%	56%	52%	46%	40%	35%	63%	59%	53%	46%	40%
Arizona	71%	68%	61%	53%	45%	55%	52%	47%	42%	37%	57%	54%	47%	41%	36%	65%	61%	55%	48%	41%
California	75%	72%	65%	57%	48%	59%	56%	51%	45%	40%	61%	57%	51%	44%	38%	69%	66%	59%	52%	45%
Colorado	66%	63%	56%	48%	41%	51%	48%	43%	38%	33%	53%	50%	44%	38%	33%	59%	56%	50%	43%	37%
Connecticut	62%	58%	51%	44%	37%	47%	44%	39%	34%	30%	49%	46%	40%	34%	30%	54%	50%	44%	38%	33%
Delaware	62%	58%	51%	44%	38%	47%	44%	40%	35%	30%	50%	46%	40%	35%	30%	55%	51%	45%	39%	34%
Florida	57%	53%	46%	40%	34%	43%	40%	35%	31%	27%	46%	42%	36%	31%	27%	49%	46%	40%	35%	30%
Georgia	69%	65%	58%	50%	43%	53%	50%	45%	40%	35%	55%	52%	46%	39%	34%	62%	59%	52%	45%	39%
Hawaii	51%	47%	40%	34%	28%	42%	39%	34%	30%	26%	41%	38%	32%	27%	23%	43%	40%	34%	29%	25%
Idaho	67%	62%	55%	47%	40%	50%	47%	42%	37%	32%	53%	49%	43%	37%	32%	58%	54%	47%	41%	35%
Illinois	70%	66%	59%	51%	44%	54%	51%	46%	41%	36%	56%	53%	46%	40%	35%	63%	59%	53%	46%	40%
Indiana	64%	60%	53%	46%	39%	49%	46%	41%	36%	32%	51%	48%	42%	36%	31%	57%	53%	47%	41%	35%
Iowa	73%	69%	62%	54%	46%	57%	54%	48%	43%	38%	59%	55%	49%	42%	37%	68%	63%	56%	49%	42%
Kansas	75%	72%	65%	57%	48%	59%	56%	50%	45%	40%	61%	57%	51%	44%	38%	69%	66%	59%	51%	44%
Kentucky	53%	49%	42%	36%	30%	39%	37%	32%	28%	24%	42%	39%	33%	28%	24%	45%	42%	36%	31%	26%
Louisiana	71%	68%	61%	53%	45%	55%	53%	47%	42%	37%	58%	54%	48%	41%	36%	65%	61%	55%	48%	41%
Massachusetts	56%	52%	45%	39%	33%	42%	39%	34%	30%	26%	45%	41%	35%	30%	26%	48%	45%	39%	33%	29%
Maryland	60%	56%	49%	42%	36%	46%	43%	38%	33%	29%	48%	45%	39%	33%	29%	52%	49%	43%	37%	32%
Maine	28%	23%	16%	12%	10%	17%	15%	11%	8%	7%	21%	17%	13%	10%	8%	17%	14%	10%	7%	6%
Michigan	65%	61%	54%	47%	40%	49%	47%	42%	37%	32%	52%	48%	42%	37%	32%	57%	54%	48%	41%	36%
Minnesota	46%	42%	35%	29%	24%	33%	30%	26%	22%	19%	36%	32%	27%	23%	20%	37%	34%	28%	24%	20%
Missouri	72%	69%	62%	54%	46%	56%	54%	48%	43%	38%	59%	55%	49%	42%	37%	66%	63%	56%	49%	42%
Mississippi	71%	68%	61%	53%	45%	55%	52%	47%	42%	37%	57%	54%	47%	41%	36%	64%	61%	54%	48%	41%
Montana	73%	71%	65%	57%	49%	58%	56%	51%	45%	40%	60%	57%	51%	44%	39%	69%	66%	60%	53%	46%
North Carolina	56%	52%	45%	39%	33%	42%	39%	34%	30%	26%	45%	41%	35%	30%	26%	48%	45%	39%	33%	29%
North Dakota	49%	45%	38%	32%	27%	36%	33%	29%	25%	22%	39%	35%	30%	26%	22%	41%	37%	32%	27%	23%
Nebraska	74%	71%	64%	56%	48%	58%	55%	50%	44%	39%	60%	57%	50%	44%	38%	68%	65%	58%	51%	44%
New Hampshire	43%	38%	31%	26%	22%	30%	27%	23%	20%	17%	33%	30%	25%	21%	18%	33%	30%	25%	21%	17%
New Jersey	64%	60%	53%	46%	39%	49%	46%	41%	36%	31%	51%	48%	41%	36%	31%	56%	53%	47%	40%	35%
New Mexico	62%	58%	51%	44%	37%	47%	44%	39%	35%	30%	50%	46%	40%	35%	30%	55%	51%	45%	39%	33%
Nevada	59%	55%	48%	41%	35%	45%	42%	37%	32%	28%	47%	44%	38%	33%	28%	51%	48%	42%	36%	31%
New York	53%	48%	40%	34%	28%	38%	35%	30%	26%	22%	41%	37%	32%	27%	23%	43%	39%	33%	28%	24%
Ohio	63%	59%	52%	45%	38%	48%	45%	40%	35%	31%	50%	47%	41%	35%	30%	55%	52%	46%	40%	34%
Oklahoma	68%	64%	57%	49%	42%	52%	49%	44%	39%	34%	54%	51%	45%	39%	34%	61%	57%	51%	44%	38%
Oregon	42%	38%	31%	25%	21%	30%	27%	23%	19%	16%	33%	29%	24%	20%	17%	33%	29%	24%	20%	17%
Pennsylvania	53%	48%	41%	34%	29%	38%	35%	31%	27%	23%	41%	38%	32%	27%	23%	43%	40%	34%	29%	25%
Rhode Island	64%	61%	54%	46%	39%	49%	46%	41%	36%	32%	52%	48%	42%	36%	31%	57%	54%	48%	41%	35%
South Carolina	57%	53%	47%	40%	34%	43%	40%	35%	31%	27%	46%	42%	36%	31%	27%	49%	46%	40%	35%	30%
South Dakota	59%	55%	48%	41%	35%	44%	41%	37%	32%	28%	47%	43%	38%	32%	28%	51%	48%	42%	36%	31%
Tennessee	51%	47%	40%	34%	28%	37%	35%	30%	26%	23%	40%	37%	31%	27%	23%	42%	39%	34%	29%	24%
Texas	64%	60%	53%	46%	39%	49%	46%	41%	36%	32%	51%	48%	42%	36%	31%	56%	53%	47%	41%	35%
Utah	42%	37%	30%	25%	21%	29%	27%	22%	19%	16%	32%	29%	24%	20%	17%	32%	29%	24%	20%	17%
Virginia	57%	53%	46%	39%	33%	43%	40%	35%	31%	27%	45%	42%	36%	31%	27%	49%	46%	40%	34%	29%
Vermont	46%	42%	35%	29%	24%	33%	30%	26%	22%	19%	36%	33%	27%	23%	20%	37%	33%	28%	23%	20%
Washington	17%	12%	7%	5%	4%	8%	6%	5%	4%	3%	11%	8%	6%	4%	4%	7%	6%	4%	4%	3%
Wisconsin	59%	55%	48%	41%	35%	44%	41%	37%	32%	28%	47%	43%	37%	32%	28%	51%	47%	42%	36%	31%
West Virginia	51%	47%	40%	33%	28%	37%	34%	30%	26%	23%	40%	36%	31%	26%	23%	42%	39%	33%	28%	24%
Wyoming	44%	39%	32%	27%	22%	31%	28%	24%	20%	18%	34%	30%	25%	21%	18%	34%	31%	26%	21%	18%

Garver, L. L., (1966): Effective Load carrying Capability of Generating Units. IEEE Transactions, Power Apparatus and Systems. Vol. Pas-85, no. 8

Perez R., B. Collins, R. Margolis, T. Hoff, C. Herig J. Williams and S. Letendre, (2005) Solution to the Summer Blackouts – How dispersed solar power generating systems can help prevent the next major outage. Solar Today, July/August 2005 Issue.

Federal Energy Regulatory Commission, (2005): Form 714 - Annual Electric Control and Planning Area Report Data. <http://www.ferc.gov/docs-filing/eforms/form-714/data.asp#skipnavsub>

Perez R., P. Ineichen, K. Moore, M. Kmiecik, C. Chain, R. George and F. Vignola, (2002): A New Operational Satellite-to-Irradiance Model. Solar Energy 73, 5, pp. 307-317.

Perez R., P. Ineichen, M. Kmiecik, K. Moore, R. George and D. Renné, (2004): Producing satellite-derived irradiances in complex arid terrain. Solar Energy 77, 4, 363-370

National Climatic Data Center, (2005): Unedited Climatological Data <http://cdo.ncdc.noaa.gov/ulcd/ULCD>

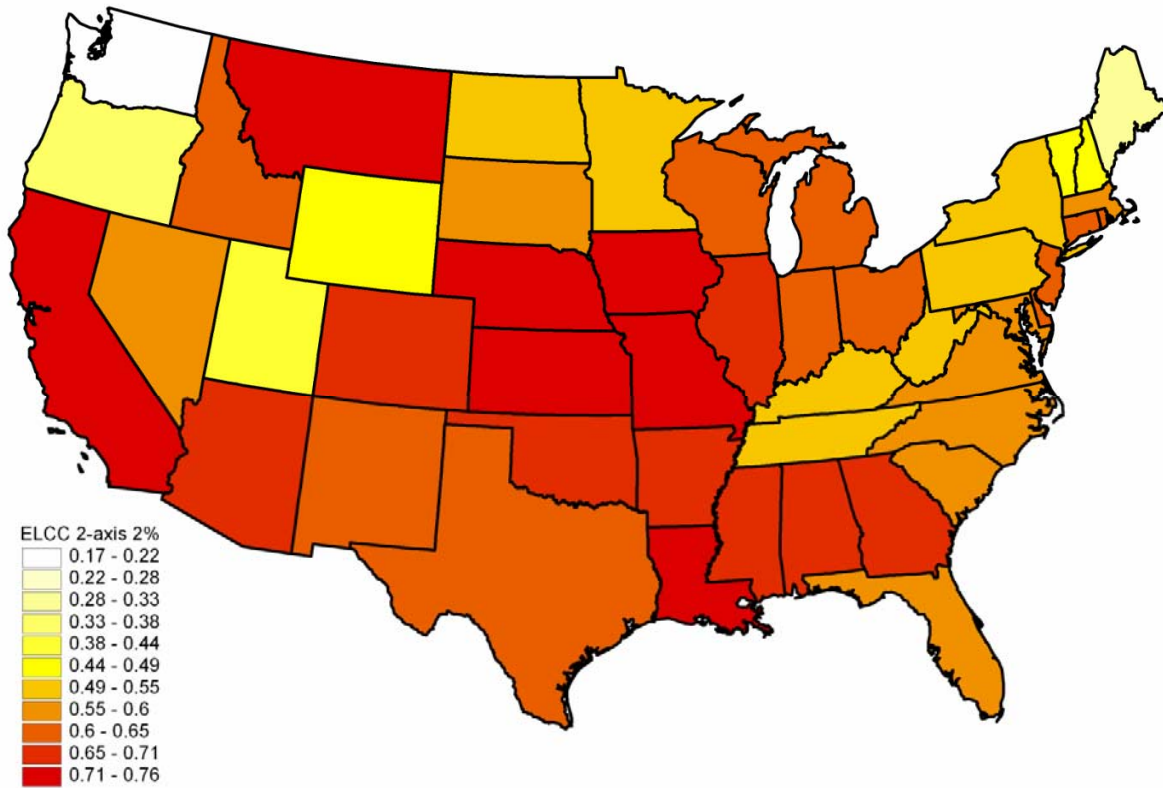


Figure 4: State-wide reference 2-axis-tracking 2% penetration ELCC

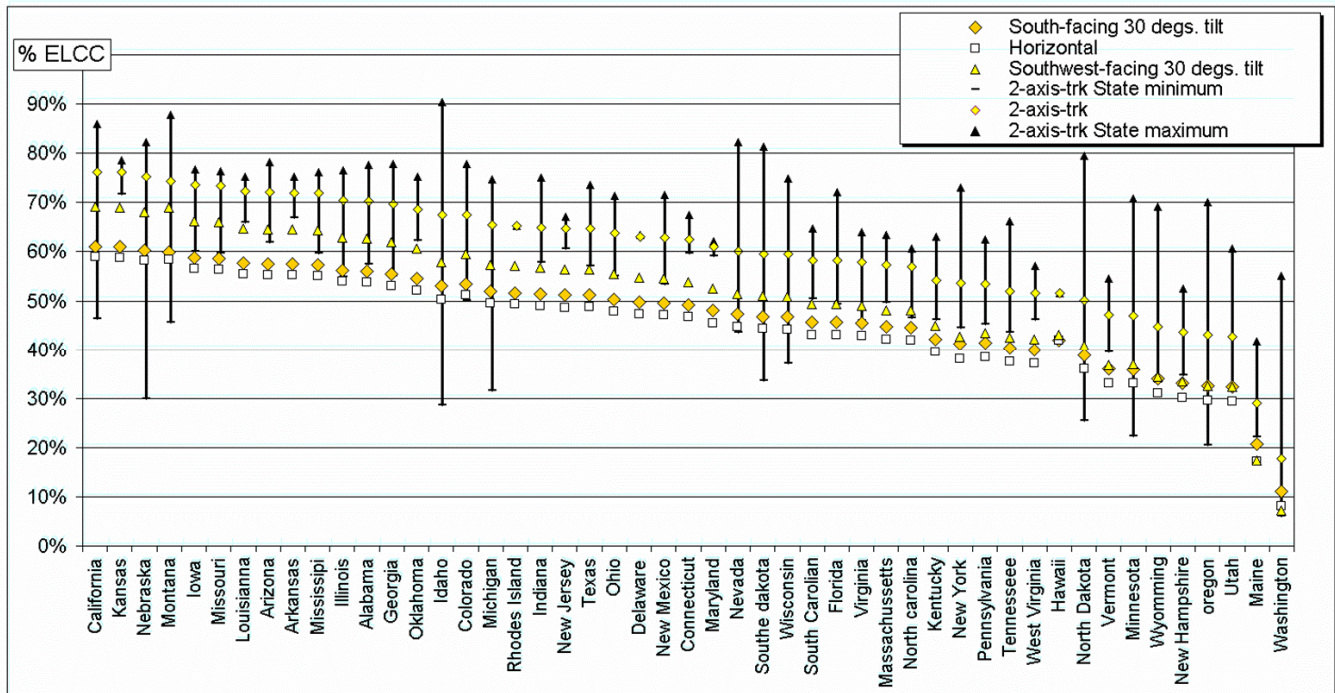


Figure 5: Low-penetration ELCCs per state including statewide range

REPORT DOCUMENTATION PAGE

Form Approved
OMB No. 0704-0188

The public reporting burden for this collection of information is estimated to average 1 hour per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing the burden, to Department of Defense, Executive Services and Communications Directorate (0704-0188). Respondents should be aware that notwithstanding any other provision of law, no person shall be subject to any penalty for failing to comply with a collection of information if it does not display a currently valid OMB control number.

PLEASE DO NOT RETURN YOUR FORM TO THE ABOVE ORGANIZATION.

1. REPORT DATE (DD-MM-YYYY) June 2006		2. REPORT TYPE Conference Paper		3. DATES COVERED (From - To)	
4. TITLE AND SUBTITLE Update: Effective Load Carrying Capability of Photovoltaics in the United States; Preprint				5a. CONTRACT NUMBER DE-AC36-99-GO10337	
				5b. GRANT NUMBER	
				5c. PROGRAM ELEMENT NUMBER	
6. AUTHOR(S) R. Perez, R. Margolis, M. Kmiecik, M. Schwab, and M. Perez				5d. PROJECT NUMBER NREL/CP-620-40068	
				5e. TASK NUMBER PVC6.1501	
				5f. WORK UNIT NUMBER	
7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES) National Renewable Energy Laboratory 1617 Cole Blvd. Golden, CO 80401-3393				8. PERFORMING ORGANIZATION REPORT NUMBER NREL/CP-620-40068	
9. SPONSORING/MONITORING AGENCY NAME(S) AND ADDRESS(ES)				10. SPONSOR/MONITOR'S ACRONYM(S) NREL	
				11. SPONSORING/MONITORING AGENCY REPORT NUMBER	
12. DISTRIBUTION AVAILABILITY STATEMENT National Technical Information Service U.S. Department of Commerce 5285 Port Royal Road Springfield, VA 22161					
13. SUPPLEMENTARY NOTES					
14. ABSTRACT (Maximum 200 Words) This paper provides an update on the U.S. distribution of effective load-carrying capability (ELLC) for photovoltaics by analyzing recent load data from 39 U.S. utilities and time-coincident output of PV installations simulated from high-resolution, time/site-specific satellite data. Results show that overall regional trends identified in the early 1990s remain pertinent today, while noting a significant increase in PV ELCC in the western and northern United States, and a modest decrease in the central and eastern United States.					
15. SUBJECT TERMS Solar photovoltaics; PV; large-scale PV; deployment; grid-connected PV; solar PV; electricity; carbon emissions; PV system; PV generation; American Solar Energy Society; ASES; Solar 2006					
16. SECURITY CLASSIFICATION OF:			17. LIMITATION OF ABSTRACT UL	18. NUMBER OF PAGES	19a. NAME OF RESPONSIBLE PERSON
a. REPORT Unclassified	b. ABSTRACT Unclassified	c. THIS PAGE Unclassified			19b. TELEPHONE NUMBER (Include area code)