# Greenidge Multi-Pollutant Control Project

# **Participant**

CONSOL Energy Inc.

# Additional Team Members

AES Greenidge, LLC — host

Babcock Power Environmental, Inc. — (EPC Contractor)

### Location

Dresden, NY (AES Greenidge Unit No. 4)

# **Technology**

Hybrid selective non-catalytic reduction (SNCR)/in-duct selective catalytic reduction (SCR) in combination with low-NO<sub>x</sub> burners to control NO<sub>x</sub> and a circulating fluidized-bed dry scrubber (CFBDS) to control SO<sub>2</sub>, mercury, and acid gases

### Plant Capacity/ Production

104 MW (Unit No. 4)

### Coal

Bituminous coal (>2% sulfur) co-fired with up to 10% biomass


### **Project Funding**

Total \$32,742,976 100% DOE 14,341,423 43.8 Participant 18,401,553 56.2 PPII

Emissions Control

Mercury ■ NO<sub>x</sub> ■

SO<sub>2</sub> ■ PM<sub>2.5</sub> ■

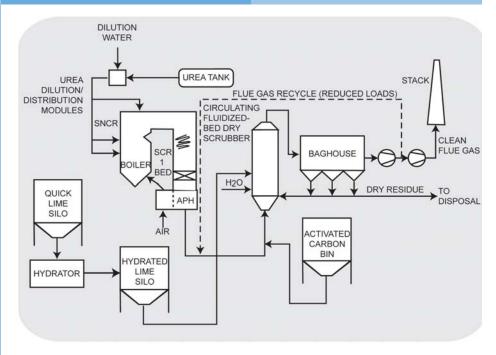

# **Objectives**

To demonstrate cost-effective multi-pollutant control for relatively small power plants using a selective non-catalytic reduction (SNCR)/in-duct selective catalytic reduction (SCR); in combination with low-NO<sub>x</sub> burners and a circulating fluidized-bed dry scrubber (CFBDS) system with recycled baghouse ash and activated carbon injection; to control nitrogen oxide (NO<sub>x</sub>) emissions to 0.10 lb/10<sup>6</sup> Btu at full load, and reduce sulfur dioxide (SO<sub>2</sub>) by 95 percent, mercury by 90 percent, and acid gases by 95 percent; and to evaluate the impact of biomass co-firing up to 10 percent heat input on the performance of the SNCR/SCR hybrid and CFBDS system.

# **Technology/Project Description**

This project will demonstrate an in-duct SNCR/SCR hybrid in combination with low-NO burners and a CFBDS system using recycled baghouse ash and activated carbon injection to cost-effectively reduce emissions of NO<sub>2</sub>, SO<sub>2</sub>, mercury, and acidic gases to levels equal to or lower than those required by regulation at an existing 104-MW plant. The project also will evaluate the effect of biomass cofiring on the multi-pollutant control system. To complement existing low-NO burners, an SNCR is strategically located upstream of a single-bed in-duct SCR. Urea injection required for the SNCR also generates the ammonia required for the SCR. Having the SCR downstream of the SNCR allows the SNCR to operate at lower temperatures than normal (normally avoided to protect against ammonia slip), which enhances performance. The CFBDS system uses a reactor vessel to facilitate contact of flue gas with separately injected dry hydrated lime, activated carbon, and water. The activated carbon absorbs mercury, and the lime reacts with the sulfur dioxide (SO<sub>2</sub>) and sulfur trioxide (SO<sub>2</sub>), hydrochloric acid (HCl), and hydrofluoric acid (HF) gases to form benign solids, all of which are captured in the baghouse. Lime and activated carbon sorbents captured in the baghouse are recycled to the CFBDS to enhance utilization. Performance testing will include biomass co-firing at heat inputs up to 10 percent.

# Project Duration 29 Months

# Period of Operation 20 Months

### Status/Schedule

\*Estimated date

### **Benefits**

The power industry is seeking lower cost and more compatible multi-pollutant control alternatives to SCR and wet scrubbers for the 473 domestic coal-fired generating units with capacities ranging from 50-300 MW. Economics of scale that make SCR and wet scrubbers viable for large plants do not apply to these relatively small units, and small units typically are space constrained, making it difficult, if not impossible, to install conventional SCR and wet scrubbers. Greenidge Unit No. 4 is representative of the small coal-fired electricity generating units that together represent almost one-quarter of the U.S. coal-fired generating capacity. The NO<sub>2</sub> control technology to be demonstrated at Greenidge is estimated to require about 65 percent of the capital costs and 75 percent of the operating costs of a conventional SCR unit. The CFBDS is projected to use at least 2.5 times less activated carbon for a given level of mercury control because the carbon has a greater average contact time in the CFBDS reactor than in a flue gas duct. Reducing the carbon feed rate results in substantial mercury control cost savings. Also, the CFBDS is estimated to be about half the capital cost of a conventional wet scrubber. The acid gas control afforded by the CFBDS is important because this removes the precursors to acid aerosols, which can form PM<sub>2.5</sub> once emitted. Acid gases must be reported to the U.S. Environmental Protection Agency (EPA) as part of the Toxic Release Inventory. Moreover, biomass co-firing may improve overall emissions performance through reduced fuel-bound nitrogen and sulfur levels, increased volatile content, and general combustion characteristics.

# Status/Accomplishments

The project was selected for award on September 26, 2001. An Environmental Assessment (EA) has been completed and a Finding of No Significant Impact (FONSI) was issued on December 3, 2004. Negotiation activities were protracted due to contract issues. The project was awarded on May 19, 2006 with design and construction activities already underway.

Construction was substantially completed in December 2006 and startup and commissioning began. The project moved to the operations and testing phase in March 2007.

### **Contacts**

# **Participant**

Steven Winberg, General Manager, Research & Development (412) 854-6600 stevewinberg@consolenergy.com

CONSOL Energy Inc. 4000 Brownville Road South Park, PA 15129

#### **NETL**

Wolfe Huber (412) 386-5747 wolfe.huber@netl.doe.gov

### Headquarters

Joseph Giove (301) 903-4130 joseph.giove@hq.doe.gov

	Ι	Final Report	
	R e	Issued	4/09*
STATUS	p o r	Draft Report Issued	1/09*
	t	Operation Completed	10/08*
	O p e r a t i o n		
	C o n s t r u c t i o n	Operation  Construction	3/07
	D e s i g n		at award
	_	Award	5/06
	P r	NEPA Completed (EA and	
	e A w a r d	FONSI)	12/04
		Selection	9/01
			May 2007