


Catawba 2

4Q/2000 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

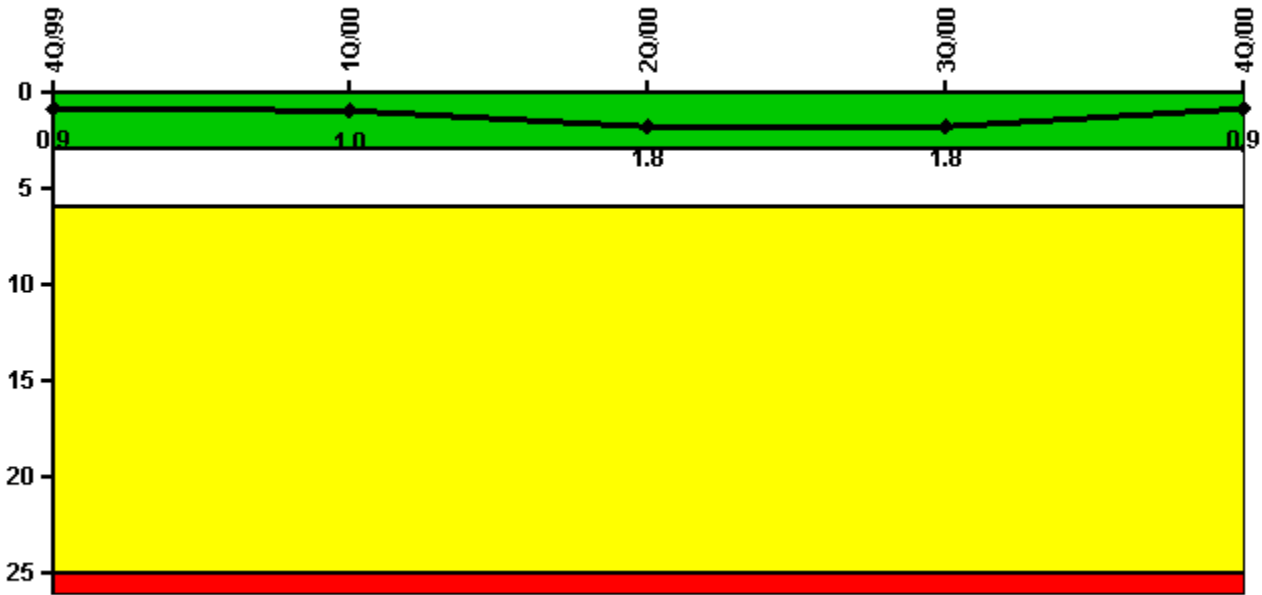


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Unplanned scrams	1.0	0	1.0	0	0
Critical hours	2179.0	1593.0	1953.0	2208.0	2209.0
Indicator value	0.9	1.0	1.8	1.8	0.9

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

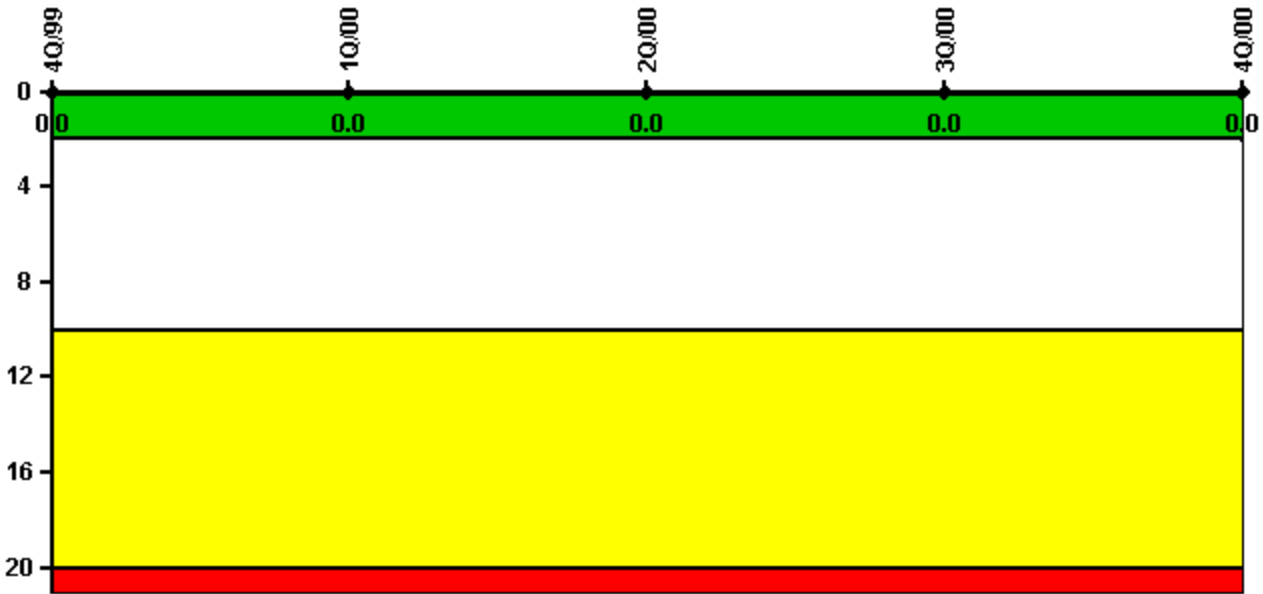


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Scrams	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

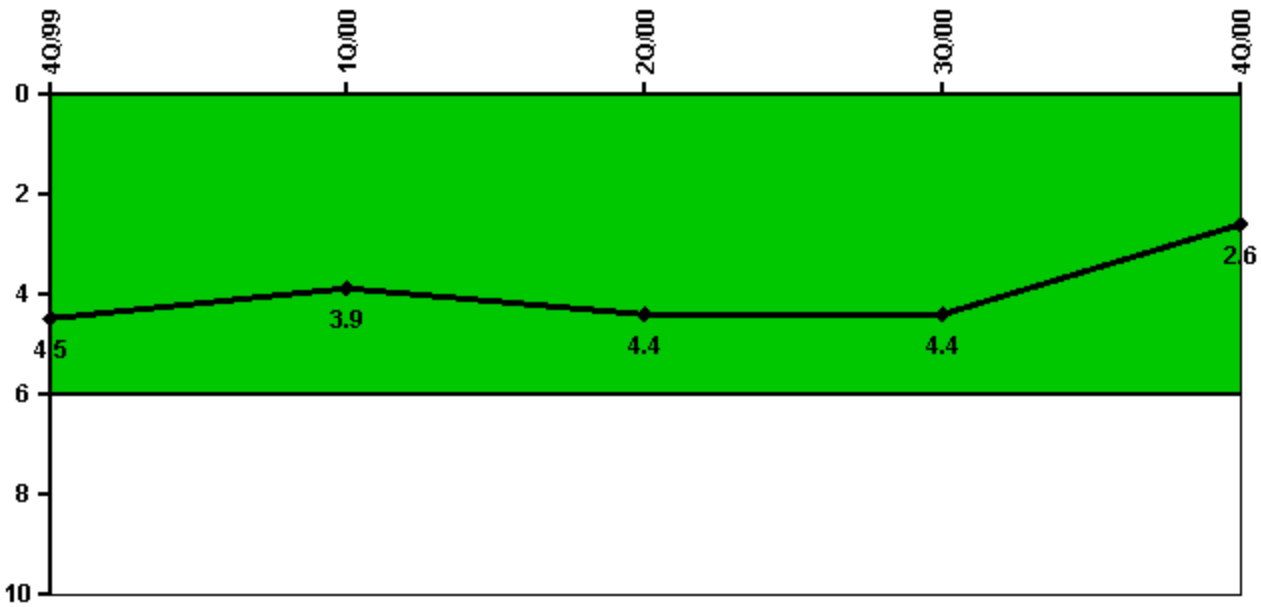


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Unplanned power changes	2.0	1.0	2.0	0	0
Critical hours	2179.0	1593.0	1953.0	2208.0	2209.0
Indicator value	4.5	3.9	4.4	4.4	2.6

Licensee Comments: none

Safety System Unavailability, Emergency AC Power

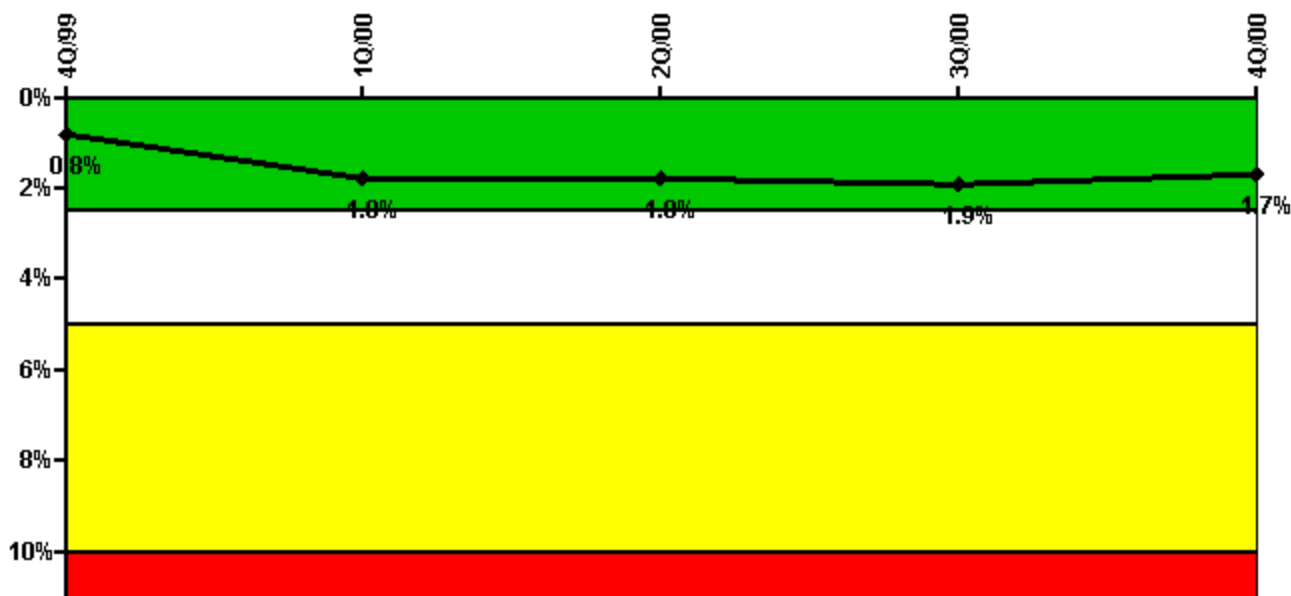

Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%

Notes


Safety System Unavailability, Emergency AC Power	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Train 1					
Planned unavailable hours	0.80	19.97	2.85	3.31	2.02
Unplanned unavailable hours	0	0	7.93	0	0
Fault exposure hours	0	0	8.10	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2184.00	2184.00	2208.00	2209.00
Train 2					
Planned unavailable hours	13.45	29.18	3.24	3.34	2.18
Unplanned unavailable hours	0	0	0	30.83	0
Fault exposure hours	0	527.97	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2184.00	2188.00	2208.00	2209.00
Indicator value	0.8%	1.8%	1.8%	1.9%	1.7%

Licensee Comments:

4Q/00: Based upon tentative approval of draft FAQ 16.12, planned overhaul hours for the nuclear service water support system have been excluded from the computation of monitored system unavailabilities.

3Q/00: Corrected data entry error (2Q2001)

Safety System Unavailability, High Pressure Injection System (HPSI)

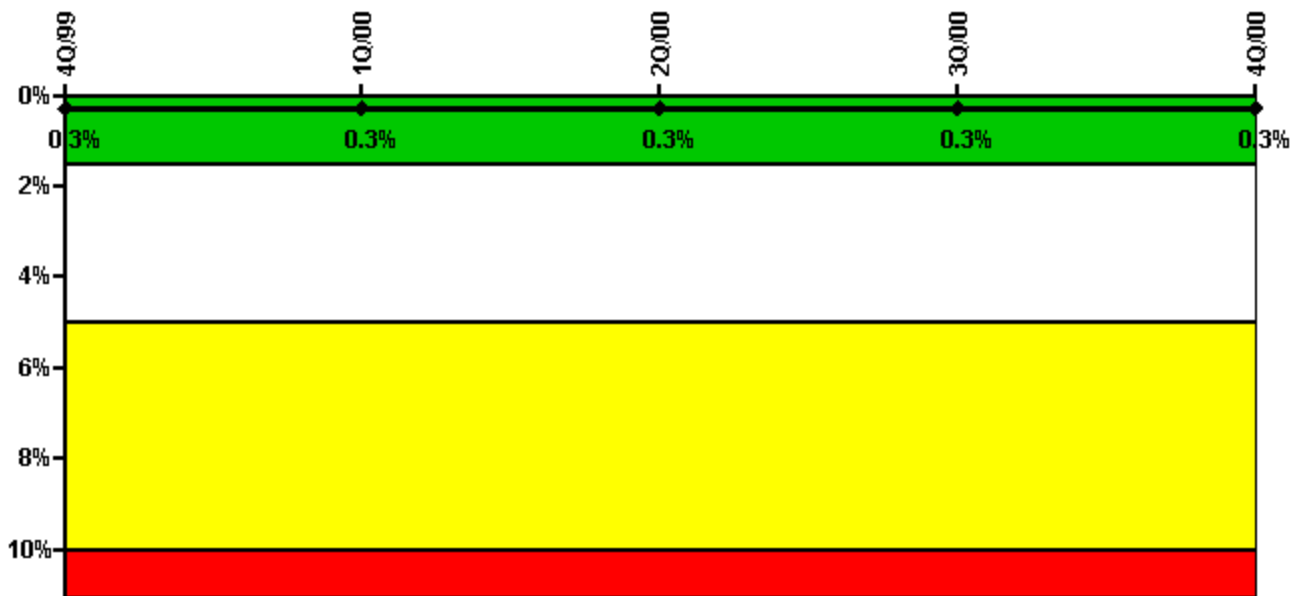

Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, High Pressure Injection System (HPSI)	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Train 1					
Planned unavailable hours	19.50	2.42	2.40	6.33	2.50
Unplanned unavailable hours	0	0	0	4.45	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	1686.00	1956.00	2208.00	2209.00
Train 2					
Planned unavailable hours	5.60	2.05	6.90	0.40	0
Unplanned unavailable hours	2.10	0	0	0	4.00
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	1686.00	1956.00	2208.00	2209.00
Train 3					
Planned unavailable hours	11.70	0	0	6.30	0
Unplanned unavailable hours	0	0	0	4.45	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	1686.00	1956.00	2208.00	2209.00
Train 4					
Planned unavailable hours	10.10	8.05	1.10	0	0
Unplanned unavailable hours	0	0	0	0	4.00
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	1686.00	1956.00	2208.00	2209.00
Indicator value	0.3%	0.3%	0.3%	0.3%	0.3%

Licensee Comments:

4Q/00: Based upon tentative approval of draft FAQ 16.12, planned overhaul hours for the nuclear service water support system have been excluded from the computation of monitored system unavailabilities.

Safety System Unavailability, Heat Removal System (AFW)



Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%

Notes


Safety System Unavailability, Heat Removal System (AFW)	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Train 1					
Planned unavailable hours	64.10	43.87	8.89	30.49	8.52
Unplanned unavailable hours	0	0	37.47	4.45	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	1692.90	2061.00	2208.00	2209.00
Train 2					
Planned unavailable hours	28.20	79.38	33.40	23.90	7.83
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	1692.90	2061.00	2208.00	2209.00
Train 3					
Planned unavailable hours	8.80	0	35.90	18.36	7.21
Unplanned unavailable hours	4.90	0	0	0	2.43
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2209.00	1692.90	2020.00	2208.00	2209.00

Indicator value	0.8%	0.9%	1.0%	1.1%	1.1%
-----------------	------	------	------	------	------

Licensee Comments:

4Q/00: Based upon tentative approval of draft FAQ 16.12, planned overhaul hours for the nuclear service water support system have been excluded from the computation of monitored system unavailabilities.

Safety System Unavailability, Residual Heat Removal System

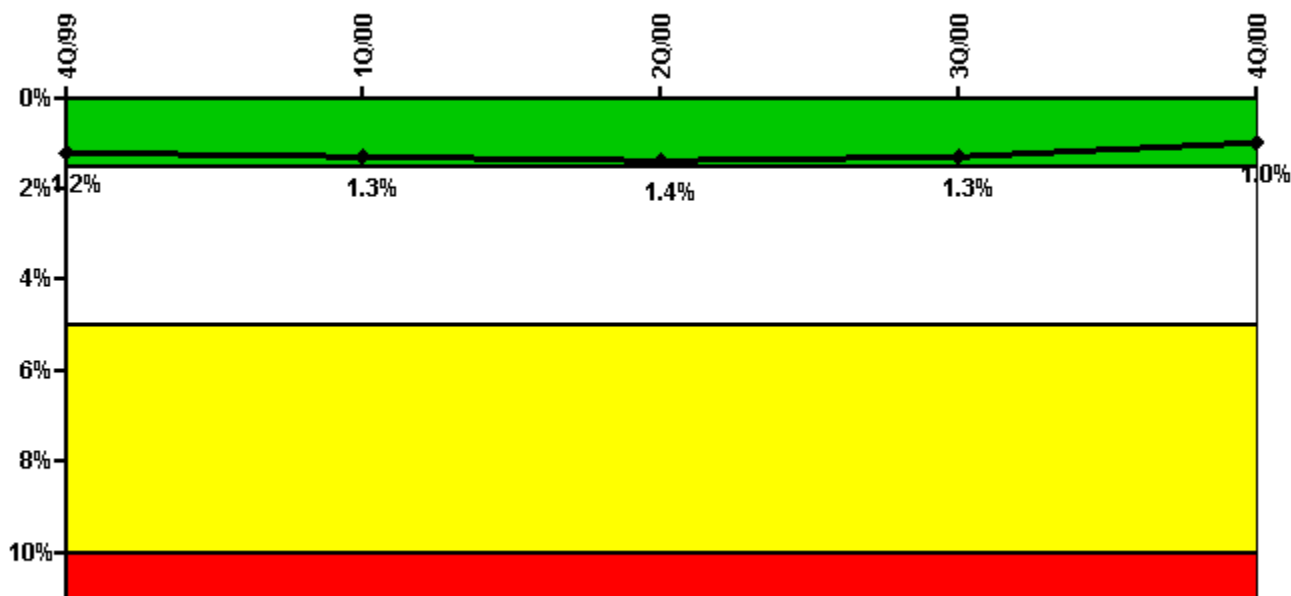

Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%


Notes

Safety System Unavailability, Residual Heat Removal System	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Train 1					
Planned unavailable hours	0.47	15.80	9.80	0	1.20
Unplanned unavailable hours	0	0	0	4.45	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2184.00	2184.00	2208.00	2209.00
Train 2					
Planned unavailable hours	0.40	55.70	28.60	0.35	0
Unplanned unavailable hours	0	5.70	0	0	23.20
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2208.00	2184.00	2184.00	2208.00	2209.00
Indicator value	1.2%	1.3%	1.4%	1.3%	1.0%

Licensee Comments:

4Q/00: Based upon tentative approval of draft FAQ 16.12, planned overhaul hours for the nuclear service water support system have been excluded from the computation of monitored system unavailabilities.

Safety System Functional Failures (PWR)

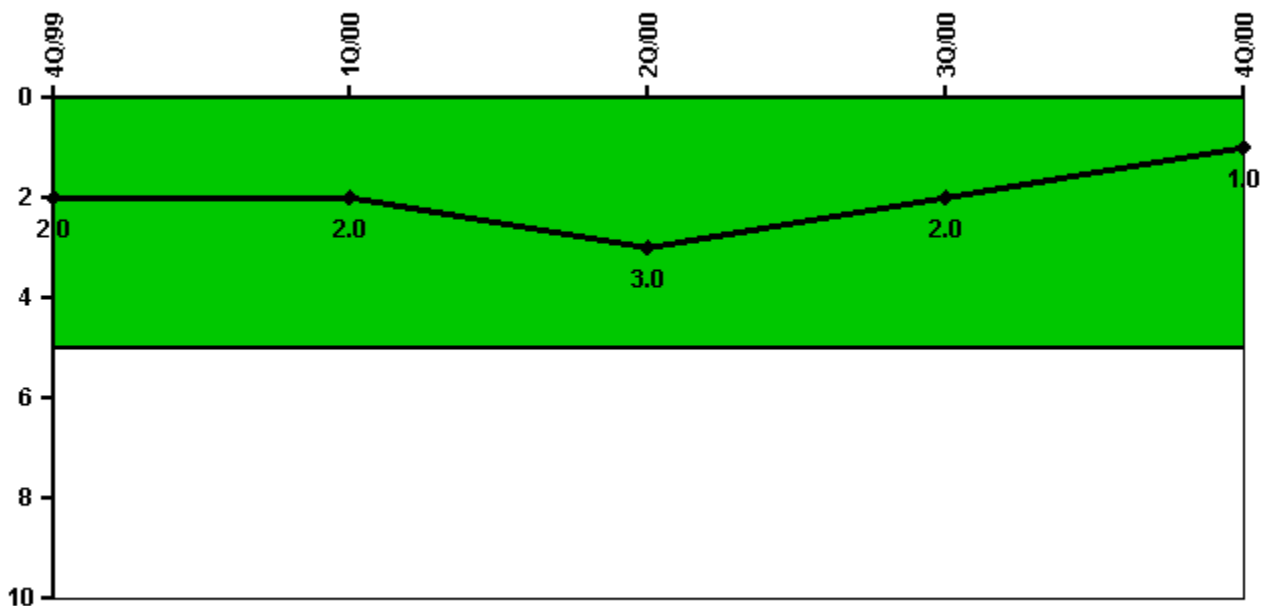

Thresholds: White > 5.0


Notes

Safety System Functional Failures (PWR)	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Safety System Functional Failures	1	0	1	0	0
Indicator value	2	2	3	2	1

Licensee Comments:

2Q/00: Based on additional testing and review, it has been determined that the event documented in LER 414/00-002 constituted a SSFF, thus the data for 5/2000 is being revised.

Reactor Coolant System Activity

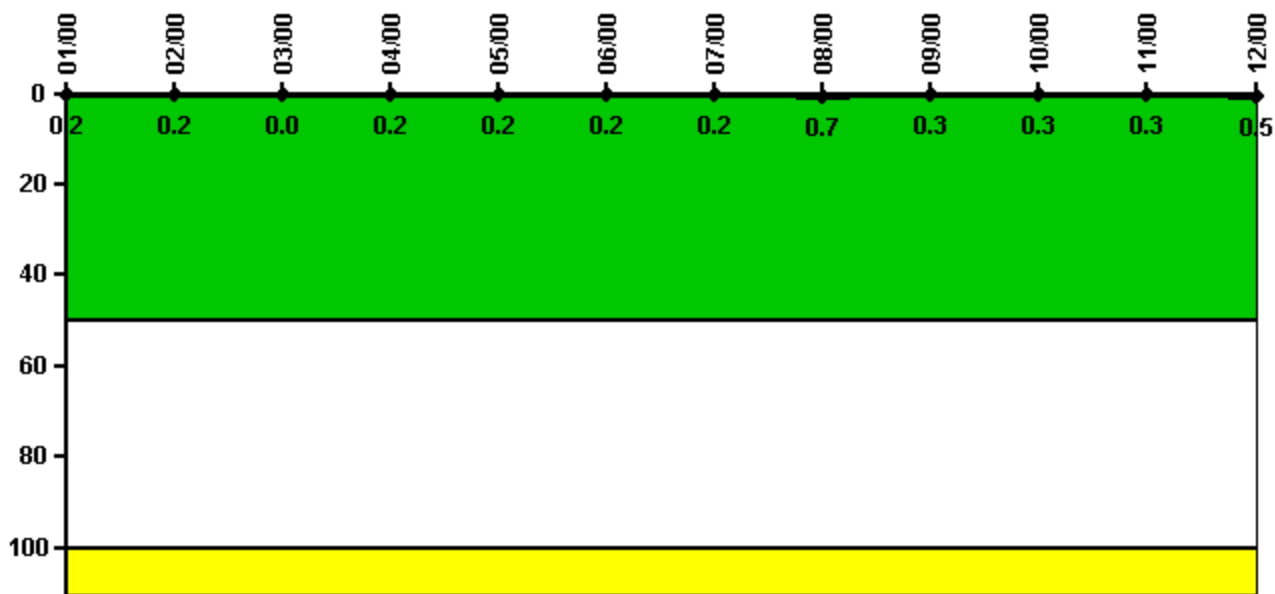


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	1/00	2/00	3/00	4/00	5/00	6/00	7/00	8/00	9/00	10/00	11/00	12/00
Maximum activity	0.000100	0.000100	0.000030	0.000110	0.000120	0.000110	0.000140	0.000440	0.000210	0.000200	0.000200	0.000300
Technical specification limit	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Indicator value	0.2	0.2	0	0.2	0.2	0.2	0.2	0.7	0.3	0.3	0.3	0.5

Licensee Comments: none

Reactor Coolant System Leakage

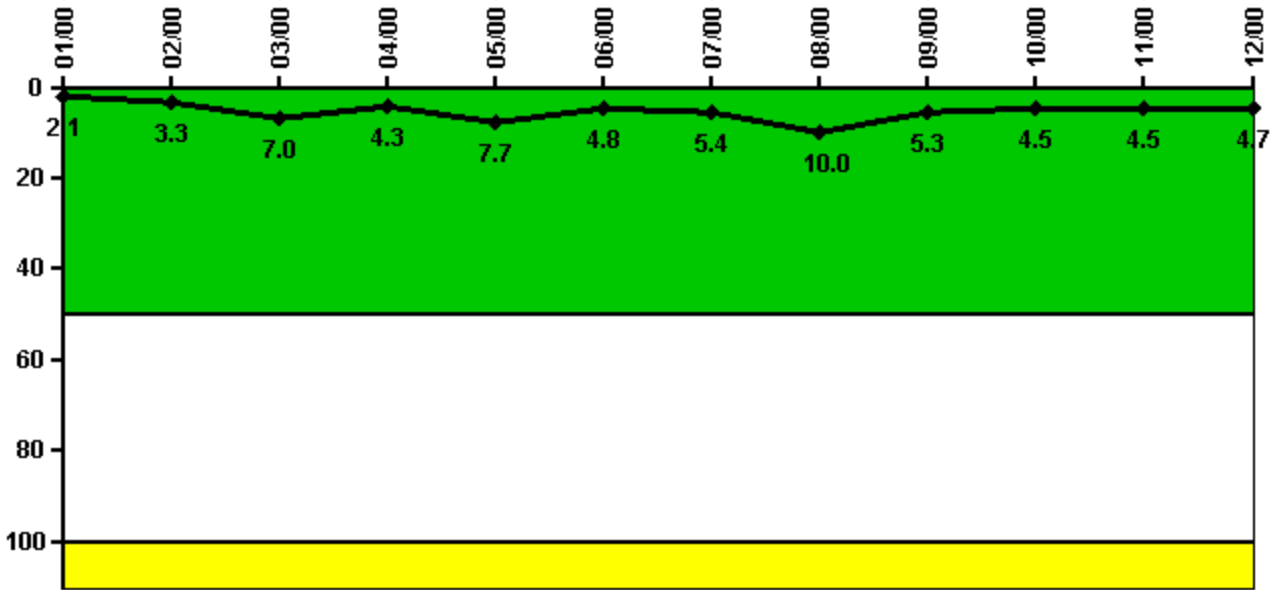


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	1/00	2/00	3/00	4/00	5/00	6/00	7/00	8/00	9/00	10/00	11/00	12/00
Maximum leakage	0.211	0.329	0.698	0.432	0.770	0.481	0.535	0.997	0.528	0.445	0.452	0.467
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	2.1	3.3	7.0	4.3	7.7	4.8	5.4	10.0	5.3	4.5	4.5	4.7

Licensee Comments: none

Drill/Exercise Performance

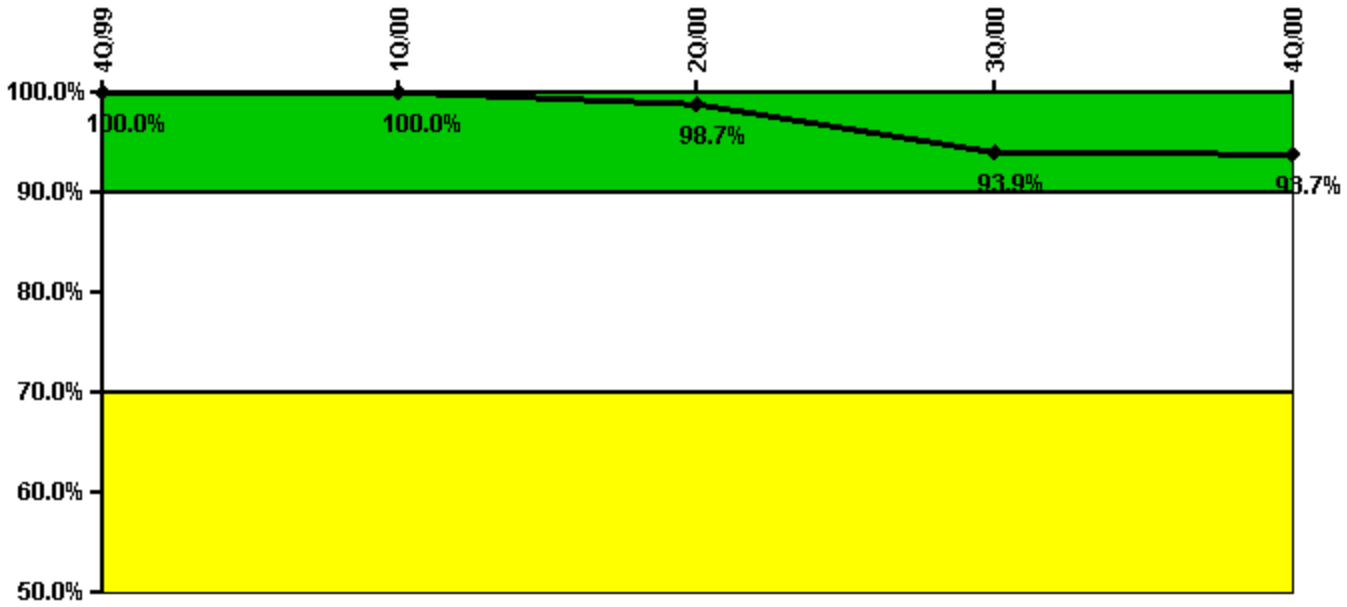


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Successful opportunities	0	21.0	8.0	69.0	9.0
Total opportunities	0	21.0	9.0	77.0	9.0
Indicator value	100.0%	100.0%	98.7%	93.9%	93.7%

Licensee Comments: none

ERO Drill Participation

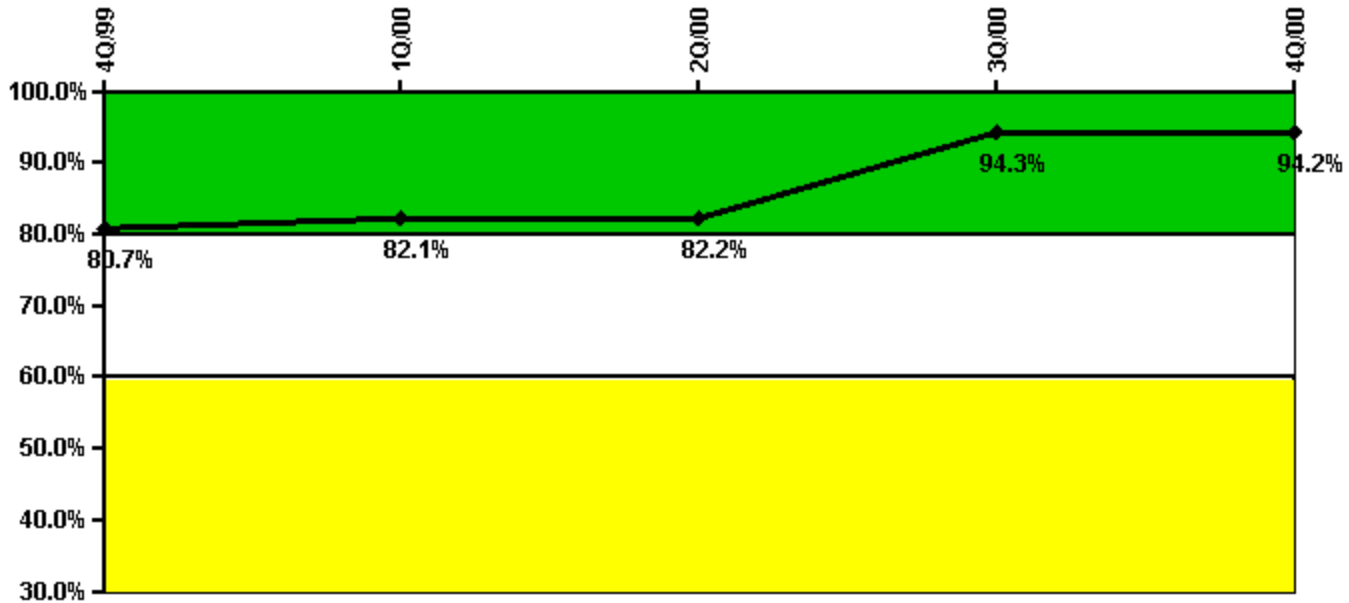


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Participating Key personnel	151.0	161.0	157.0	181.0	180.0
Total Key personnel	187.0	196.0	191.0	192.0	191.0
Indicator value	80.7%	82.1%	82.2%	94.3%	94.2%

Licensee Comments: none

Alert & Notification System

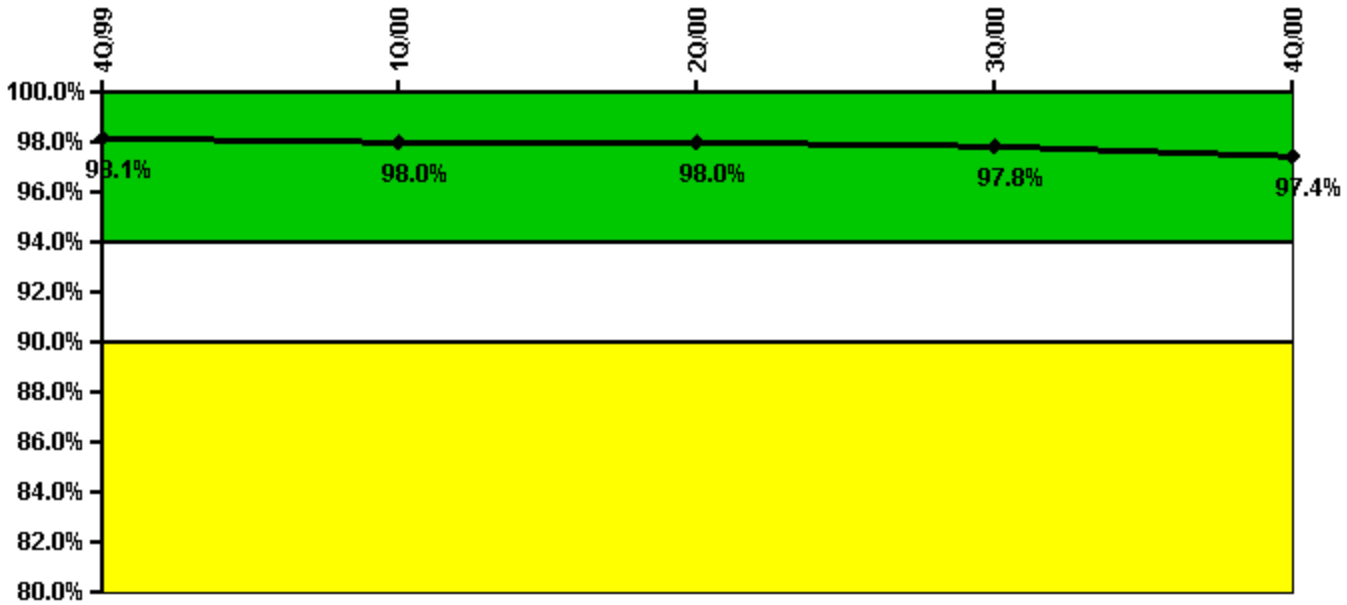

Thresholds: White < 94.0% Yellow < 90.0%

Notes


Alert & Notification System	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Successful siren-tests	2226	2213	2234	2123	2195
Total sirens-tests	2264	2276	2270	2188	2262
Indicator value	98.1%	98.0%	98.0%	97.8%	97.4%

Licensee Comments:

4Q/00: Continued evaluation revealed a specific siren (#40) indicated success on certain tests and failure on quarterly full cycle tests. Successful tests for #40 (from August 2000 to present) are now being reported as failures.

3Q/00: Continued evaluation revealed a specific siren (#40) indicated success on certain tests and failure on quarterly full cycle tests. Successful tests for #40 (from August 2000 to present) are now being reported as failures.

Occupational Exposure Control Effectiveness

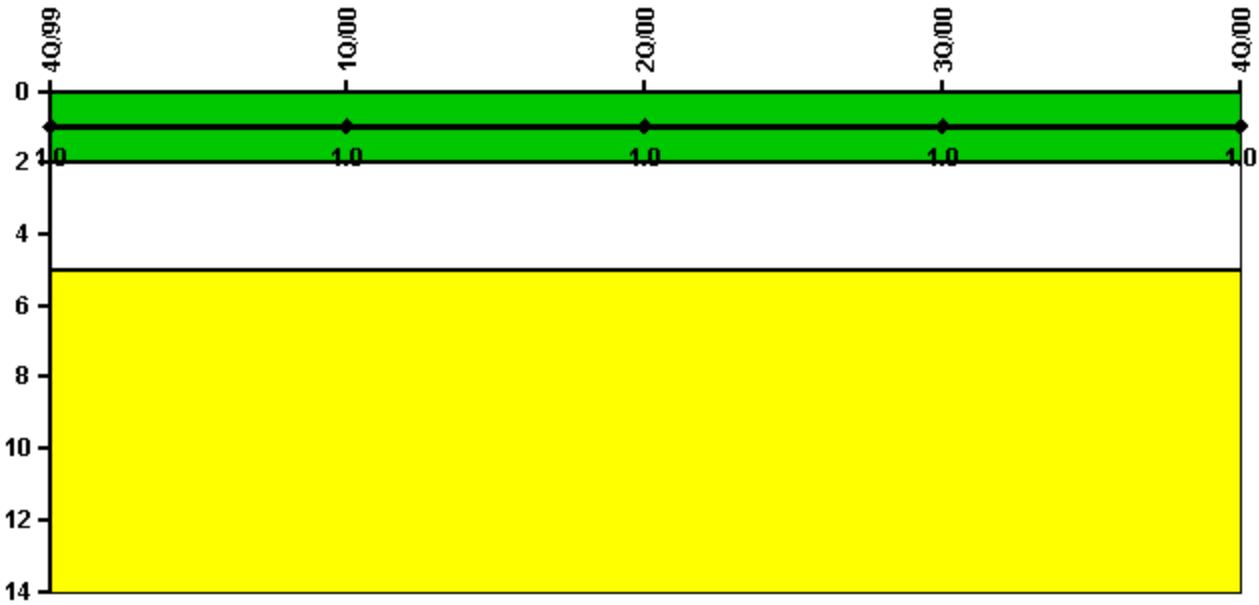

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
High radiation area occurrences	0	0	1	0	0
Very high radiation area occurrences	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0
Indicator value	1	1	1	1	1

Licensee Comments: none

RETS/ODCM Radiological Effluent




Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
RETS/ODCM occurrences	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

Protected Area Security Performance Index

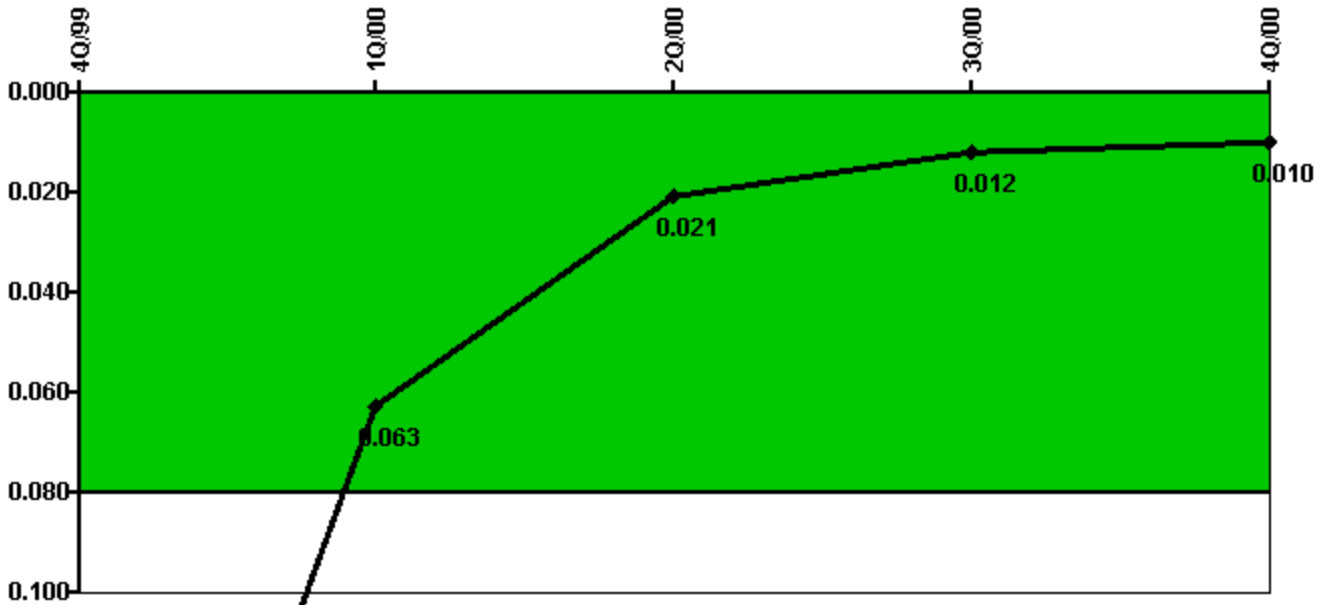


Thresholds: White > 0.090

Notes

Protected Area Security Performance Index	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
IDS compensatory hours	88.80	37.50	63.90	30.30	0
CCTV compensatory hours	5.4	105.0	10.5	7.9	0.5
IDS normalization factor	2.45	2.45	2.45	2.45	2.45
CCTV normalization factor	1.0	1.0	1.0	1.0	1.0
Index Value	0.223	0.063	0.021	0.012	0.010

Licensee Comments: none

Personnel Screening Program

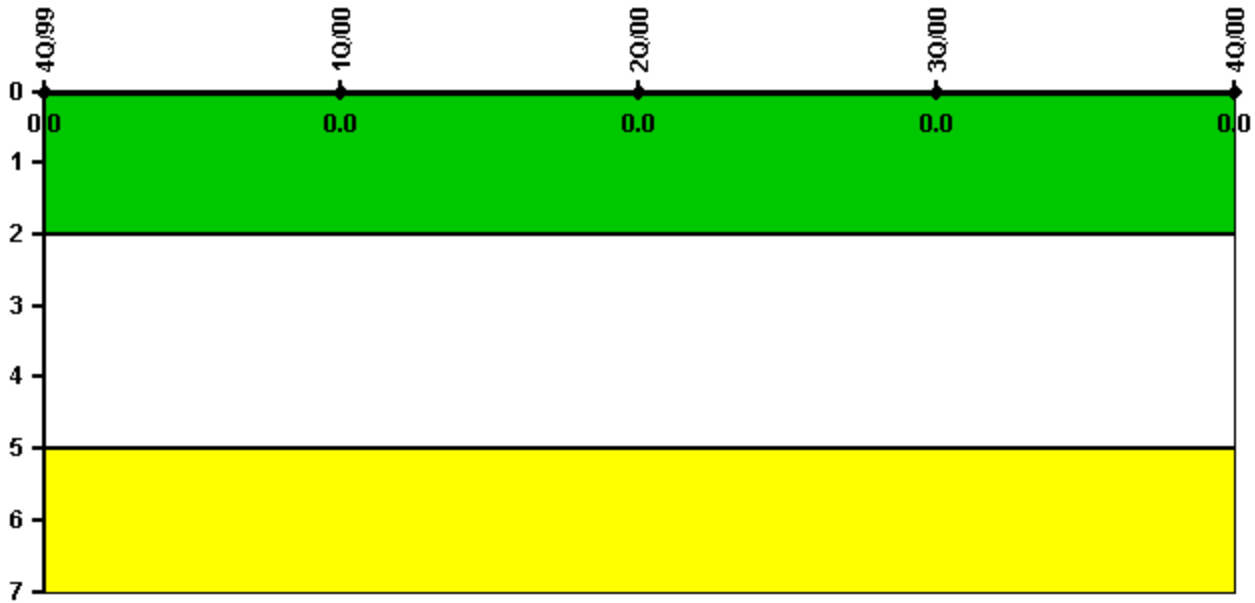


Thresholds: White > 2.0 Yellow > 5.0

Notes

Personnel Screening Program	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Program failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

FFD/Personnel Reliability

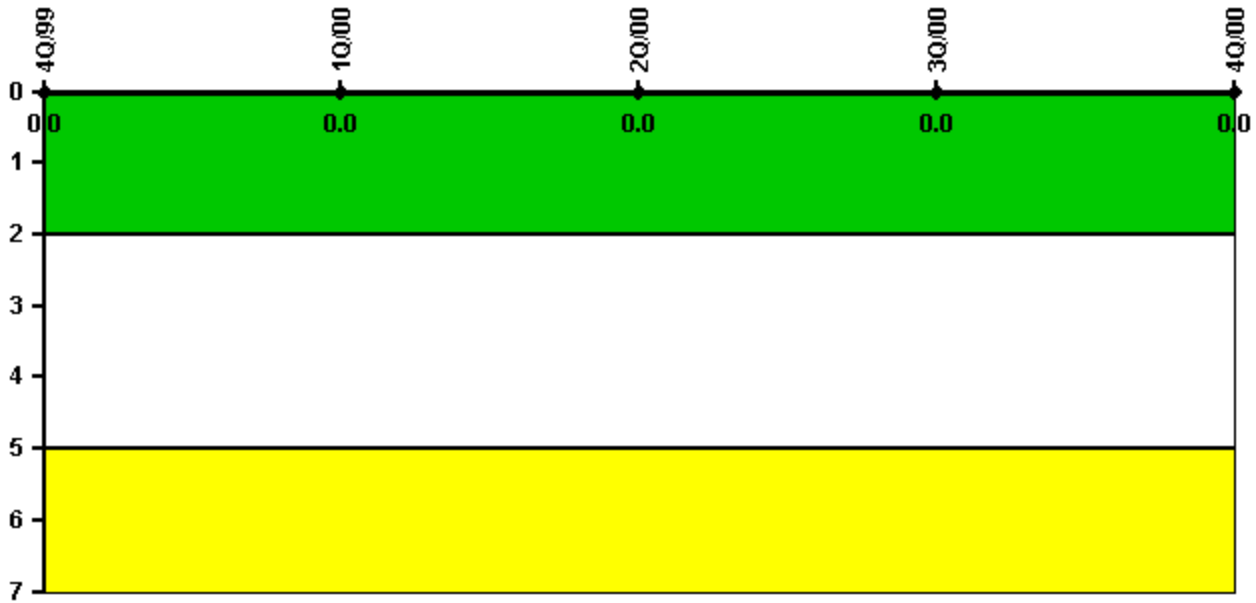

Thresholds: White > 2.0 Yellow > 5.0

Notes

FFD/Personnel Reliability	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00
Program Failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

▲ [PI Summary](#) | [Inspection Findings Summary](#) | [Action Matrix Summary](#) | [Reactor Oversight Process](#)

Last Modified: March 28, 2002