


Cooper

1Q/2002 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

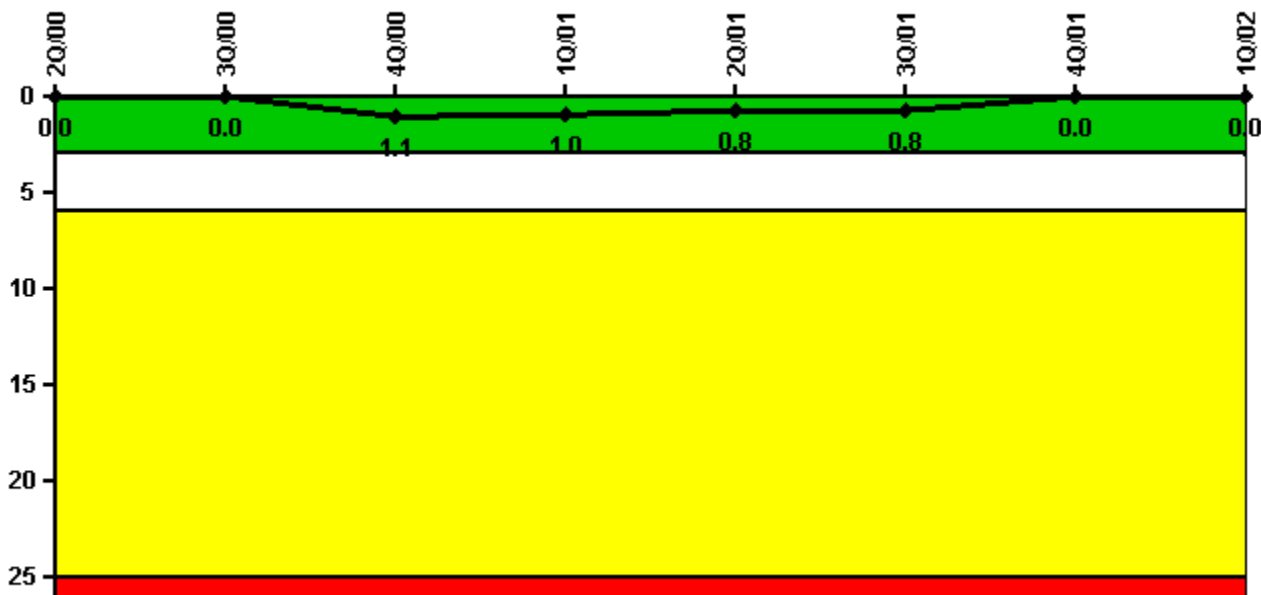


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Unplanned scrams	0	0	1.0	0	0	0	0	0
Critical hours	849.5	2208.0	2092.6	1873.9	2183.0	2208.0	863.3	2160.0
Indicator value	0	0	1.1	1.0	0.8	0.8	0	0

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

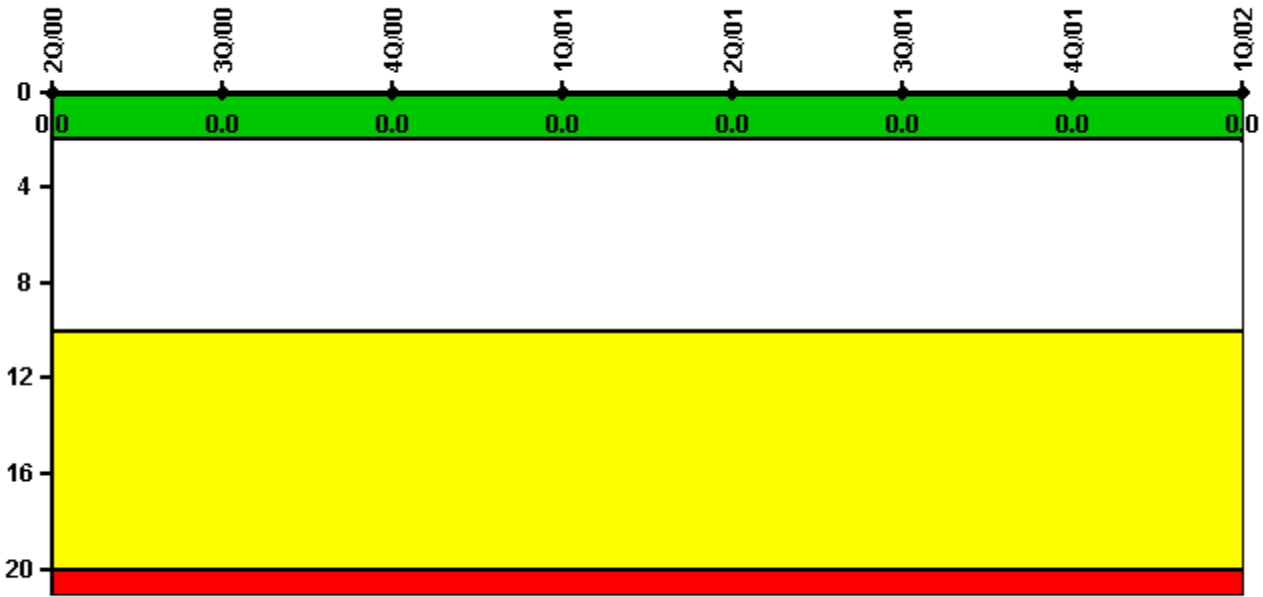


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Scrams	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

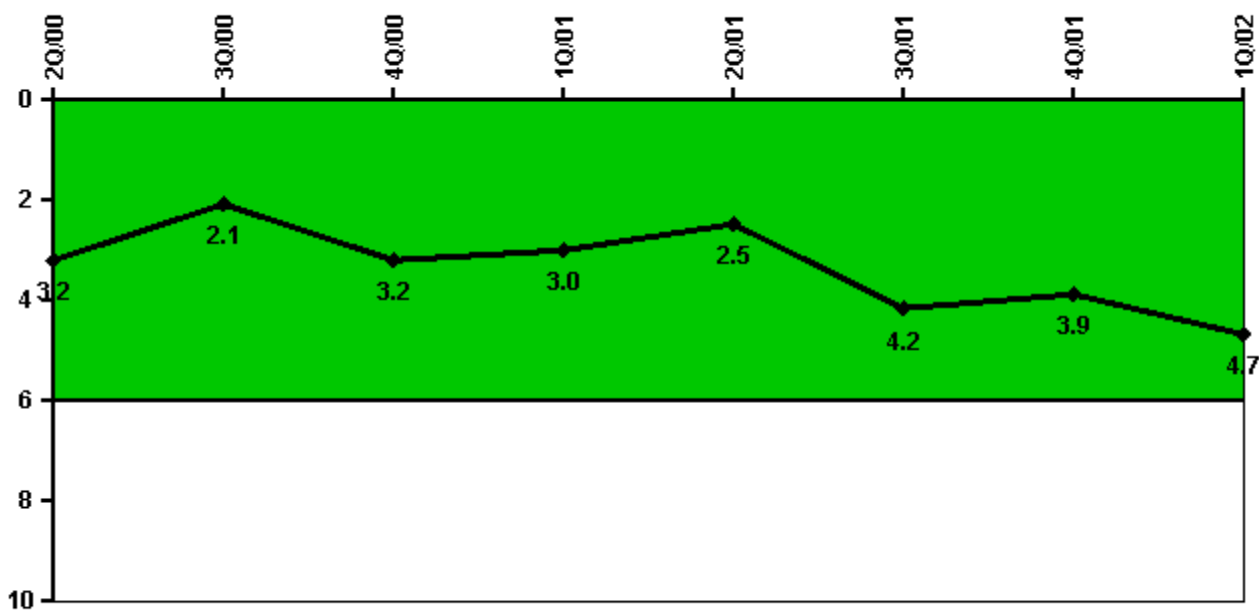

Thresholds: White > 6.0


Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Unplanned power changes	1.0	0	1.0	1.0	1.0	2.0	0	2.0
Critical hours	849.5	2208.0	2092.6	1873.9	2183.0	2208.0	863.3	2160.0
Indicator value	3.2	2.1	3.2	3.0	2.5	4.2	3.9	4.7

Licensee Comments:

1Q/02: January - "B" Feedpump Turbine/ Turbine Control Problem

Safety System Unavailability, Emergency AC Power

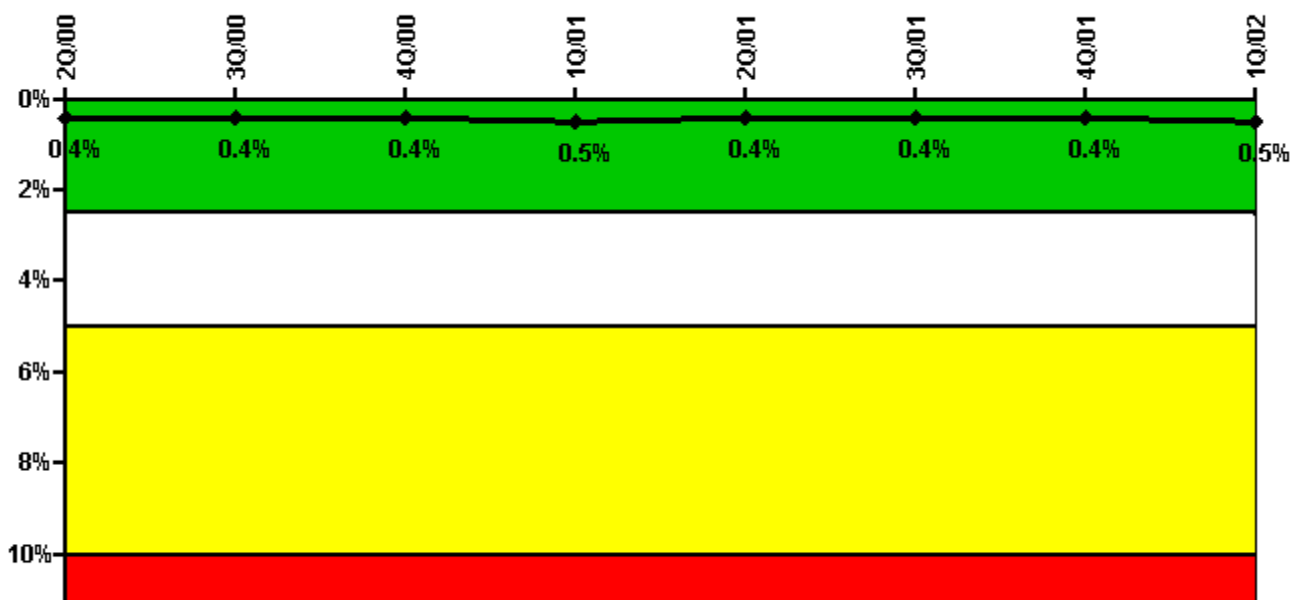


Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Emergency AC Power	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Train 1								
Planned unavailable hours	0	1.10	18.02	11.20	0	0	23.58	37.48
Unplanned unavailable hours	0	0	7.95	0	2.00	7.86	6.31	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2071.20	2208.00	2208.00	2160.00	2183.00	2208.00	2209.00	2160.00
Train 2								
Planned unavailable hours	0	0.72	28.05	0	0	20.43	0	25.65
Unplanned unavailable hours	0	0	4.29	45.65	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2184.00	2208.00	2208.00	2160.00	2183.00	2208.00	2209.00	2160.00
Indicator value	0.4%	0.4%	0.4%	0.5%	0.4%	0.4%	0.4%	0.5%

Licensee Comments: none

Safety System Unavailability, High Pressure Injection System (HPCI)

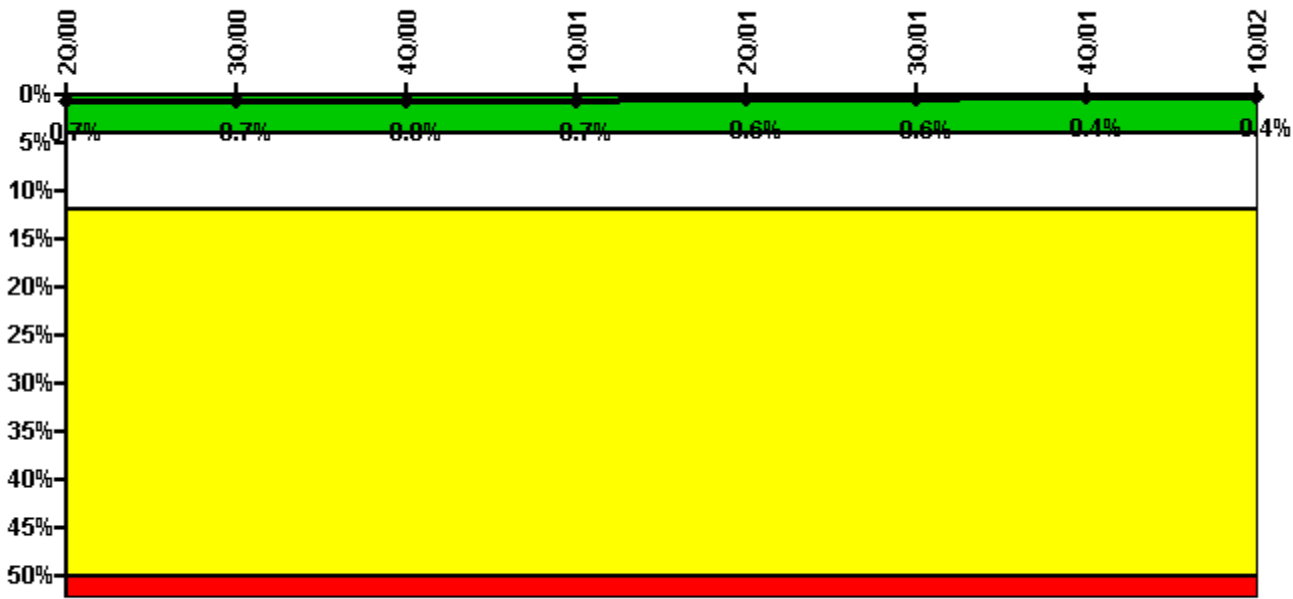


Thresholds: White > 4.0% Yellow > 12.0% Red > 50.0%

Notes

Safety System Unavailability, High Pressure Injection System (HPCI)	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Train 1								
Planned unavailable hours	0.43	1.74	31.48	1.22	0.60	20.49	0.56	9.21
Unplanned unavailable hours	0	0	0	0	0	0	7.30	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	838.08	2208.00	2094.65	1833.20	2183.00	2208.00	834.38	2160.00
Indicator value	0.7%	0.7%	0.8%	0.7%	0.6%	0.6%	0.4%	0.4%

Licensee Comments: none

Safety System Unavailability, Heat Removal System (RCIC)

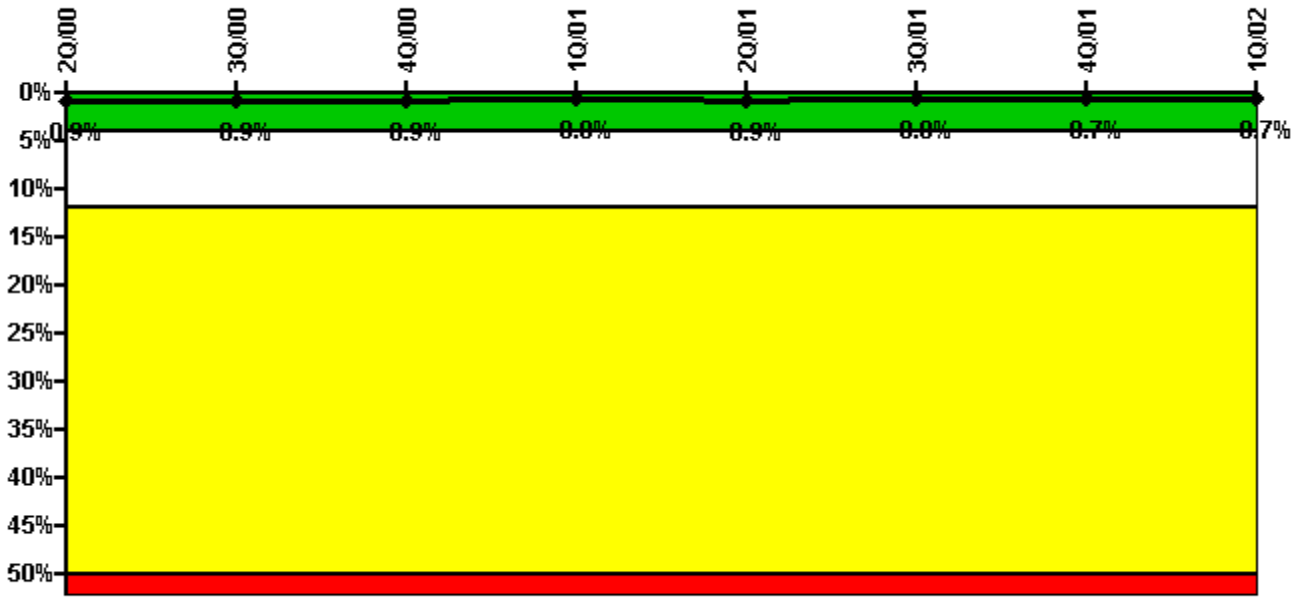


Thresholds: White > 4.0% Yellow > 12.0% Red > 50.0%

Notes

Safety System Unavailability, Heat Removal System (RCIC)	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Train 1								
Planned unavailable hours	0.10	3.35	7.39	0.22	11.82	1.18	12.62	5.19
Unplanned unavailable hours	80.77	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	838.08	2208.00	2094.65	1833.20	2183.00	2208.00	834.38	2160.00
Indicator value	0.9%	0.9%	0.9%	0.8%	0.9%	0.8%	0.7%	0.7%

Licensee Comments: none

Safety System Unavailability, Residual Heat Removal System

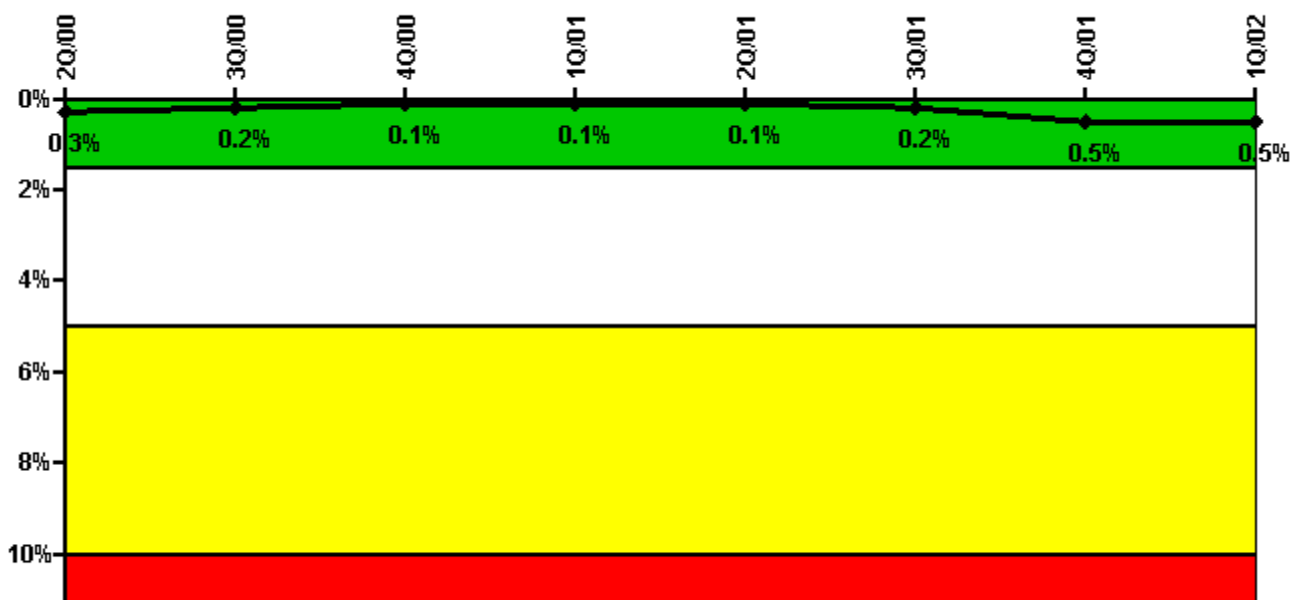


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Residual Heat Removal System	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Train 1								
Planned unavailable hours	21.02	0	0.40	1.32	0	33.89	10.28	0
Unplanned unavailable hours	0	0	0	0	2.00	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2063.80	2208.00	2208.00	2080.00	2183.00	2208.00	2209.00	2160.00
Train 2								
Planned unavailable hours	2.53	0	0.35	0.88	0	3.18	90.10	10.87
Unplanned unavailable hours	0	0	0	0	0	6.50	35.38	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2063.80	2208.00	2208.00	2080.00	2183.00	2208.00	2209.00	2160.00
Indicator value	0.3%	0.2%	0.1%	0.1%	0.1%	0.2%	0.5%	0.5%

Licensee Comments: none

Safety System Functional Failures (BWR)

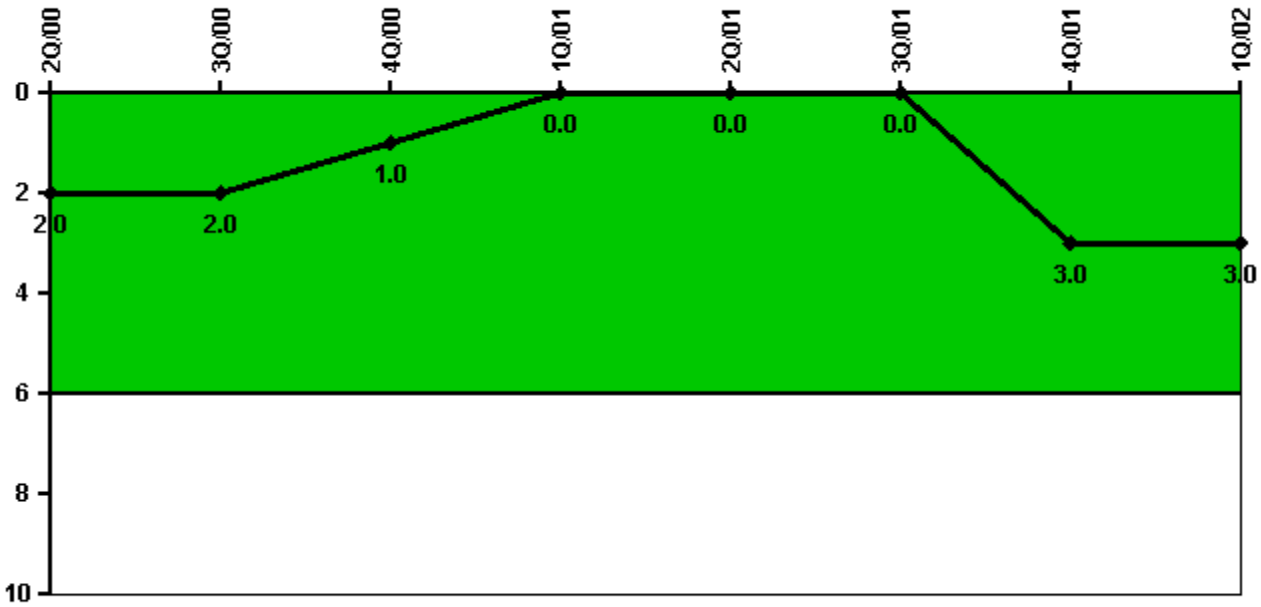


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Safety System Functional Failures	0	0	0	0	0	0	3	0
Indicator value	2	2	1	0	0	0	3	3

Licensee Comments: none

Reactor Coolant System Activity

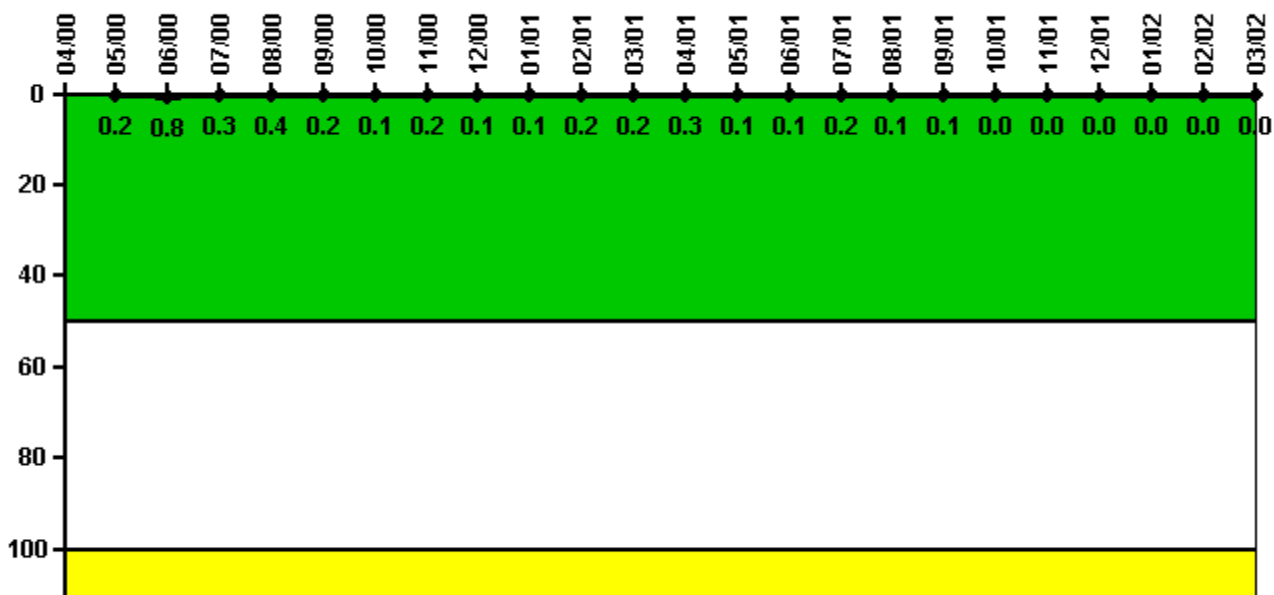

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	4/00	5/00	6/00	7/00	8/00	9/00	10/00	11/00	12/00	1/01	2/01	3/01
Maximum activity	N/A	0.000410	0.001690	0.000681	0.000727	0.000454	0.000195	0.000434	0.000238	0.000283	0.000329	0.000427
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	N/A	0.2	0.8	0.3	0.4	0.2	0.1	0.2	0.1	0.1	0.2	0.2

Reactor Coolant System Activity	4/01	5/01	6/01	7/01	8/01	9/01	10/01	11/01	12/01	1/02	2/02	3/02
Maximum activity	0.000560	0.000209	0.000198	0.000371	0.000184	0.000201	0.000037	0.000028	0.000018	0.000081	0.000069	0.000011
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.3	0.1	0.1	0.2	0.1	0.1	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

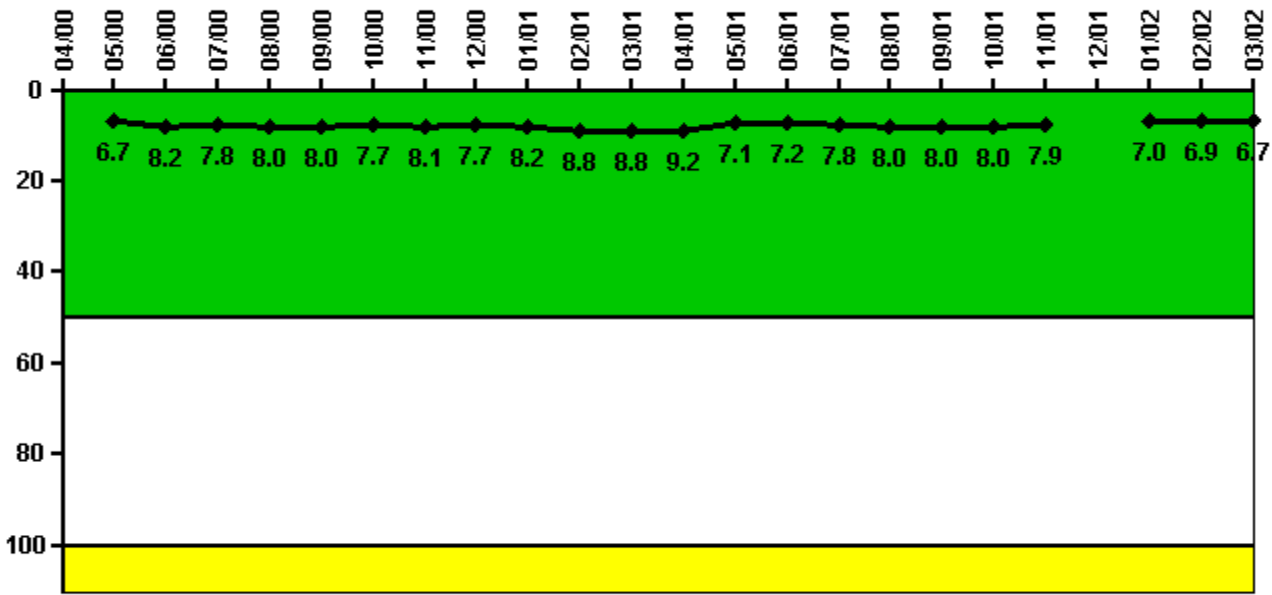

Thresholds: White > 50.0 Yellow > 100.0

Notes


Reactor Coolant System Leakage	4/00	5/00	6/00	7/00	8/00	9/00	10/00	11/00	12/00	1/01	2/01	3/01
Maximum leakage	N/A	2.000	2.453	2.348	2.390	2.410	2.320	2.443	2.312	2.464	2.630	2.626
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	N/A	6.7	8.2	7.8	8.0	8.0	7.7	8.1	7.7	8.2	8.8	8.8

Reactor Coolant System Leakage	4/01	5/01	6/01	7/01	8/01	9/01	10/01	11/01	12/01	1/02	2/02	3/02
Maximum leakage	2.760	2.121	2.146	2.340	2.400	2.410	2.400	2.360	N/A	2.100	2.070	2.010
Technical specification limit	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0	30.0
Indicator value	9.2	7.1	7.2	7.8	8.0	8.0	8.0	7.9	N/A	7.0	6.9	6.7

Licensee Comments:

12/01: Refueling Shutdown in December

Drill/Exercise Performance

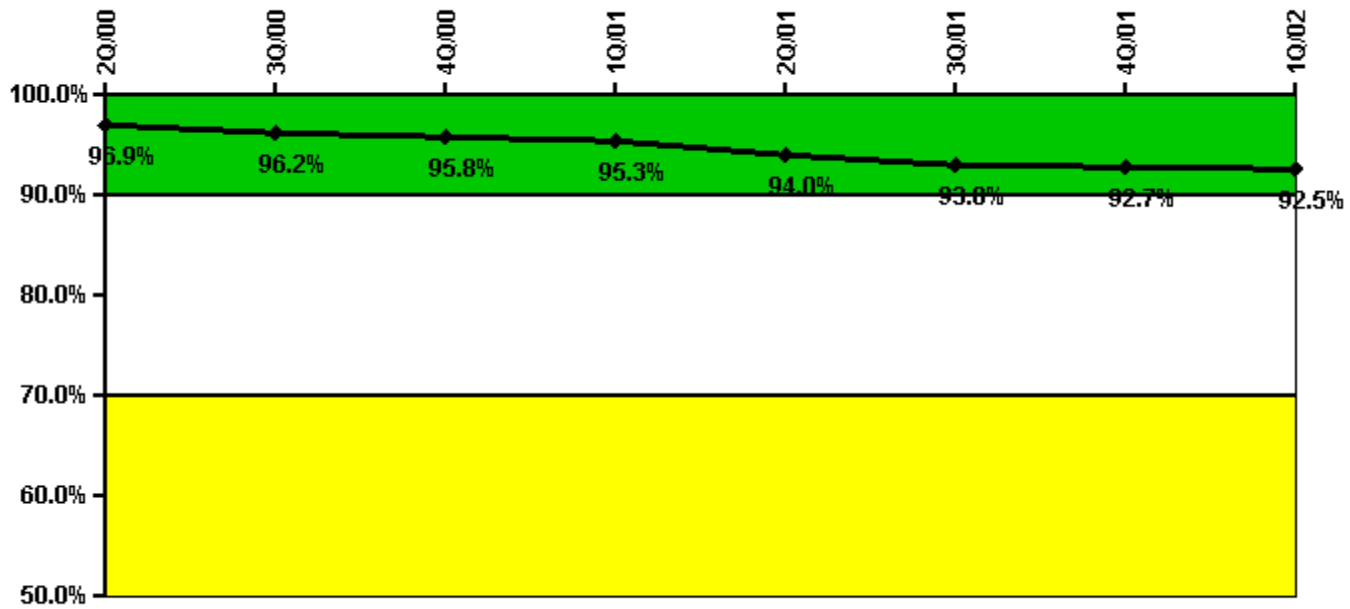


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Successful opportunities	44.0	24.0	62.0	8.0	32.0	18.0	11.0	46.0
Total opportunities	45.0	27.0	66.0	8.0	37.0	21.0	11.0	50.0
Indicator value	96.9%	96.2%	95.8%	95.3%	94.0%	93.0%	92.7%	92.5%

Licensee Comments: none

ERO Drill Participation

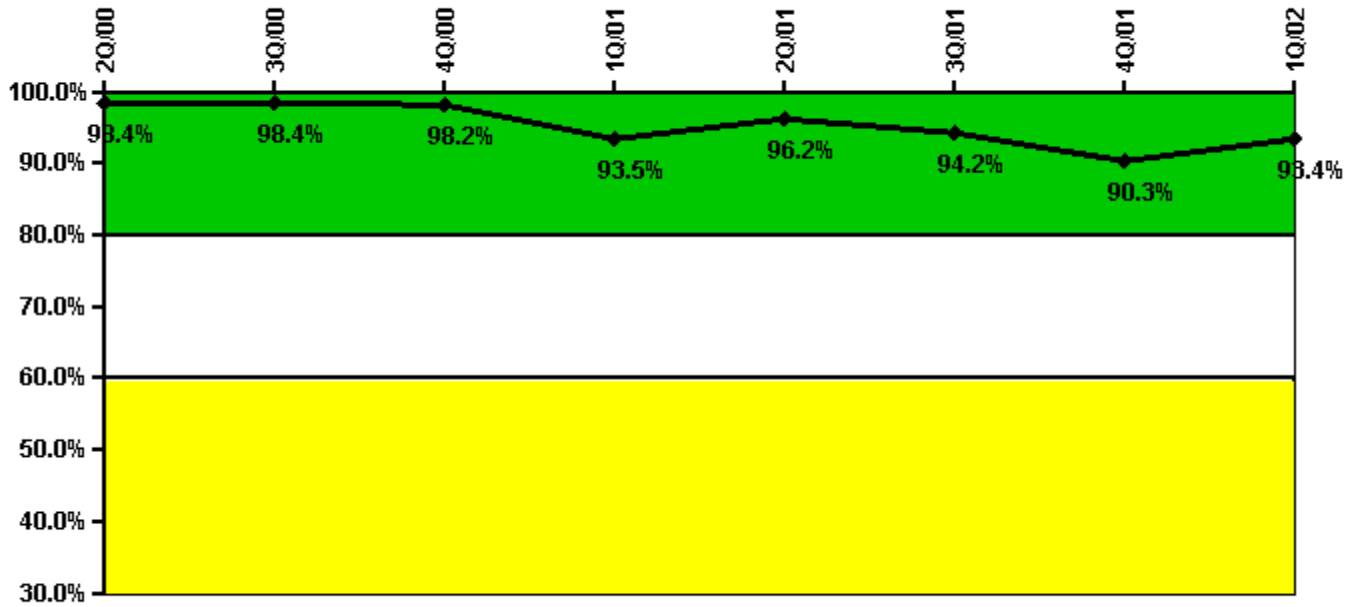


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Participating Key personnel	125.0	126.0	108.0	100.0	102.0	98.0	84.0	85.0
Total Key personnel	127.0	128.0	110.0	107.0	106.0	104.0	93.0	91.0
Indicator value	98.4%	98.4%	98.2%	93.5%	96.2%	94.2%	90.3%	93.4%

Licensee Comments: none

Alert & Notification System

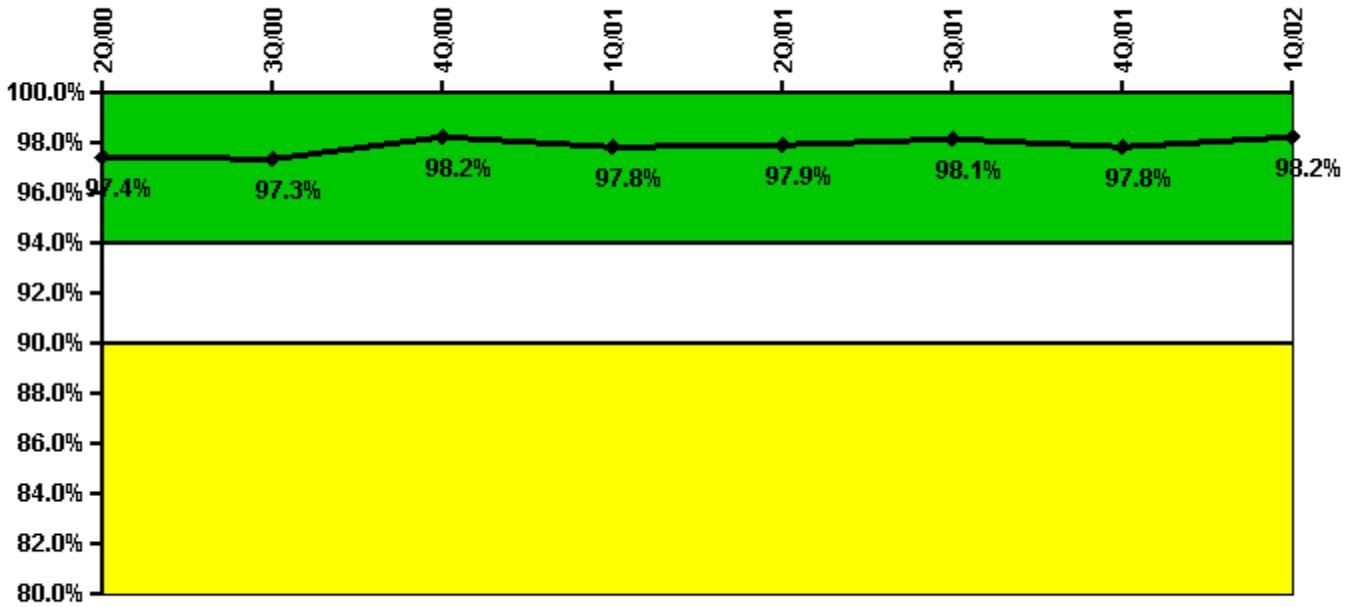


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Successful sirens-tests	141	140	166	140	165	141	164	143
Total sirens-tests	144	144	168	144	168	144	168	144
Indicator value	97.4%	97.3%	98.2%	97.8%	97.9%	98.1%	97.8%	98.2%

Licensee Comments: none

Occupational Exposure Control Effectiveness

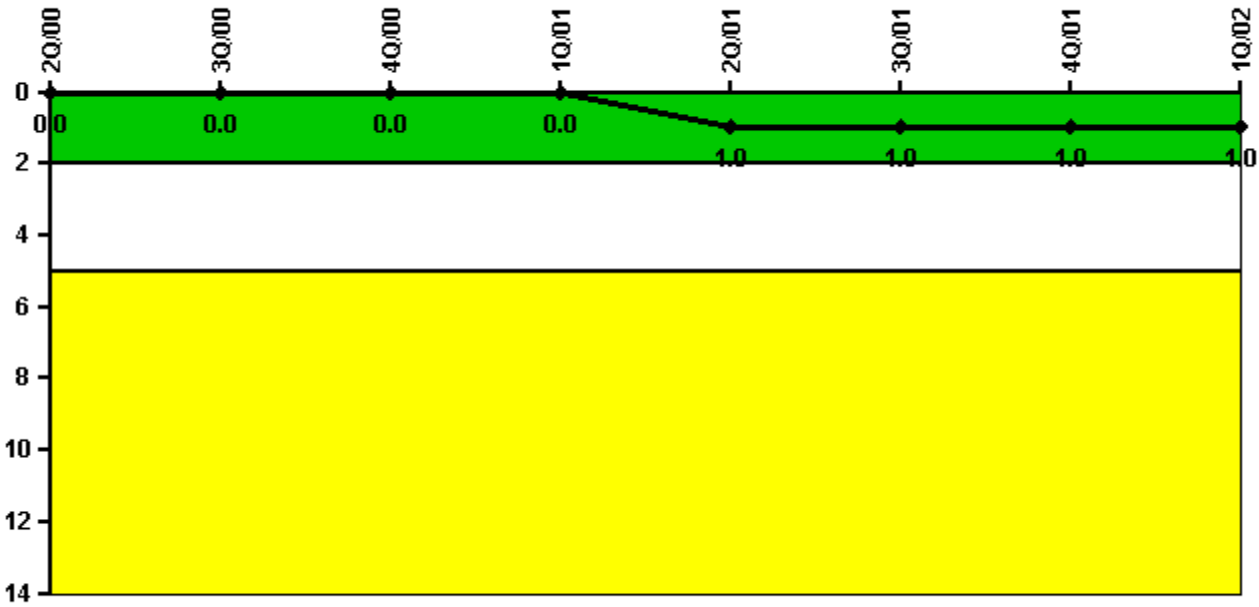


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
High radiation area occurrences	0	0	0	0	1	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	1	1	1	1

Licensee Comments: none

RETS/ODCM Radiological Effluent

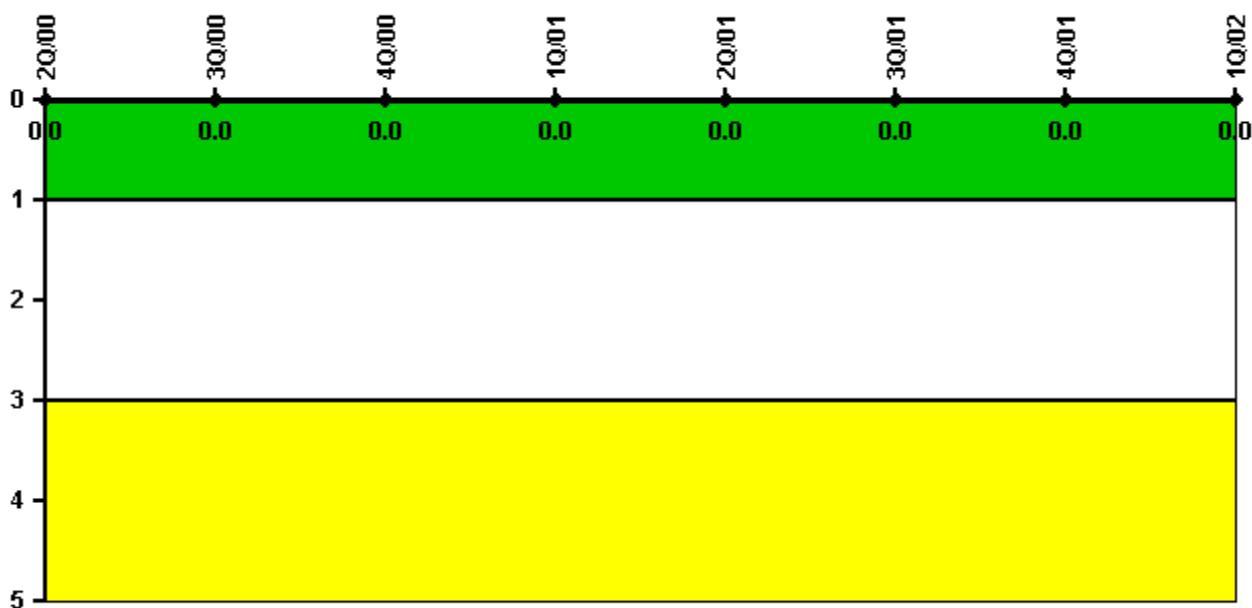


Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Protected Area Security Performance Index

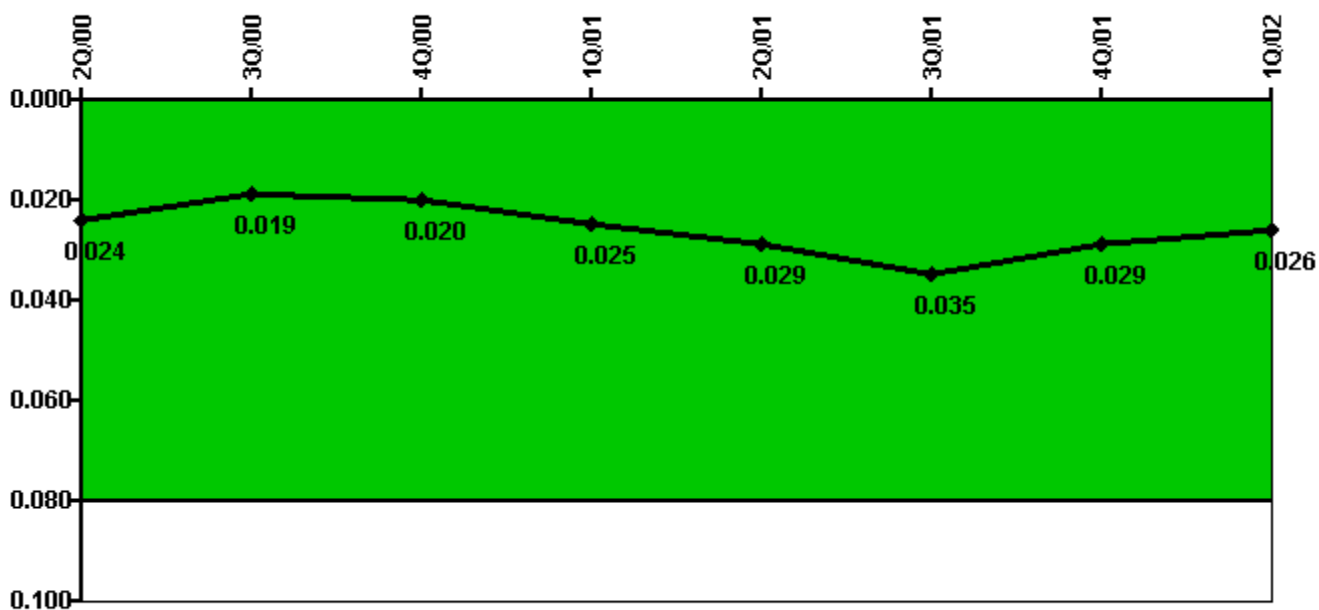

Thresholds: White > 0.080

Notes

Protected Area Security Performance Index	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
IDS compensatory hours	141.89	84.28	130.19	150.12	205.80	218.81	35.68	78.53
CCTV compensatory hours	1.6	0.7	48.4	3.0	29.8	2.3	0	19.5
IDS normalization factor	1.30	1.30	1.30	1.30	1.30	1.30	1.30	1.30
CCTV normalization factor	1.1	1.1	1.1	1.1	1.1	1.1	1.1	1.1
Index Value	0.024	0.019	0.020	0.025	0.029	0.035	0.029	0.026

Licensee Comments: none

Personnel Screening Program




Thresholds: White > 2.0 Yellow > 5.0

Notes

Personnel Screening Program	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Program failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

FFD/Personnel Reliability

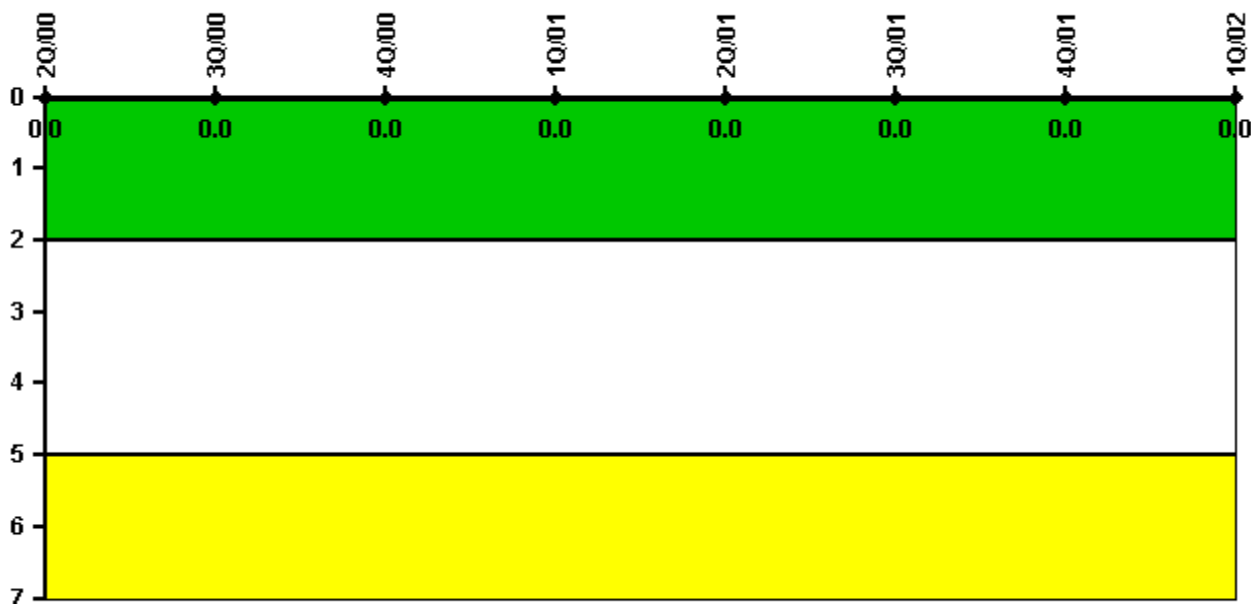

Thresholds: White > 2.0 Yellow > 5.0

Notes

FFD/Personnel Reliability	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Program Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

▲ [PI Summary](#) | [Inspection Findings Summary](#) | [Reactor Oversight Process](#)

Last Modified: May 1, 2002