


Catawba 1

4Q/2003 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

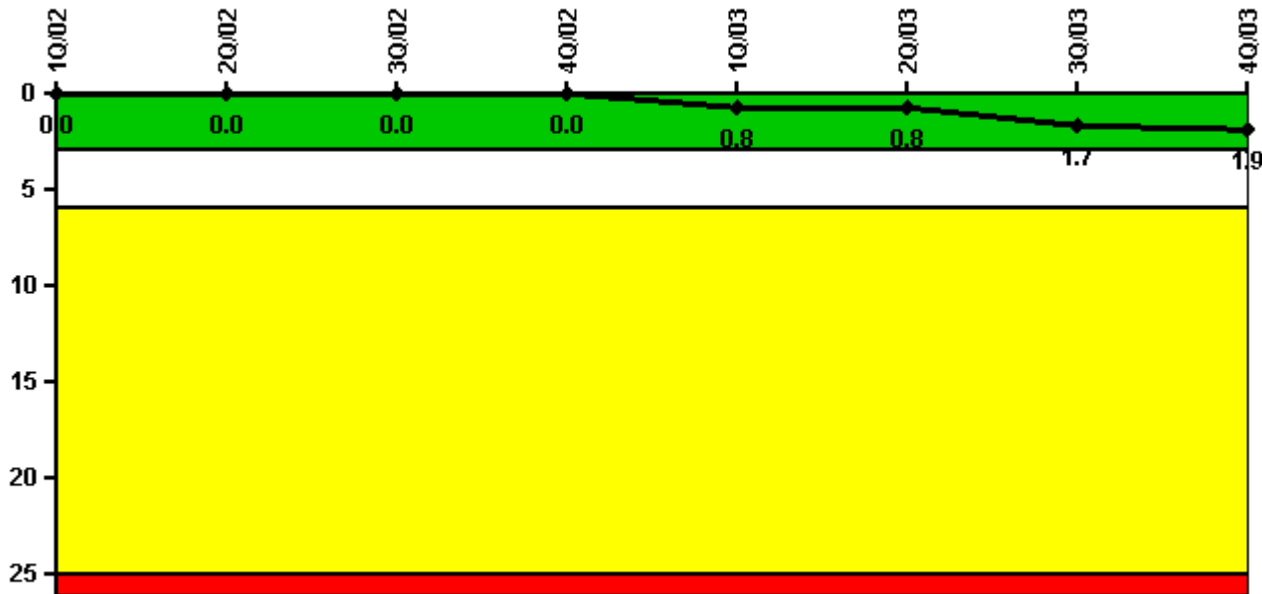

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	1Q/02	2Q/02	3Q/02	4Q/02	1Q/03	2Q/03	3Q/03	4Q/03
Unplanned scrams	0	0	0	0	1.0	0	1.0	0
Critical hours	2160.0	1695.0	2208.0	2209.0	2129.0	2183.0	1944.7	1226.8
Indicator value	0	0	0	0	0.8	0.8	1.7	1.9

Licensee Comments: none

Scrams with Loss of Normal Heat Removal




Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	1Q/02	2Q/02	3Q/02	4Q/02	1Q/03	2Q/03	3Q/03	4Q/03
Scrams	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

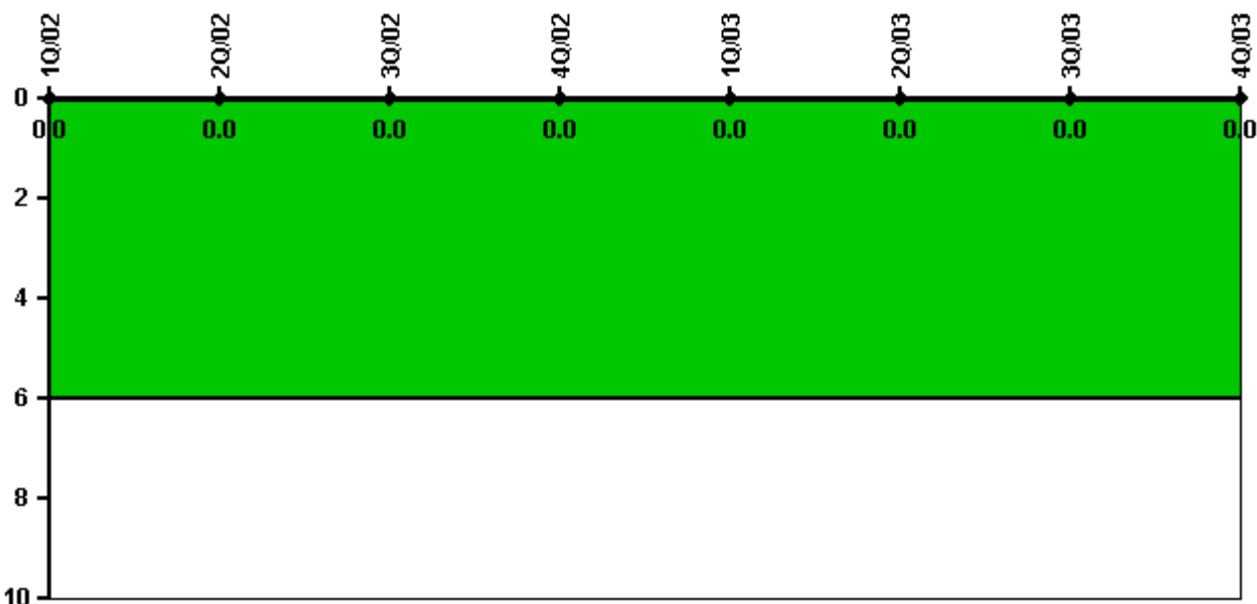


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	1Q/02	2Q/02	3Q/02	4Q/02	1Q/03	2Q/03	3Q/03	4Q/03
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2160.0	1695.0	2208.0	2209.0	2129.0	2183.0	1944.7	1226.8
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Safety System Unavailability, Emergency AC Power

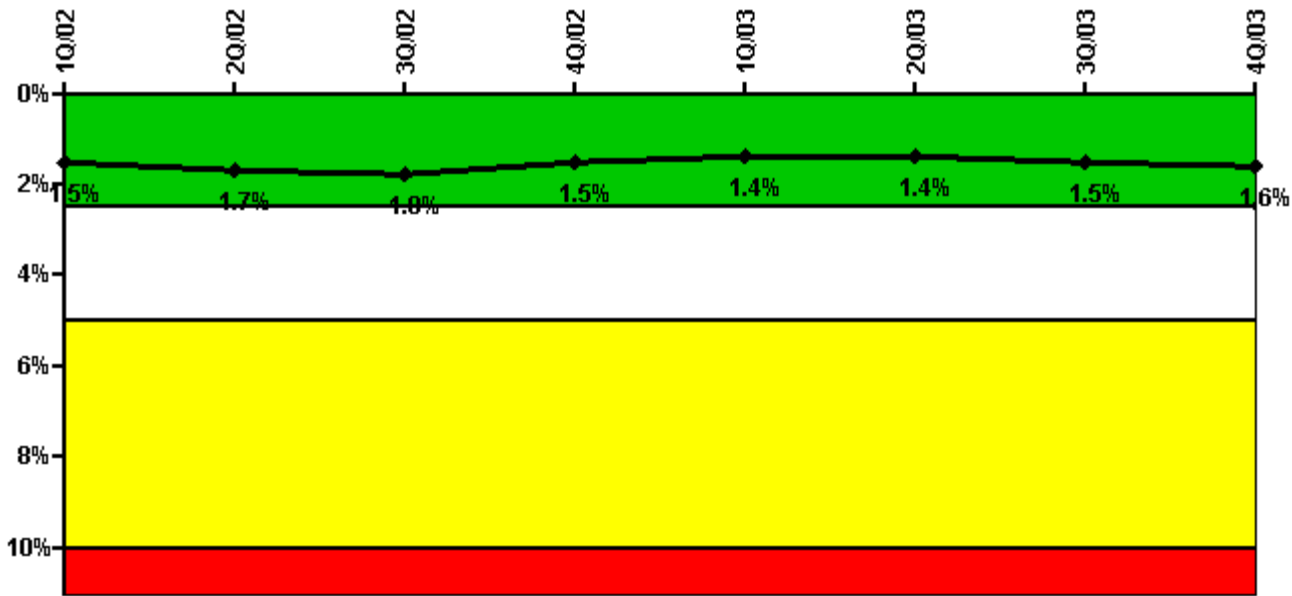


Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Emergency AC Power	1Q/02	2Q/02	3Q/02	4Q/02	1Q/03	2Q/03	3Q/03	4Q/03
Train 1								
Planned unavailable hours	50.15	0	34.18	21.32	0	0	56.39	0
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2160.00	2184.00	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00
Train 2								
Planned unavailable hours	0	61.25	41.73	0	0	19.60	0	37.08
Unplanned unavailable hours	0	20.90	0	0	0	0	0	5.65
Fault exposure hours	0	85.35	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2160.00	2184.00	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00
Indicator value	1.5%	1.7%	1.8%	1.5%	1.4%	1.4%	1.5%	1.6%

Licensee Comments: none

Safety System Unavailability, High Pressure Injection System (HPSI)

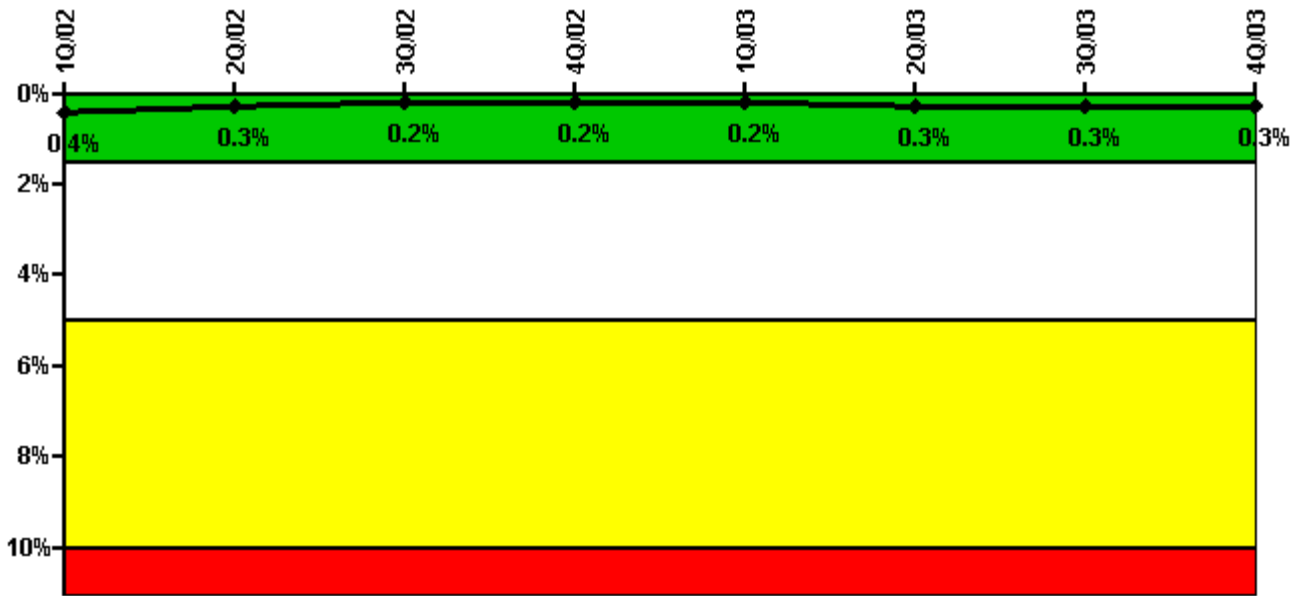

Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%


Notes

Safety System Unavailability, High Pressure Injection System (HPSI)	1Q/02	2Q/02	3Q/02	4Q/02	1Q/03	2Q/03	3Q/03	4Q/03
Train 1								
Planned unavailable hours	3.60	2.10	0	11.10	0	27.30	1.00	0
Unplanned unavailable hours	0	0.80	0	1.80	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2160.00	1695.00	2208.00	2209.00	2129.00	2183.00	1944.70	1226.90
Train 2								
Planned unavailable hours	5.60	13.20	3.30	8.60	0	12.70	11.40	0
Unplanned unavailable hours	0	0	0	1.30	3.80	13.70	0	3.50
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2160.00	1695.00	2208.00	2209.00	2129.00	2183.00	1944.70	1226.90
Train 3								
Planned unavailable hours	2.70	0	0	5.40	0	29.60	16.50	0
Unplanned unavailable hours	0	0.80	0	1.80	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2160.00	1695.00	2208.00	2209.00	2129.00	2183.00	1944.70	1226.90
Train 4								
Planned unavailable hours	3.50	13.20	0	5.10	0	19.60	0	8.40
Unplanned unavailable hours	0	0	0	1.30	3.80	13.70	0	3.50
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0

Required hours	2160.00	1695.00	2208.00	2209.00	2129.00	2183.00	1944.70	1226.90
Indicator value	0.4%	0.3%	0.2%	0.2%	0.2%	0.3%	0.3%	0.3%

Licensee Comments: none

Safety System Unavailability, Heat Removal System (AFW)

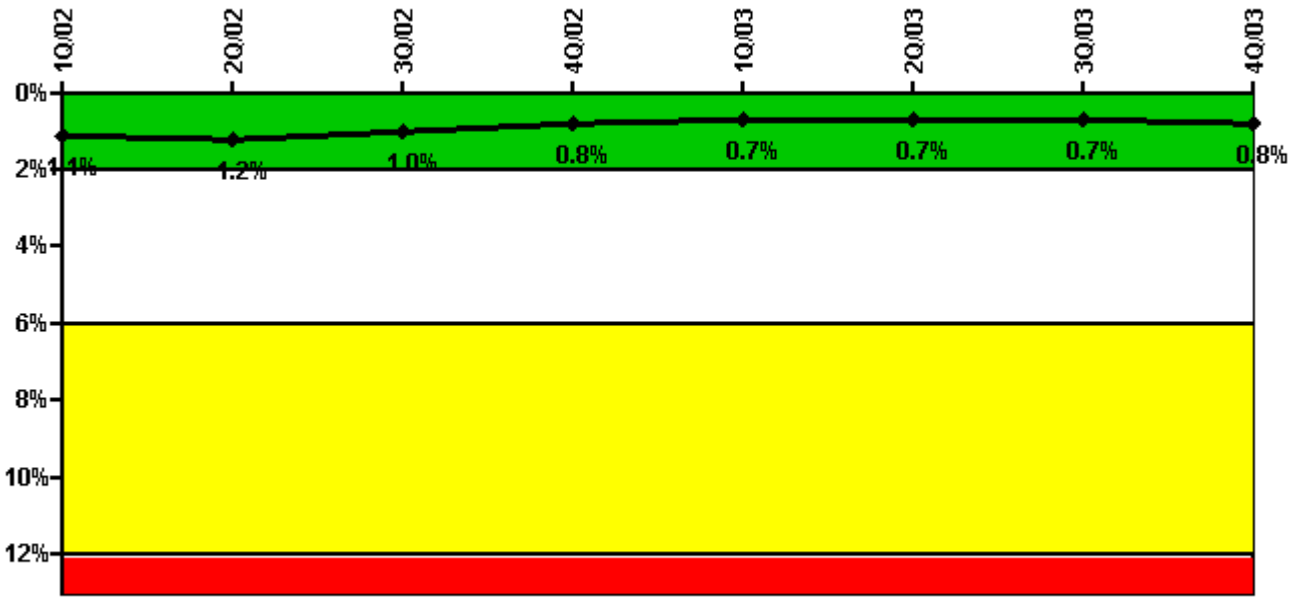

Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%


Notes

Safety System Unavailability, Heat Removal System (AFW)	1Q/02	2Q/02	3Q/02	4Q/02	1Q/03	2Q/03	3Q/03	4Q/03
Train 1								
Planned unavailable hours	30.90	15.47	28.32	3.71	4.12	40.22	30.66	2.50
Unplanned unavailable hours	0	0.75	0	1.77	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2160.00	1751.45	2208.00	2209.00	2160.00	2183.00	2013.30	1300.40
Train 2								
Planned unavailable hours	38.22	17.11	6.80	2.20	0.50	47.92	1.82	1.55
Unplanned unavailable hours	0	0	0	1.26	3.80	13.67	0	3.50
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2160.00	1751.45	2208.00	2209.00	2160.00	2183.00	2013.30	1300.40
Train 3								

Planned unavailable hours	21.32	3.52	26.78	12.10	31.09	19.83	12.70	16.55
Unplanned unavailable hours	0	0	0	0	0	3.27	6.70	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2160.00	1751.45	2208.00	2209.00	2160.00	2183.00	2013.30	1300.40
Indicator value	1.1%	1.2%	1.0%	0.8%	0.7%	0.7%	0.7%	0.8%

Licensee Comments: none

Safety System Unavailability, Residual Heat Removal System

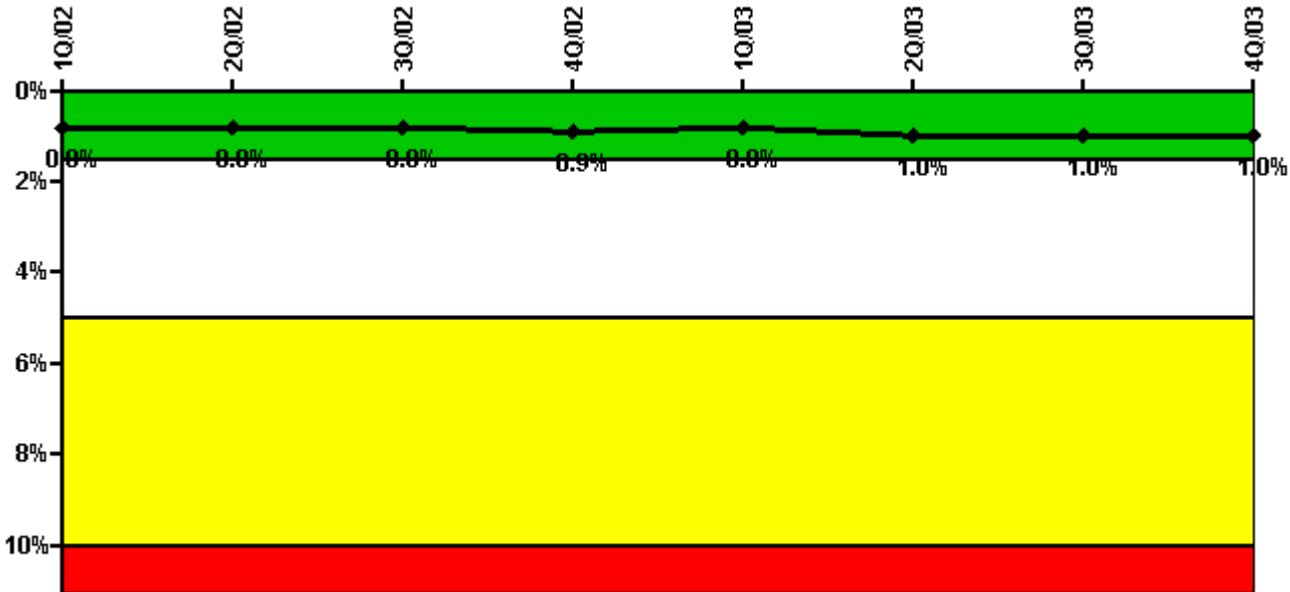

Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes


Safety System Unavailability, Residual Heat Removal System	1Q/02	2Q/02	3Q/02	4Q/02	1Q/03	2Q/03	3Q/03	4Q/03
Train 1								
Planned unavailable hours	94.20	0	0	21.60	0	73.30	28.40	0
Unplanned unavailable hours	0	27.10	0	30.60	0	0.70	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2160.00	2183.00	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00
Train 2								
Planned unavailable hours	80.20	21.80	0	0	0	35.40	0.80	1.50
Unplanned unavailable hours	0	0	0	27.50	11.80	13.70	0	3.50

Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2160.00	2183.00	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00
Indicator value	0.8%	0.8%	0.8%	0.9%	0.8%	1.0%	1.0%	1.0%

Licensee Comments:

3Q/03: Corrected value of Train 2 Planned Unavailable Hours from 0.40 to 0.80 (computational error)

Safety System Functional Failures (PWR)

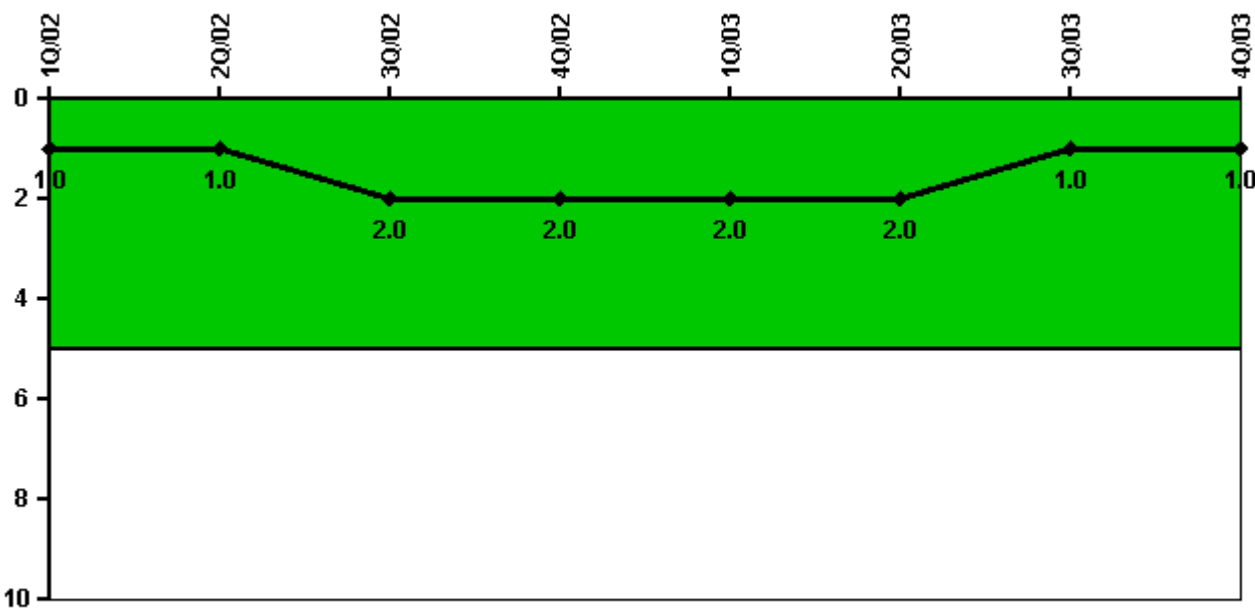


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	1Q/02	2Q/02	3Q/02	4Q/02	1Q/03	2Q/03	3Q/03	4Q/03
Safety System Functional Failures	0	1	1	0	0	1	0	0
Indicator value	1	1	2	2	2	2	1	1

Licensee Comments: none

Reactor Coolant System Activity

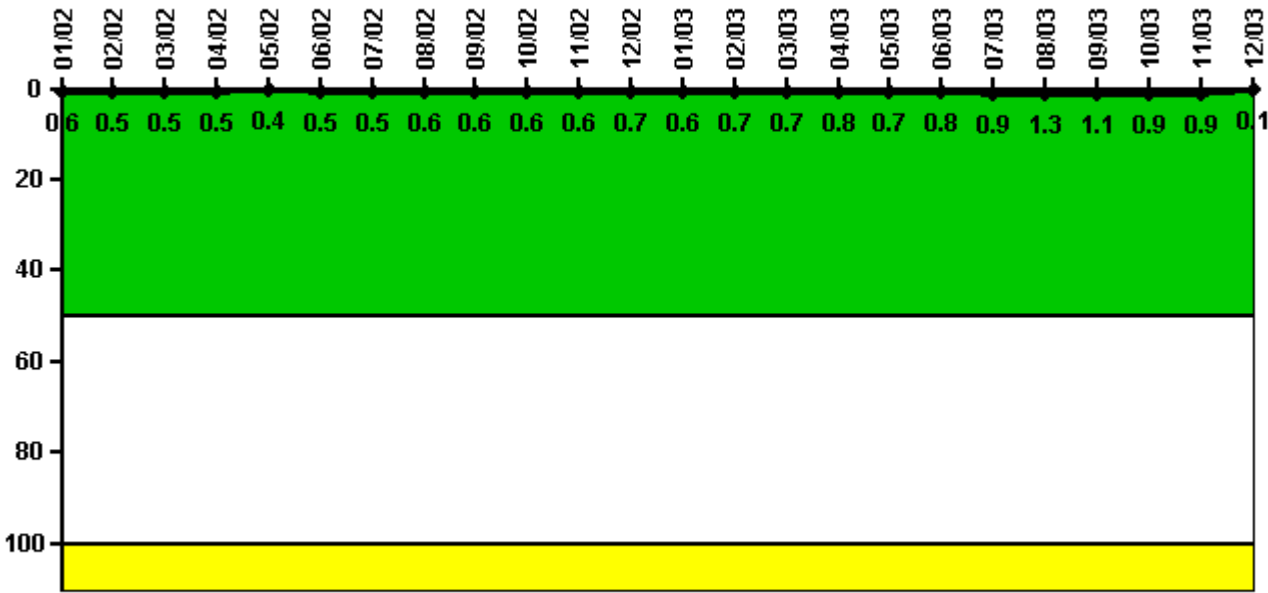

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	1/02	2/02	3/02	4/02	5/02	6/02	7/02	8/02	9/02	10/02	11/02	12/02
Maximum activity	0.000389	0.000337	0.000335	0.000328	0.000241	0.000297	0.000320	0.000360	0.000380	0.000370	0.000410	0.000430
Technical specification limit	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Indicator value	0.6	0.5	0.5	0.5	0.4	0.5	0.5	0.6	0.6	0.6	0.6	0.7

Reactor Coolant System Activity	1/03	2/03	3/03	4/03	5/03	6/03	7/03	8/03	9/03	10/03	11/03	12/03
Maximum activity	0.000410	0.000440	0.000445	0.000490	0.000452	0.000543	0.000580	0.000844	0.000700	0.000567	0.000561	0.000094
Technical specification limit	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Indicator value	0.6	0.7	0.7	0.8	0.7	0.8	0.9	1.3	1.1	0.9	0.9	0.1

Licensee Comments: none

Reactor Coolant System Leakage

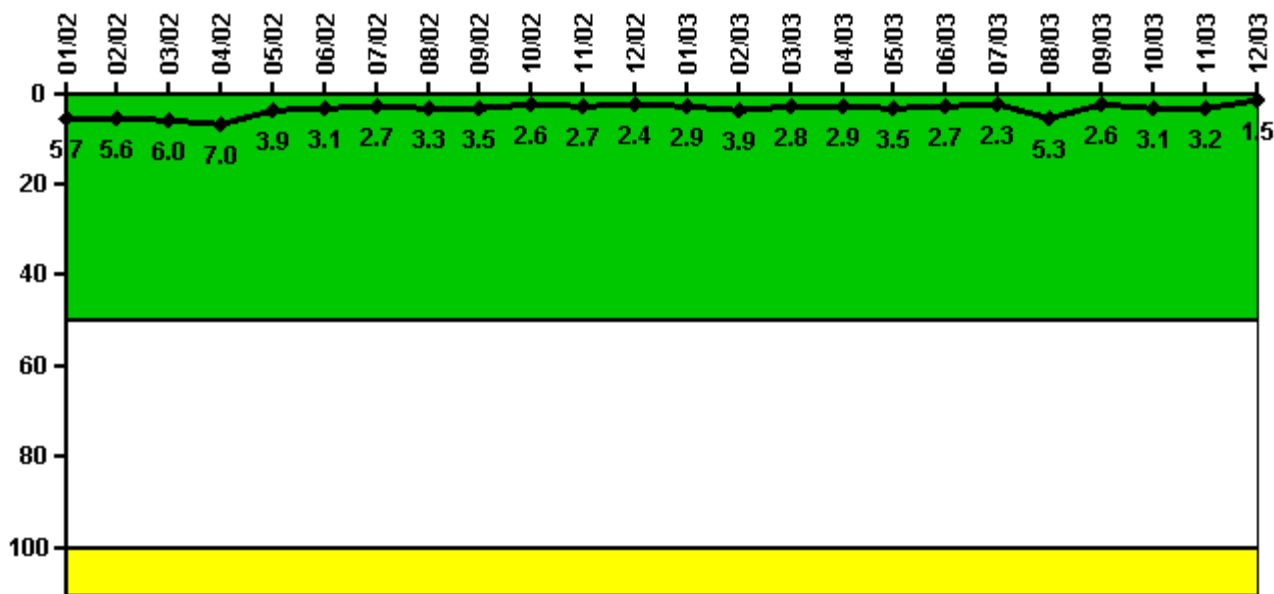

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	1/02	2/02	3/02	4/02	5/02	6/02	7/02	8/02	9/02	10/02	11/02	12/02
Maximum leakage	0.569	0.563	0.598	0.698	0.385	0.310	0.270	0.330	0.350	0.256	0.274	0.240
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	5.7	5.6	6.0	7.0	3.9	3.1	2.7	3.3	3.5	2.6	2.7	2.4

Reactor Coolant System Leakage	1/03	2/03	3/03	4/03	5/03	6/03	7/03	8/03	9/03	10/03	11/03	12/03
Maximum leakage	0.290	0.389	0.284	0.294	0.349	0.273	0.232	0.532	0.262	0.312	0.323	0.145
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	2.9	3.9	2.8	2.9	3.5	2.7	2.3	5.3	2.6	3.1	3.2	1.5

Licensee Comments: none

Drill/Exercise Performance

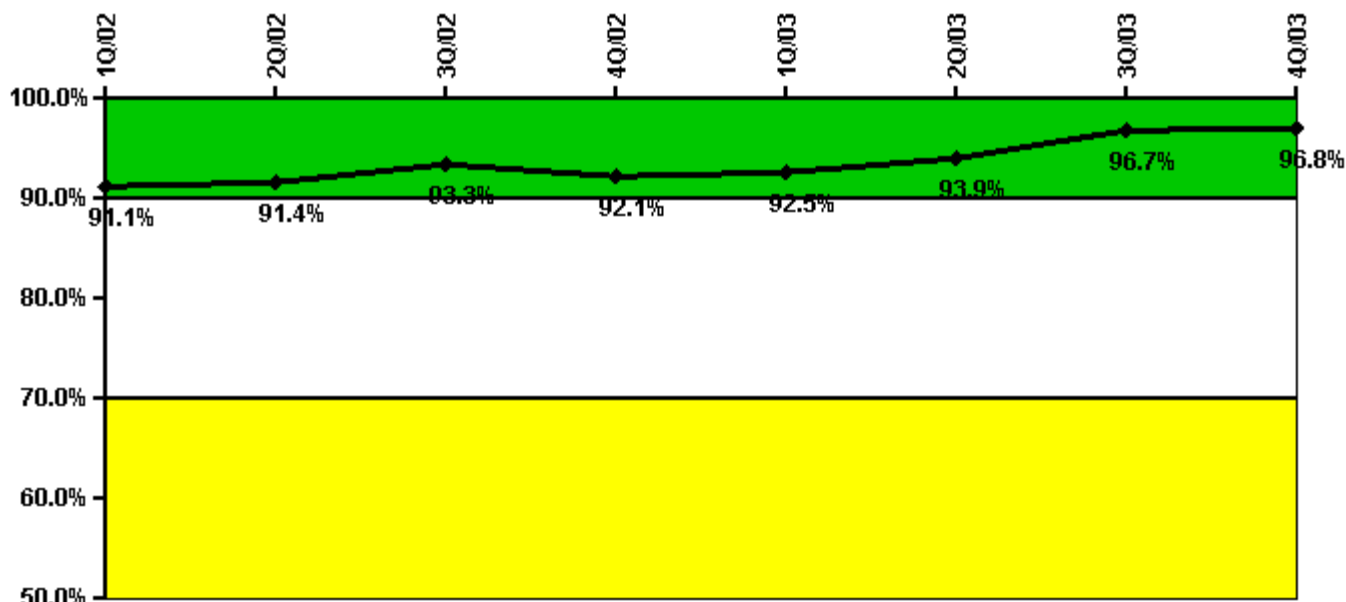

Thresholds: White < 90.0% Yellow < 70.0%


Notes

Drill/Exercise Performance	1Q/02	2Q/02	3Q/02	4Q/02	1Q/03	2Q/03	3Q/03	4Q/03
Successful opportunities	16.0	8.0	71.0	40.0	18.0	78.0	80.0	22.0
Total opportunities	16.0	8.0	74.0	46.0	18.0	78.0	82.0	22.0
Indicator value	91.1%	91.4%	93.3%	92.1%	92.5%	93.9%	96.7%	96.8%

Licensee Comments:

1Q/02: Amended value of successful opportunities and total opportunities from null to zero for 2002-01 and 2002-02

ERO Drill Participation

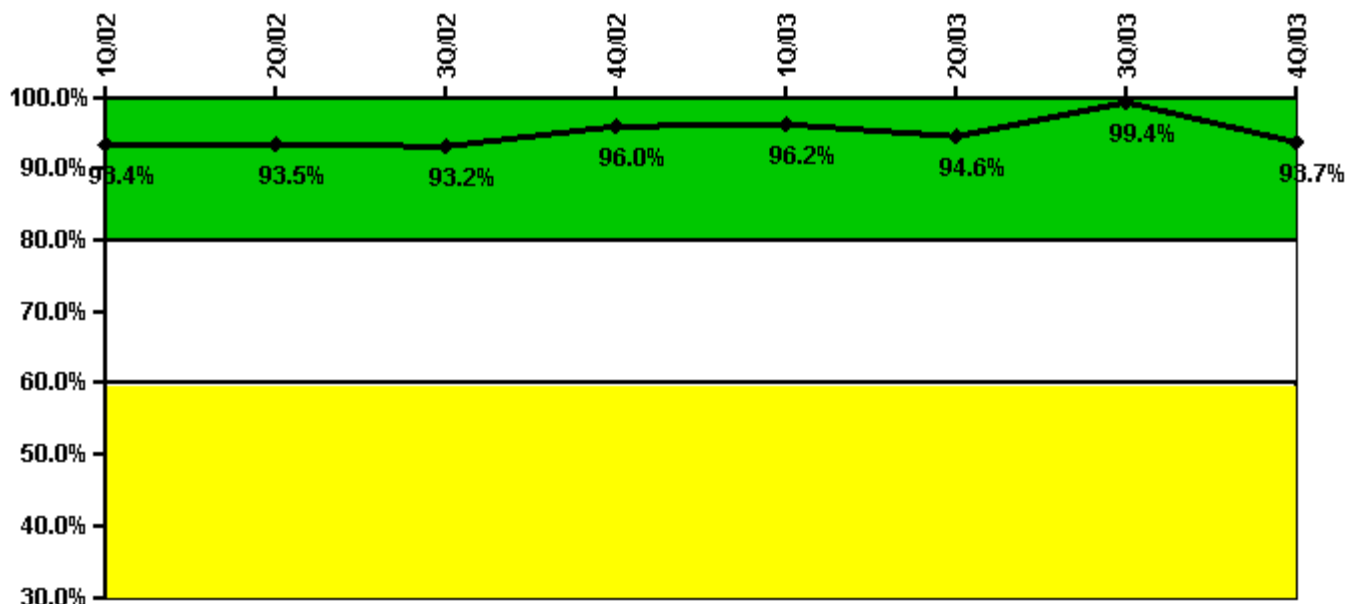


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	1Q/02	2Q/02	3Q/02	4Q/02	1Q/03	2Q/03	3Q/03	4Q/03
Participating Key personnel	184.0	186.0	177.0	192.0	177.0	175.0	159.0	149.0
Total Key personnel	197.0	199.0	190.0	200.0	184.0	185.0	160.0	159.0
Indicator value	93.4%	93.5%	93.2%	96.0%	96.2%	94.6%	99.4%	93.7%

Licensee Comments: none

Alert & Notification System

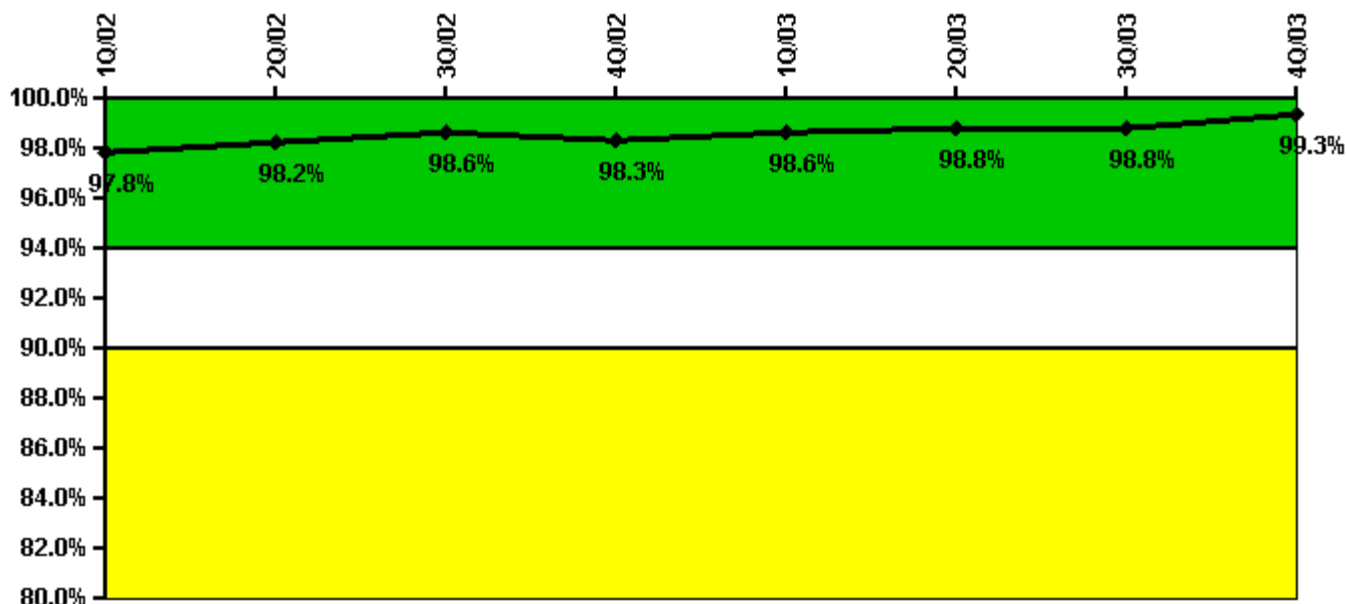


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	1Q/02	2Q/02	3Q/02	4Q/02	1Q/03	2Q/03	3Q/03	4Q/03
Successful siren-tests	2337	2253	2251	2248	2220	2386	2457	2375
Total sirens-tests	2375	2288	2281	2302	2225	2403	2492	2388
Indicator value	97.8%	98.2%	98.6%	98.3%	98.6%	98.8%	98.8%	99.3%

Licensee Comments: none

Occupational Exposure Control Effectiveness

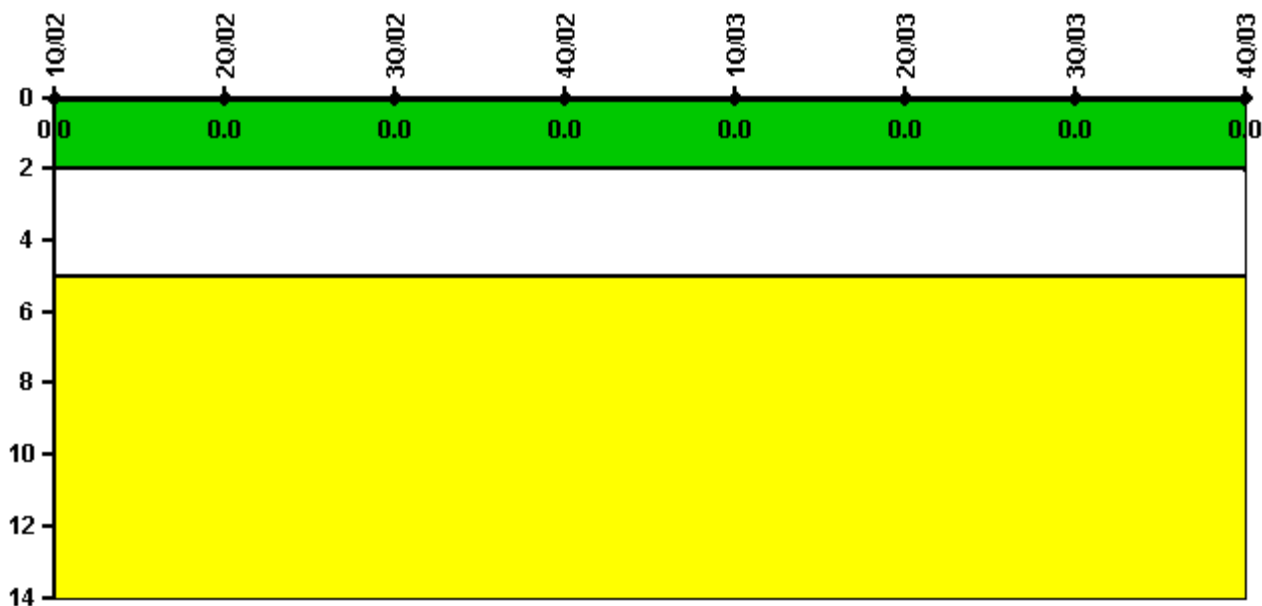

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	1Q/02	2Q/02	3Q/02	4Q/02	1Q/03	2Q/03	3Q/03	4Q/03
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent




Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	1Q/02	2Q/02	3Q/02	4Q/02	1Q/03	2Q/03	3Q/03	4Q/03
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Protected Area Security Performance Index

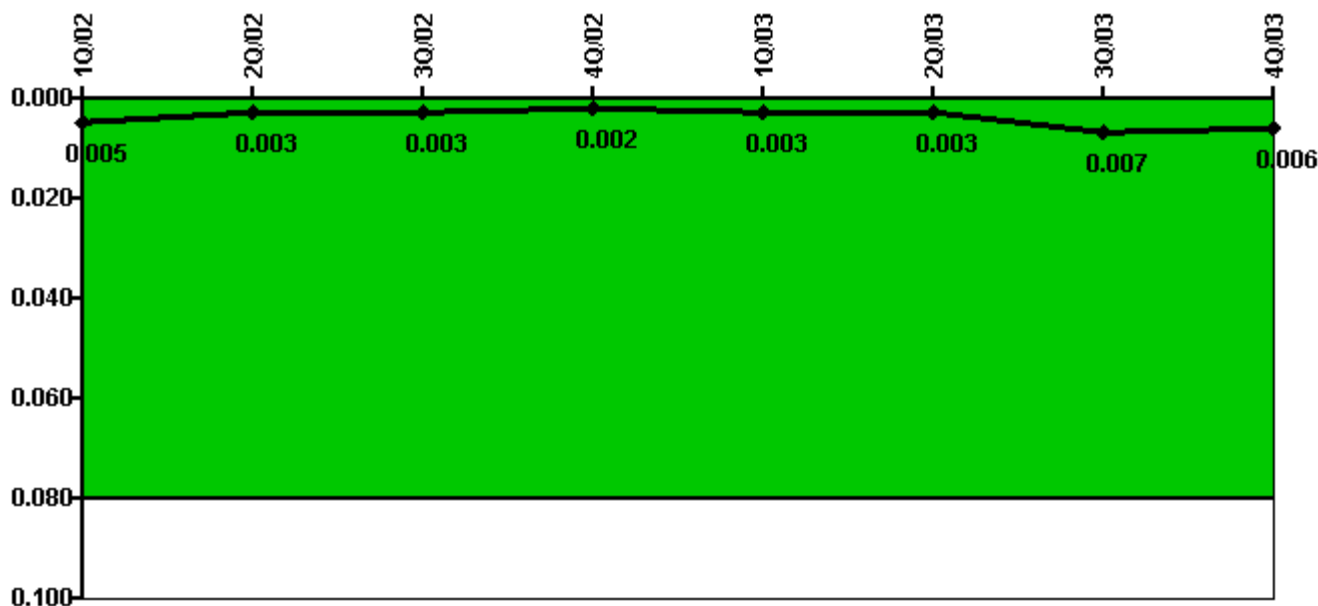

Thresholds: White > 0.080

Notes

Protected Area Security Performance Index	1Q/02	2Q/02	3Q/02	4Q/02	1Q/03	2Q/03	3Q/03	4Q/03
IDS compensatory hours	20.00	5.10	2.10	62.30	29.00	28.50	146.20	1.80
CCTV compensatory hours	0	0	0	0	3.6	0	7.5	2.2
IDS normalization factor	2.45	2.45	2.45	2.45	2.45	2.45	2.45	2.45
CCTV normalization factor	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Index Value	0.005	0.003	0.003	0.002	0.003	0.003	0.007	0.006

Licensee Comments: none

Personnel Screening Program



Thresholds: White > 2.0 Yellow > 5.0

Notes

Personnel Screening Program	1Q/02	2Q/02	3Q/02	4Q/02	1Q/03	2Q/03	3Q/03	4Q/03
Program failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

FFD/Personnel Reliability



Thresholds: White > 2.0 Yellow > 5.0

Notes

FFD/Personnel Reliability	1Q/02	2Q/02	3Q/02	4Q/02	1Q/03	2Q/03	3Q/03	4Q/03
Program Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

▲ [PI Summary](#) | [Inspection Findings Summary](#) | [Reactor Oversight Process](#)

Last Modified: January 23, 2004