


# Braidwood 2

## 1Q/2007 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

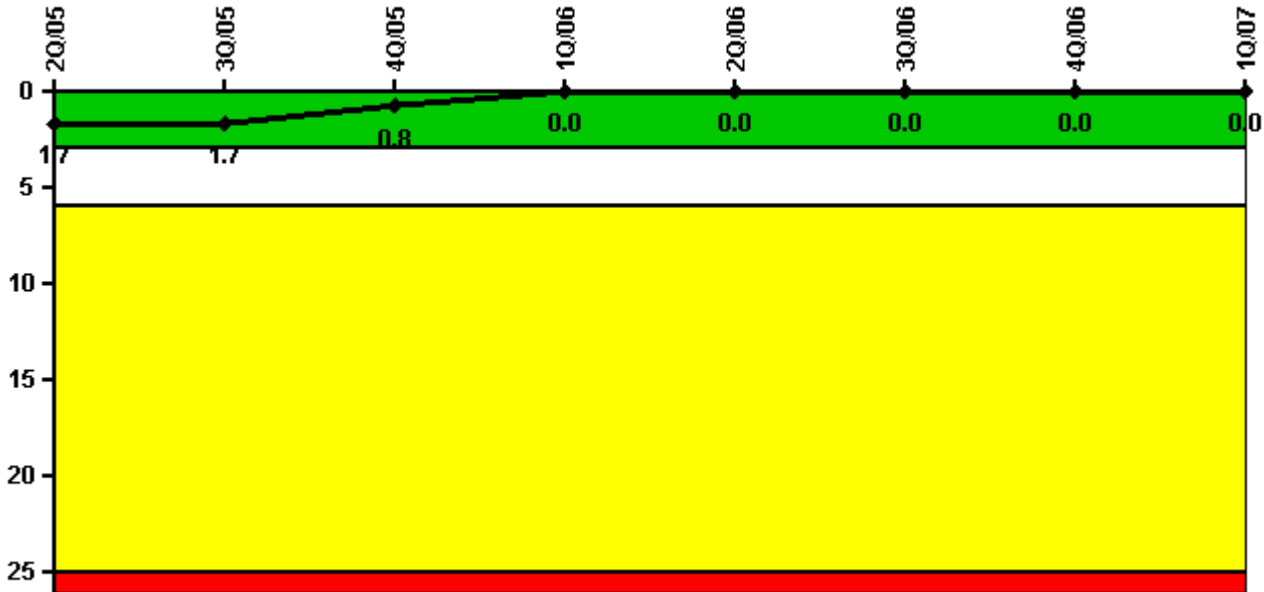


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	1783.9	2208.0	2209.0	2160.0	2183.0	2208.0	1800.5	2159.0
Indicator value	1.7	1.7	0.8	0	0	0	0	0

Licensee Comments: none

## Scrams with Loss of Normal Heat Removal

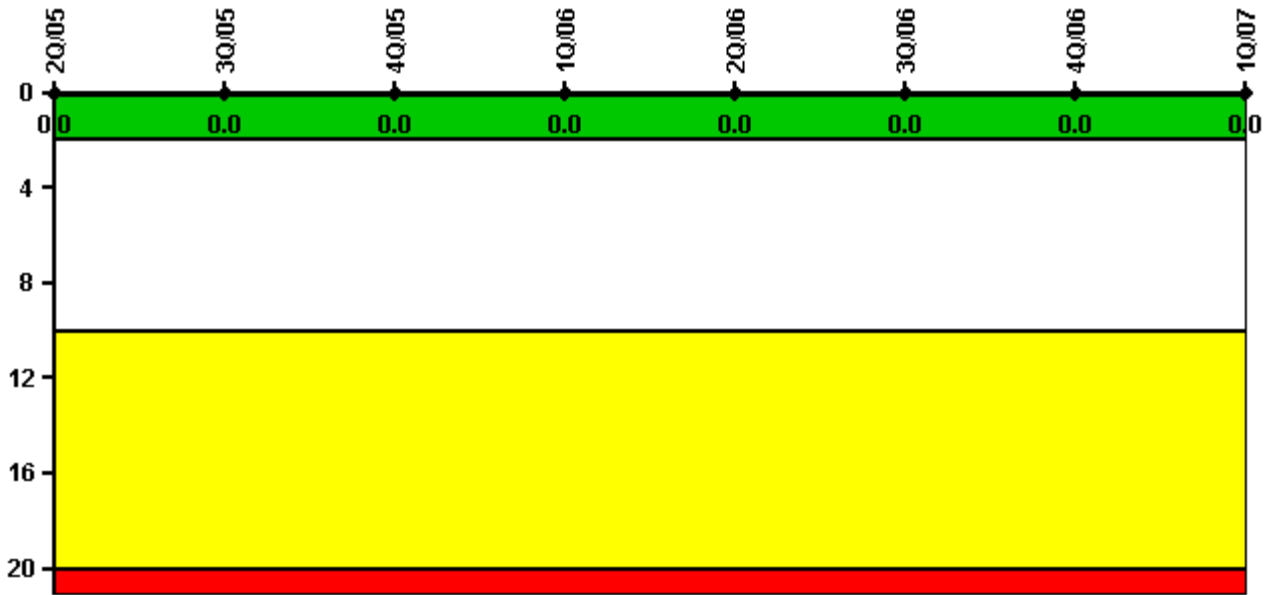


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

### Notes

Scrams with Loss of Normal Heat Removal	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Scrams	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

## Unplanned Power Changes per 7000 Critical Hrs

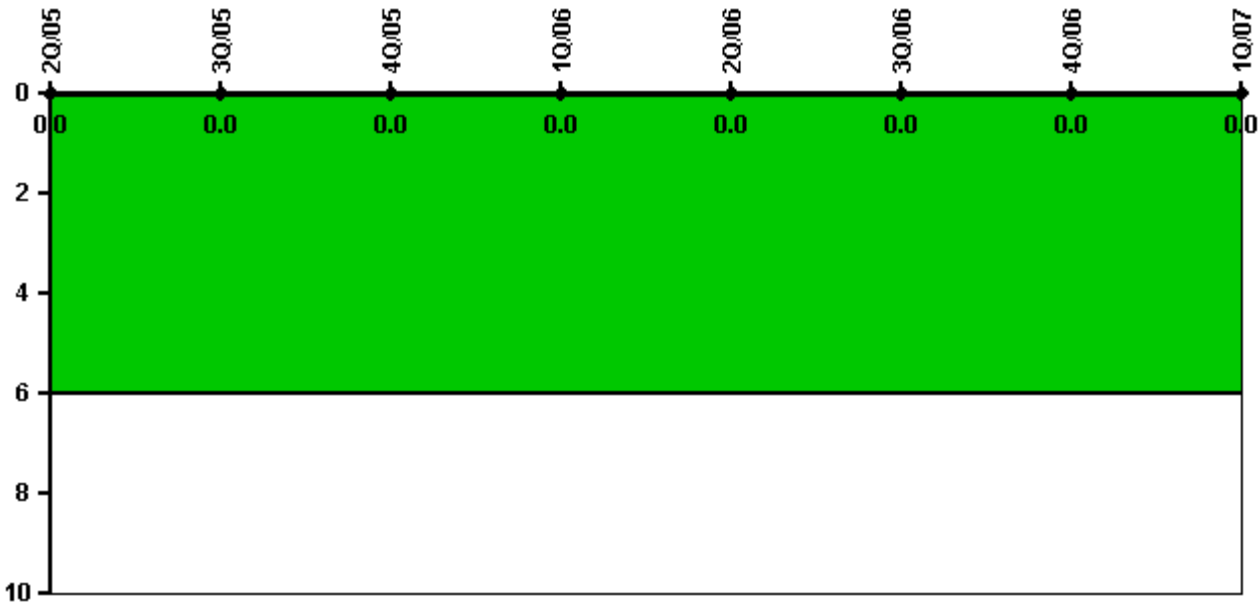


Thresholds: White > 6.0

### Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	1783.9	2208.0	2209.0	2160.0	2183.0	2208.0	1800.5	2159.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

# Safety System Functional Failures (PWR)

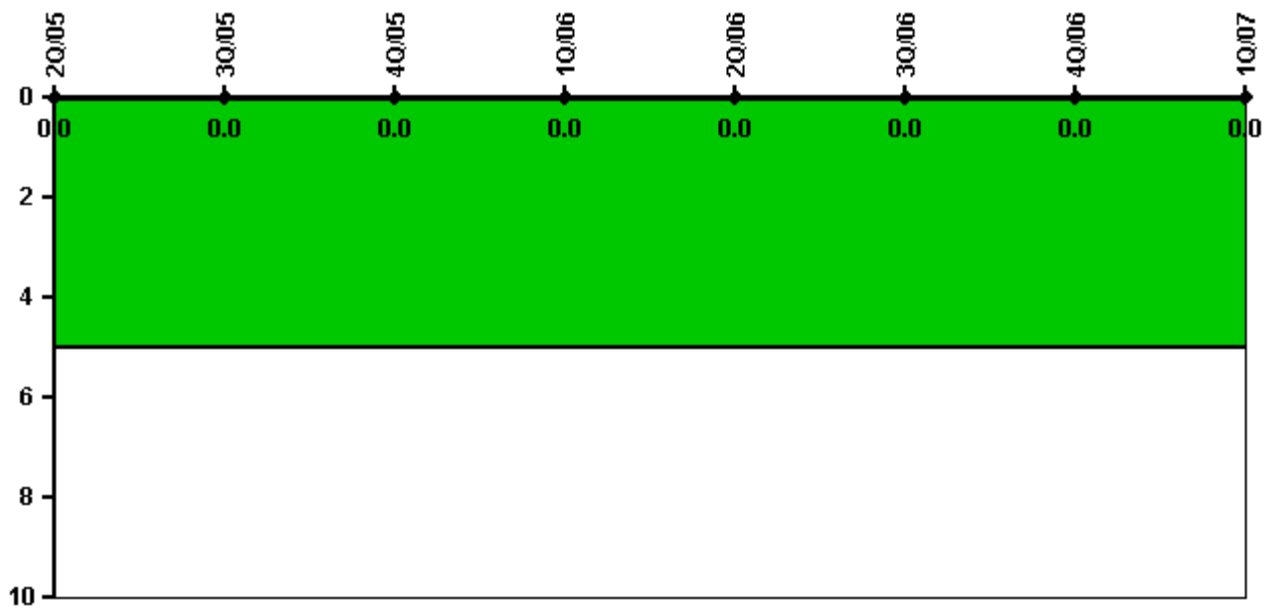


Thresholds: White > 5.0

## Notes

Safety System Functional Failures (PWR)	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

# Mitigating Systems Performance Index, Emergency AC Power System

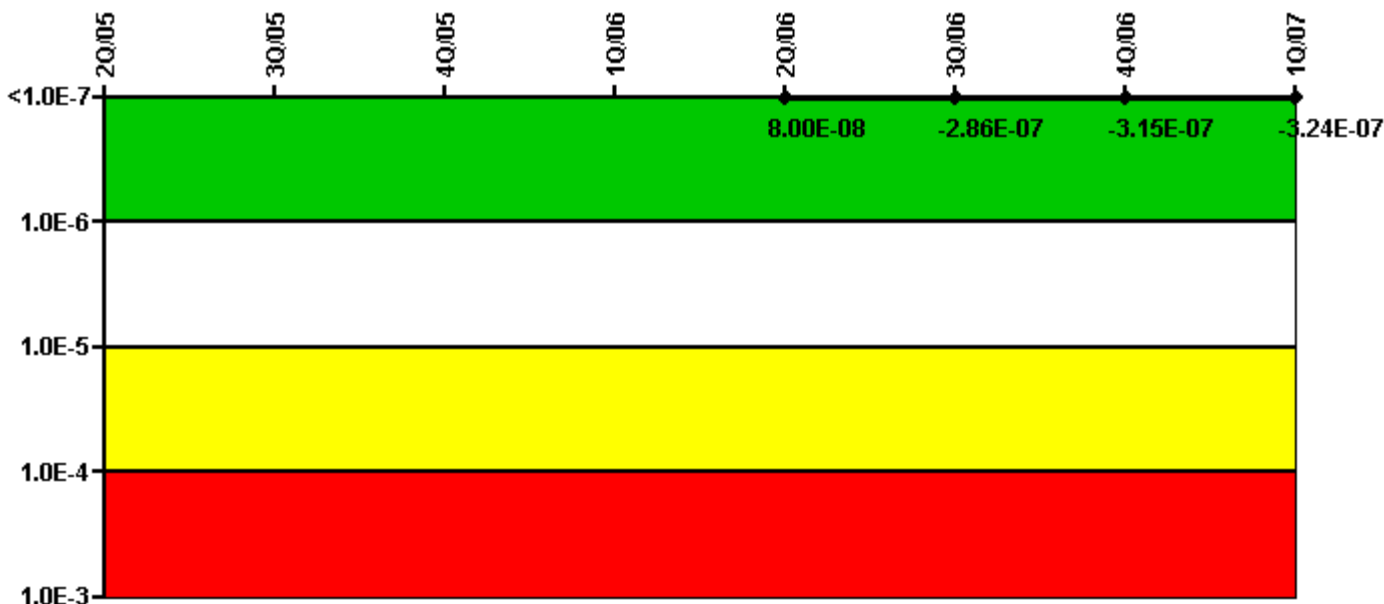

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI ( $\Delta$ CDF)					1.60E-08	-6.30E-09	-4.80E-09	-4.40E-09
URI ( $\Delta$ CDF)					6.40E-08	-2.80E-07	-3.10E-07	-3.20E-07
PLE					NO	NO	NO	NO
Indicator value					8.00E-08	-2.86E-07	-3.15E-07	-3.24E-07


Licensee Comments:

4Q/06: Changed PRA Parameter(s). 3/31/07 - PRA parameters changed based on updates made to system unavailability data.

3Q/06: Changed PRA Parameter(s). 3/31/07 - PRA parameters changed based on updates made to system unavailability data.

2Q/06: Changed PRA Parameter(s). 3/31/07 - PRA parameters changed based on updates made to system unavailability data.

# Mitigating Systems Performance Index, High Pressure Injection System

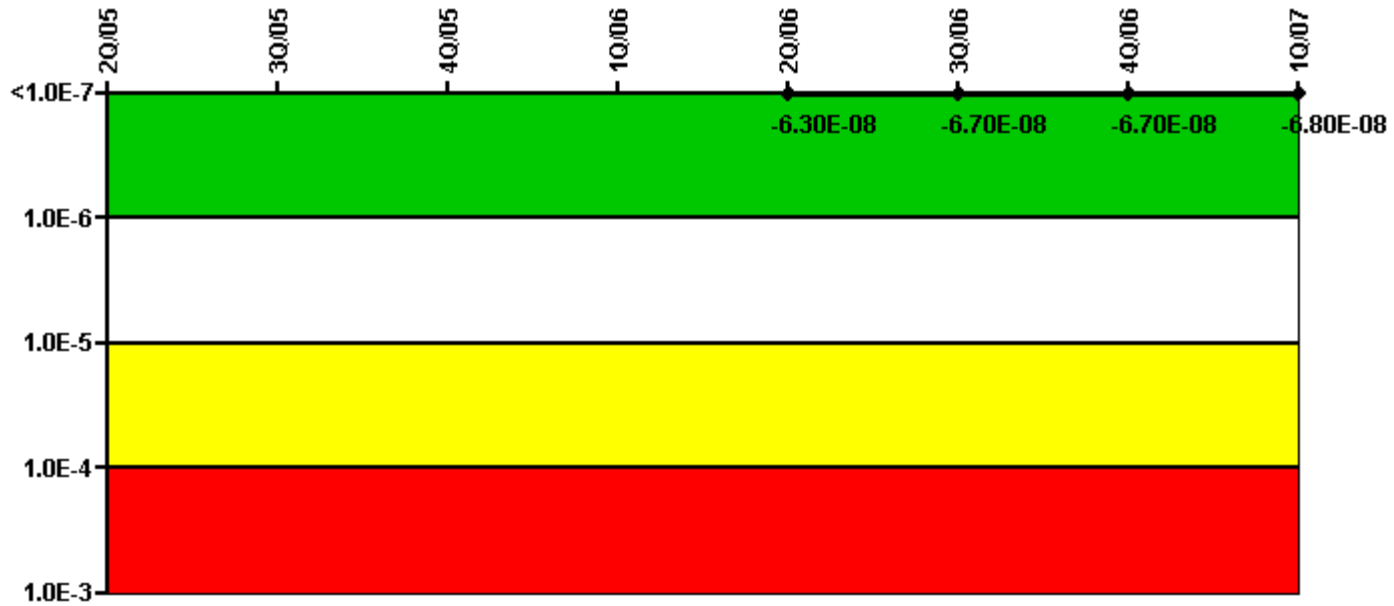

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI ( $\Delta$ CDF)					-4.90E-08	-5.30E-08	-5.30E-08	-5.40E-08
URI ( $\Delta$ CDF)					-1.40E-08	-1.40E-08	-1.40E-08	-1.40E-08
PLE					NO	NO	NO	NO
Indicator value					-6.30E-08	-6.70E-08	-6.70E-08	-6.80E-08


Licensee Comments:

4Q/06: Changed PRA Parameter(s). 3/31/07 - PRA parameters changed based on updates made to system unavailability data.

3Q/06: Changed PRA Parameter(s). 3/31/07 - PRA parameters changed based on updates made to system unavailability data.

2Q/06: Changed PRA Parameter(s). 3/31/07 - PRA parameters changed based on updates made to system unavailability data.

# Mitigating Systems Performance Index, Heat Removal System

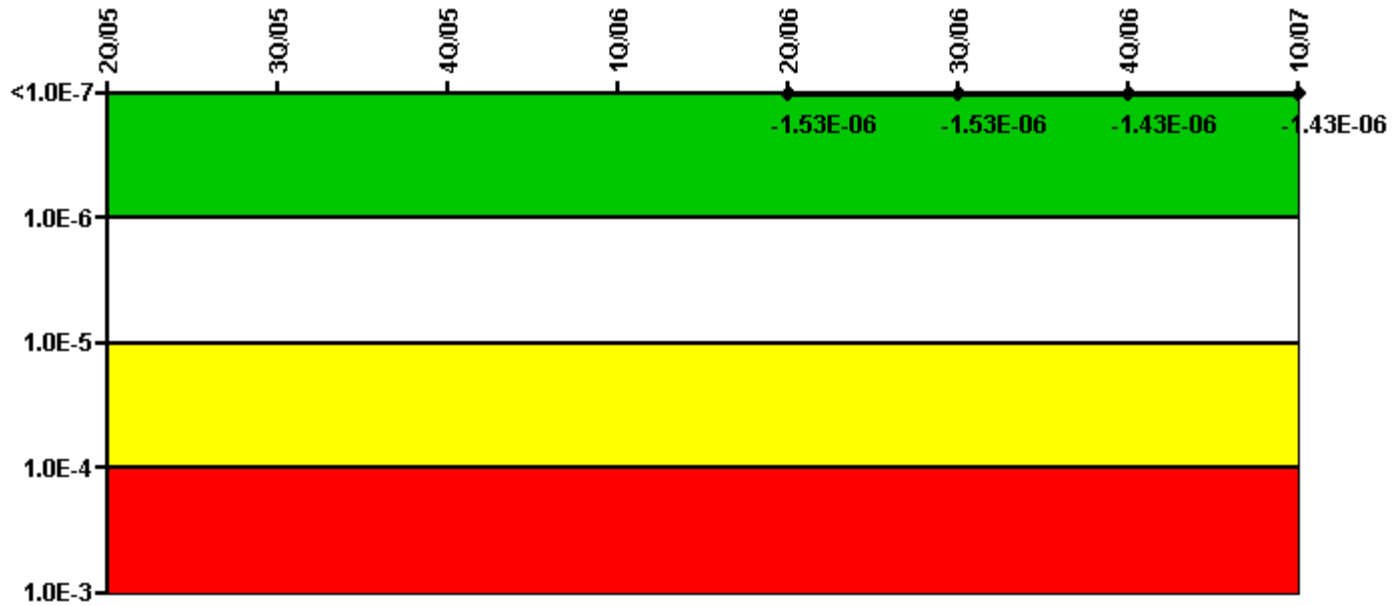

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI ( $\Delta$ CDF)					-3.30E-07	-3.30E-07	-3.30E-07	-3.30E-07
URI ( $\Delta$ CDF)					-1.20E-06	-1.20E-06	-1.10E-06	-1.10E-06
PLE					NO	NO	NO	NO
Indicator value					-1.53E-06	-1.53E-06	-1.43E-06	-1.43E-06


Licensee Comments:

4Q/06: Changed PRA Parameter(s). 3/31/07 - PRA parameters changed based on updates made to system unavailability data.

3Q/06: Changed PRA Parameter(s). 3/31/07 - PRA parameters changed based on updates made to system unavailability data.

2Q/06: Changed PRA Parameter(s). 3/31/07 - PRA parameters changed based on updates made to system unavailability data.

# Mitigating Systems Performance Index, Residual Heat Removal System

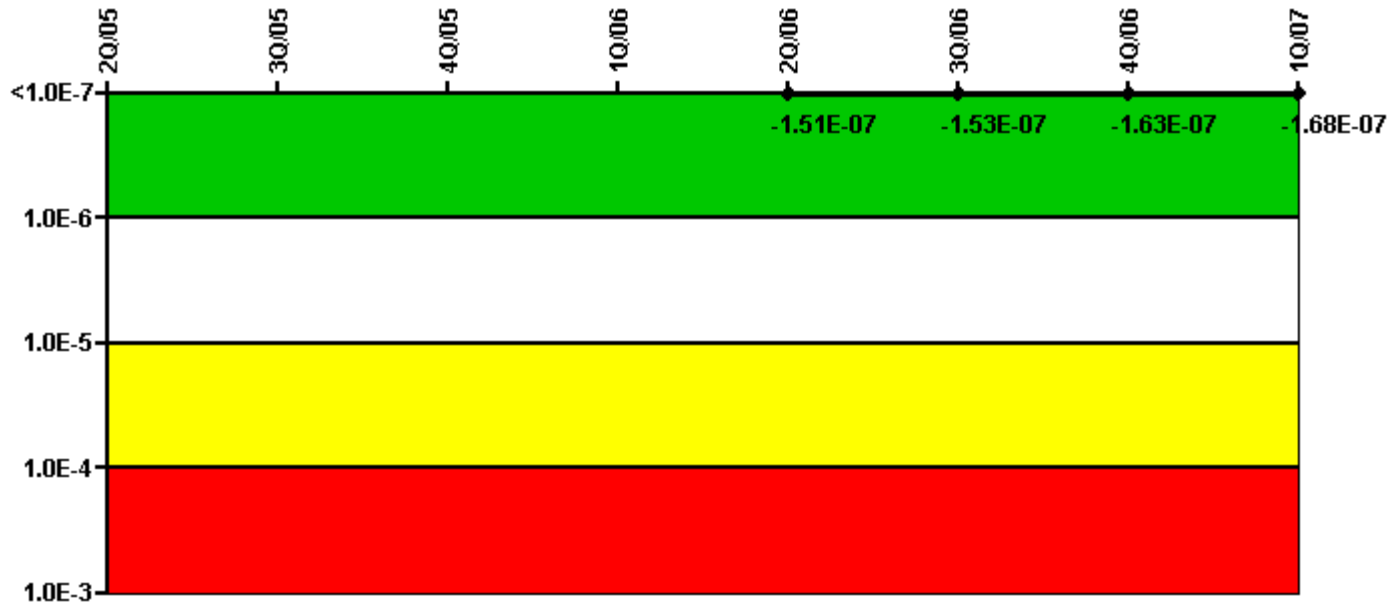

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI ( $\Delta$ CDF)					-2.10E-08	-3.30E-08	-3.30E-08	-3.80E-08
URI ( $\Delta$ CDF)					-1.30E-07	-1.20E-07	-1.30E-07	-1.30E-07
PLE					NO	NO	NO	NO
Indicator value					-1.51E-07	-1.53E-07	-1.63E-07	-1.68E-07

Licensee Comments:


4Q/06: Changed PRA Parameter(s). 3/31/07 - PRA parameters changed based on updates made to system unavailability data.

3Q/06: Changed PRA Parameter(s). 3/31/07 - PRA parameters changed based on updates made to system unavailability data.

2Q/06: Changed PRA Parameter(s). 3/31/07 - PRA parameters changed based on updates made to system unavailability data.



# Mitigating Systems Performance Index, Cooling Water Systems

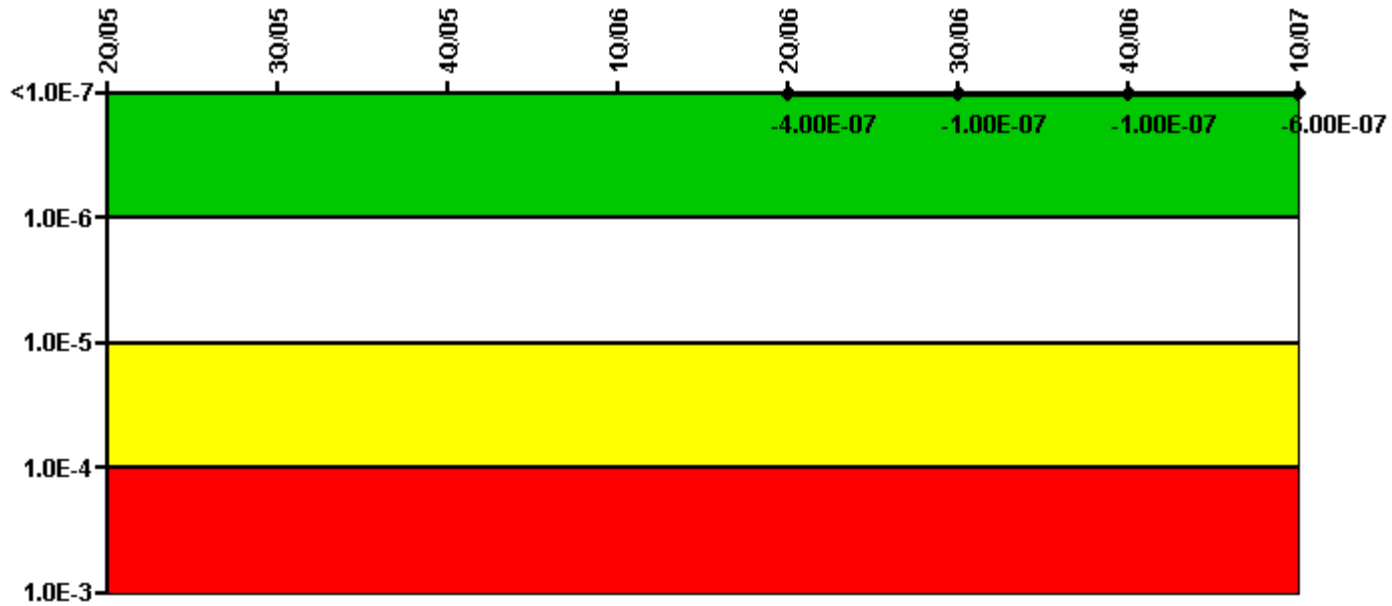

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

## Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI ( $\Delta$ CDF)					1.40E-06	1.60E-06	1.60E-06	1.00E-06
URI ( $\Delta$ CDF)					-1.80E-06	-1.70E-06	-1.70E-06	-1.60E-06
PLE					NO	NO	NO	NO
Indicator value					-4.00E-07	-1.00E-07	-1.00E-07	-6.00E-07


Licensee Comments:

4Q/06: Changed PRA Parameter(s). 3/31/07 - PRA parameters changed based on updates made to system unavailability and demand/run time data.

3Q/06: Changed PRA Parameter(s). 3/31/07 - PRA parameters changed based on updates made to system unavailability and demand/run time data.

2Q/06: Changed PRA Parameter(s). 3/31/07 - PRA parameters changed based on updates made to system unavailability and demand/run time data.

# Reactor Coolant System Activity

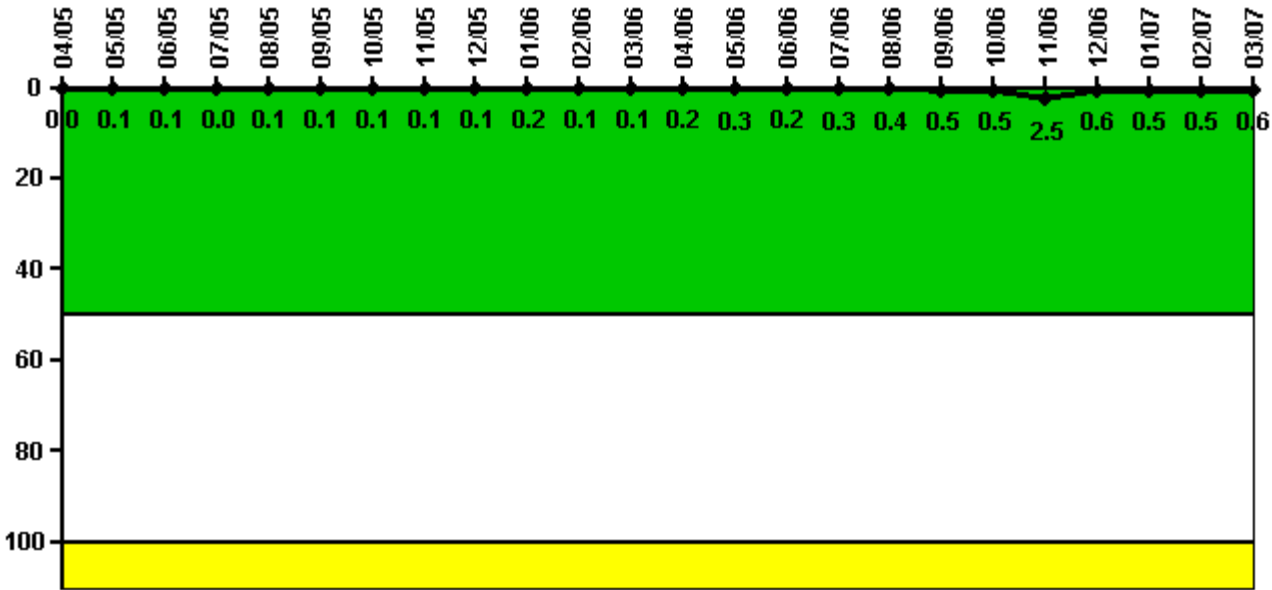

Thresholds: White > 50.0 Yellow > 100.0

## Notes


Reactor Coolant System Activity	4/05	5/05	6/05	7/05	8/05	9/05	10/05	11/05	12/05	1/06	2/06	3/06
Maximum activity	0.000378	0.001020	0.000509	0.000453	0.000768	0.000535	0.000738	0.000748	0.000935	0.001590	0.001120	0.001390
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0.1	0.1	0	0.1	0.1	0.1	0.1	0.1	0.2	0.1	0.1

Reactor Coolant System Activity	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07
Maximum activity	0.001780	0.002530	0.002380	0.002990	0.004020	0.005010	0.004710	0.025200	0.005560	0.004961	0.005070	0.005540
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.2	0.3	0.2	0.3	0.4	0.5	0.5	2.5	0.6	0.5	0.5	0.6

Licensee Comments: none

# Reactor Coolant System Leakage

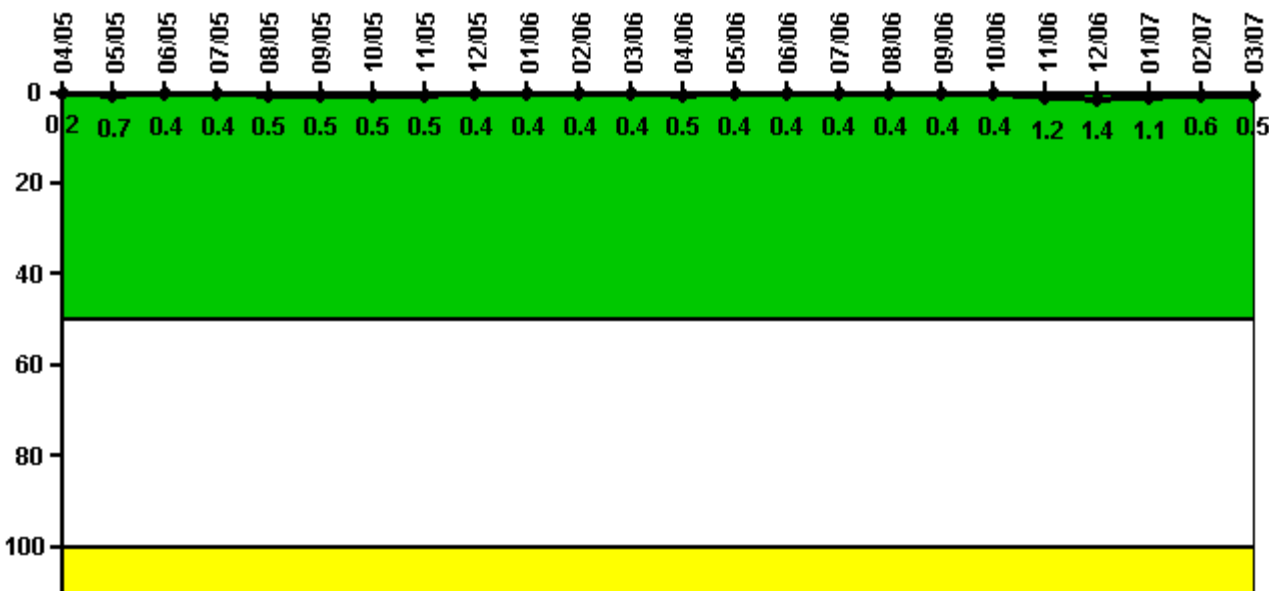

Thresholds: White > 50.0 Yellow > 100.0

## Notes


Reactor Coolant System Leakage	4/05	5/05	6/05	7/05	8/05	9/05	10/05	11/05	12/05	1/06	2/06	3/06
Maximum leakage	0.022	0.069	0.044	0.038	0.051	0.048	0.048	0.049	0.042	0.035	0.043	0.041
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.2	0.7	0.4	0.4	0.5	0.5	0.5	0.5	0.4	0.4	0.4	0.4

Reactor Coolant System Leakage	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07
Maximum leakage	0.046	0.043	0.041	0.035	0.035	0.037	0.036	0.124	0.138	0.106	0.057	0.049
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.5	0.4	0.4	0.4	0.4	0.4	0.4	1.2	1.4	1.1	0.6	0.5

Licensee Comments: none

## Drill/Exercise Performance

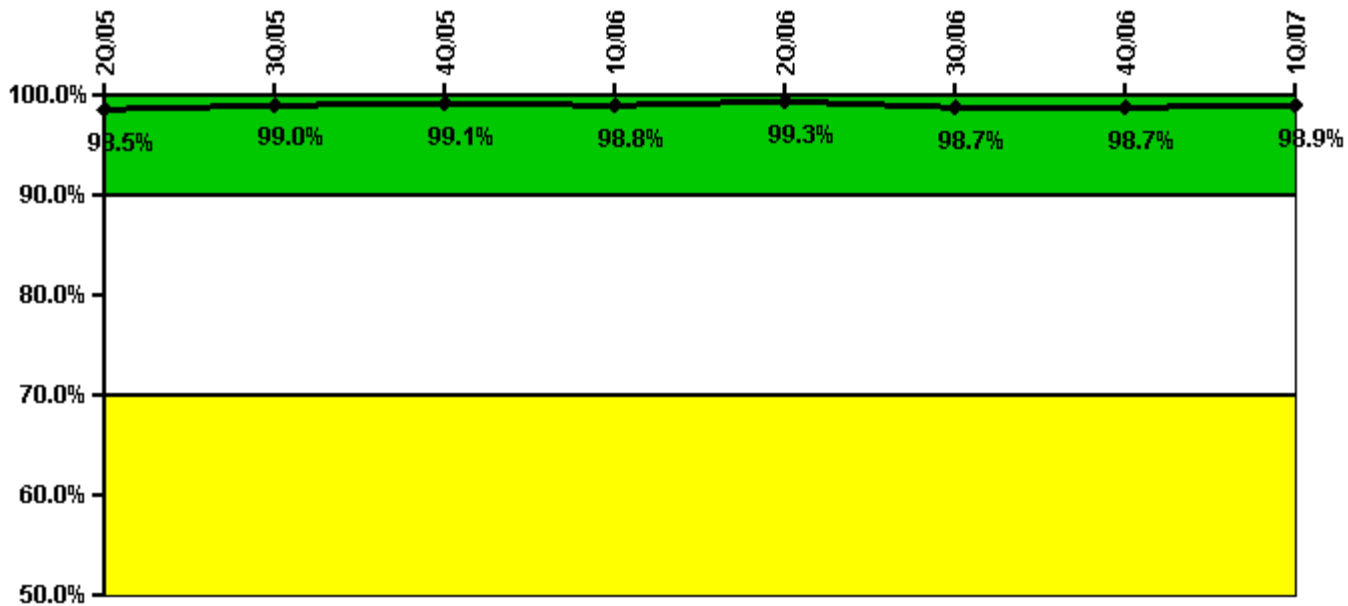


Thresholds: White < 90.0% Yellow < 70.0%

### Notes

Drill/Exercise Performance	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Successful opportunities	12.0	146.0	46.0	39.0	38.0	190.0	28.0	20.0
Total opportunities	13.0	146.0	46.0	40.0	38.0	194.0	28.0	20.0
<b>Indicator value</b>	<b>98.5%</b>	<b>99.0%</b>	<b>99.1%</b>	<b>98.8%</b>	<b>99.3%</b>	<b>98.7%</b>	<b>98.7%</b>	<b>98.9%</b>

Licensee Comments: none

# ERO Drill Participation

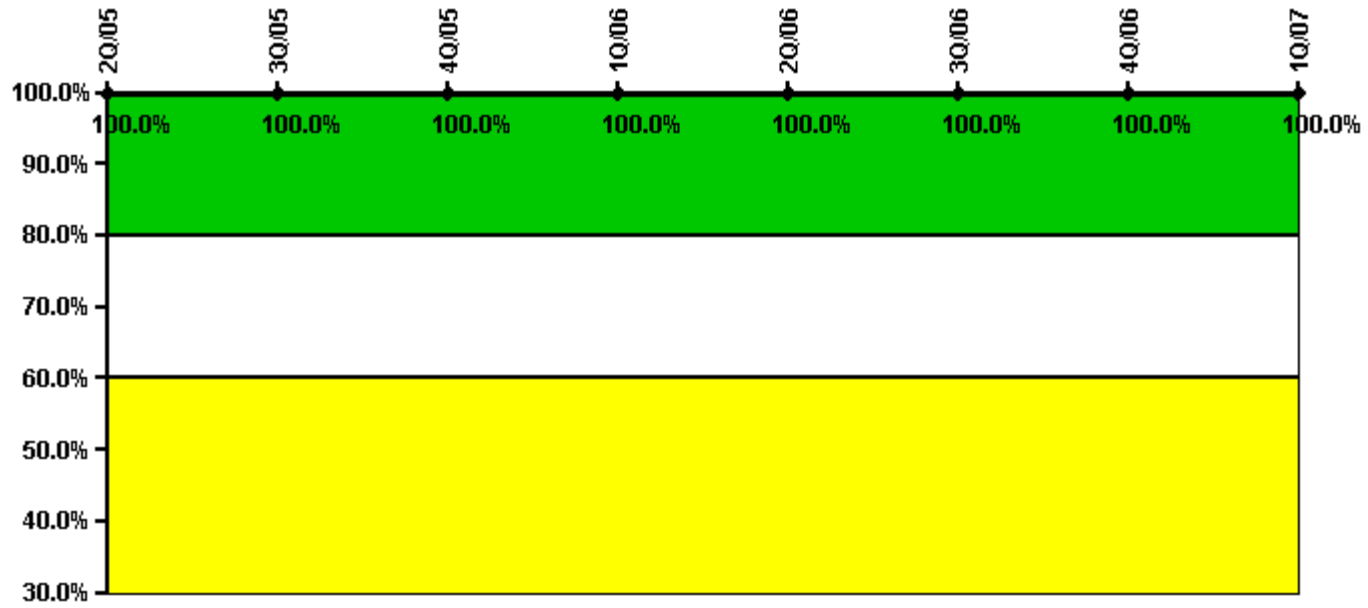


Thresholds: White < 80.0% Yellow < 60.0%

## Notes

ERO Drill Participation	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Participating Key personnel	67.0	71.0	73.0	75.0	75.0	74.0	76.0	74.0
Total Key personnel	67.0	71.0	73.0	75.0	75.0	74.0	76.0	74.0
<b>Indicator value</b>	<b>100.0%</b>	<b>100.0%</b>	<b>100.0%</b>	<b>100.0%</b>	<b>100.0%</b>	<b>100.0%</b>	<b>100.0%</b>	<b>100.0%</b>

Licensee Comments: none

# Alert & Notification System

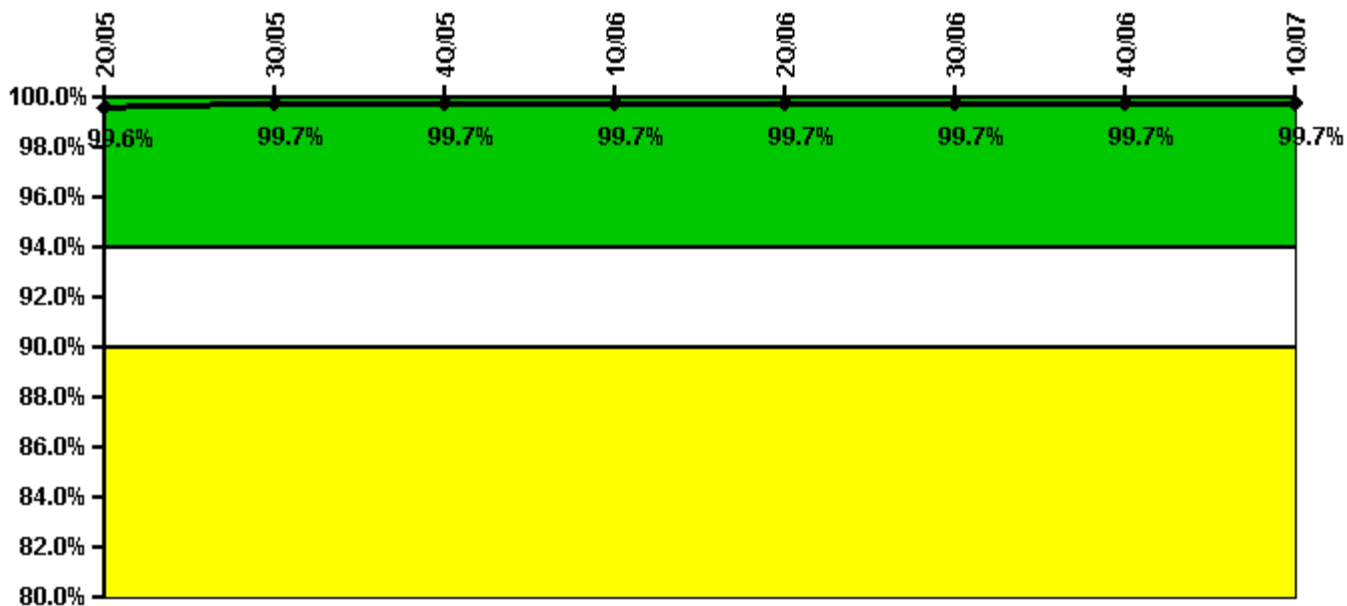


Thresholds: White < 94.0% Yellow < 90.0%

## Notes

Alert & Notification System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Successful siren-tests	4460	4449	4474	4538	4469	4451	4400	4470
Total sirens-tests	4471	4480	4480	4548	4479	4480	4410	4480
<b>Indicator value</b>	<b>99.6%</b>	<b>99.7%</b>	<b>99.7%</b>	<b>99.7%</b>	<b>99.7%</b>	<b>99.7%</b>	<b>99.7%</b>	<b>99.7%</b>

Licensee Comments: none

# Occupational Exposure Control Effectiveness

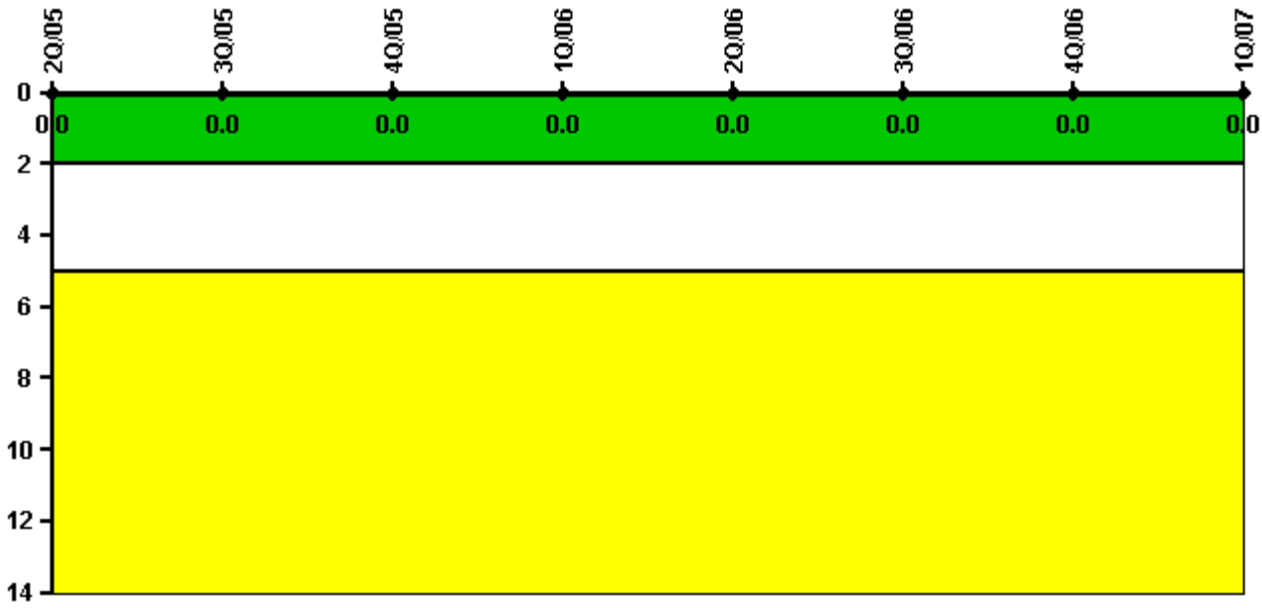


Thresholds: White > 2.0 Yellow > 5.0

## Notes

Occupational Exposure Control Effectiveness	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

# RETS/ODCM Radiological Effluent

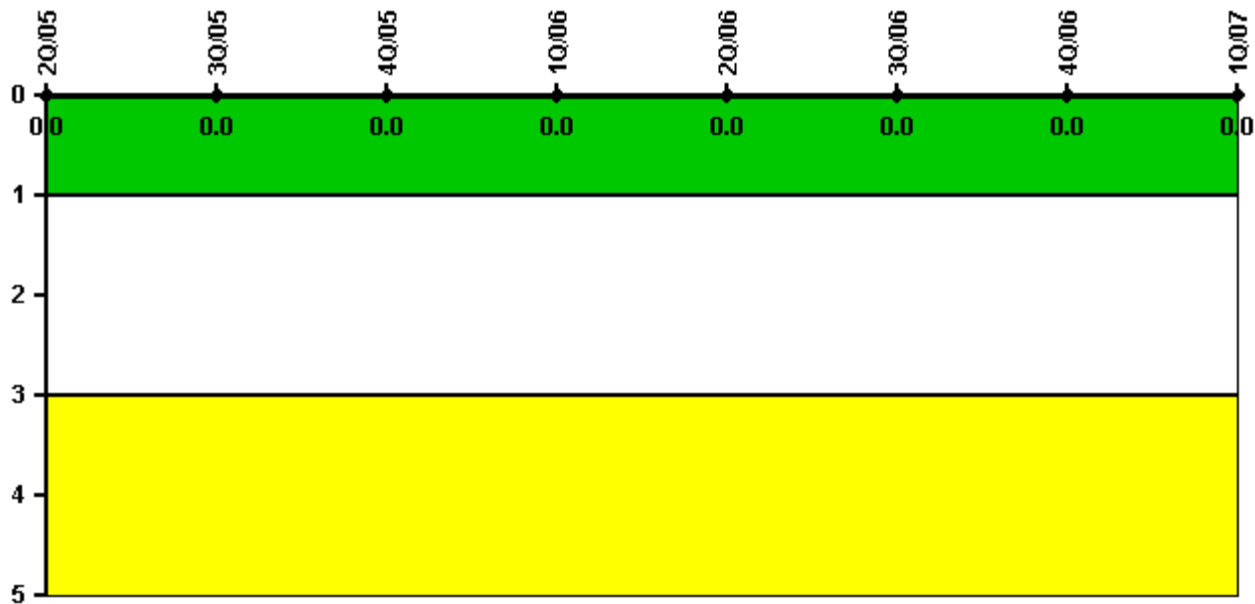

Thresholds: White > 1.0 Yellow > 3.0

## Notes

RETS/ODCM Radiological Effluent	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: June 1, 2007