


Monticello

2Q/2007 Performance Indicators

Licensee's General Comments: ANS PI data for 3rd and 4th quarter of 2006 and 1st quarter of 2007 has been revised to capture additional test failures not previously identified. Revision of data does not change color of indicator.

Unplanned Scrams per 7000 Critical Hrs

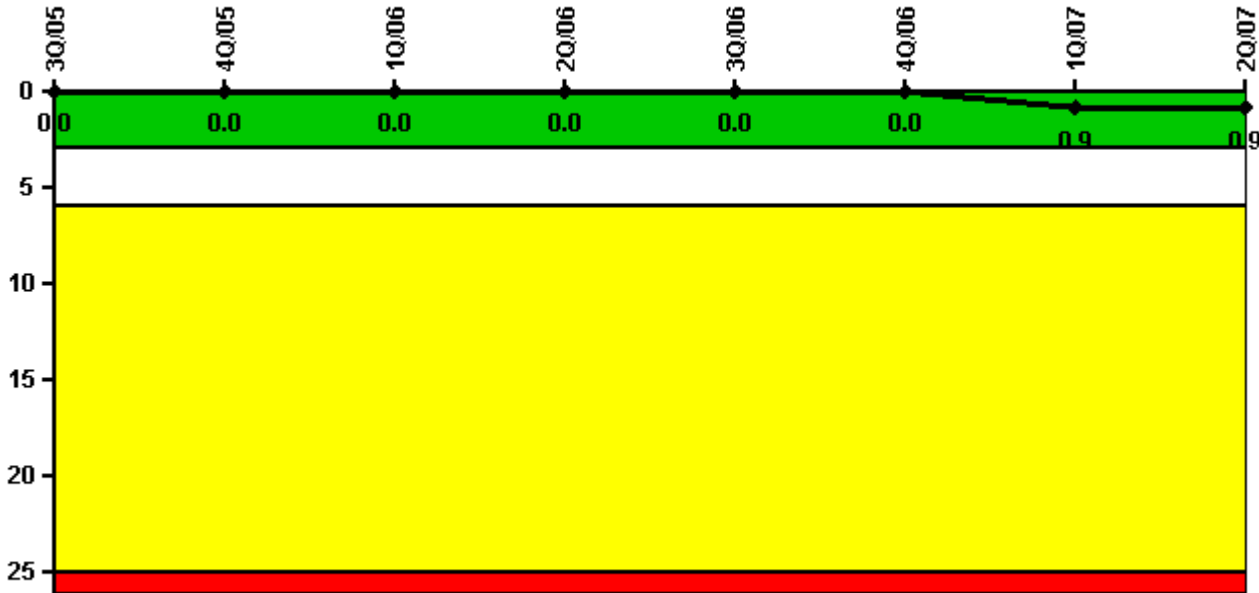


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07
Unplanned scrams	0	0	0	0	0	0	1.0	0
Critical hours	2208.0	2209.0	2160.0	2183.0	2208.0	2209.0	1422.8	1573.9
Indicator value	0	0	0	0	0	0	0.9	0.9

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

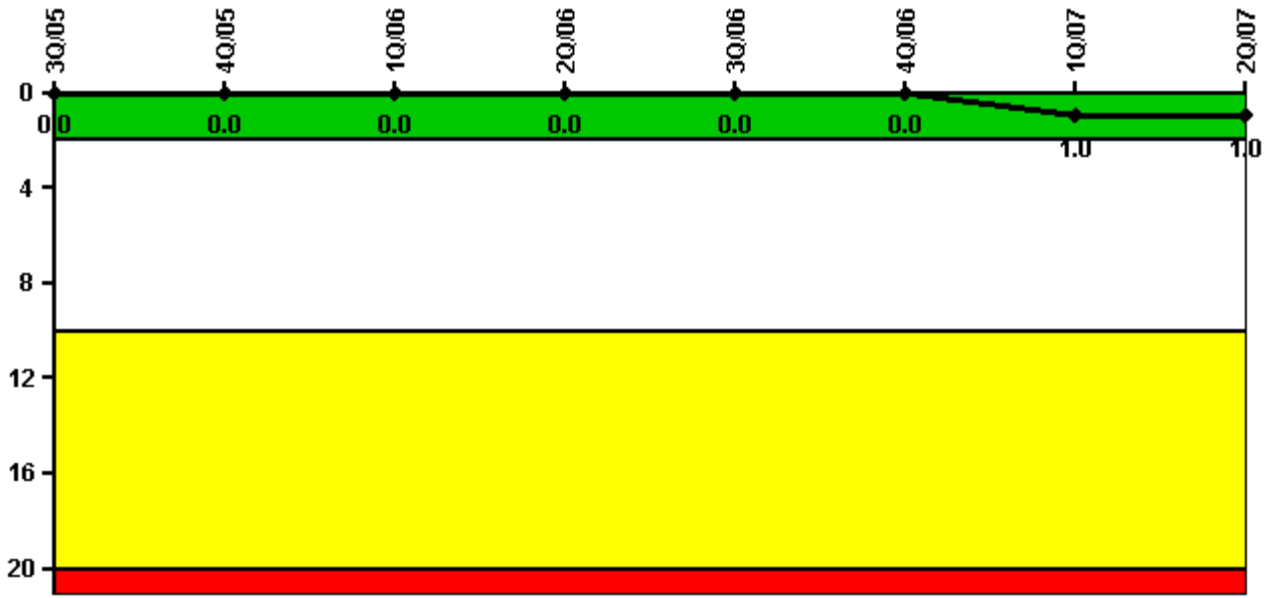


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07
Scrams	0	0	0	0	0	0	1.0	0
Indicator value	0	0	0	0	0	0	1.0	1.0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

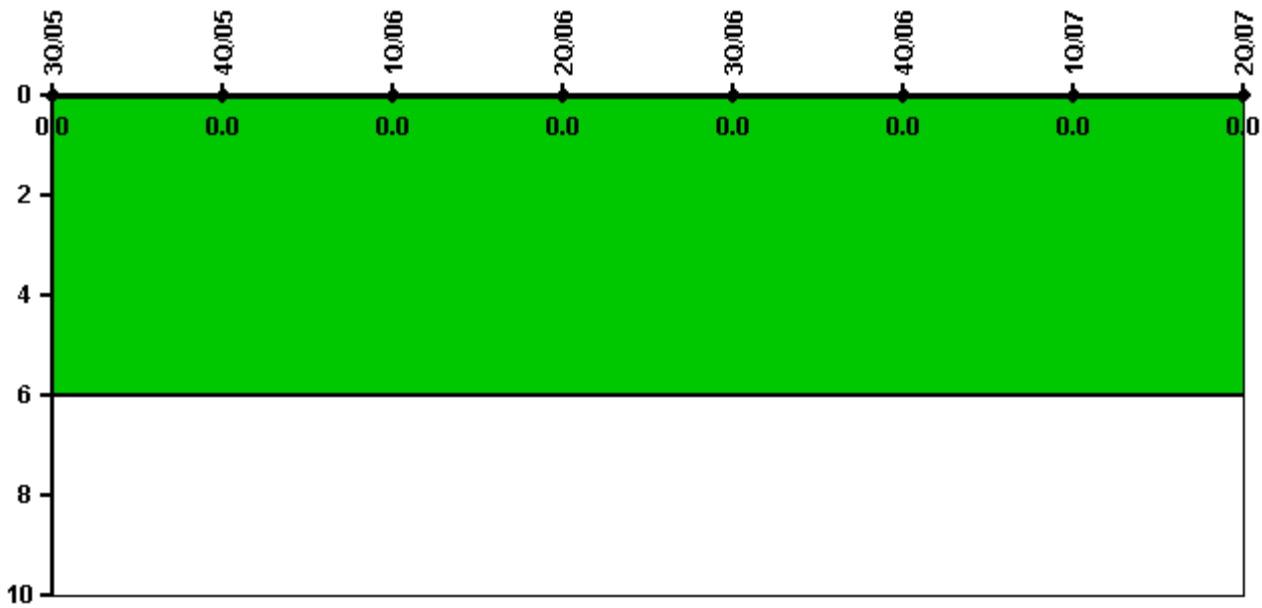


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2208.0	2209.0	2160.0	2183.0	2208.0	2209.0	1422.8	1573.9
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Safety System Functional Failures (BWR)

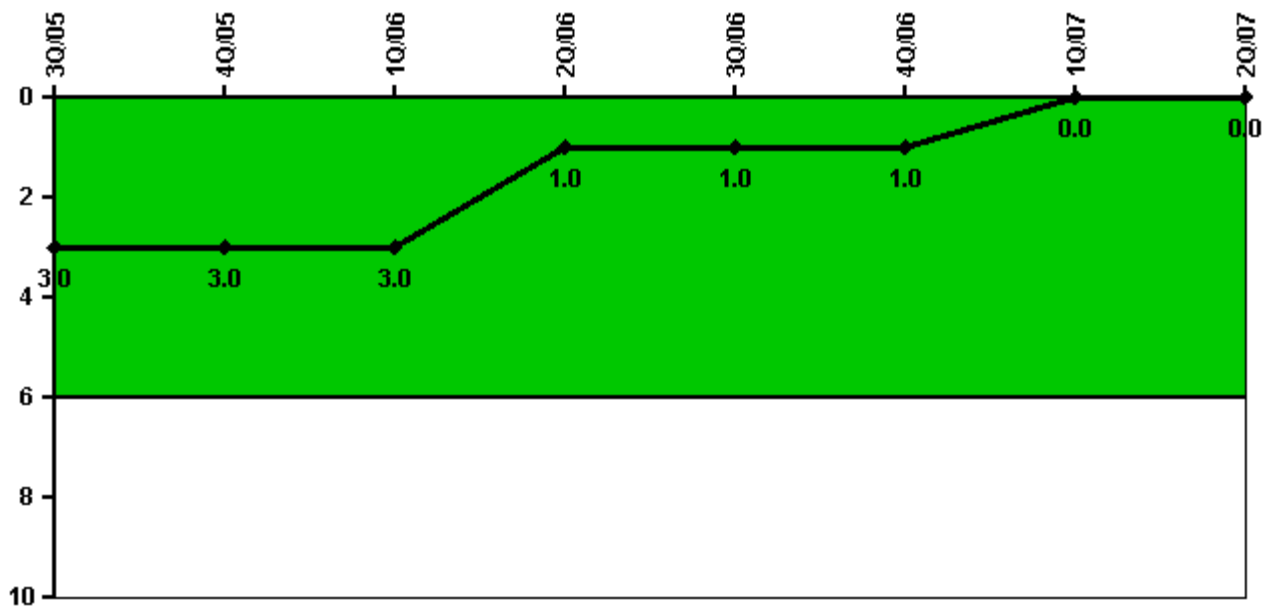


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07
Safety System Functional Failures	0	0	1	0	0	0	0	0
Indicator value	3	3	3	1	1	1	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

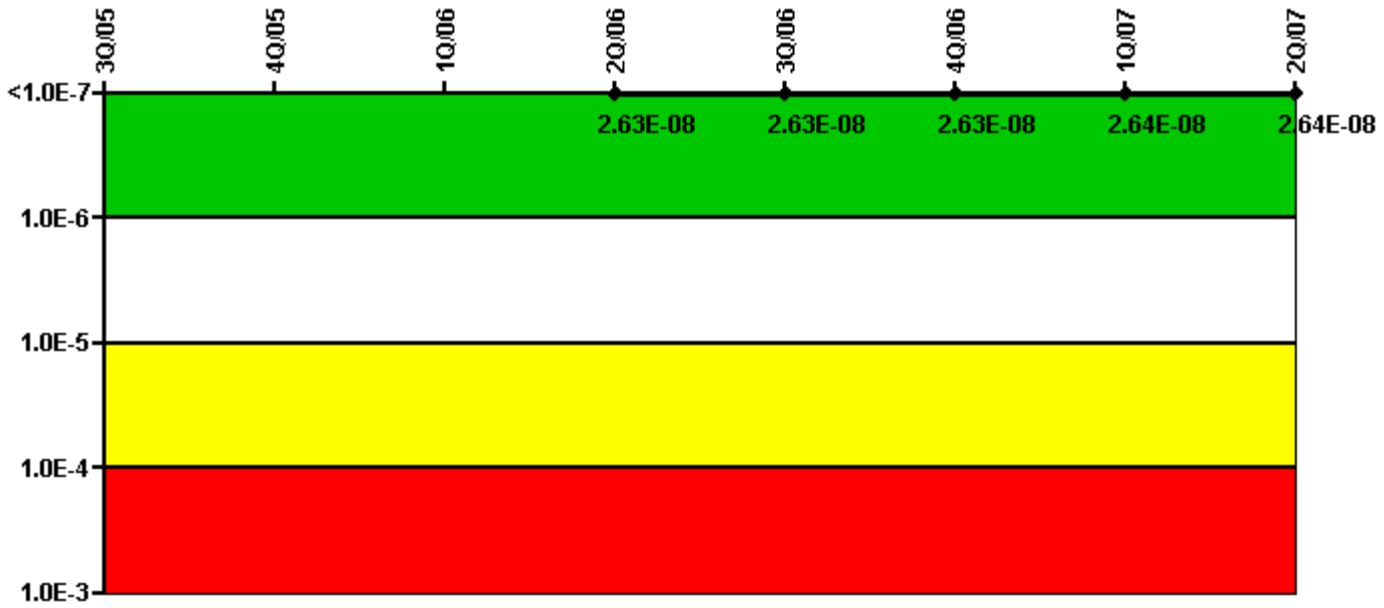


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07
UAI (ΔCDF)				-6.60E-10	-6.60E-10	-6.60E-10	-6.30E-10	-6.10E-10
URI (ΔCDF)				2.70E-08	2.70E-08	2.70E-08	2.70E-08	2.70E-08
PLE				NO	NO	NO	NO	NO
Indicator value				2.63E-08	2.63E-08	2.63E-08	2.64E-08	2.64E-08

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

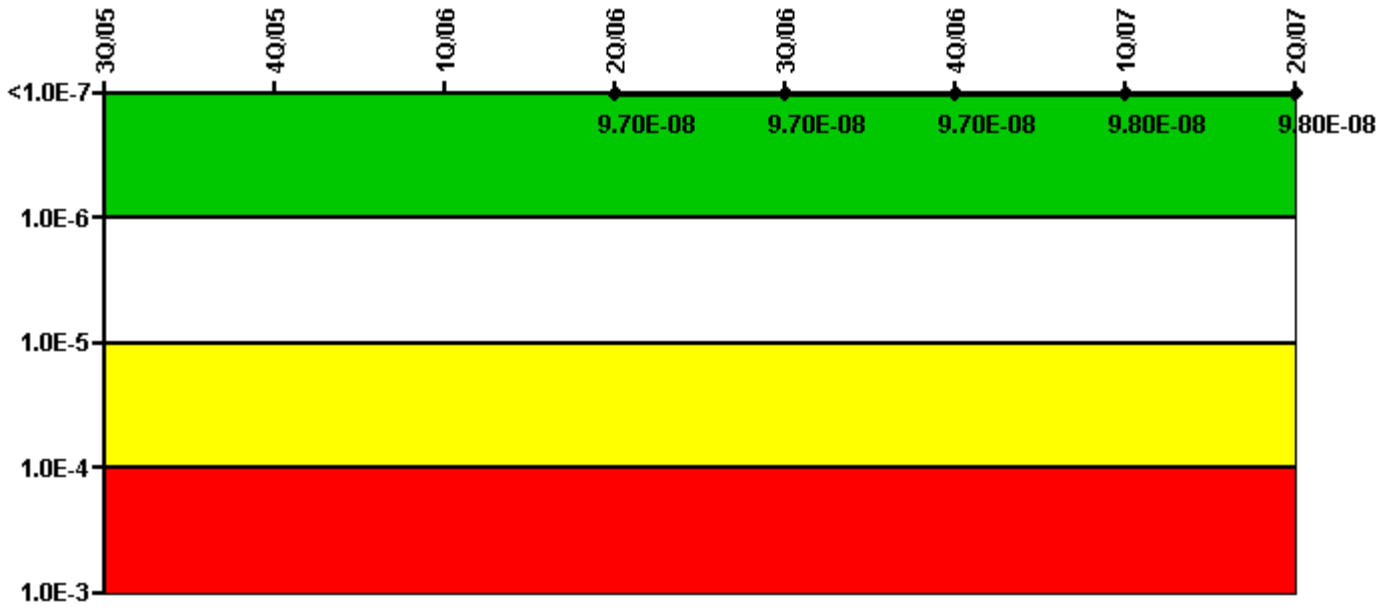


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07
UAI (ΔCDF)				-1.30E-08	-1.30E-08	-1.30E-08	-1.20E-08	-1.20E-08
URI (ΔCDF)				1.10E-07	1.10E-07	1.10E-07	1.10E-07	1.10E-07
PLE				NO	NO	NO	NO	NO
Indicator value				9.70E-08	9.70E-08	9.70E-08	9.80E-08	9.80E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

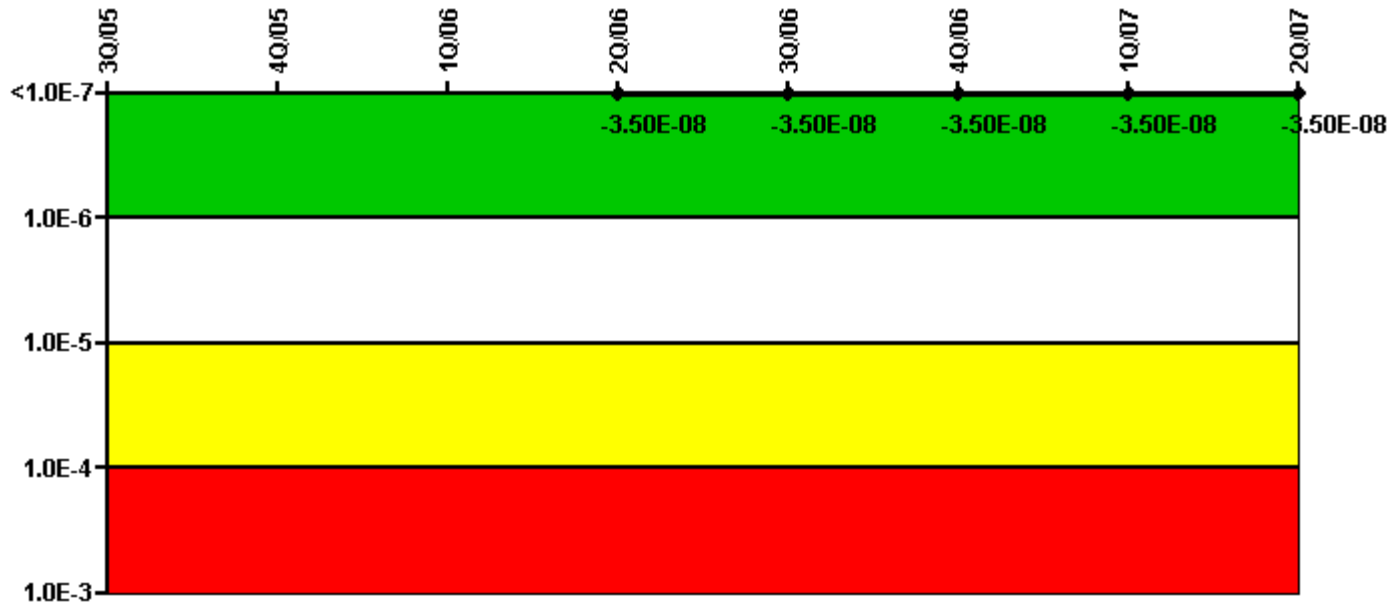


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07
UAI (Δ CDF)				-1.40E-08	-1.40E-08	-1.40E-08	-1.40E-08	-1.40E-08
URI (Δ CDF)				-2.10E-08	-2.10E-08	-2.10E-08	-2.10E-08	-2.10E-08
PLE				NO	NO	NO	NO	NO
Indicator value				-3.50E-08	-3.50E-08	-3.50E-08	-3.50E-08	-3.50E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

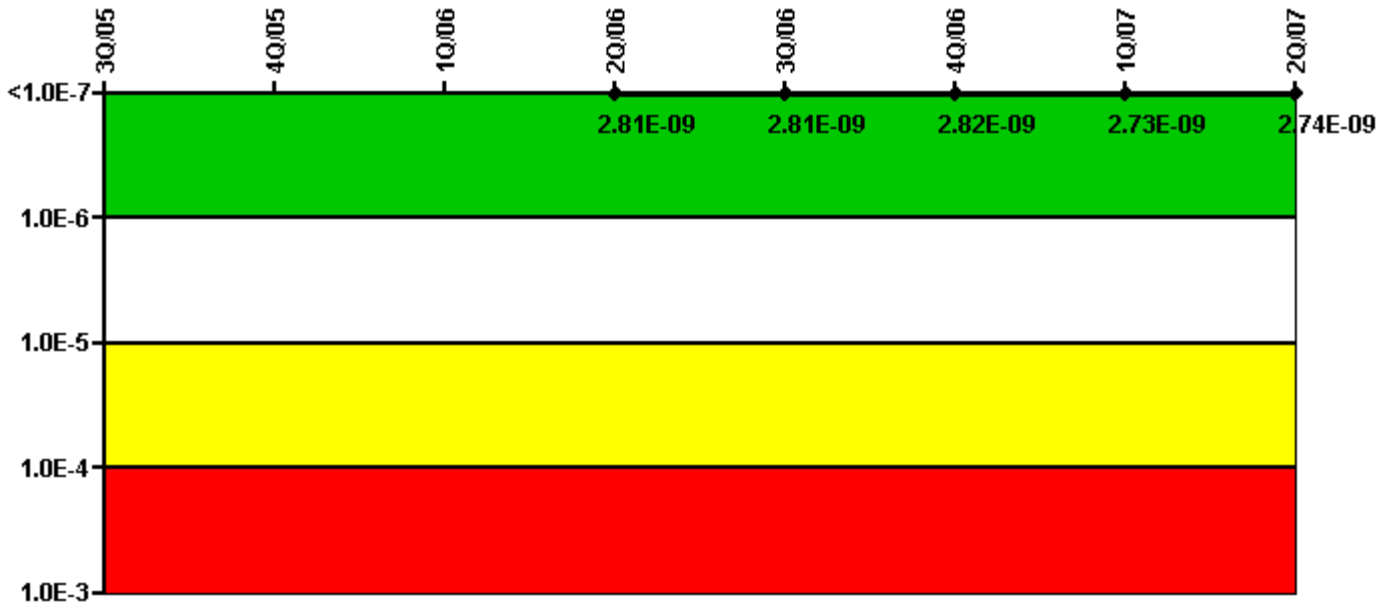


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07
UAI (Δ CDF)				1.10E-10	1.10E-10	1.20E-10	2.80E-11	3.80E-11
URI (Δ CDF)				2.70E-09	2.70E-09	2.70E-09	2.70E-09	2.70E-09
PLE				NO	NO	NO	NO	NO
Indicator value				2.81E-09	2.81E-09	2.82E-09	2.73E-09	2.74E-09

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

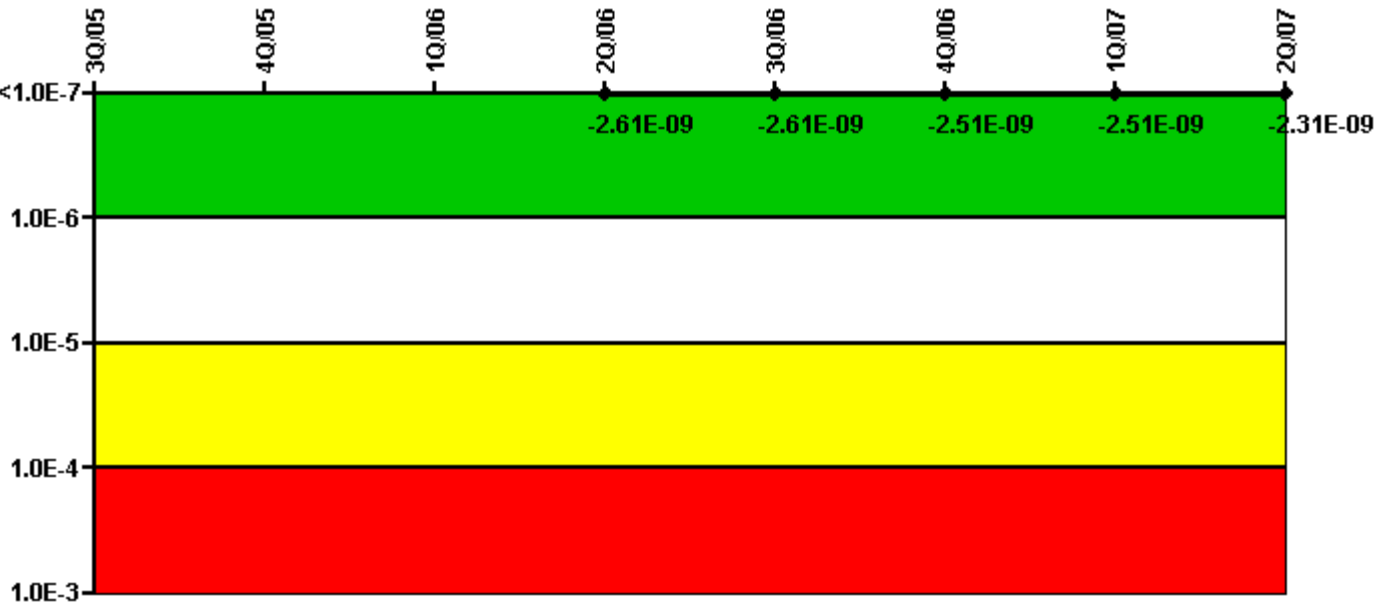


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07
UAI (ΔCDF)				-2.60E-09	-2.60E-09	-2.50E-09	-2.50E-09	-2.30E-09
URI (ΔCDF)				-1.20E-11	-1.20E-11	-1.20E-11	-1.20E-11	-1.20E-11
PLE				NO	NO	NO	NO	NO
Indicator value				-2.61E-09	-2.61E-09	-2.51E-09	-2.51E-09	-2.31E-09

Licensee Comments: none

Reactor Coolant System Activity

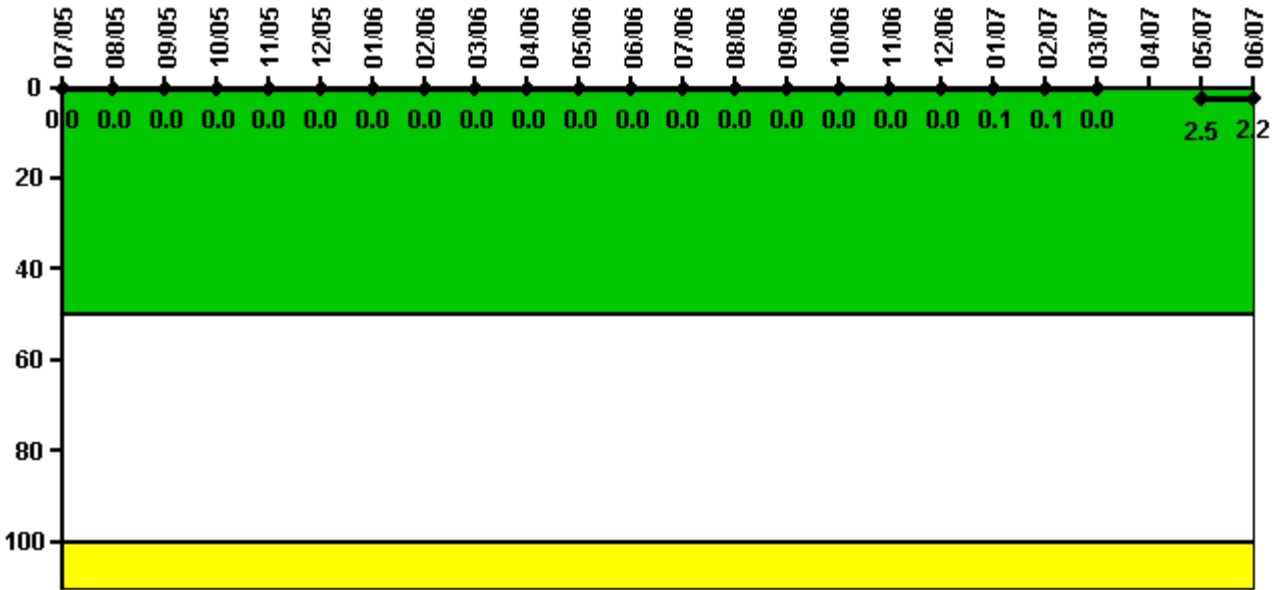

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	7/05	8/05	9/05	10/05	11/05	12/05	1/06	2/06	3/06	4/06	5/06	6/06
Maximum activity	0.000097	0.000100	0.000107	0.000125	0.000162	0.000133	0.000139	0.000117	0.000108	0.000151	0.000101	0.000109
Technical specification limit	2.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0	2.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07	4/07	5/07	6/07
Maximum activity	0.000093	0.000097	0.000088	0.000081	0.000087	0.000087	0.000216	0.000121	0.000081	N/A	0.004920	0.004460
Technical specification limit	2.0	2.0	2.0	2.0	2.0	2.0	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0.1	0.1	0	N/A	2.5	2.2

Licensee Comments: none

Reactor Coolant System Leakage

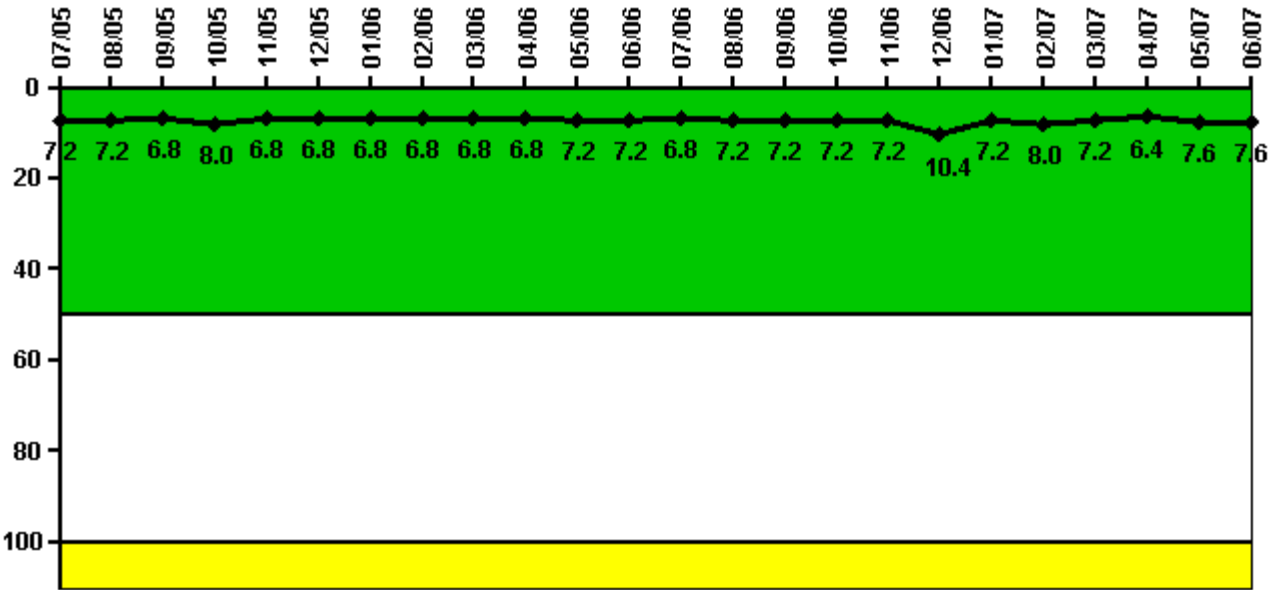


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/05	8/05	9/05	10/05	11/05	12/05	1/06	2/06	3/06	4/06	5/06	6/06
Maximum leakage	1.800	1.800	1.700	2.000	1.700	1.700	1.700	1.700	1.700	1.700	1.800	1.800
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	7.2	7.2	6.8	8.0	6.8	6.8	6.8	6.8	6.8	6.8	7.2	7.2
Reactor Coolant System Leakage	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07	4/07	5/07	6/07
Maximum leakage	1.700	1.800	1.800	1.800	1.800	2.600	1.800	2.000	1.800	1.600	1.900	1.900
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	6.8	7.2	7.2	7.2	7.2	10.4	7.2	8.0	7.2	6.4	7.6	7.6

Licensee Comments: none

Drill/Exercise Performance

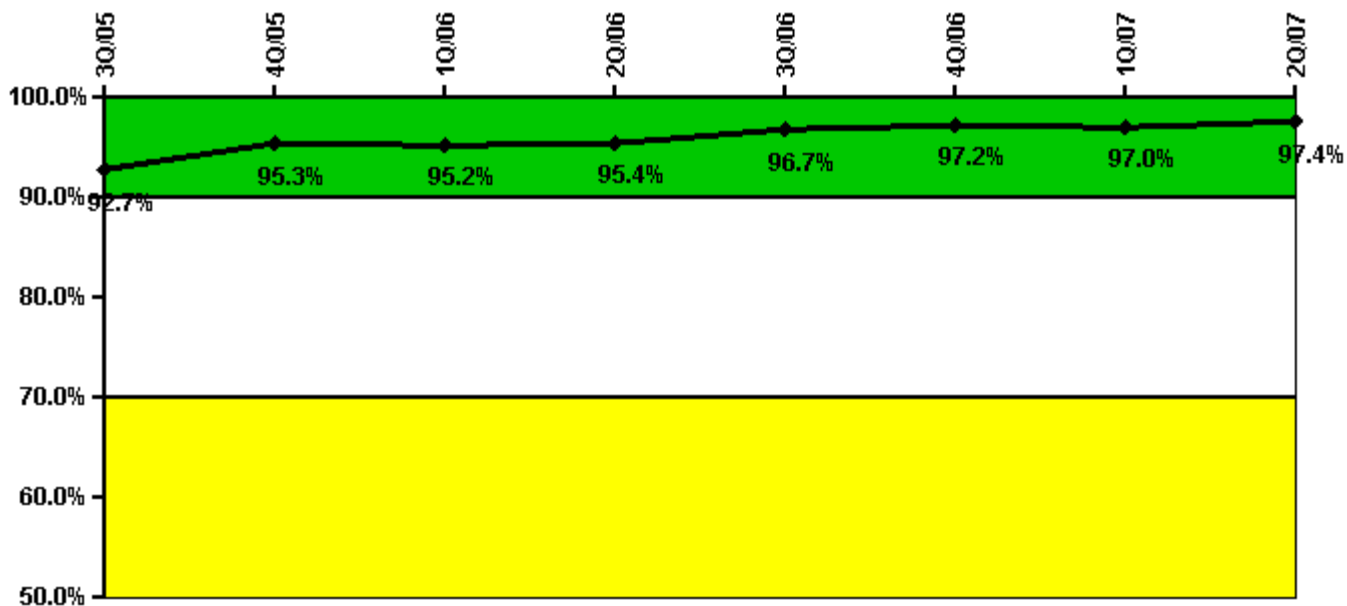


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07
Successful opportunities	53.0	15.0	54.0	23.0	56.0	42.0	25.0	31.0
Total opportunities	56.0	15.0	56.0	24.0	56.0	43.0	26.0	31.0
Indicator value	92.7%	95.3%	95.2%	95.4%	96.7%	97.2%	97.0%	97.4%

Licensee Comments: none

ERO Drill Participation

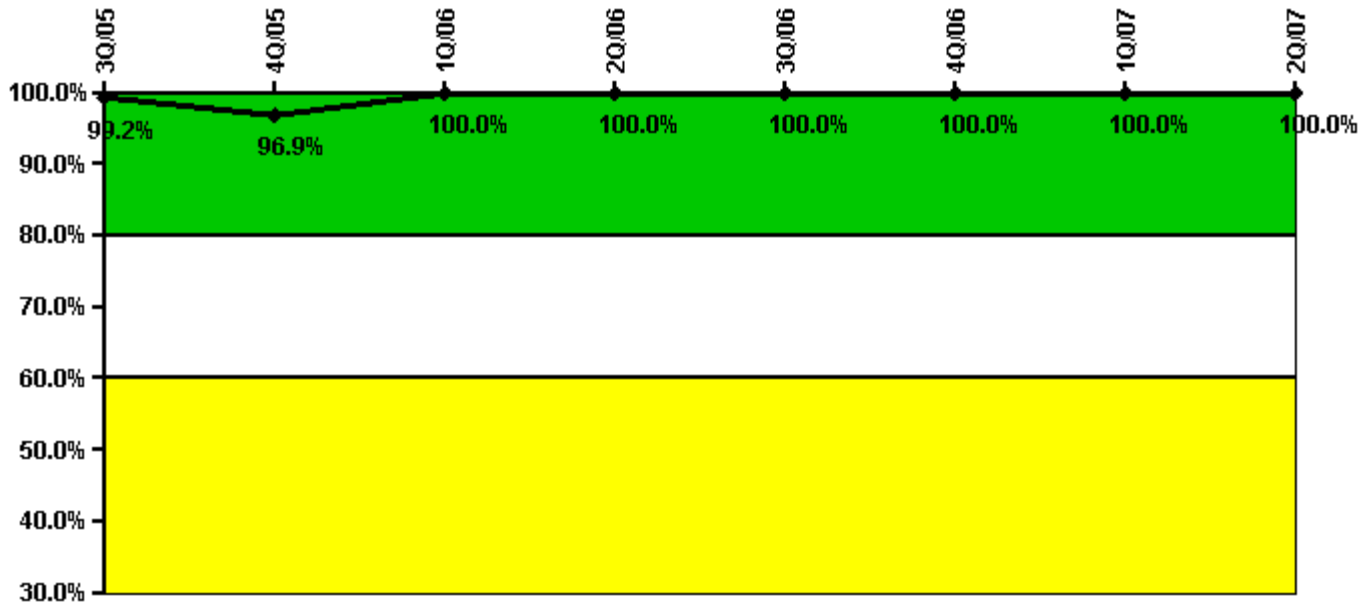


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07
Participating Key personnel	126.0	127.0	129.0	124.0	129.0	122.0	120.0	111.0
Total Key personnel	127.0	131.0	129.0	124.0	129.0	122.0	120.0	111.0
Indicator value	99.2%	96.9%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

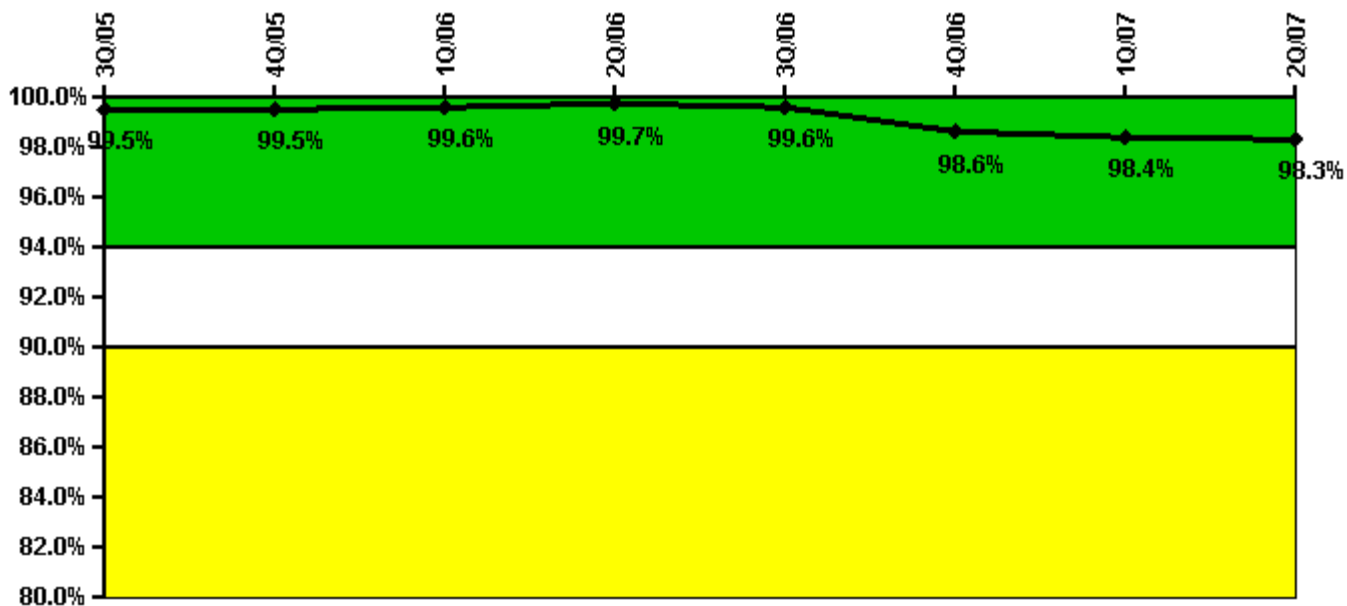

Thresholds: White < 94.0% Yellow < 90.0%


Notes

Alert & Notification System	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07
Successful siren-tests	1225	1233	1234	1232	1363	1324	1362	1367
Total sirens-tests	1235	1235	1235	1235	1378	1378	1378	1378
Indicator value	99.5%	99.5%	99.6%	99.7%	99.6%	98.6%	98.4%	98.3%

Licensee Comments:

3Q/06: The weekly test results for 11 sirens were added to the ANS PI at the start of the 3rd quarter 2006.

Occupational Exposure Control Effectiveness

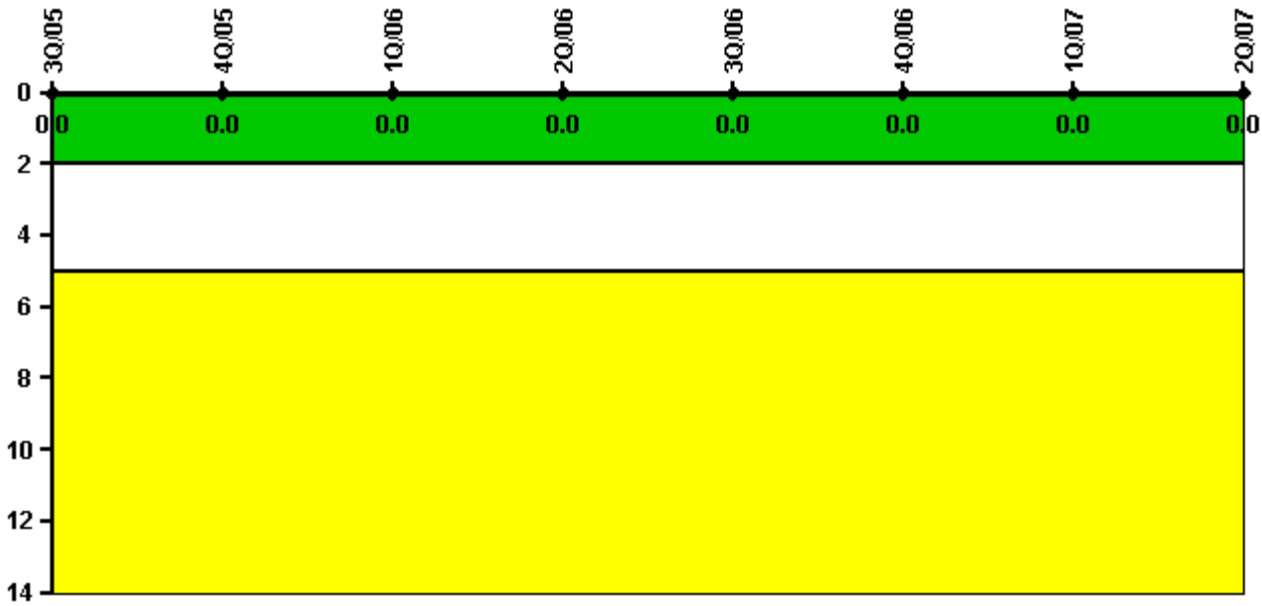


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

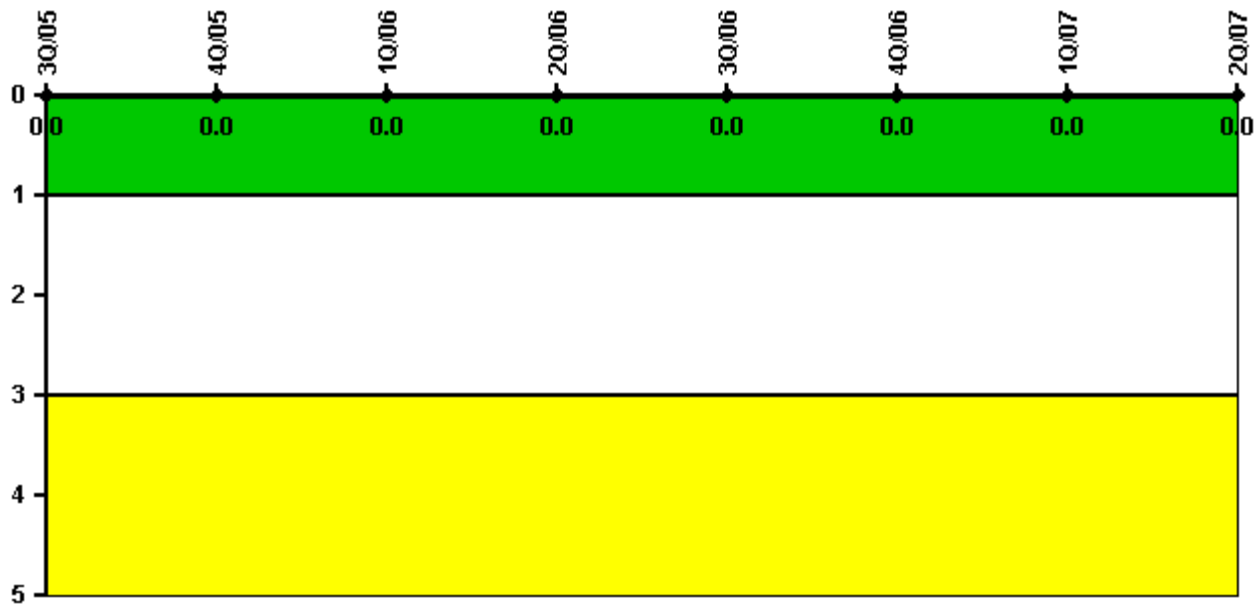

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: August 6, 2007