

1. ADDITIONAL POWER REACTANTS FOR THE ELECTRICAL POWER SYSTEM REQUIRED FOR EXTENDED FLIGHTS WILL BE INSTALLED IN THE PAYLOAD BAY AND WILL BE DETERMINED BY THE LENGTH OF THE ORBITAL MISSION. LANDING SITES WILL BE NOTIFIED REGARDING KIT INSTALLATION CONFIGURATION PRIOR TO EACH MISSION.

2. TANK SETS FOR EACH KIT ARE IDENTIFIED AS FOLLOWS:

POWER REACTANT	KIT NO.	KIT NO.	KIT NO.	VOLUME/TANK METRIC (U.S. STD)
LO 2 TANK NO.	1	2	3	354 kg
LH 2 TANK NO.	3	4	5	781 LB
				42.6 kg
				92 LB

Note  
LINE MARKING TAPES ARE IN ACCORDANCE WITH MIL-STD-1247 (REFER TO TABLE C-1)

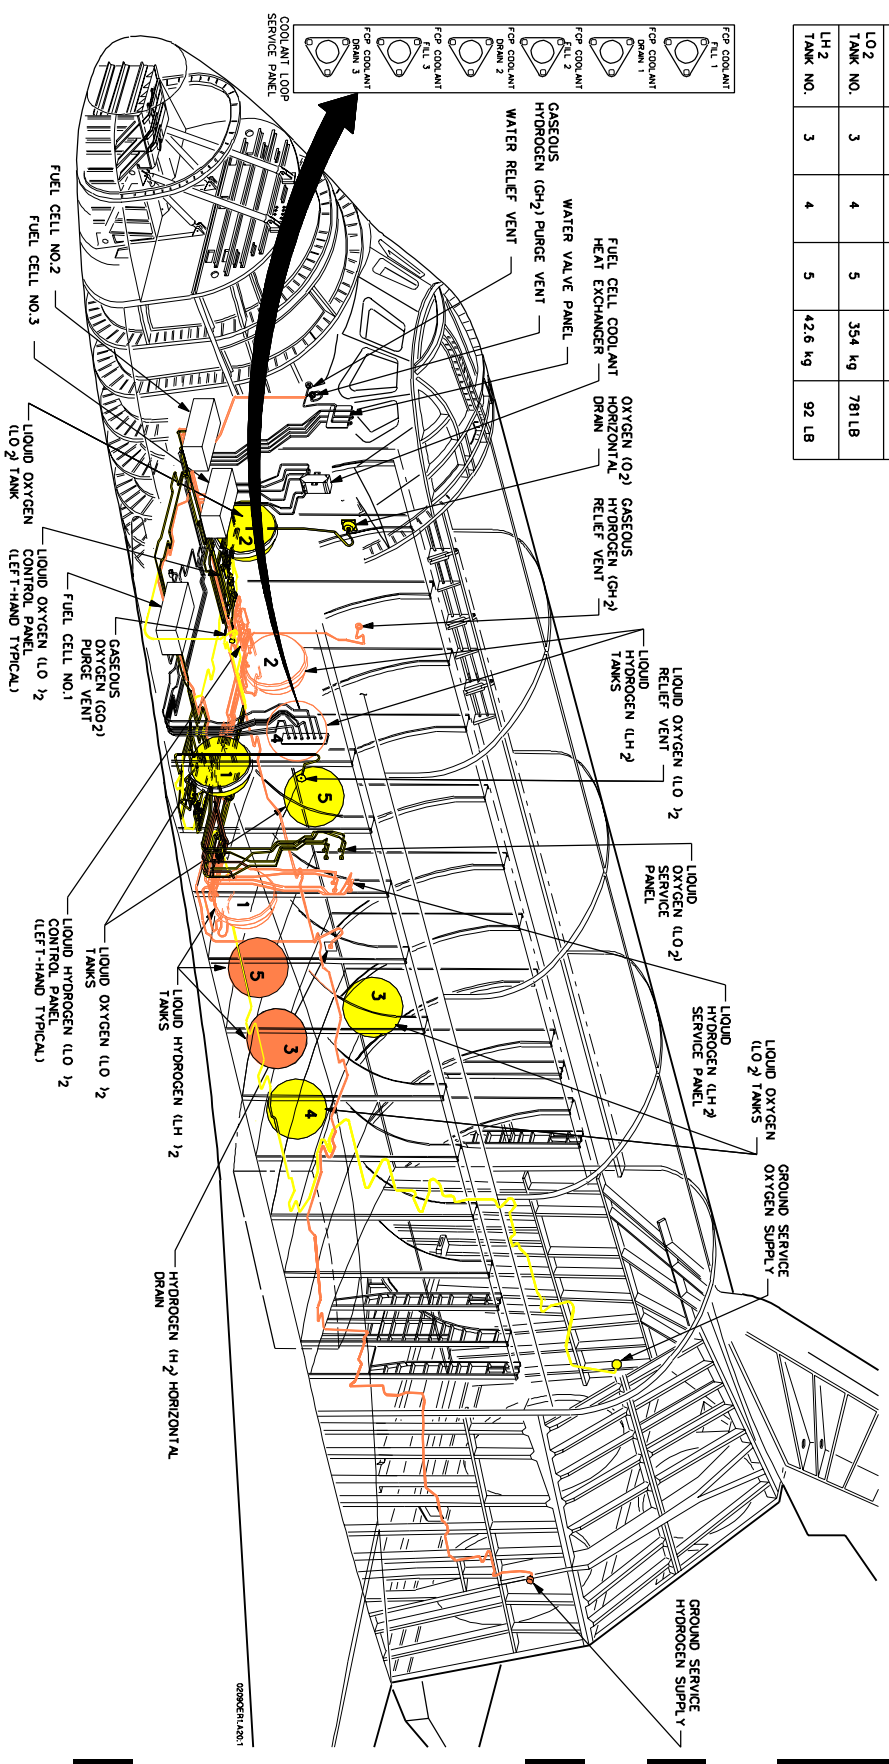


Figure 2-9 - Electrical power system components/line location.