


1. ADDITIONAL POWER REACTANTS FOR THE ELECTRICAL POWER SYSTEM REQUIRED FOR EXTENDED FLIGHTS WILL BE INSTALLED IN THE PAYLOAD BAY AND WILL BE DETERMINED BY THE LENGTH OF THE ORBITAL MISSION. (LANDING SITES WILL BE NOTIFIED REGARDING KIT INSTALLATION CONFIGURATION PRIOR TO EACH MISSION.)

2. TANK SETS FOR EACH KIT ARE IDENTIFIED AS FOLLOWS:

POWER REACTANT	KIT NO. 1	KIT NO. 2	KIT NO. 3	VOLUME/TANK	
				METRIC	U.S. STD
LO ₂ TANK NO.	3	4	5	354 kg	781 LB
LH ₂ TANK NO.	3	4	5	42.6 kg	92 LB

Note

LINE MARKING TAPES ARE IN ACCORDANCE WITH MIL-STD-1247 (REFER TO TABLE G-1.)

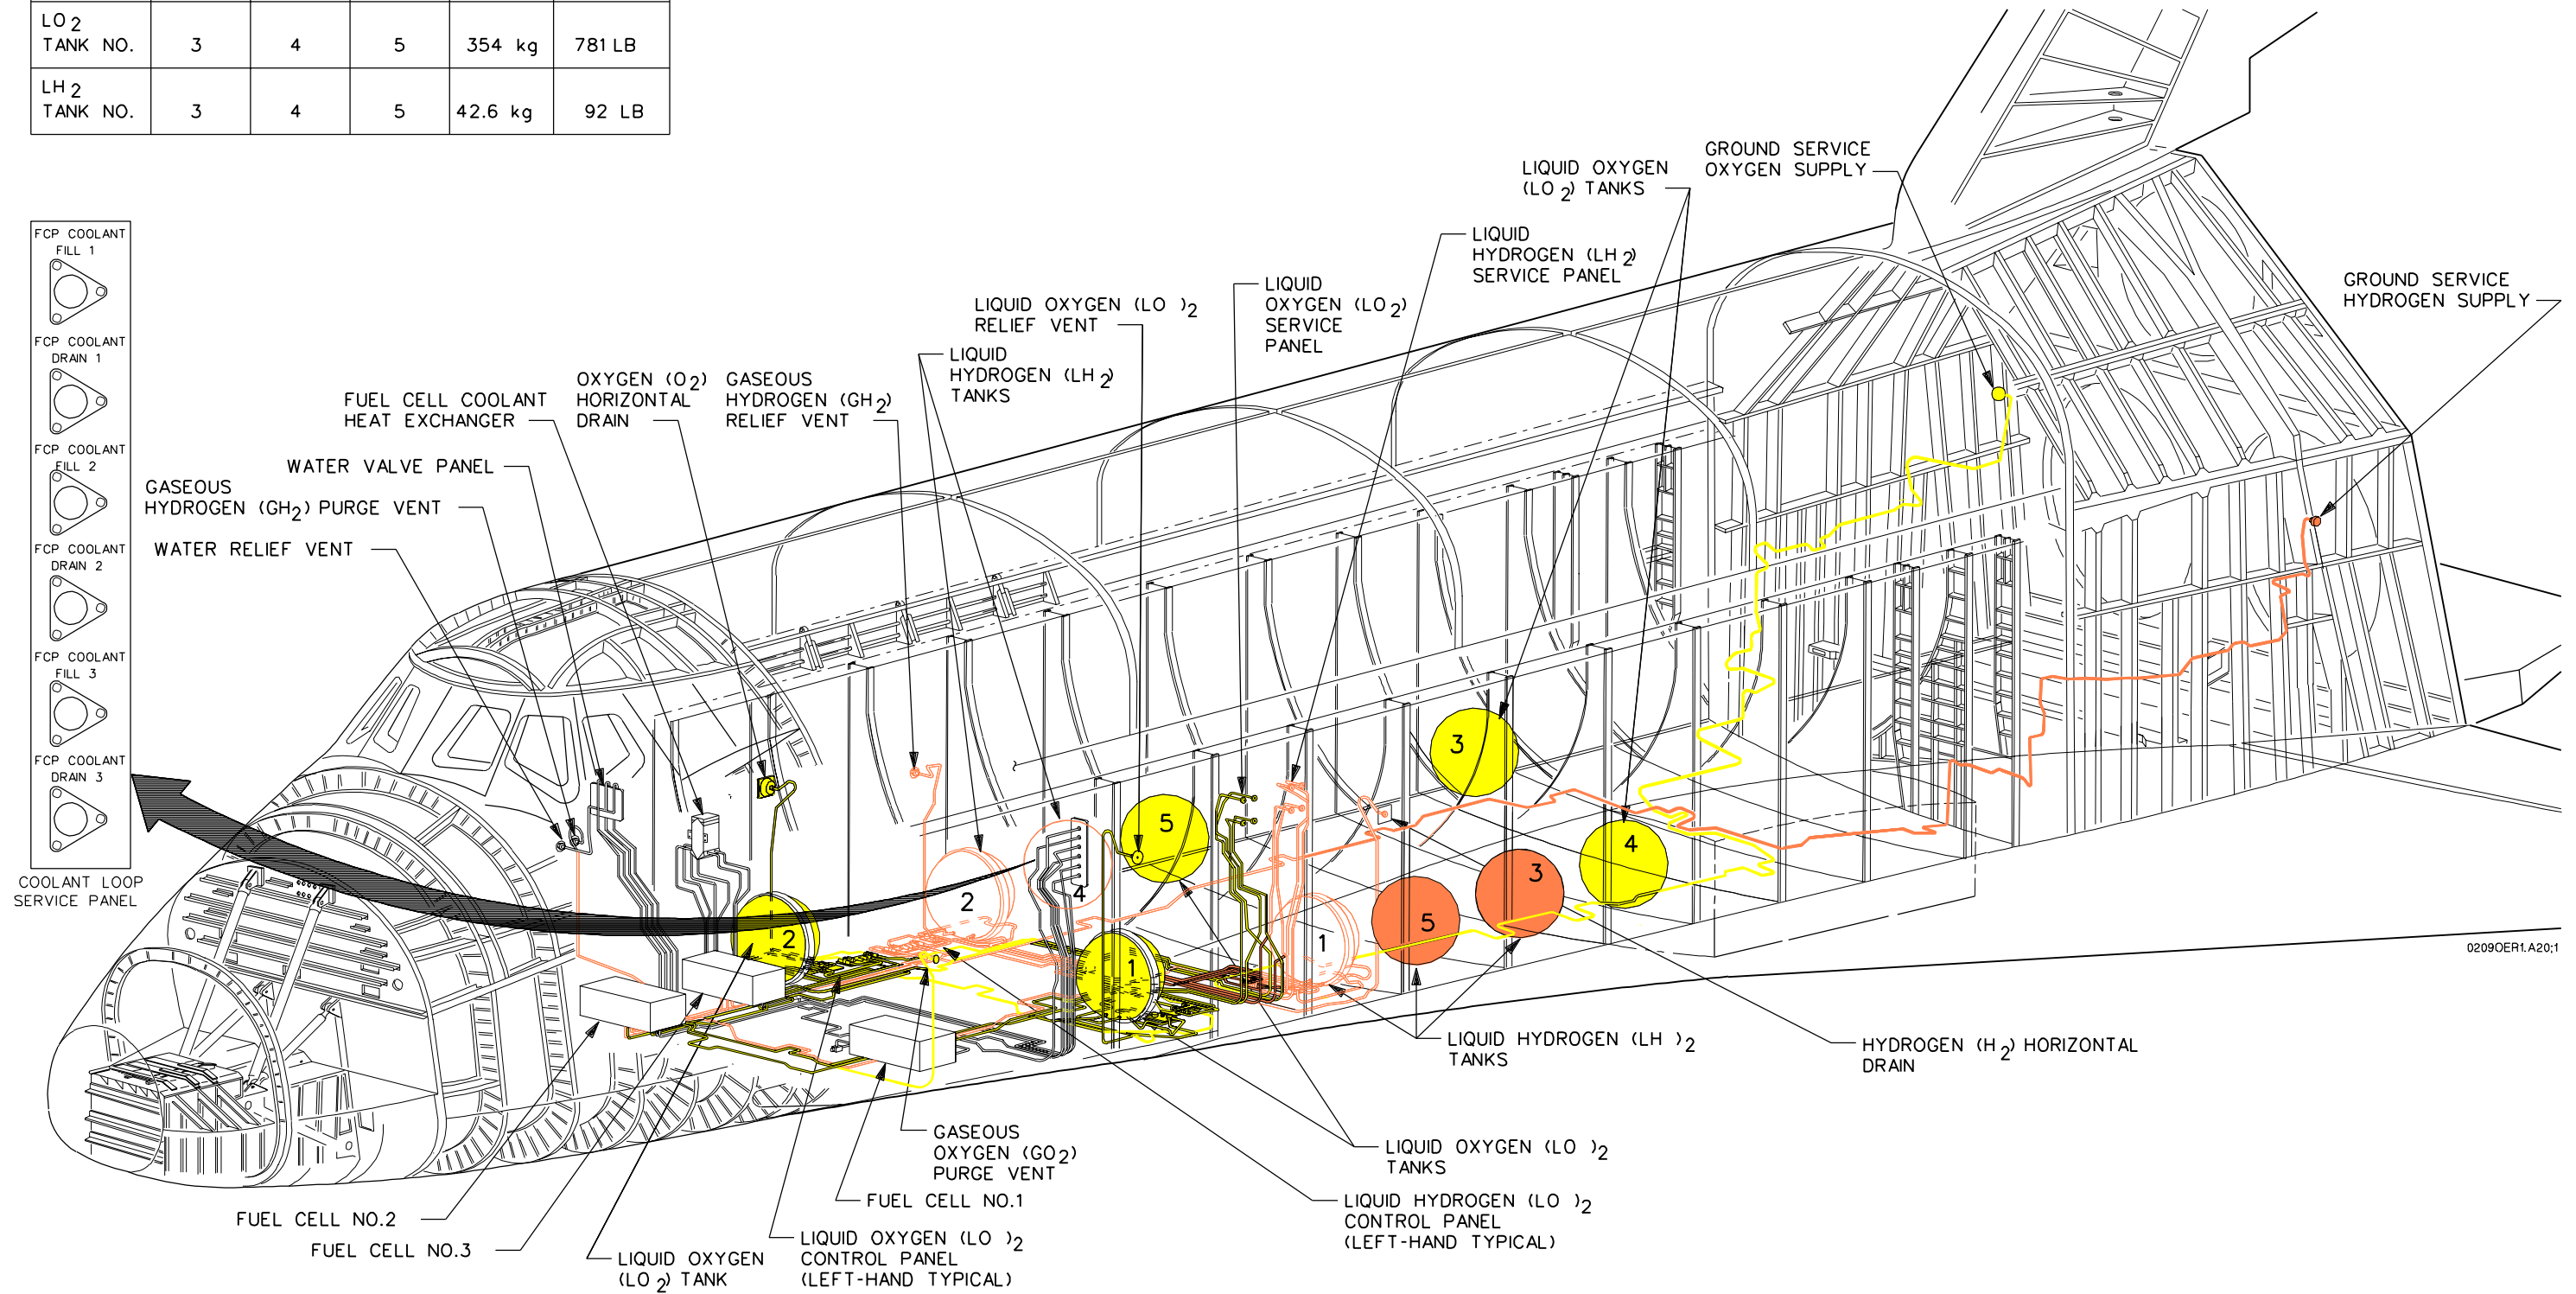

02090ER1.A20:1

Figure 2-9.- Electrical power system component/line locator.