



**EXPLANATION**



Of the total permitted public water-supply withdrawals, 489 Mgal/d (88 percent) came from surface-water sources, and 69 Mgal/d (12 percent) came from ground-water sources.

$\frac{0.00}{0.00}$  Surface-water withdrawals  
 $\frac{0.00}{0.00}$  Ground-water withdrawals

Withdrawals are in million gallons per day (Mgal/d)

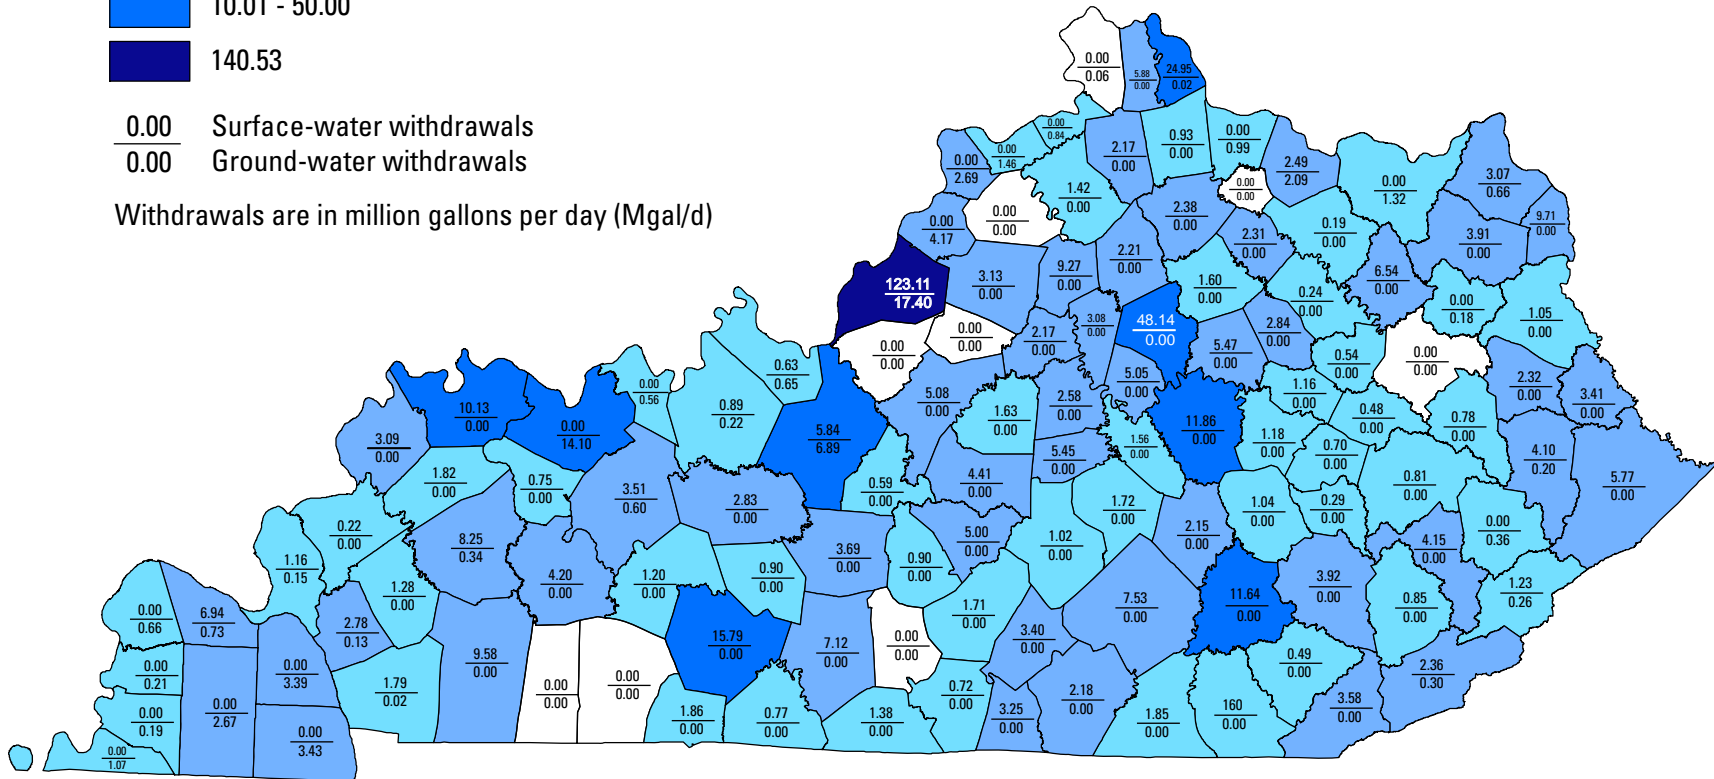

**Figure 4 . Permitted public water-supply withdrawal ranges and surface- and ground-water withdrawal totals in Kentucky, 2005.**