

Unit X

COURSE TITLE	Building Design for Homeland Security	TIME	150 minutes
---------------------	---------------------------------------	-------------	-------------

UNIT TITLE	Building Design Guidance
-------------------	--------------------------

OBJECTIVES	<ol style="list-style-type: none">1. Explain architectural considerations to mitigate impacts from blast effects and transmission of chemical, biological, and radiological agents from exterior and interior incidents2. Identify key elements of building structural and nonstructural systems for mitigation of blast effects3. Compare and contrast the benefit of building envelope, mechanical system, electrical system, fire protection system, and communications system mitigation measures, including synergies and conflicts4. Apply these concepts to an existing building or building conceptual design and identify mitigation measures needed to reduce vulnerabilities
-------------------	--

SCOPE	The following topics will be covered in this unit:
--------------	--

1. Architectural considerations, including building configuration, space design, and special situations
2. Building structural and nonstructural considerations with emphasis on progressive collapse, loads and stresses, and good engineering practices
3. Design issues for the building envelope, including wall design, window design, door design, and roof system design with approaches to define levels of protection
4. Mechanical system design issues, including interfacing with operational procedures, emergency plans, and training
5. Other building systems design consideration for electrical, fire protection, communications, electronic security, entry control, and physical security that mitigate the effects of a threat or hazard
6. Activity: Select mitigation measures that reduce vulnerability and associated risk from the building perspective for the highest risk pairs (asset - threat/hazard) identified in Unit V-B.

REFERENCES

1. FEMA 426, *Reference Manual to Mitigate Potential Terrorist Attacks Against Buildings*, pages 3-1 to 3-46 and 3-48 to 3-52; Checklist at end of Chapter 1
2. FEMA 427, *Primer for Design of Commercial Buildings to Mitigate Terrorist Attacks*
3. FEMA 430, *Primer for Incorporating Building Security Components in Architectural Design* (when available)
4. FEMA 452, *Risk Assessment: A How-To Guide to Mitigate Potential Terrorist Attacks Against Buildings*, pages 5-1 to 5-16
5. Student Manual, Unit X-A or Unit X-B as selected
6. Case Study – Appendix A: Suburban, Hazardville Information Company or Appendix B: Suburban, HazardCorp Building as selected
7. Unit X visuals

REQUIREMENTS

1. FEMA 426, *Reference Manual to Mitigate Potential Terrorist Attacks Against Buildings* (one per student)
2. FEMA 452, *Risk Assessment: A How-To Guide to Mitigate Potential Terrorist Attacks Against Buildings* (one per student)
3. Instructor Guides, Unit X
4. Student Manual(one per student) for selected case study
5. Overhead projector or computer display unit
6. Unit X visuals
7. Threat Matrices and dry-erase markers
8. Chart paper, easel, and markers

UNIT X OUTLINE

	<u>Time</u>	<u>Page</u>
X. Building Design Guidance [65 slides at about 1.5 minutes per slide over 90 minutes]	150 minutes	
1. Introduction and Unit Overview Third Layer of Defense	13.5 minutes	IG X-5
2. Architecture	15 minutes	IG X-11
3. Structural Systems	9 minutes	IG X-18
4. Building Envelope	24 minutes	IG X-24
5. Utility Systems	4.5 minutes	IG X-39

6. Mechanical and Electrical Systems	10.5 minutes	IG X-41
7. Plumbing and Gas Systems	1.5 minutes	IG-X-48
8. Fire Alarm Systems	1.5 minutes	IG-X-49
9. Communications – Information Technology Systems	3 minutes	IG-X-50
10. Equipment Operations and Maintenance	3 minutes	IG-X-52
11. Security Systems	4.5 minutes	IG-X-54
12. Practical Applications	1.5 minutes	IG-X-58
13. Building Materials: General Guidance	1.5 minutes	IG-X-58
14. Desired Building Protection Level	1.5 minutes	IG-X-59
15. Summary	1.5 minutes	IG-X-60
16. Student Activity Instructions	1.5 minutes	IG-X-61
17. <u>Student Activity</u> : Building Design Guidance (Version A Suburban) [45 minutes for students, 15 minutes for instructor review]	60 minutes	IG X-A-62
18. <u>Student Activity</u> : Building Design Guidance (Version B Urban) [45 minutes for students, 15 minutes for instructor review]	60 minutes	IG X-B-83

PREPARING TO TEACH THIS UNIT

Tailoring Content to the Local Area: Review the Instructor Guides to identify topics that should focus on the local area. Plan how you will use the generic content, and prepare for a locally oriented discussion. The locally oriented discussion should be in conjunction with the version of the case study selected as the student activity used during the course offering.

Optional Activity: There are three versions of the student activity available for use during this course -- Suburban, Urban, or Continuity of Operations Planning (COOP).

Activity: The students will continue the familiarization with the Case Study materials. The Case Study is a complete risk assessment and analysis of mitigation options and strategies for a typical commercial office building located in a mixed urban-suburban environment business park (suburban), a 50-story high-rise office building located in a downtown urban environment (urban), or an alternate facility to be assessed for potential COOP use (based

upon the suburban building). The assessment will use the DoD Antiterrorism Standards and the GSA Interagency Security Criteria to determine Levels of Protection and identify specific vulnerabilities. Mitigation options and strategies will use the concepts provided in **FEMA 426** and other FEMA publications related to emergency planning and disaster recovery.


Refer students to their Student Manuals for worksheets and activities.

- Direct students to the appropriate page in the Student Manual.
- Read the activity instructions found in the Student Manual.
- Describe how the selected case study appendix in the Student Manual is used to obtain the data needed for the building assessment.
- “Walk through” the pages of the activity with the students, describing the steps followed to obtain the answers in the completed examples, and what is expected of the groups for this activity.
- If applicable to this activity, explain what information is to be transferred to the Risk Matrix poster. For this activity, the assessment of the building in greater depth may result in the groups adjusting the Risk Matrix scores for vulnerability rating, with resultant changes to risk rating.
- Tell students how long they have to work on the requirements.
- While students are working, all instructors should closely observe the groups’ process and progress. If any groups are struggling, immediately assist them by clarifying the assignment and providing as much help as is necessary for the groups to complete the requirement in the allotted time. Also, monitor each group for full participation of all members. For example, ask any student who is not fully engaged a question that requires his/her viewpoint to be presented to the group.
- At the end of the working period, reconvene the class.
- Ask a representative from one group to provide the answer to the first requirement. Then simply ask if anyone disagrees. If the answer is correct and no one disagrees, state that the answer is correct and move on to the next requirement. If there is disagreement, provide the “school solution” and move on.
- If time is short, simply provide the “school solution” and ask for questions. Do not end the activity without ensuring that students know if their answers are correct or at least on the right track. Note, there are no right or wrong answers, but all answers must be justified with rationale.
- Ask for and answer questions.

INSTRUCTOR NOTES

CONTENT/ACTIVITY

VISUAL X-1

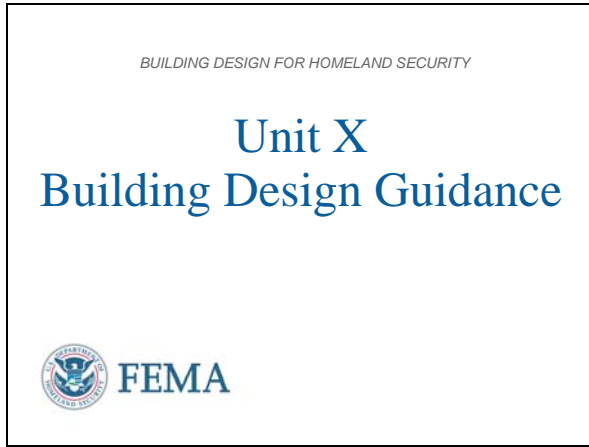

Introduction and Unit Overview

This is Unit X Building Design Guidance. Continuing with our understanding of vulnerability and mitigation measures, we have looked at site and layout concerns and now turn our attention to what considerations are needed in building design to mitigate tactics involving explosive blast or CBR agents.

We will examine design considerations that achieve a balanced building envelope that provides a defensive layer against the given terrorist tactic and avoids creating ripple effects where one incident may affect more than one building system.


Catastrophic collapse of any building is a primary concern. Historically, the majority of fatalities that occur in terrorist attacks directed against buildings are due to building collapse. This was true for the Oklahoma City bombing in 1995 when 87 percent of the building occupants who were killed were in the collapsed portion of the Murrah Federal Building. But glass causes over 80 percent of injuries during bomb blast and there are some low cost techniques to keep CBR agents outside of buildings or to limit their spread inside.

VISUAL X-2

Unit Objectives

Explain architectural considerations to mitigate impacts from blast effects and transmission of chemical, biological, and radiological agents from exterior and interior incidents.

Identify key elements of building structural and non-structural systems for mitigation of blast effects.



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-2

References

FEMA Building Vulnerability Assessment Checklist, Chapter 1, page 1-46, FEMA 426

Building Design Guidance, Chapter 3, FEMA 426

FEMA 430, Primer for Incorporating Building Security Components in Architectural Design

VISUAL X-3

Unit Objectives (cont.)

Compare and contrast the benefit of building envelope, mechanical system, electrical system, fire protection system, and communication system mitigation measures, including synergies and conflicts.

Apply these concepts to an existing building or building conceptual design and identify mitigation measures needed to reduce vulnerabilities.



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-3

Unit Objectives

At the end of this unit, the students should be able to:

Explain architectural considerations due to impact from blast effects and transmission of chemical, biological, and radiological agents from exterior and interior incidents.

Identify key elements of a building's structural and non-structural systems for mitigation of blast effects.


In addition to FEMA 426, also consult [FEMA 430](#) (future) for additional design concepts.

Unit Objectives (continued)

Compare and contrast the benefit of building envelope, mechanical system, electrical system, fire protection system, and communication system mitigation measures, including synergies and conflicts.

Apply these concepts to an existing building or building conceptual design and identify mitigation measures needed to reduce vulnerabilities.

VISUAL X-4

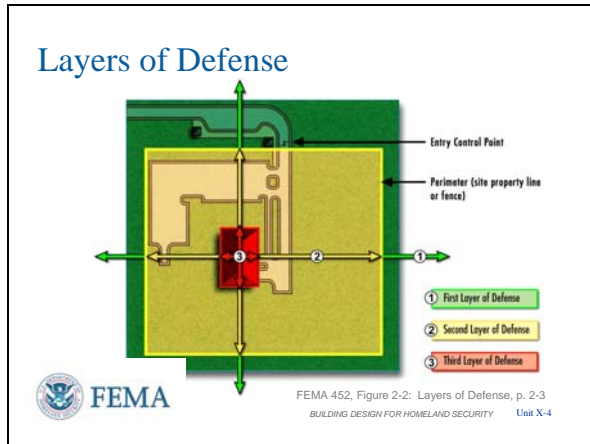

From FEMA 452


The layers of defense is a traditional approach in security engineering and use concentric circles extending out from an area or site to the building or asset that requires protection. They can be seen as demarcation points for different security strategies. Identifying the layers of defense early in the assessment process will help you to understand better the assets that require protection and determine your mitigation options. Figure 2-2 shows the layers of defense described above.

Layers of Defense

The first and second layers were discussed in the previous instruction unit. The Third Layer of Defense is applicable to Building Design – starting at the building drip line, taking into account the complete building envelope, and including any additional considerations found anywhere in the building.

FEMA 452 -- Third Layer of Defense. This deals with the protection of the asset itself. It proposes to harden the structures and systems, incorporate effective HVAC systems and surveillance equipment, and wisely design and locate utilities and mechanical systems. Note that, of all blast mitigation measures, distance is the most effective measure because other measures vary in effectiveness and can be more costly. However, often it is not possible to provide adequate stand-off distance. For example, sidewalks in many urban areas may be less than 10 meters (33 feet), while appropriate stand-off may require a minimum of 25 meters (82 feet). **The building owner has control of this layer and its main mitigation measures are hardening against blast and security sensors/CCTV as final access control.**

VISUAL X-5

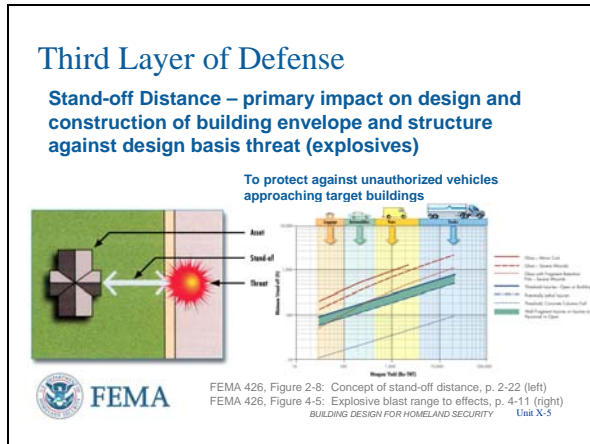

Third Layer of Defense


Stand-off Distance versus Hardening of Structures

Of all blast mitigation measures, distance is the most effective measure because other measures vary in effectiveness and can be more costly. However, many times it is not possible to provide adequate stand-off distance.

Desired minimum stand-off in the DoD Unified Facility Criteria (UFC) and used as the initial screening distance in FEMA 426 is 82 feet. However, this may only protect against column collapse for a 250 pound car bomb at 82 feet.

The design basis threat weapon yield and the level of protection desired drive the hardening required for the stand-off distance available.

VISUAL X-6

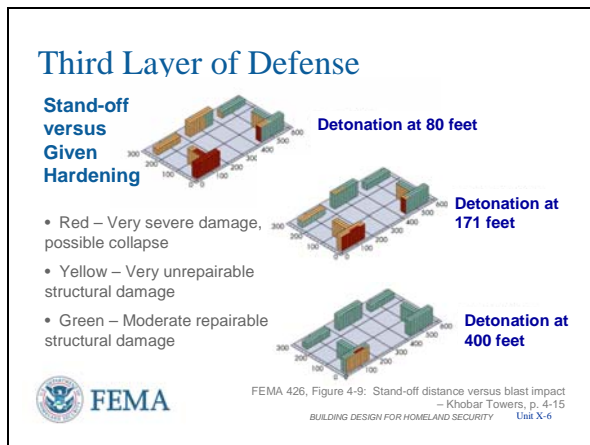

Third Layer of Defense

Stand-off versus Given Hardening

This representation of the estimated damage at Khobar Towers uses the blast modeling software available circa 1997. It shows the front façade of the target building receiving very severe damage when the estimated bomb is at 80 feet. Increasing the stand-off using the same building construction and bomb size shows that the stand-off required to limit damage is 400 feet.

INSTRUCTOR NOTES

CONTENT/ACTIVITY

VISUAL X-7

U.S. Embassy: Kampala, Uganda designed to resist explosive blast [upper left – DOS and Hinman]. Other three photos are from New York City indicating glass and overhang (poor) [lower left], similar glass and overhang (poor) but with wall (better) [upper right], and window curtain wall (usually poor) [lower right].

VISUAL X-8

Layers of Defense	Architecture	Structural Systems	Building Envelope	Utility Systems	Mechanical & Electrical Sys	Plumbing & Gas Systems	Fire Alarm Systems	Comm - Info Technology Sys	Equipment Ops & Maint	Security Systems
First Layer										
Second Layer										
Third Layer										

Note that one mitigation measure may reduce the risk of more than one asset-threat/hazard pair of interest as illustrated by **Table 2-1, page 2-54, of FEMA 426**, where a mitigation measure may apply to multiple tactics. On

Third Layer of Defense Hardening

Less stand-off requires more mass and more steel for hardening, thicker and stronger glass, and better window frame connection to the building/wall. However, this should be done in concert with good architecture design and aesthetics principles. As you can see, the other photos show architectural treatments that increase blast damage – overhangs and much glass.

Note that 82 feet of stand-off allows use of conventional construction with minimal upgrades when used in conjunction with a controlled perimeter that detects larger bombs prior to getting anywhere near the building.

Third Layer of Defense

The third layer of defense deals with the protection of the asset itself. The column headings include key elements of protection and the row headings includes the three layers of defense. The matrix allows designers to consider different methods of protection and when they could be used. For the third layer of defense, designers should go through each system to take appropriate mitigation measures for an existing building or provide increased hardening when designing a building.

The rest of this instruction unit will follow along the column headings in the order shown. This is the same order as found in the Building Vulnerability Checklist at the end of Chapter 1 of FEMA 426.

INSTRUCTOR NOTES

CONTENT/ACTIVITY


the other hand, a mitigation measure against one tactic may increase the vulnerability to other tactics.

VISUAL X-9

Third Layer of Defense

When hardening a building, the following should be considered:

- Progressive collapse
- Appropriate security systems
- Hardening the building envelope
- Appropriate HVAC systems to mitigate CBR
- Hardening the remaining structure
- Hardening and location of utilities




BUILDING DESIGN FOR HOMELAND SECURITY Unit X-9

Third Layer of Defense

Hardening Considerations:

- **Progressive collapse**
This should be the first consideration as most deaths result from building collapse and life safety seeks to ensure safe evacuation of a building during or after any incident. Structural framing and load-bearing components are the concern here.
- **Appropriate security systems**
For an existing building the addition of security systems to deter, detect, and deny the building needs to be done whether or not building hardening can be done.
- **Hardening the building envelope**
After progressive collapse, hardening the building envelope provides the most protection against injury during blast events and aligns with building tightness considerations for exterior CBR releases.
- **Appropriate HVAC systems to mitigate against CBR**
Next the control of HVAC operation for exterior and interior CBR releases should be considered based upon the complexity of the existing or designed system.
- **Hardening the structure**
After progressive collapse and hardening the building envelope, hardening the rest of the structural/nonstructural components to reduce injury should be considered.
- **Hardening and location of utilities**
This might be the most expensive to do with an existing building, but should be fully implemented in a new building design. Accessible, aboveground utilities should receive first consideration for hardening.

VISUAL X-10

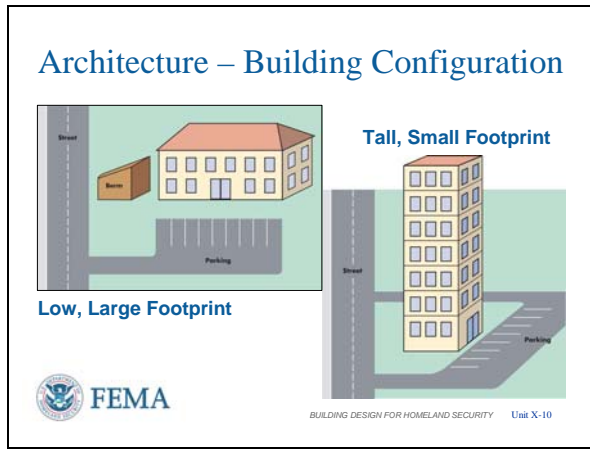

Architecture – Building Configuration

Designers should balance a number of relevant considerations to the extent that site, economic, and other factors allow.

Some of the relevant considerations include the following:

- The shape of the building
- Low, large footprint buildings
- Tall, small footprint buildings

General benefits of the two basic approaches:

Low, Large Footprint:

- Reduced effect of explosive blast (catches less of the blast wave) – Dispersed and blast wave rolls over the top.
- Reduced effect of progressive collapse (less of the building can fall) – Due to less structural members impacted.
- Reduced surveillance or easier mitigation (lower height allows terrain and landscaping options)
- Better energy conservation (green roof potential and earth-sheltered design – earth berm reduces energy loss and directs blast wave over the building if the berm is as high as the building)

Tall, Small Footprint:

- Reduced blast effects on upper floors
- Air intakes better protected against CBR events
- Site runoff reduced, reducing culvert size as a covert entry point
- More parking space that meets local planning commission/building code

VISUAL X-11

Architecture – Building Configuration

Rectangular versus “U”, “L” or “E”

Avoid re-entrant corners

Flush face versus eaves and overhangs

Shapes That Accentuate Blast

FEMA 426, Figure 3-2: Re-entrant corners in a floor plan, p. 3-6
 FEMA 427, Figure 6-3: Effects of building shape vs. air blast, p. 6-9
 BUILDING DESIGN FOR HOMELAND SECURITY Unit X-11

FEMA

Architecture – Building Configuration

A lot can be done architecturally to mitigate the effects of a terrorist bombing on a facility. These measures often cost nothing or very little if implemented early in the design process. FEMA 430 (future) will contain an expanded discussion of incorporating security components in architectural design.

- Further looking at building shapes, certain configurations trap the blast wave, increasing overall damage to the structure. For example, “U” or “L” shaped buildings, overhangs, and re-entrant corners in general should be avoided. Either the reflected pressure increases as it cannot vent around the building or the building gets hit with reflected blast waves at points already hit by the initial blast wave.

VISUAL X-12

Architecture – Building Configuration

Hardening – Story height vs Stand-off

- Hardening of first three floors is critical as these take brunt of blast
- At third through sixth floor, hardening can be reduced due to reflection angle
- Above the sixth floor, conventional construction may be sufficient depending upon design threat and reflections off adjacent buildings

FEMA

BUILDING DESIGN FOR HOMELAND SECURITY Unit X-12

Architecture – Building Configuration

GSA has stated the hardening for the urban situation will be fully evaluated for the first three floors of the building because these floors are most vulnerable. At the third through sixth floor, the hardening can be reduced, but some hardening is still necessary. Above the sixth floor may need only conventional construction with minimal hardening -- because the reflection angle is going to result in a lower coefficient of reflection and the increased stand-off distance to these floors also results in less reflected pressure.

However, as the bomb gets bigger, the upper floors will see severe damage even with the increased reflection angles just due to the higher incident pressure generated by larger bombs.

The GSA approach would hold very well for a

INSTRUCTOR NOTES

CONTENT/ACTIVITY

high-rise building surrounded by low-rise buildings (3 floors and less), but is probably less applicable for the high-rise building surrounded by other high-rise buildings. Blast wave reflections off adjacent buildings, will affect all floors of the building of interest to varying degrees. The reflections will follow much longer paths resulting in larger effective stand-off distances and the various reflection angles will result in lower incident and reflected pressures compared to the initial blast wave. Unfortunately, the reflections may hit a very weak point in the response motion of the building or building component at any floor level resulting in more damage than would have been originally expected.

Architecture – Building Configuration

- Elevating the ground floor makes moving vehicle attack more difficult
- If the glazing looks perpendicular to the direction of travel for the blast wave, the glass sees less reflected pressure.
- Do not have structural elements, like columns, easily exposed on the outside of the building. This goes for any architectural feature that can become damaged or disconnected by a blast wave.
- If armed attack includes Molotov cocktails or home-made grenades, pitched roofs and pitched window sills tend to cause the thrown item to roll off and away from the building. Air intakes have similar considerations.

VISUAL X-13


Architecture – Building Configuration

Ground floor elevation 4 feet above grade


Orient glazing perpendicular to principal threat direction

Avoid exposed structural elements

Pitched roofs and pitched window sills



FEMA 426, Figure 3-1: Glazed areas perpendicularly oriented away from streets, p. 3-5
BUILDING DESIGN FOR HOMELAND SECURITY Unit X-13




VISUAL X-14


Architecture – Building Configuration

Loading Docks

- Avoid trucks parking in or underneath buildings
- Design to prevent progressive collapse
- Ensure separation from critical systems, functions, and utility service entrances
- Separate loading docks from building critical functions



- Provide sufficient area for screening vehicles and packages
- Keep dumpsters away from buildings



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-14

Architecture – Building Configuration

Loading Docks

- Loading docks are higher risk locations as larger vehicles with potentially larger bombs are allowed minimal stand-off from the building.
- Building design calls for the basics of preventing progressive collapse, and separating critical equipment, systems, components and functions away from the loading dock.
- Do not provide a hiding location by placing dumpsters adjacent to the building
- Screen packages and vehicles coming to the loading dock at other locations or in an area of sufficient size to allow searches and sufficient distance from the building to reduce the impact of any incident.

VISUAL X-15

Architecture – Building Configuration

Parking Considerations



- Restrict parking underneath buildings
- Well-lit, security presence, emergency communications, and/or CCTV
- Apply progressive collapse hardening to columns when parking garage is in building

- Garage elevators service garage only to unsecured zone of lobby




BUILDING DESIGN FOR HOMELAND SECURITY Unit X-15

Architecture – Building Configuration

Parking Considerations

- As with loading docks, parking underneath a building is a higher risk situation as larger bombs than can be hand-carried approach the building with minimal stand-off.
- As with loading docks, progressive collapse is a primary concern
- Restrict parking to vetted vehicles, but also provide access control and security systems
- Access from underground parking (stairwells and elevators) to the building should be only to unsecured spaces where access control then occurs, such as outside the footprint of the building

VISUAL X-16

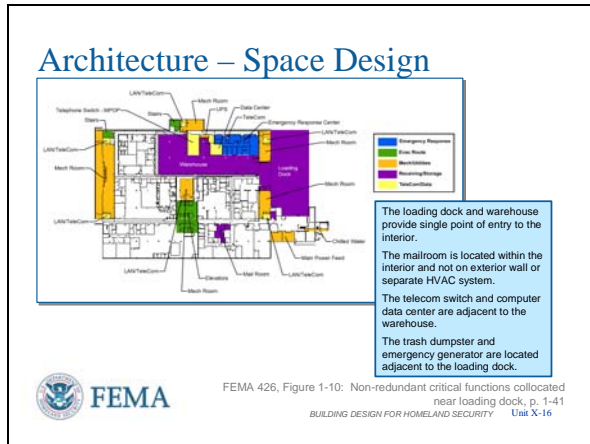


Architecture – Space Design

Functional Layout

Public areas such as the lobby, loading dock, mail room, garage, and retail areas need to be separated from the more secured areas of the facility. This can be done by creating internal “hard lines” or buffer zones, using secondary stairwells, elevator shafts, corridors, and storage areas between public and secured areas.

In lobby areas, the architect would be wise to consider the queuing requirements in front of the inspection stations so that visitors are not forced to stand outside during bad weather conditions or in a congested line inside a small lobby while waiting to enter the secured areas. Consider allowing enough lobby space for future inspection equipment.

VISUAL X-17

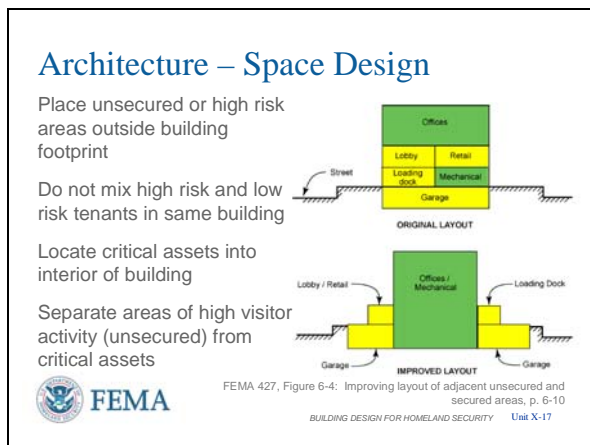

Architecture – Space Design


Structural Layout

Unsecured areas should be physically separated from the main building to the extent possible.

For example, a separate lobby pavilion or loading dock outside the main footprint provides enhanced protection against damage and potential building collapse in the event of an explosion. Similarly, placing parking areas outside the main footprint of the building can be highly effective in reducing the vulnerability to catastrophic collapse.

Mixed occupancies. High-risk tenants should not be housed with low-risk tenants. Terrorists may identify some targets based on their symbology, visibility, ideology, political views, potential for publicity, or simply the

VISUAL X-18

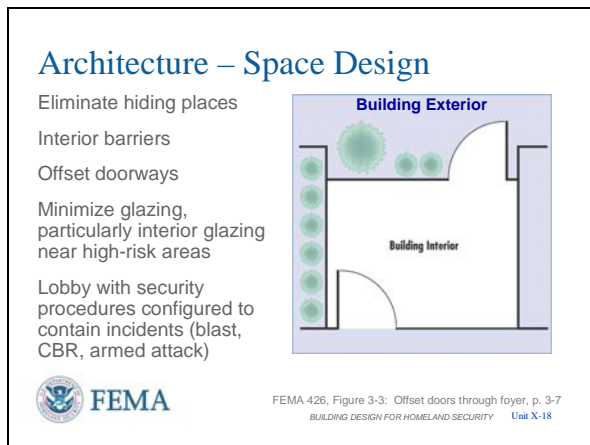

consequences of their loss. Low-risk tenants are then placed at higher risk due to proximity.

- However, if there are very few high-risk tenants among many low-risk tenants, then dispersal and devalue can be mitigation techniques.
- After Oklahoma City, day care centers (low-risk) are separated from the main building functions (high-risk) to reduce the risk to the day care centers. This has been done at the Pentagon, with a relatively minor decrease in convenience.

Architecture – Space Design

Design Measures

- Eliminate hiding places
Generally a good security idea, especially in any areas where few people may frequent, like stairwells or underground parking
- Interior barriers
Channel building staff and visitors to their respective areas and use interior barriers to provide separation between unsecure and secure areas
- Offset doorways
If an explosive blast breaches the first door in a foyer, the offset will provide additional protection to the next door -- less incident pressure striking the interior door due to swirling of the blast wave.
- Minimize glazing
Glass, unless hardened, adds to injuries during incidents. Reducing glazing is one approach, hardening is another, and proper placement is a third.
- Lobby design
While it is a given that security and access control should be in the lobby, but design should accommodate the occurrence of an incident within lobby – reversal of standard design pressures, containment of the event

VISUAL X-19

Architecture – Other Location Concerns

- Safe havens / shelters
- Office locations
- Public toilets and service areas
- Retail spaces
- Stairwells
- Mailroom



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-19

For additional information on safe havens, see **FEMA 453** (future) - *Multihazard Shelter (Safe Havens) Design*

inside the lobby without affecting the rest of the building, control of agents and toxic gases, and hardening against armed attack.

Architecture – Other Location Concerns

When designing high-risk buildings, engineers and architects should consider the following:

The innermost layer of protection within a physical security system is the **safe haven**. Safe havens are not intended to withstand a disciplined, paramilitary attack featuring explosives and heavy weapons. They are locations where sheltering-in-place for CBR, protection from natural hazards or bomb blast can occur.

Offices considered to be high risk (more likely to be targeted by terrorists) should be placed or glazed so that the occupants cannot be seen from an uncontrolled public area such as a street. Whenever possible, these spaces should face courtyards, internal sites, or controlled areas.

Public toilets and service areas, or access to vertical circulation systems (stairwells and elevators) should not be located in any non-secure areas, including the queuing area before visitor screening at the public entrance.

Retail and other mixed uses, which have been encouraged in public buildings by the Public Buildings Cooperative Use Act of 1976, create spaces that are open and inviting. Although important to the public nature of the buildings, the presence of retail and other mixed uses may present a risk to buildings and their occupants and should be carefully considered on a project-specific basis during project design. Consider allowing access to retail space only from the outside of the building and not between any interior spaces

or consider access configuration so that movement from retail spaces must go past security to get to the rest of the building.

Stairwells required for emergency egress should be located as remotely as possible from areas where blast events might occur and, wherever possible, should not discharge into lobbies, parking, or loading areas. When possible, emergency egress stairwells should be separate from the main building ingress stairwells, and secured to prevent individuals from accessing the secured floors of the building. Also do “What-If” as what would be done if a stairwell is lost as an egress during an incident.

Mailrooms should be located away from facility main entrances, areas containing critical services, utilities, distribution systems, and important assets. Avoid locating a mailroom in the same building as a child care center. In fact, the processing and inspection of mail and packages is best done in a separate building if possible. If an incident requires evacuation of the building, a separate building would limit the impact, vice a high-occupancy office building. Ditto, do “What-If” and plan alternatives.

Structural Systems

Progressive Collapse Design

Progressive collapse is a situation where local failure of a primary structural component leads to the collapse of adjoining members, which, in turn, leads to additional collapse. Hence, the total damage is disproportionate to the original cause. Progressive collapse is a chain reaction of structural failures that follows from damage to a relatively small portion of a structure. More information on progressive collapse can also be found in


VISUAL X-20

Structural Systems

Progressive Collapse Design

GSA Progressive Collapse Analysis and Design Guidance for New Federal Office Buildings and Major Modernization Projects

DoD Unified Facilities Criteria - Minimum Antiterrorism Standards for Buildings

BUILDING DESIGN FOR HOMELAND SECURITY Unit X-20

INSTRUCTOR NOTES

CONTENT/ACTIVITY

To minimize the potential for **progressive collapse**, designers should understand the following:


- The use of **redundant** lateral and vertical load paths is highly encouraged.
- Ductile materials are needed for both primary and secondary structural elements to be capable of deforming well beyond the elastic limit.
- Both the primary and secondary structural elements should be designed to resist load reversals.
- Primary structural elements should be able to resist shear failures by having flexural capacity greater than shear capacity.
- Fire protection should be applied to structural members to survive a worst-case fire duration allows fire fighters to control damage prior to initiation of structural collapse. Suggest reviewing the National Institute of Standards and Technology (NIST) report dealing with World Trade Center 7 (WTC 7) which collapsed due to fire.

FEMA 427, *Primer for Design of Commercial Buildings to Mitigate Terrorist Attacks*.

Buildings should be designed with the intent of reducing the potential for progressive collapse as a result of an abnormal loading event, regardless of the required level of protection.

- Primary structural elements are columns girders and roof beams that are the first items for design to prevent progressive collapse.
- Secondary structural elements, such as floor beams and slabs, also may contribute to progressive collapse. Of particular weakness to progressive collapse is flat slab construction where the floor is thickened in areas to substitute for beams in the interest of cost savings. Floor connections to columns are the concern in this type of construction. This has been a standard office building design for many years, but should not be used if progressive collapse is a concern.
- Primary nonstructural elements, such as ceilings and heavy suspended mechanical equipment, contribute to casualties but not progressive collapse.
- Secondary nonstructural elements, such as partitions, furniture, and light fixtures, like primary nonstructural elements, also contribute to casualties, but not progressive collapse.

VISUAL X-21

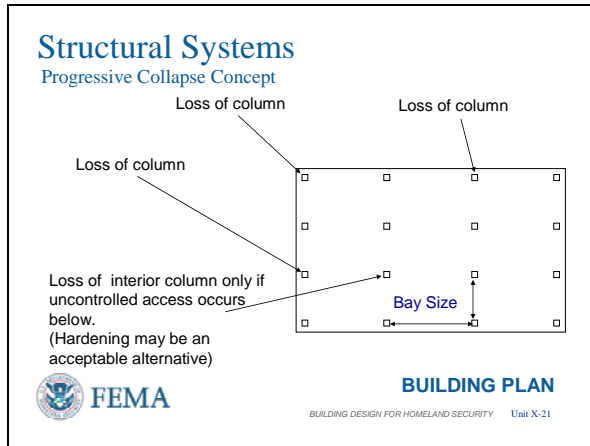

NOTE: The BAY SIZE is the distance between columns in the vertical and horizontal directions. The Bay Size can be identical or different in any part of the building and change between different parts of the building.

Structural Systems

Progressive Collapse Concept

The GSA and DoD require that the structural response of a building be analyzed in a methodology that removes a key structural element (e.g., vertical load carrying column, section of bearing wall, beam, etc.) to simulate local damage from any incident. If effective alternative load paths are available for redistributing the loads that was originally supported by the removed structural element, the building has a low potential for progressive collapse.

- If a column is lost, will the rest of the building still stand?
- If an exterior beam is lost, will the rest of the building still stand?
- If connections between column and floors are lost will the slenderized column still be able to carry the load or if the column fails, will the rest of the building still stand?
DoD criteria states that columns of high-occupancy buildings will remain standing if all the floor connections on a given floor connecting to that column are lost.

If the threat can get to an interior column or beam, the same questions apply, such as underground parking or a mailroom.

Note that the more complex the structure layout (differing from square or rectangle) the more components (columns and beams) that must be analyzed.

INSTRUCTOR NOTES

CONTENT/ACTIVITY


VISUAL X-22

Structural Systems -- Collapse

GSA and DoD criteria do not provide specific guidance for an engineering structural response model

These organizations are working toward Interagency Security Committee consolidated guidance

Owner and design team should decide how much progressive collapse analysis and mitigation to incorporate into design.




BUILDING DESIGN FOR HOMELAND SECURITY Unit X-22

Structural Systems -- Collapse

- Although these criteria provide specific guidance on which structural elements must be analyzed for removal from the structural design configuration, they do not provide specific guidance for choosing an engineering structural response model for verifying the effectiveness of alternate load paths.
- Unless a building is being designed to meet the GSA or DOD criteria, it is up to the owner and the design team to decide how much progressive collapse analysis and mitigation to incorporate into their design.
- Priority should be given to the critical elements that are essential to mitigating the extent of collapse. Designs for secondary structural elements should minimize injury and damage.
- Consideration should be given to reducing damage and injury from primary as well as secondary nonstructural elements.

Both GSA and DoD take a threat-independent approach to progressive collapse – it does not matter how the column or beam is damaged or removed, the intent is that the building will remain standing. However, the concept is a single structural member being removed – if the Design Basis Threat is large enough to damage two components simultaneously, then additional analysis would be needed.

VISUAL X-23

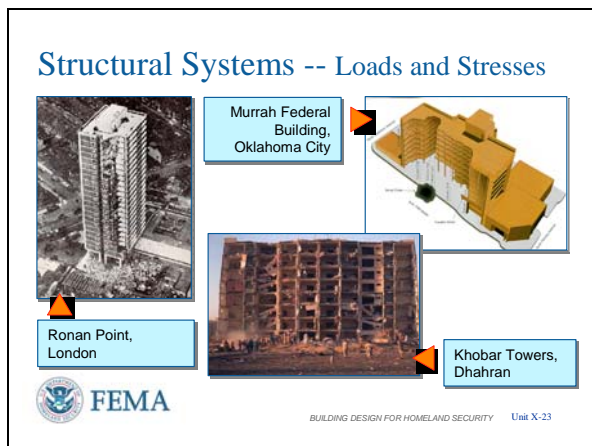

Ronan Point: On the morning of 16 May 1968, Mrs. Ivy Hodge, a tenant on the 18th floor of the 22 (24 in other reports) -story Ronan Point apartment tower in Newham, east London, struck a match in her kitchen. The match set off a gas explosion that knocked out load-bearing precast concrete panels near the corner of the building. The loss of support at the 18th floor caused the floors above to collapse all the way to the roof.

The impact of these collapsing floors set off a chain reaction of collapses almost all the way to the ground. The ultimate result can be seen in Figure 1: the corner bay of the building has collapsed from top to bottom. Mrs. Hodge survived but four others died.

Construction of Ronan Point primarily consisted of precast concrete panels. While this type of construction can be designed to avoid progressive collapse from abnormal loading conditions, Ronan Point lacked the connection details necessary to effectively redistribute load. The essential missing detail was reinforcement continuity between panels. Because of this, there was no mechanism in place for achieving effective alternate load

Structural Systems -- Loads and Stresses

The DoD designates the level of blast protection a building must meet based on how many occupants it contains and its function. The demands on the structure will be equal to the combined effects of dead, live, and blast loads. Blast loads or dynamic rebound may occur in directions opposed to typical gravity loads.

Ronan Point had a whole section of the building collapse due to load-bearing precast concrete panels in one apartment being lost. That incident changed the British Code to prevent similar occurrences.

Khobar Towers was designed to the British Code, and only the façade was lost.

The Murrah Federal Building was not designed to the British Code and the loss of one column then affected a transfer girder. There were discontinuities in columns across the lobby causing multiple columns to fail when the transfer girder became unsupported, resulting in load transfers that the building could not handle.

The minimum goal is to have continuous columns from foundation to roof. When assessing a building any discontinuity of columns is a flag indicated the need for further analysis.

INSTRUCTOR NOTES

CONTENT/ACTIVITY

paths once failure began to propagate.

Khobar Towers was built to the British Standard that was a result of Ronan Point.

The Murrah Building owner wanted no columns in the lobby, thus designer used transfer beams to carry the load of the upper columns.

VISUAL X-24

Structural Systems – Best Practices

Consider incorporating active or passive internal damping into structural system (sway reduction in high-rise)

Use symmetric reinforcement, recognizing components might act in directions opposite to original or standard design – flooring especially

Column spacing should be minimized (<=30 feet)



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-24

Structural Systems – Best Practices

The following guidelines are commonly used to mitigate the effects of blast on structures and to mitigate the potential for progressive collapse. These guidelines are not meant to be complete, but are provided to assist the designer in the initial evaluation and selection of design approaches. For example:

- Consider incorporating internal damping into the structural system to absorb the blast impact. Although mass has been the blast design approach in the past, using more ductile materials with damping is being investigated. Damping systems will most likely be found in high-rise buildings.
- The use of symmetric reinforcement can increase the ultimate load capacity of the structure. This is especially true for load reversals on floor slabs.
- A practical upper level for column spacing is 30 feet, but 20 feet is better. If the column is lost, the remaining beam must span 40 to 60 feet. Above 60 feet, the beam becomes unreasonably large and expensive. Note that the Murrah Building had 40-foot column spacing in the lobby.


VISUAL X-25

Structural Systems – Best Practices (cont.)

Stagger lap splices and other discontinuities and ensure full development of reinforcement capacity or replace with more flexible connections – floors to columns especially

Protect primary load carrying members with architectural features that provide 6 inches minimum of stand-off

Use ductile detailing requirements for seismic design when possible



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-25

Structural Systems – Best Practices (cont.)

- Lap splices must be upgraded from those found in conventional construction to handle the forces during a blast event. Consider interlocking “J” splices.
- By keeping a 6-inch stand-off from vertical load carrying members, a small weapons charge is less likely to shear the member.
- In many cases, the ductile detailing requirements for seismic design and the alternate load paths provided by progressive collapse design assist in the protection from blast.
- Ductility can be imbedded in the material, like steel reinforcing of concrete, or added to an existing component, like fragment-retention film on windows or spray-on truck bed liner on walls to strengthen weaker structures and catch fragmentation.

VISUAL X-26


Building Envelope

During actual blast or CBR event, building envelope provides some level of protection for people inside:

- Walls
- Windows
- Doors
- Roofs

Soil can be highly effective in reducing damage during an explosive event

Minimize “ornamentation” that may become flying debris in an explosion.



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-26

Building Envelope

General principles:

- The exterior envelope of the building is the most vulnerable to an exterior explosive threat because it is closest to the blast.
- The exterior envelope also impacts the infiltration of CBR agents into the structure, but tight building construction must be done in conjunction with other actions to ensure some level of protection
- Soil can be highly effective in reducing the impact of a major explosion by reducing fragmentation off walls and street furniture or directing a blast wave over a building.
- Minimize “ornamentation” that may become flying debris in an explosion.

VISUAL X-27

Building Envelope – Walls


Design should ensure a flexible failure mode

Resist actual pressures and impulses acting on exterior wall surfaces from design basis threats

Withstand dynamic reactions from windows and windows stay connected to walls

Use multiple barrier materials and construction techniques – composites can add ductility and strength at savings

As desired Level of Protection increases, additional mass and reinforcement may be required



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-27

This includes street furniture, overhangs, sculptures, etc.

Building Envelope – Walls

Ideally, the exterior walls need to be able to resist the loads transmitted by the windows and doors. It is not uncommon for bullet-resistant windows to have a higher ultimate capacity than the walls to which they are attached.

Beyond ensuring a flexible failure mode, design the exterior wall to resist the pressure levels of the design basis threat. Special reinforcing and anchors should be provided around blast-resistant window and door frames.

Deflections around certain members, such as windows, should be controlled to prevent premature failure. Additional reinforcement is generally required. Window frame deflection must not cause premature window glazing failure and window frame deflection must not differ greatly from the wall deflections. Seismic pinning of window frames may be required.

Poured-in-place reinforced concrete will provide the highest level of protection, but solutions like pre-cast concrete, reinforced CMU block, metal studs, and a combination of these may also be used to achieve lower levels of protection. Connections are the key, especially for pre-cast concrete curtain walls.

Retrofitting existing unreinforced masonry walls may consider steel plates, metal studs, reinforced concrete backing wall, high-strength fibers glued to the wall, or spray-on truck bed liner. If the wall is double-wythe (two wall system) – usually a brick exterior, air gap, and interior CMU block, consider

VISUAL X-28


Building Envelope – Best Wall Practices

Use symmetric reinforcement, recognizing that components might act in directions opposite to original or standard design

- Lobbies and mailrooms

Use wire mesh in plaster – reduces spalling / fragmentation

Floor to floor heights should be minimized (<=16 feet)



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-28

spraying vermiculite into the air gap to add mass and ductility.

When the design basis threat increases or the level of protection desired increases, the solution is more mass and more reinforcement to add ductility. Increasing the ductility of exterior walls along with mass are suitable ways to ensure blast pressure and fragmentation do not readily enter the building.

Building Envelope – Best Wall Practices

The following best practices are commonly used to mitigate the effects of blast on structures and to mitigate the potential for progressive collapse. These guidelines are not meant to be complete, but are provided to assist the designer in the initial evaluation and selection of design approaches. For example:

Just as mentioned with structural framing, symmetrical reinforcement adds strength to masonry and concrete walls, especially on the side away from the bomb where the reinforcement increases the tensile strength of the concrete. Thus, for lobbies and mailrooms the bombs can be exterior (where standard design places wind loading, rain, snow, and flying debris) or interior, so the symmetric reinforcement adds strength to the wall in either direction.

Wire mesh keeps plaster together, adds tensile strength, reduces spalling of the plaster, and assists in keeping fragmentation from entering the room (plaster or otherwise).

In general, floor to floor heights should be minimized. Unless there is an overriding architectural requirement, a practical limit is generally less than or equal to 16 feet. Consider bond beams (which connect

INSTRUCTOR NOTES

CONTENT/ACTIVITY

VISUAL X-29

Building Envelope – Best Wall Practices (cont.)

Connect façade from floor slab to floor slab to avoid attachments to columns (one-way wall elements)

- Limits forces transferred to vertical structural elements

No unreinforced CMU – use fully grouted and reinforced construction



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-29

columns at about the mid-point between floor or run across the top of doors and windows), as used in seismic zones, to reduce the effective height of the wall. Since the walls are connected to the floor above and below, the shorter the wall height the stronger the wall all other things being equal.

Building Envelope – Best Wall Practices (cont.)

Additional best practices include:


The reason why the walls are connected to the floor above and the floor below is to ensure there is no direct loading on the columns. Since the walls are only pinned at the top and the bottom this is called one-way. If they were also pinned to the columns on each side they would be two-way wall elements. Good blast design seeks to keep the structural framing as the absolute last component of the building to fail, thus the use of one-way wall elements.

Avoid the use of unreinforced masonry when blast is a threat. Masonry walls break up readily and become secondary fragments during blasts. Grout (mass) and reinforcement (ductility) are definitely required for blast resistance. The Ufundi building next to the Kenya embassy was all unreinforced brick and the bomb blast toppled the whole building.

VISUAL X-30

Building Envelope – Windows
Balanced Window Design

- Glass strength
- Glass connection to window frame (bite)
- Frame strength
- Frame anchoring to building
- Frame and building interaction



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-30

Building Envelope – Windows

Window systems on the exterior façade of a building should be designed to mitigate the hazardous effects of flying glass during an explosion event. Designs should integrate the features of the glass, connection of the glass to the frame (bite), and anchoring of the frame to the building structure to achieve a “balanced design.” This means all the components should have compatible capacities and theoretically would all fail at the same pressure-pulse levels. In this way, the damage sequence and extent of damage are controlled.

Ultimately, in a “balanced” design, the order of failure should be:

- Glass
- Window frame and frame anchoring
- Wall
- Building structural framing


The pressure differences should not be large and the Level of Protection for the Design Basis Threat should be met.

VISUAL X-31


Building Envelope – Windows

Glass (weakest to strongest)

- Annealed (shards)
- Heat Strengthened (shards)
- Fully Thermally Tempered (pellets)
- Laminated (large pieces)
- Polycarbonate (bullet-resistant)



“Balanced Design”



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-31

Building Envelope – Windows

Five types of glass are commonly used in window glazing systems: annealed glass, heat strengthened glass, fully thermally tempered, laminated glass, and polycarbonate. Other types of glass materials exist, but are not commonly used in typical commercial window systems. Of the five common types, **annealed glass** and **fully thermally tempered glass** are the type of windows for most office buildings.

Annealed glass, also known as float, plate, or sheet glass, is the most common glass type used in commercial construction. Annealed

INSTRUCTOR NOTES

CONTENT/ACTIVITY

glass is of relatively low strength and, upon failure, fractures into razor sharp, dagger-shaped fragments (see slide -- the right photo is annealed glass failing during an actual explosive test and the left photo is a close-up of the shards). Annealed glass breaks at about 0.2 psi (incident pressure).

Heat strengthened glass (HS), also known as double strength glass, is used where wind loading starts becoming a problem. It breaks like annealed glass, but at about 0.4 psi (incident pressure).


Fully thermally tempered glass (TTG) is typically four to five times stronger than annealed glass. Instead of shards, TTG breaks into pellets that can be stopped by a regular suit coat. It breaks at about 0.8 psi (incident pressure).

Laminated glass is a pane with multiple glass layers and a pliable interlayer material (usually made from polyvinyl butyral (PVB)) between the glass layers. This interlayer should have a thickness of 30 mils [30 thousandths of an inch] (minimum) or 60 mils (recommended). Do not use an interlayer of 15 mils.

Thermoplastic polycarbonates are very strong and suitable for blast- and forced entry-resistant window design. They are usually laminated in 3 or more layers with glass on the outside to prevent environmental degradation of the plastic (yellowing) and to aid in cleaning (avoid scratches).

Wire-reinforced glass is a common glazing material. It consists of annealed glass with an embedded layer of wire mesh. It is usually used for fire resistance and as a forced entry barrier. It is not recommended for blast design.

VISUAL X-32

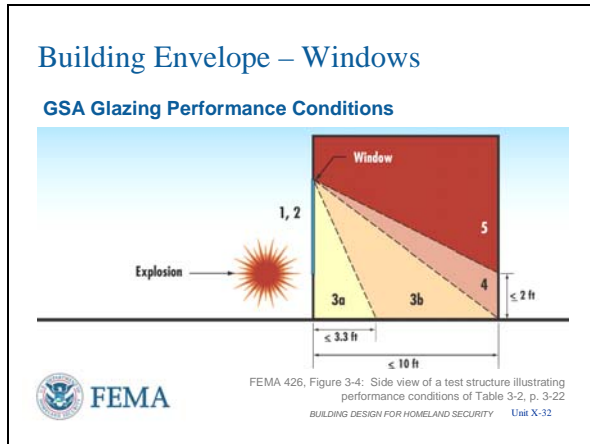


Building Envelope – Windows

GSA Glazing Performance Conditions

Table 3-1, page 3-21, in FEMA 426 presents six GSA glazing protection levels based on how far glass fragments would enter a space and potentially injure its occupants (known as a flight model). This slide depicts how far glass fragments could enter a structure for each GSA performance condition. The divide between performance conditions 3a and 3b can be equated to the “threshold of injury.” The divide between performance conditions 4 and 5 can be equated to the “threshold of lethality.” A person standing in the room has a potential of being hit in the upper body/head area by glass fragments that are traveling fast enough to penetrate the body.

The GSA glazing performance conditions shown will correlate with the DoD levels of protection presented in **Table 3-2, page 3-22, in FEMA 426** as shown previously in Unit VII, Explosive Blast.

VISUAL X-33

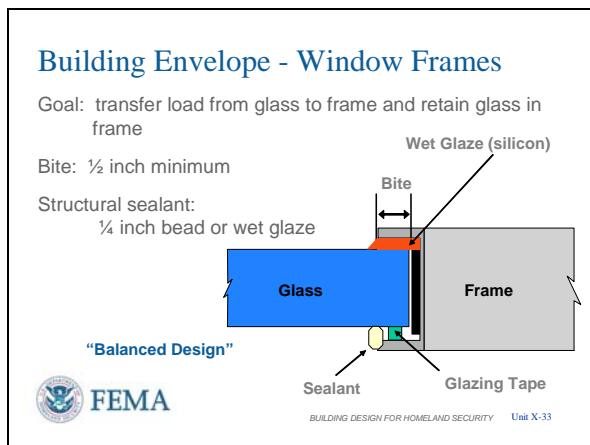


Building Envelope -- Window Frames

Window frames need to retain the glass so that the entire pane does not pull out (glass flexes and can pull out of frame during the blast) and also should be designed to resist the breaking stress of the window glass.

The window bite (i.e., the depth of window captured by the frame) needs to be at least 1/2 inch. DoD criteria call for a minimum 3/8-inch bite if silicon sealant is applied, but call for a 1-inch bite if no silicone sealant is used. Butt-glazed strip windows can require even more bite with or without sealant, since there is bite only on the top and bottom of the window.

VISUAL X-34

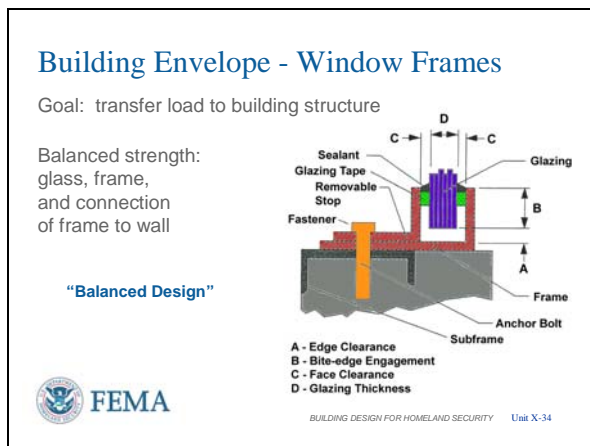

To retain the glass in the frame, a minimum of a ¼-inch bead of structural sealant (i.e., silicone or polyvinyl butyral) should be used around the inner perimeter of the window. This should be done on all four sides of the window. Since strip windows with butt glazing can only apply sealant on the top and bottom, they are not good options for blast as the bite must be large, even with sealant.

Window Frames

The frame must not flex during the blast loading and cause the glass to pop out.

The blast loading across the glass and frame now transfers to the frame connections to the building. These connections must handle the shear and tensile stresses and the bending moments of the connection design.

The frame members connecting adjoining windows are referred to as mullions. These members may be designed using a static approach when the breaking strength of the window glass is applied to the mullion, or a dynamic load may be applied using the peak pressure and impulse values. Because mullions only connect at their top and bottom ends to the building structure, the mullion must handle the transferred blast loading from both adjacent windows.

Other considerations for windows must balance the amount of light, energy conservation, noise transmission, venting of fumes, and emergency egress in addition to blast response and CBR protection.

VISUAL X-35

Building Envelope - Fragment Retention Film



Clear tough polyester film attached to inside of glass surface with strong pressure-sensitive adhesive


Also known as shatter-resistant film, safety film, or protective film

Relatively low installation costs

Level of protection varies with thickness of film and method of installation

Limited life for FRF



 FEMA

BUILDING DESIGN FOR HOMELAND SECURITY Unit X-35

When obscuration of rooms cannot be handled by site and layout design, one alternative is to install glazing with mirrored finishes or add fragment retention film that is mirrored. This works fairly well with single pane windows, but double pane windows may overheat with the mirrored fragment retention film – consult window manufacturer if there is a question. Realize, however that the mirrored finishes work best during daytime ambient light (room light less bright compared to ambient light). At night time or on overcast days, observation into the room is possible if interior lights are on. Shades or Venetian blinds can provide obscuration during low ambient light.


Building Envelope – Fragment Retention Film (FRF)

Another treatment used for mitigating the effects of an explosive attack is **security window film**. The polyester film used in commercial products is commonly referred to as fragment retention film (FRF), safety film, security film, protective film, or shatter-resistant film. These films adhere to the interior surface of the window to provide fragment retention and reduce the overall velocity of the glass fragments at failure. The film greatly increases the tensile strength of thin annealed glass and limits the deflection of the glass under blast loading.

Fragment retention film combines a strong pressure sensitive adhesive with a tough polyester layer. It should be limited to use in retrofit applications due to degradation of the film and adhesive by ultraviolet light. Do not use for new construction and it is of little to negative benefit on thicker, higher strength glass. For example, applying FRF to 3/8-inch thermally tempered glass will INCREASE the stand-off required for a given bomb size as the film will hold the glass together, acting like a sail and increasing the distance that the glass will fly into the test room.

Note that fragment retention film can be justified for multiple reasons – blast protection, physical security (smash and grab), and energy conservation (mirrored or tinted). Thus, justification can be based upon the multiple benefits derived for little difference in cost.

VISUAL X-36

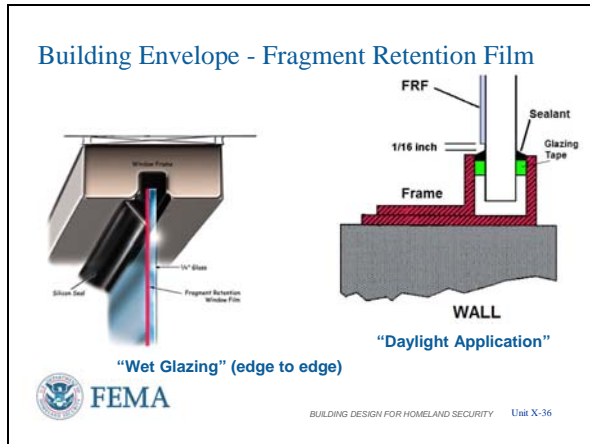

Building Envelope – Fragment Retention Film

Fragment retention film behaves similarly to relatively thin laminated and polycarbonate glazing in terms of fragmentation. It is available in common thicknesses of 2, 4, 7, and 10 mils. Also found up to 15 mils. The Navy recommends 10 mils.

Fragment retention film improves the performance of the glass under blast loading to varying degrees, depending on the thickness, quality, and type of film installation. Note a daylight application will leave a 1/16 inch space around the edge of the FRF where water used to apply the FRF is squeegeed out. Daylight application of FRF to very thin glass can reduce the stand-off distance in half for a given level of protection. The best performance is achieved when the film is installed into the bite of the glazing or is connected to the frame (mechanically or with chemical sealants).

Fragment retention film can also be purchased with tinted, mirrored, or solar versions that provide energy conservation benefits when using air conditioning.

VISUAL X-37


Building Envelope - Blast Curtains


Invented by British during WW II

Kevlar curtains

Allow venting of blast wave while "catching" fragments

May be augmented with FRF



 FEMA

BUILDING DESIGN FOR HOMELAND SECURITY Unit X-37

Building Envelope – Blast Curtains

- Can now see out of these curtains as opposed to the “blackout” curtains from WWII -- uses Kevlar or other high strength fibers. In fact it is easier to see out of sheer black curtains than sheer white curtains.
- They allow venting of the blast wave while “catching” glass fragments
- May be augmented with FRF (British only specify them with FRF)
- Connections of curtains or blast shields to building frame are critical.


VISUAL X- 38


Building Envelope - Catch Bar

Must be centered on window and window panes

FRF must be thick enough to hold the fragments (= 7 mil)

Laminated glass should have 60 mil interlayer

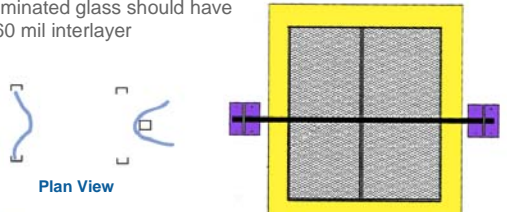

 FEMA

FEMA 427, Figure 6-7: Safe laminated glass systems and failure modes, p. 6-29

BUILDING DESIGN FOR HOMELAND SECURITY Unit X-38

Building Envelope – Catch Bar

Increased safety for fragment retention can be obtained in the event of catastrophic failure from an explosive blast by placing a decorative catch bar or grillwork on the interior of the glazing. Note, catch bars must be mounted across the center of mass of each window pane (vision area of glass) to be effective. A catch bar is ineffective with 4 mil FRF as the FRF will just tear (shear) on the catch bar. This is also another reason why the Navy recommends 10 mil.

Catch bars are usually considered with a retrofit of fragment retention film to not only catch the glass, but also catch the existing window frame that may not be adequately connected to the wall. They can also be considered for laminated glass.

INSTRUCTOR NOTES

CONTENT/ACTIVITY

VISUAL X-39

Building Envelope – Best Window Practices

- No windows adjacent to doors
- Minimize number and size of windows - watch building code requirements
- Laminated glass for high-occupancy buildings
- Stationary, non-operating windows, but operable window may be needed by building code
- Steel versus aluminum window framing



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-39

Building Envelope – Best Window Practice

Windows adjacent to doors allow easy access to the locking mechanism on the door by just breaking the window and reaching in.


Smaller windows are stronger against blast for a given window material and less expensive as well. Using fewer windows also reduces cost. However, building codes may specify the square footage of windows required based upon the total square footage of the floor level the windows are on.

Laminated glass is required for high-occupancy buildings by DoD. For life cycle costing and blast resistance, especially at the lower end of weapon yield, laminated glass is the best choice.

Life safety/fire codes may require operable windows as an escape route in certain occupancies (dormitories, for example). Recommend sliding or swing-out windows for better blast performance.

Heavy duty aluminum frames have performed well, although steel should be specified if design basis threat is large.

VISUAL X-40

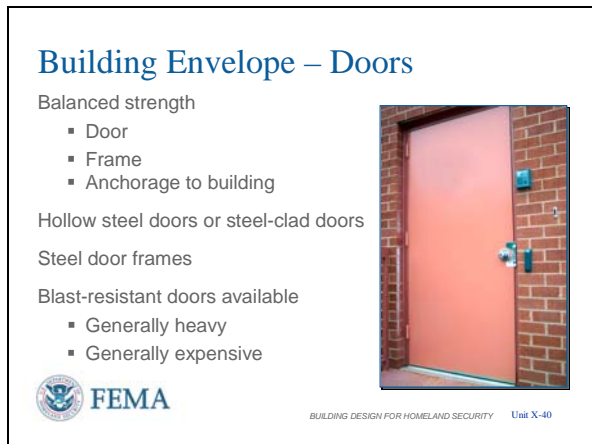

Building Envelope – Doors

A door system includes the door, frame, and anchorage to the building. As part of a balanced design approach, exterior doors in high risk buildings should be designed to withstand the maximum dynamic pressure and duration of the load from the design threat explosive blast. Other general door considerations are as follows:

Provide hollow steel doors or steel-clad doors with steel frames.

Provide blast-resistant doors for high threats and high levels of protection.

Limit normal entry/egress through one door, if possible.

Keep exterior doors to a minimum while accommodating emergency egress.


Ensure that exterior doors open outward from inhabited areas. If inward opening the locking mechanism must handle the blast loading [A 3 foot by 7 foot door has $3 \times 7 \times 144 = 3,024$ square inches of surface area. A reflected blast pressure of 2 psi puts 3 tons of force on that locking mechanism.] If outward opening the whole door frame takes the blast loading.

Replace externally mounted locks and hasps with internally locking devices because the weakest part of a door system is the latching component.

Install doors, where practical, so that they present a blank, flush surface to the outside to reduce their vulnerability to attack.

Locate hinges on the interior or provide concealed hinges to reduce their vulnerability to tampering. [Ask students if they see anything wrong with the door in the photo – exterior hinges. However, there is a balanced magnetic switch on the inside of the door connected to the security alarm which mitigates the

VISUAL X-41

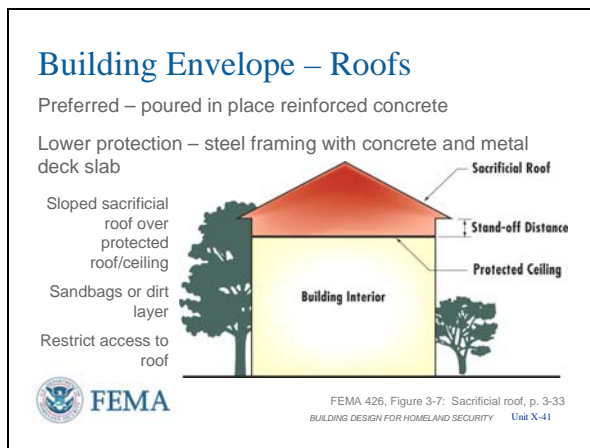

exterior hinges.
Install emergency exit doors so that they facilitate only exiting movement.
Equip any outward-opening double door with protective hinges and key-operated mortise-type locks.
Provide solid doors or walls as a backup for glass doors in foyers.

Building Envelope – Roofs

For an explosive threat, especially for thrown explosives (e.g., satchels, hand grenades, and even mortars), the primary loading on the roof is downward over-pressure. The stand-off to the protected ceiling provides the protection. The sloped roof tends to cause the explosive to roll off and away from the building. For explosions at ground level, secondary loads include upward pressure on the protected ceiling and roof due to the blast penetrating through openings and upward suction during the negative loading phase. The upward pressures may have an increased duration due to multiple reflections of the air blast internally. It is conservative to consider the downward and upward loads separately.

The preferred system is to use poured-in-place reinforced concrete with beams in two directions. If this system is used, beams should have stirrups along the entire span spaced not greater than one half the beam depths. Steel pan formwork provides additional protection as the formwork mitigates falling debris, but since load reversals may occur, the concrete in the steel pan formwork should have steel in both faces (symmetrical reinforcement).

Less desirable systems include metal plate systems without concrete, and precast and pre/post tensioned systems.

INSTRUCTOR NOTES

CONTENT/ACTIVITY

Precast roof panels are problematic because of the tendency to fail at the connections, like pre-cast curtain walls.

Pre/post tensioned systems tend to fail in a brittle manner if stressed beyond their elastic limit and they also are not able to accept upward loads without additional reinforcement.

Standard construction found in the Middle East, for example, uses soil/dirt as insulation in the roof at a thickness of 18 inches or so. The soil is placed on a waterproofed concrete poured-in-place deck and covered with 1-meter square concrete panels that are waterproofed and sloped to roof drains. With two layers of standard sand bags (about 8 inches in total deep) on top, this roof, has a high level of protection.

Many conventional roof designs will provide a suitable blast response for most buildings, considering minimum Design Basis Threats. The intent here is to point out what roofs may be a problem and why. For higher Design Basis Threats and tactics involving the roof, the protected ceiling and sacrificial roof concept applies.

INSTRUCTOR NOTES


CONTENT/ACTIVITY

VISUAL X-42

Utility Systems

Building Service

- Electric – commercial and backup
- Domestic water
- Fire protection water
- Fuel – coal, oil, natural gas, or other
- Steam heat with or without condensate return
- Hot water heat



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-42

Utility Systems

Building Service

While Utility Systems are first and foremost considered under Site and Layout Design, they have a direct impact on the building envelope based upon where and how they enter the building to provide service to that structure. While most will think of what is brought into a building, it is equally important to note what needs to be taken out of the building to maintain function and operation.


For example, steam heat may be provided by a central boiler plant on the site/campus that requires condensate to be returned for energy efficiency. But steam heat purchased from a commercial steam heat company in an urban environment is usually dumped to drain to prevent contaminants beyond the steam heat company's control from fouling their boilers.

VISUAL X-43

Utility Systems

Building Service (cont)

- Sewer – piping and sewage lift stations
- Storm drainage
- Information
- Communications
- Fire alarm
- Security systems and alarms



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-43

Utility Systems

Building Service (cont.)

Thus, anything feeding into and out of the building should be considered due to its impact on the building envelope and building operations if damaged.

For example, water service into a building balances against sewer service to get it out of the building. A sewage lift pump or station that is not on backup power results in raw sewage backing up into the building.

VISUAL X-44

Utility Systems

Entrances


- Proximity to each other
- Aboveground or underground
- Accessible or secure

Delivery capacity

- Separate
- Aggregate

Storage capacity

- Outage duration
- Planned or historical



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-44

Utility Systems

Service entrances of utilities into buildings take on the following concerns:

- Reduce the number of utility openings, manholes, tunnels, air conditioning ducts, filters, and access panels into the structure. Balance this with having two well separated service entrances for each utility.
- Proximity: How close are the service entrances to each other and can a single event affect more than one utility – for example all utilities entering along the loading dock ramp because the utility room is adjacent or underneath the loading dock.
 - Locate utility systems away from likely areas of potential attack, such as loading docks, lobbies, and parking areas. The alternative is hardening.
- Above or below ground: Below ground is preferred, but gas meters and pressure regulators, electric meters and transformers, and tankage may be aboveground. By building code gas lines must come above ground before entering a building to prevent gas leaks from following the piping into the building and reaching explosive concentrations in a basement.
- Can someone outside the building access the utility where it enters the building or use it as a way of getting into the building?
 - Use lockable systems for utility openings and manholes where appropriate. Infrequently used utility covers/manholes can be tack-welded as an inexpensive alternative to locking tamper-resistant covers.

Delivery capacity is an operational consideration before and after an incident:

INSTRUCTOR NOTES

CONTENT/ACTIVITY

VISUAL X-45


Mechanical & Electrical Systems


Functional layout – physical separation or hardening

Structural layout – systems installation

Do not mount utility equipment or fixtures on exterior walls or mailrooms

Avoid hanging utility equipment and fixtures from roof slab or ceiling



 FEMA

BUILDING DESIGN FOR HOMELAND SECURITY Unit X-45

- Will each service entrance handle 50% of the total building needs or 100% (like hospitals require for electric service). Emergency operations plans should consider all contingencies for losing either or both service entrances for each given utility.

Storage capacity is a concern during:

- Evacuation (i.e., How long will the emergency lighting system continue to operate?)
- Orderly shutdown of a computer system (battery backup for uninterruptible power supply)
- Continued operations (fuel stored for emergency generator use to last as long as historically longest commercial outage or until contingency contracts in place can refuel the generator on an acceptable schedule).

Mechanical and Electrical Systems

The major security functions of an electrical are to maintain power to essential building services, provide lighting and surveillance to deter criminal activity, and provide emergency communications.

The primary goal of a mechanical and electrical system after a terrorist attack should be to continue to operate key life safety and evacuations systems.

The following suggestions attempt to protect the mechanical and electric systems during an explosive blast event:


- Do not mount plumbing, electrical fixtures, or utility lines on the inside of exterior walls, but, when this is unavoidable, mount fixtures on a separate wall at least 6 inches from the exterior wall face.


VISUAL X-46

Mechanical & Electrical Systems

Overhead components, architectural features, and other fixtures > 14 kilograms (31 pounds), especially in occupied spaces

- Mount to resist forces 0.5 x W in any direction and 1.5 x W in downward direction (DoD Unified Facilities Criteria)
- Plus any seismic requirements



 FEMA

BUILDING DESIGN FOR HOMELAND SECURITY Unit X-46

- Avoid suspending plumbing fixtures and piping from the ceiling or roof slab. Remember the upheaval if the blast wave gets inside the building.
 - The roof slab is part of the building envelope.
 - The ceiling is less sturdy than the floor above.
- When the above cannot be done, add ductility, additional supports, and hardening to achieve some level of protection.

Mechanical and Electrical Systems

Nonstructural Elements

False ceilings, light fixtures, Venetian blinds, ductwork, air conditioning components, and other equipment may become flying debris in the event of an explosion once the building envelope is breached. Marques and other exterior nonstructural elements must also be considered since upward blast pressure will be much greater.

Wherever possible, it is recommended that the design be simplified to limit these hazards. Placing heavy equipment such as air conditioners near the floor rather than the ceiling is one idea; using curtains rather than Venetian blinds, and using exposed duct work as an architectural device are others.

When using seismic requirements added to the above will require about a Seismic Zone 4 (old system) [highest level] design. For example, 30 years ago 2-foot 4-foot light fixtures in drop ceilings required additional support (other than the drop ceiling support) on two opposing corners using 9-gauge wire. Seismic Zone 4 would consider threaded rod on all four corners to satisfy the requirement.

INSTRUCTOR NOTES

CONTENT/ACTIVITY

VISUAL X-47



Mechanical and Electrical Systems

Distribution – similar to comments about utility systems previously

- Multiple risers and looping on each floor with isolation valving or switches adds redundancy
- As high voltage and low voltage electricity is separated from communications circuits due to capacitive coupling and fault tolerance situations, other systems should not share the same pipe chases or provide vertical separation to overcome secondary effects of leakage.

Locations of emergency equipment also figure into redundancy:


- Locate components in less vulnerable areas such as away from loading docks, entrances and parking. Seek 50-foot separation as a minimum.
- Placing emergency switchgear and commercial switchgear in the same room allows one event in either system to affect the other.
- Fuel tanks should be mounted near the emergency generator(s) and be given the same protection as the generator. Separating them puts the fuel distribution at greater risk due to the distance of the separation.
- If an emergency generator cannot be justified, consider running conduits with conductors through a manual transfer switch to a quick disconnect on the outside of the building. A rental generator / company can be prearranged to provide rapid backup power as required without major rewiring. This would be equivalent to a Siamese water connection for fire fighting.
- Similarly, placing electric fire pumps and diesel fire pumps side-by-side allows one event to affect both primary and backup

VISUAL X-48

Mechanical & Electrical Systems

Restrict access - locks / alarms / surveillance

- Utility floors / levels
- Rooms
- Closets
- Roofs
- Security locks/interlocks comply with building code
- Building information
- Also consider for other systems



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-48


VISUAL X-49

Mechanical & Electrical Systems

Building lighting and CCTV compatibility

- Intensity
- Resolution
- Angle
- Color

Exit lighting – consider floor level, like airplanes
Emergency lighting – battery packs have their place



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-49

systems. The event is not just loss of commercial power.

Mechanical and Electrical Systems

Restrict Access

- Physical security for utility rooms, closets, etc., should be implemented to prevent tampering with the systems and to prevent the direct introduction of hazardous materials into heating, ventilating, and air conditioning (HVAC) ducts that distribute air to portion(s) of the building.
- Public access to building roofs should be prevented. Access to the roof may allow entry to the building and access to air intakes and HVAC equipment (e.g., self-contained HVAC units, laboratory or bathroom exhausts) located on the roof.
- Access to information on building operations (including mechanical, electrical, vertical transport, fire and life safety, security system plans and schematics, and emergency operations procedures) should be strictly controlled.

Mechanical and Electrical Systems

Closed circuit television/security cameras and building lighting must be worked as a system to ensure compatible operation:

- The intensity, angle, and color of the lighting affect camera resolution, including low-light and infra-red
 - Detection for response versus identification for police/legal action
- Exit lighting has traditionally been at top of door level shining downward to floor or along halls. After incidents smoke, heat, and toxic fumes are normally lighter than air so traditional exit lighting is obscured. Putting exit lighting at floor level works whether walking upright or crawling.


INSTRUCTOR NOTES

CONTENT/ACTIVITY

VISUAL X-50

Mechanical & Electrical Systems
Ventilation and Filtration – HVAC Control Options

- Building specific
- System shutdown – configuration and access
 - HVAC fans and dampers
 - Include 24/7 exhausts, i.e. restrooms
- Zone pressurization
 - Doors and elevator use
 - Shelter-in-place



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-50

- Emergency lighting from a distribution system with central batteries and backup generator is one design approach, but distributed emergency lighting with self-contained battery packs along the egress route ensures operation during a wider range of potential incidents. Do not forget restrooms in the emergency lighting scheme.

Mechanical and Electrical Systems

Ventilation and Filtration – HVAC Control Options

Available options are specific to the building as HVAC equipment and configuration, building functions, continuing operations, and other factors affect what can be done.

- HVAC control may not be appropriate in all emergency situations. Protection from CBR attacks depends upon the design and operation of the HVAC system and the nature of the CBR agent release.
 - Ducted returns (vice using hallways as returns) offer limited access points to introduce a CBR agent. The return vents can be placed in conspicuous locations, reducing the risk of an agent being secretly introduced into the return system.
 - Large buildings usually have multiple HVAC zones, with each zone served by its own air handling unit and duct system.
- Complete system shutdown of all HVAC systems is the simplest initial approach to handle either external or internal releases
 - Since speed is critical, a single shutdown point is desirable, but the larger the system(s) the difficult this becomes.
 - A rapid response may involve closing various dampers, especially those

INSTRUCTOR NOTES


CONTENT/ACTIVITY

- controlling the flow of outdoor air (in the event of an exterior CBR release).
- Consideration should be given to installing low leakage dampers to minimize this flow pathway.
 - Must include all air handling systems, such as restroom exhausts that run continuously.
 - If zone pressurization is designed into the system (for fire fighting as an example, where the fire floor is ventilated to remove heat and adjacent areas are overpressurized to keep smoke and gases contained), then realize that opening and closing doors or operating elevators will change the zone pressurization being attempted.
 - Even without zone pressurization, opening and closing doors and operating elevators will affect the flow of air and spread smoke, toxic fumes, and CBR agents within the building.
 - Consider “shelter-in-place” rooms or areas where people can congregate in the event of an outdoor release and, in some cases, indoor releases.
 - Without pressurization the goal is to create areas where outdoor air infiltration is very low.
 - With pressurization requires a filtered air supply from an installed or portable unit with filters suitable for the agent released.

VISUAL X-51

Mechanical & Electrical Systems
Ventilation and Filtration – HVAC Control Options

- Specialized exhaust for some areas – i.e., lobbies and mailrooms
 - Air purge (e.g., 100 percent outside air if internal release)
 - CBR filters to trap and prevent spread elsewhere
- Pressurized egress routes (may already exist)
 - Filtered air supply or shutdown if release external

 FEMA

BUILDING DESIGN FOR HOMELAND SECURITY Unit X-51

Mechanical and Electrical Systems

Ventilation and Filtration – HVAC Control Options

- To prevent widespread dispersion of a contaminant released within lobbies, mailrooms, and loading docks, their HVAC systems should be isolated and the areas maintained at a negative pressure relative to the rest of the building, but at positive pressure relative to the outdoors.
 - Air purge is suitable for removal of smoke and toxic fumes from fire or explosive blast
 - If a CBR release, an air purge would not be suitable as it would just spread the agent vice controlling it unless CBR filters installed on exhaust to trap the agents and prevent spreading them.
 - Another consideration is glazing in these areas.
 - If not hardened, then windows will be blown out during an internal blast which lessens the need for air purge. This is a good design example for a frangible panel that vents pressure and reduces pressure on the walls shared by the rest of the building.
 - If hardened, then smoke and gases are trapped and air purge is beneficial. However, all walls will require additional hardening because of the increased internal blast pressures.
- Egress routes (stairwells) are normally pressurized to prevent smoke from internal fire from entering the stairwells. An external CBR release would be pulled into the stairwells by this system. Thus, either the pressurization system must be turned off during an external release or a filtering

VISUAL X-52

Plumbing and Gas Systems

Same considerations as electrical and mechanical systems

Added concern is fuel distribution

- Heating sources / open flames / fuel load

Interaction with other systems during an incident

- Fuel versus alarms / electric / fire protection water / structure
- Water versus electronic / electric



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-52

system must engage to provide clean air to the stairwells.

Plumbing and Gas Systems

All systems distributed throughout the building have similar consideration. There are other concerns based upon “What-If” scenarios, such as leaks occurring in plumbing or gas systems.


- Look at the physical relationship between the systems (which also includes utilities as they enter the building)
 - Will a leak in a fuel system reach a heat source and will the fuel distribution system aid in spreading the fire throughout the building?
 - Will leaks from water or fuel systems fall upon electrical systems and equipment?
 - For example, standard underground construction always puts water systems above sewer systems so that a sewer leak will have less chance of contaminating the water system.
 - Additionally, are flammable systems like fuel/natural gas separated from mass notification/communication systems so that an initial fire incident does not disable the mass notification system?

VISUAL X-53

Fire Alarm Systems

Considerations similar to information and communications systems, but tighter building codes

- Centralized or localized
- Fire alarm panel access for responding fire fighters or fire control center
- Interaction with other building systems
 - Telephone / IT
 - Energy management
 - HVAC controls
- Off-premises reporting and when

 **FEMA**

BUILDING DESIGN FOR HOMELAND SECURITY Unit X-53

Fire Alarm Systems

Similar concerns as with communications systems to be covered next, but building codes based upon National Fire Protection Association standards are more prescriptive

- First alarm to evacuate, then call the fire department
 - If localized, alarm bells sound to evacuate the building, then automatically calls fire department
 - If centralized (hotels for example), a response would verify fire before sounding evacuation and calling fire department from manned location
- Fire alarm panels are normally near main entrances of buildings so first responder fire fighters can determine which zone of the building alarmed if fire location is not obvious
 - Fire control centers are normally manned and fire department should know where they are located
- Interaction with other systems should confirm wiring of the fire alarm system, whether it is combined with any other system for information flow, and whether or not an alarm activation also initiates actions through other systems, like energy management, SCADA (Supervisory Control and Data Acquisition), or HVAC controls.
- Finally, as explained above, how is off-premises reporting done – direct telephone line to fire department, reporting to a commercial central security/fire company who contacts the fire department, centralized system manned in building which then triggers a call to the fire department or calls 911, autodial to someone else, etc.

VISUAL X-54

Communications - Information Technology Systems
Looped versus radial distribution

Redundancy

- Landline, security, fire watch
 - Copper
 - Fiber optics
- Cell phones (voice, walkie-talkie, text)
- Handheld radios / repeaters
- Radio telemetry / microwave links
- Satellite



Mass notification

- Loud speakers
- Telephone hands-off speaker
- Computer pop-up
- Pager

 FEMA

BUILDING DESIGN FOR HOMELAND SECURITY Unit X-54

Communications – Information Technology Systems

Distribution considerations are the same as for other systems, especially to ensure some communications capability if an incident affects communication lines

- **Redundancy** is always a consideration and technology selected has pros and cons
 - Copper easier to tap through electromagnetic signals
 - **Cell phones** get tied up during major incidents, especially analog voice (which locks bandwidth), but walkie-talkie and text features on phones or Blackberrys use packet transmission when bandwidth is available so there is more capability as found during Hurricane Katrina
 - **Handheld radios** have blind spots both in dispersed campuses and high-rise buildings, necessitating use of repeaters or distributed antennas to maintain coverage. Consider a base radio communication system with antenna(s) installed in stairwells, and portable sets distributed on floors.
 - **Alarm and information systems.** Should not be collected and mounted in a single conduit, or even collocated. Circuits to various parts of the building should be installed in at least two directions and/or risers
 - **NOTE:** The red phone shown is a telephone connected to the local telephone company and powered by the telephone company. It is the backup to VOIP phones throughout the campus.
- Mass notification to building occupants can take many approaches, but must ensure system capability or redundancy for the range of potential incidents. Keeping occupants informed as response requirements change is vital to save lives.

VISUAL X-55

Communications - Information Technology Systems (cont.)


Empty conduits

- Future growth
- Speed repair

Battery and backup power for IT


- Hubs, switches, servers, switchboards, MW links, etc.
- VOIP, building ops, alarms, etc.

Fire stopping in conduits between floors



Secure dedicated lines between critical security functions

Backup control center with same capability as primary



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-55

Communications – Information Technology Systems (cont.)

The one thing about information is that it is ever expanding, thus future load growth should always be considered, especially extra conduits that assist repairs and allow additional capability as needed.

- These conduits are for future dedicated electrical circuits, updated information systems, and additional security systems. The last being the quickest way to provide reduction in risk.

Note that battery backup and emergency power must be at or link to all distributed equipment in the IT system to keep system functional

- If other capabilities like VOIP (Voice Over Internet Protocol) telephones, building operations, or alarms on IT Systems increases need for the electric backup

Historically, communications systems have been installed without consideration for other building codes – for example, conduits between floors must have fire stopping installed to prevent spread of fires, fuel leaks, gas leaks, defeat of zone pressurization, or spread of CBR agents and other toxic materials.


Security information and flow of information to building occupants is critical before, during, and after an incident. Dedicated communication lines between security functions – such as central security control and entry control stations keeps information current, especially during deter and detect situations. Control centers for security, fire, and emergency operations may have backup locations depending upon the size of the organization or site. Communications

VISUAL X-56

Equipment Operations and Maintenance

Preventive Maintenance and Procedures

- Drawings indicating locations and capacities are current?
- Maintenance critical to keep systems operational
 - Critical systems air balanced and pressurization monitored regularly?
 - Periodic recommissioning of major systems?
- Regularly test strategic equipment
 - Sensors, backup equipment and lighting, alarms, and procedures tested regularly to ensure operation when needed?
 - Backup systems periodically tested under worst case loadings?



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-56

capability should be replicated at the backup site, or if alternative methods are used, staff must be trained for both primary and backup procedures and equipment.

Equipment Operations and Maintenance


- Keeping drawings up to date and ensuring capacities meet current needs as functions and infrastructure changes occur are necessary for proper maintenance and operation
- An emergency system that will not function properly when called upon will result in increased damage and casualties
 - In the past, US military installations in a foreign country tested their Class B generator plant (sized to support the complete installation when commercial power lost) at 5:00 am on Sunday morning to avoid inconveniencing people. Class A plants are prime power and used where there is no reliable commercial power. Class C units are also backups but of smaller size and distributed at the critical loads and buildings. One engineer knew that this did not ensure operation when needed and convinced decision makers to run the test during the peak electrical load of the month (units were tested once a month for two hours). It took almost six months of incremental repair before the plant could run for the full 2 hours. Six months later a country-wide power outage occurred. This installation was the only US installation that stayed fully operational for the whole commercial power outage.
- Bottom line: Preventive maintenance and testing that ensures the systems will work in all required modes, including emergency situations, must be done to ensure proper functioning when they are called upon.

VISUAL X-57

Equipment Operations and Maintenance

Maintenance Staff Training

- System upgrades will require new training
- Specific instructions for CBR event (internal vs external release)
- Systems accessible for adjustment, maintenance, and testing



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-57

Equipment Operations and Maintenance

Maintenance Staff Training

Since emergency systems, especially HVAC, are not standard building components, the staff must receive training in how the upgraded mechanical systems are designed to work, how they should be operated, and how they should be maintained and tested.

- A high-rise in Chicago was designed to have all lights burning 24 hours a day in the winter as part of the heating system design. A new manager demanded the lights be turned off and the staff could not explain why so they were turned off. A cold snap hit and the small supplemental boiler in the basement and the lights turned back on took 4 days to bring the building back to desired office temperatures.
- Maintenance and operational staff must have the training in the operational procedures for all potential situations in how the building will be reconfigured, especially for CBR events outside and inside the building.
- Another point based upon experience, is that maintenance staff will be more likely to perform maintenance, repairs, and testing if the equipment is accessible. The more difficult it is to perform these actions the less likely they will be done.
 - Example – steam boiler in penthouse of 3-story building required weekly replenishment of water treatment chemicals. An elevator got the heavy chemicals to the third floor, but to get to the penthouse required winding through offices and then carrying them up a vertical ladder to a roof hatch. The building was originally designed for a location with water that did not need water treatment.


VISUAL X-58


Security Systems

Electronic Security Systems

Purpose is to improve the reliability and effectiveness of life safety systems, security systems, and building functions.

- Detection
- Access control
- Duress alarms
- Primary and backup control centers – same procedures



 FEMA

BUILDING DESIGN FOR HOMELAND SECURITY Unit X-58

Chapter 3 of FEMA 426 is not a design guide for Electronic Security Systems (ESS). The following criteria are only intended to stress those concepts and practices that warrant special attention to enhance public safety. Consult design guides pertinent to the specific project for detailed information about electronic security. A description of Electronic Security Systems is provided in **Appendix D of FEMA 426**.

Security Systems

Electronic Security Systems

The purpose of electronic security is to improve the reliability and effectiveness of life safety systems, security systems, and building functions. When possible, accommodations should be made for future developments in security systems.

- Basic intrusion detection devices should be provided: magnetic reed switches for interior doors and openings, glass break sensors for windows up to scalable heights, and balanced magnetic contact switch sets for all exterior doors, including overhead/roll-up doors. Roof intrusion detection should be reviewed.
- A color CCTV surveillance system with recording capability should be provided to view and record activity at the perimeter of the building, particularly at primary entrances and exits.
- Consider duress alarms at Entry Control Stations, where the general public has contact, and other locations as deemed necessary from threat or past history. Also call boxes in parking areas for similar function.
- The Operational Control Center (OCC), Fire Command Center (FCC), and Security Control Center (SCC) may be collocated. If collocated, the chain of command should be carefully pre-planned to ensure the most qualified leadership is in control for specific types of events. Secure information links should be provided between the OCC, FCC, and SCC.
- A Backup Control Center (BCC) should be provided in a different location, such as a manager's or engineer's office. If

INSTRUCTOR NOTES


CONTENT/ACTIVITY

VISUAL X-59

Security Systems

Entry Control Stations

Channel visitors entering building to access control in lobby
Signs should assist in controlling authorized entry
Have sufficient lobby space for security measures (current or future)
Avoid extensive queuing, especially outside building
Proper lighting, especially if manned 24 hours/ day
Hardened against attack based upon security needs



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-59

- feasible, an off-site location should be considered.
- A fully redundant BCC should be installed (this is an alternative to the above).
 - An on-site monitoring center should be used during normal business hours and be operational 24 hours. When not manned the monitoring center responsibility can be transferred to an off-site location

These criteria primarily address access control design, including stair and lobby design, because access control must be considered when design concepts for a building are first conceived. Although fewer options are available for modernization projects, some designs can be altered to consider future access control objectives.

Security Systems

Entry Control Stations

Entry control stations should be provided at main perimeter entrances of the building where security personnel are present (see **Figure 3-12, page 3-48, of FEMA 426**). In addition, entry control stations should be located close to the perimeter entrance to permit people inside the entry control station to maintain constant surveillance over the entrance and its approaches. Note that many of the considerations for entry control stations listed here are appropriate for Site and Layout Design as discussed in **Chapter 2 of FEMA 426**. Additional considerations at entry control stations include:

- Channel visitors to access control with appropriate signage to differentiate between visitors and building occupants / tenants
- Additional space is needed for metal

detectors and x-ray machines. If not installed initially, allow future space in case they may be installed later.

- Queuing should be limited, i.e. access control should have sufficient throughput to avoid having a high concentration of personnel at the entrance at any time. Queuing that takes the line outside the building should be avoided at all costs.
- Lighting, with CCTV should assist in identification and access control.
- Entry control stations should be hardened against attacks according to the type of threat. The methods of hardening may include:
 - Reinforced concrete or masonry
 - Steel plating
 - Bullet-resistant glass
 - Commercially fabricated, bullet-resistant building components or assemblies
- Entry control stations adjacent to the building but not inside should have appropriate environmental support (heat / air conditioning), lighting, and sufficient glassed area to afford adequate observation for people inside.

VISUAL X-60

Security Systems


Emergency Plans

All buildings should have current plans

- Building evacuation with signage & emergency lighting
- Accountability – rally points, call-in
- Incorporate CBR scenarios into plans
 - General occupant actions
 - Response staff actions – HVAC and control centers

Exercise the plans to ensure they work

- Coordinate with local emergency response personnel
- Test all aspects



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-60

Security Systems

Emergency Plans

All buildings should have current **emergency plans** to address fire, weather, and other types of emergencies.

In light of past U.S. experiences with anthrax and similar threats, these plans should be updated to consider CBR attack scenarios and the associated procedures. Emergency plans should have procedures for communicating instructions to building occupants, identifying suitable shelter-in-place areas (if they exist), identifying appropriate use and selection of

INSTRUCTOR NOTES

CONTENT/ACTIVITY

personal protective equipment (i.e., clothing, gloves, respirators), and directing emergency evacuations.

Building design should be able to ensure the optimal operation of the emergency plans. The emergency plans should not default to only what can be done after the building is constructed. In other words, like security and homeland defense, emergency planning should be an up-front design consideration that gets incorporated into the planning, budgeting, and design of the building.

Note that bomb threats have been used in the past by terrorists to evaluate evacuation procedures and determine where the evacuees congregate after leaving the building. Consider multiple rally points (A, B, and C) and vary their use so that a pattern cannot be determined by terrorist surveillance.

Then the plans must be tested to ensure they work in all situations, that what is written can actually be done, especially at the speed required, and that the plans and equipment operation work in agreement.

Note that walking egress routes are not always down a single stairwell, especially in high-rise building as in the World Trade Center Complex. Recommend exercising an annual evacuation exercise to ensure most people know the egress routes (primary and alternate) and can negotiate them in a speedy manner. Signage and lighting along the whole route should also be evaluated at the same time.

Additionally, all security locking arrangements on doors used for egress must comply with requirements of the National Fire Protection Association (NFPA) 101, Life Safety Code.


VISUAL X-61

Practical Applications

What can be done with a reasonable level of effort?

End of Chapter 3, FEMA 426 listing of mitigation measures

- Less protection, less cost, with less effort
- Greater protection, greater cost, at greater effort



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-61

Direct students to **Table 2-1 in FEMA 426** and arrow listing on **pages 3-51 and 3-52 of FEMA 426.**

VISUAL X-62


Building Materials: General Guidance

All building materials and types acceptable under building codes are allowed.

Special consideration should be given to materials having inherent flexibility and ability to respond to load reversals.

Careful detailing is required for materials (such as pre-stressed concrete, pre-cast concrete, and masonry) to adequately respond to design loads.

Construction type selected must meet all performance criteria of specified protection level.



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-62

Practical Applications

What can be done with a reasonable level of effort?

Consult **Table 2-1, page 2-54, of FEMA 426** to understand the benefit of various mitigation efforts against a range of terrorist tactics.

There is a range of FEMA 426 mitigation efforts at a range of cost. Consult **pages 3-51 and 3-52 of FEMA 426** to see the range of relative costs for most situations.

Building Materials: General Guidance

- All building materials and types acceptable under model building codes are allowed (except unreinforced masonry – brick and/or CMU (concrete masonry unit) – concrete block).
- Special consideration should be given to materials that have inherent flexibility and that are better able to respond to load reversals (i.e., cast in place reinforced concrete and steel construction).
- Careful detailing is required for material such as pre-stressed concrete, pre-cast concrete, and masonry (brick and concrete masonry unit) to adequately respond to the design loads. Even calling out seismic connections may not be adequate as the workforce may not be familiar with the changes from their norm; thus detailing is very important.
 - For example, aluminum wiring is not used in homes in the US because copper trained electricians over-

INSTRUCTOR NOTES

CONTENT/ACTIVITY

VISUAL X-63

Desired Building Protection Level
Component design based on:
Design Basis Threat
Threat Independent approach
Level of Protection sought
Leverage natural hazards design/retrofit
Incorporate security design as part of normal capital or O&M program
Use existing tools/techniques, but augment with new standards/guidelines/codes



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-63

Establishing the design basis threat early in the design cycle reduces cost, has synergies with other requirements – seismic and wind, and should never be an afterthought of the design. Even for a low threat, there is value

torqued the connections, causing cold flow, loose connections, and fires. Great Britain took path to put copper on the outside of aluminum, taking advantage of the less expensive aluminum without getting the cold flow problem.

- Another example, plastic water pipe initially installed by copper-trained plumbers were not twisted 90 degrees to spread the glue as this was not needed when soldering copper. Imperfections in the plastic would scrape the glue away resulting in leaks. Plumbers now know this procedure and we still use plastic water piping.
- The construction type selected must meet all performance criteria of the specified level of protection.
- The designer must bear in mind that the design approaches are, at times, in conflict. These conflicts must be worked out on a case by case basis.

Desired Building Protection Level

The assessment process to this point should determine the level of protection sought for the building structure based upon the threat / hazard specific to the facility. Explosive blast threats usually govern building structural design for high risk buildings.

Some design approaches are threat independent, such as progressive collapse. Other approaches depend upon an identified Design Basis Threat. The design basis threat is the terrorism hazard equivalent to the natural hazards design basis which is based upon recorded history, measurement methods to determine the magnitude of the hazard and have been established as building codes based on the weather and geological conditions of the locality.

INSTRUCTOR NOTES

CONTENT/ACTIVITY

in providing certain minimum features to the site and building design. This allows adjustment to the level of protection if the level of threat changes. This is the current philosophy of the Department of Defense.

Even if no design changes result, the understanding in going through the assessment process, especially in the data collection and identifying Points of Contact, is beneficial if future man-made hazards threaten or occur.

VISUAL X-64


Summary

Building Design Guidance and Mitigation Options

Using the FEMA 426 Checklist will help identify vulnerabilities and provide recommended mitigation options.

There are many methods to mitigate each vulnerability.

Relatively low cost mitigations significantly reduce risk.



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-64

Whenever there are projects to accomplish in a building, seek to leverage natural hazard upgrades, energy conservation upgrades, and other capital improvement or O&M (Operations and Maintenance) work to achieve synergies at less cost to achieve HVAC upgrades and building hardening.

In every design situation, the intent is to seek a balance between all the different requirements to include in the design (e.g., antiterrorism, energy conservation, building code, seismic, wind, snow loading, handicap access, adjacent architecture, etc.).

Summary

To summarize:

This unit provides a foundation for a systematic approach to assessing the vulnerabilities of a building to manmade hazards.

The Building Vulnerability Assessment Checklist in FEMA 426 can provide an excellent framework for the identification of mitigation options that will, over time, significantly reduce the vulnerability of a building to manmade hazards.

Note that there are many different techniques to mitigate each vulnerability. They have different costs and may increase, reduce, or have no effect on risk for other tactics. Thus, each mitigation measure needs to be compared to every threat / hazard tactic for the building particulars.

Antiterrorism assessment teams that have been operating over 5 years indicate that historically about 80 percent of mitigation recommendations are low cost /no cost

INSTRUCTOR NOTES

CONTENT/ACTIVITY


VISUAL X-65

Unit X Case Study Activity
Building Design Guidance and Mitigation Measures Background
Emphasis:

- Providing a balanced building envelope that is a defensive layer against the terrorist tactic of interest
- Avoiding situations where one incident affects more than one building system

FEMA 426, Building Vulnerability Assessment Checklist

Requirements
Assign sections of the checklist to qualified group members
Refer to Case Study, and answer worksheet questions
Review results to identify vulnerabilities and possible mitigation measures



BUILDING DESIGN FOR HOMELAND SECURITY Unit X-65

Refer participants to **FEMA 426**, the Unit X Case Study activity in the Student Manual.

Members of the instructor staff should be available to answer questions and assist groups as needed.

At the end of 45 minutes, reconvene the class and facilitate group reporting. Take 15 minutes to review group results.

There are 48 questions to answer by the team and then confer. With an average of 7 team members this means each member answers about 7 questions or about 4 minutes per question during their 30 minutes of research.

planning and procedural changes.

Student Activity

The **Building Vulnerability Assessment Checklist in FEMA 426** can be used as a screening tool for vulnerability assessment of an existing building or a preliminary design.

The checklist includes questions that determine if critical systems will continue to function to enhance deterrence, detection, denial, and damage limitation, and emergency systems function during a threat or hazard situation.

Activity Requirements

- Continue working in small groups.
- Assign sections of the checklist to the group members who are most knowledgeable and qualified to perform an assessment of the assigned area. There are 49 questions so that with 7 students (working group size sought), each student would need to answer 7 questions in about 30 minutes (4-5 minutes per question) leaving 15 minutes to discuss results as a group.
- Refer to the Case Study to determine answers to the worksheet questions.
- Then review results as a team to identify vulnerabilities and possible mitigation measures.

Take 45 minutes to complete this activity. Solutions will be reviewed in plenary group.

Transition

Unit XI will cover Electronic Security Systems.

**UNIT X-A CASE STUDY ACTIVITY:
BUILDING DESIGN GUIDANCE
(Suburban Version)**

In this unit, the emphasis will be upon providing a balanced building envelope that is a defensive layer against the terrorist tactic of interest and avoiding situations where one incident affects more than one building system. The **Building Vulnerability Assessment Checklist in FEMA 426** can be used as a screening tool for preliminary building design vulnerability assessment.

Requirements

Assign sections of the checklist to the group members who are most knowledgeable and qualified to perform an assessment of the assigned area. Refer to the Case Study to determine answers to the questions. Then review results as a team to identify vulnerabilities and possible mitigation measures.

1. Complete the following questions of the **Building Vulnerability Assessment Checklist (FEMA 426, Table 1-22, pages 1-46 to 1-93)** that address building design. Note: Vulnerability Questions that cannot be answered with the case study information provided have not been included in this student exercise.
2. Upon completion of these portions of the checklist, refer back to the vulnerability ratings determined in the Unit IV Case Study Activity and, based on this more detailed analysis, decide if any vulnerability rating needs adjustment. Adjust the Threat Matrix chart accordingly.
3. Select mitigation measures to reduce vulnerability and associated risk based upon the building design.
4. Estimate the new risk ratings for high-risk asset-threat pairs (as adjusted in step 2 above) based on the recommended mitigation measures.

Section	Vulnerability Question	Guidance	Observations
2	Architectural		
2.5	Do entrances avoid significant queuing?	If queuing will occur within the building footprint, the area should be enclosed in blast-resistant construction. If queuing is expected outside the building, a rain cover should be provided. For manpower and equipment requirements, collocate or combine staff and visitor entrances. Reference: GSA PBS-P100	<i>Because of the mixed time of employees coming to work, queuing at the entrance is minimal to non-existent. Visitors are also few in number so that they do not exceed the reception area capacity.</i>

Section	Vulnerability Question	Guidance	Observations
2.7	Is access control provided through main entrance points for employees and visitors? (lobby receptionist, sign-in, staff escorts, issue of visitor badges, checking forms of personal identification, electronic access control systems)	Reference: Physical Security Assessment for the Department of Veterans Affairs Facilities	<p>Visitor access control is handled in the lobby by the receptionist, who signs the visitors in and contacts staff to provide escort. Employees use electronic access control to enter the building.</p> <p>Access control at other companies within the complex is unknown.</p>
2.8	Is access to private and public space or restricted area space clearly defined through the design of the space, signage, use of electronic security devices, etc.?	<p>Finishes and signage should be designed for visual simplicity.</p> <p>Reference: Physical Security Assessment for the Department of Veterans Affairs Facilities</p>	<p>The building is monitored by door and window alarms, which connect to ADT, the nationwide alarm company. Unauthorized opening of any door or window will immediately notify ADT via telephone. ADT will normally call the HIC Security Office prior to contacting the police and DPS. Employees have proximity cards to allow them to enter the front and loading dock doors without activating the alarm.</p> <p>The innermost layer of physical security involves the Computer Data Center and the Communications Center. Equipped with locked doors, these two rooms meet the government's requirements for handling classified</p>

Section	Vulnerability Question	Guidance	Observations
			material. Only authorized employees possess the necessary proximity cards and PINs to gain access.
2.9	Is access to elevators distinguished as to those that are designated only for employees and visitors?	Reference: Physical Security Assessment for the Department of Veterans Affairs Facilities	No elevators in building.
2.10	Do public and employee entrances include space for possible future installation of access control and screening equipment?	These include walk-through metal detectors and x-ray devices, identification check, electronic access card, search stations, and turnstiles. Reference: GSA PBS-P100	Yes, lobby / reception area within building could accommodate space-saving screening equipment. Interior office space also has adequate room for such equipment.
2.11	Do foyers have reinforced concrete walls and offset interior and exterior doors from each other?	Consider for exterior entrances to the building or to access critical areas within the building if explosive blast hazard must be mitigated. Reference: U.S. Army TM 5-853	The exterior walls are made of CMU with a brick veneer on the outside. Steel framework supports the structure, and exposed columns are enclosed in gypsum wallboard. The exterior wall of the foyer has extensive glass. The exterior and interior doors of the foyer are in a straight line The construction of interior walls is gypsum wallboard on metal studs.

Section	Vulnerability Question	Guidance	Observations
2.13	Do circulation routes have unobstructed views of people approaching controlled access points?	<p>This applies to building entrances and to critical areas within the building.</p> <p>References: USAF Installation Force Protection Guide and DoD UFC 4-010-01</p>	<p>Yes, circulation routes have unobstructed views of people approaching controlled access points. The front door is monitored both by the receptionist and CCTV. The rear entrance is monitored by CCTV.</p>
2.15	<p>Are critical assets (people, activities, building systems and components) located close to any main entrance, vehicle circulation, parking, maintenance area, loading dock, or interior parking?</p> <p>Are the critical building systems and components hardened?</p>	<p>Critical building components include: Emergency generator including fuel systems, day tank, fire sprinkler, and water supply; Normal fuel storage; Main switchgear; Telephone distribution and main switchgear; Fire pumps; Building control centers; Uninterruptible Power Supply (UPS) systems controlling critical functions; Main refrigeration and ventilation systems if critical to building operation; Elevator machinery and controls; Shafts for stairs, elevators, and utilities; Critical distribution feeders for emergency power. Evacuation and rescue require emergency systems to remain operational during a disaster and they should be located away from potential attack locations. Primary and backup systems should be separated to reduce the risk of both being impacted by a single incident if</p>	<p>Electrical service is provided through two buried transmission lines from two separate pad-mounted transformers outside the building near the rear loading dock. Emergency power is provided by a single diesel generator, located in a shed in the rear parking lot, also near the loading dock. The generator has a 50-gallon day tank, maintained at 80 percent capacity. The 2,000-gallon main tank is buried under the parking lot, near the generator.</p> <p>The batteries to support the UPS are in a small room next to the UPS room.</p> <p>Natural gas enters the building through two meters under the loading dock staircase and goes overhead to the mechanical and electrical (M&E) room</p>

Section	Vulnerability Question	Guidance	Observations
		<p>collocated. Utility systems should be located at least 50 feet from loading docks, front entrances, and parking areas.</p> <p>One way to harden critical building systems and components is to enclose them within hardened walls, floors, and ceilings. Do not place them near high-risk areas where they can receive collateral damage.</p> <p>Reference: GSA PBS-P100</p>	<p>at the building's southwest corner.</p> <p>Thus, most of the critical utilities are either in the rear parking area or near the loading dock or both.</p>
2.16	<p>Are high-value or critical assets located as far into the interior of the building as possible and separated from the public areas of the building?</p>	<p>Critical assets, such as people and activities, are more vulnerable to hazards when on an exterior building wall or adjacent to uncontrolled public areas inside the building.</p> <p>Reference: GSA PBS-P100</p>	<p>People are located along the exterior wall at the front of the building. The secure space has the best interior space location – not on an exterior wall, as does the conference room. The office space acts as the buffer between the critical functions in the back and the public area of the building at the main entrance.</p> <p>M&E room is located on an exterior wall.</p> <p>There are no public use areas within the building.</p>
2.17	<p>Is high visitor activity away from critical assets?</p>	<p>High-risk activities should also be separated from low-risk activities. Also, visitor activities should be separated from daily</p>	<p>All visitors enter through a common front entrance. Once admitted to the site, visitor activity is escorted and</p>

Section	Vulnerability Question	Guidance	Observations
		<p>activities.</p> <p>Reference: USAF Installation Force Protection Guide</p>	<p>part of daily activities.</p>
2.19	<p>Are loading docks and receiving and shipping areas separated in any direction from utility rooms, utility mains, and service entrances, including electrical, telephone/data, fire detection/alarm systems, fire suppression water mains, cooling and heating mains, etc.?</p>	<p>Loading docks should be designed to keep vehicles from driving into or parking under the building. If loading docks are in close proximity to critical equipment, consider hardening the equipment and service against explosive blast. Consider a 50-foot separation distance in all directions.</p> <p>Reference: GSA PBS-P100</p>	<p>No, the loading dock connects directly into interior space, critical functions, and infrastructure. A commercial power transformer, the natural gas meters, and the M&E rooms are within 50 feet of the loading dock.</p>
2.20	<p>Are mailrooms located away from building main entrances, areas containing critical services, utilities, distribution systems, and important assets?</p> <p>Is the mailroom located near the loading dock?</p>	<p>The mailroom should be located at the perimeter of the building with an outside wall or window designed for pressure relief.</p> <p>By separating the mailroom and the loading dock, the collateral damage of an incident at one has less impact upon the other. However, this may be the preferred mailroom location.</p> <p>Off-site screening stations or a separate delivery processing building on site may be cost-effective, particularly if several buildings may share one mailroom. A separate delivery processing</p>	<p>HIC has no mail room. Incoming mail is normally processed by the receptionist inside the front door. Large packages are delivered to the loading dock.</p> <p>The foyer, where mail is delivered, is of standard office construction. Blast would affect exterior walls (glazing) and interior walls (gypsum board on metal studs) about equally.</p>

Section	Vulnerability Question	Guidance	Observations
		<p>building reduces risk and simplifies protection measures.</p> <p>Reference: GSA PBS-P100</p>	
2.21	<p>Does the mailroom have adequate space available for equipment to examine incoming packages and for an explosive disposal container?</p>	<p>Screening of all deliveries to the building, including U.S. mail, commercial package delivery services, delivery of office supplies, etc.</p> <p>Reference: GSA PBS-P100</p>	<p>HIC has no mail room. Mail is delivered to the receptionist in the foyer. Space is limited for mail screening equipment, especially if personnel screening equipment is installed.</p> <p>However, package screening could be done at or near the loading doc, where there would be sufficient room for the equipment. However, someone from Security would have to process the mail as the reception desk cannot be left unmanned.</p>
2.22	<p>Are areas of refuge identified, with special consideration given to egress?</p>	<p>Areas of refuge can be safe havens, shelters, or protected spaces for use during specified hazards.</p> <p>Reference: FEMA 386-7</p>	<p>Yes, the Computer Data Center and the large conference room are identified as areas of refuge.</p>
2.23	<p>Are stairwells required for emergency egress located as remotely as possible from high-risk areas where blast events might occur?</p> <p>Are stairways maintained with positive pressure or are there other smoke</p>	<p>Consider designing stairs so that they discharge into other than lobbies, parking, or loading areas.</p> <p>Maintaining positive pressure from a clean source of air (may require special filtering) aids in egress by keeping smoke,</p>	<p>Stairways are located in the interior of the building, away from the perimeter walls. They are part of the steel mezzanine design and are towards the front of the building. Multiple exits are located around the building and from</p>

Section	Vulnerability Question	Guidance	Observations
	control systems?	heat, toxic fumes, etc. out of the stairway. Pressurize exit stairways in accordance with the National Model Building Code. Reference: GSA PBS-P100 and CDC/NIOSH, Pub 2002-139	both the front and rear. Stairways are open and not designed with any fire protection features, such as a positive pressure system.
2.25	Do interior barriers differentiate level of security within a building?	Reference: USAF Installation Force Protection Guide	Electronic controls exist in the form of alarms, door locks, proximity cards, and use of PIN numbers for room/area access.
2.26	Are emergency systems located away from high-risk areas?	The intent is to keep the emergency systems out of harm's way, such that one incident takes out all capability – both the regular systems and their backups. Reference: FEMA 386-7	The high risk areas are the front entrance and the rear loading dock. Emergency/backup generator is located over 50 feet away from main power supply lines, loading dock, and M&E room. UPS is located inside the building's high bay area, but probably within 50 feet of the loading dock.
3	Structural Systems		
3.1	What type of construction? What type of concrete and reinforcing steel? What type of steel? What type of foundation?	The type of construction provides an indication of the robustness to abnormal loading and load reversals. A reinforced concrete moment-resisting frame provides greater ductility and redundancy than a flat-slab or flat-plate construction. The ductility of steel frame with metal deck depends on the connection details and pre-tensioned or post-tensioned construction provides little capacity for abnormal loading patterns and load reversals. The resistance of load-bearing wall structures varies to a great extent, depending on whether the	Located in a suburban office complex, the HIC office building comprises a 19,000- square foot main floor for offices and computers, and a 3,300-square foot executive mezzanine (a second floor over part of the office). The building that houses the Hazardville Information Company (HIC) is an office building of standard construction. The walls are made of concrete blocks (CMU-

Section	Vulnerability Question	Guidance	Observations
		<p>walls are reinforced or unreinforced. A rapid screening process developed by FEMA for assessing structural hazards identifies the following types of construction with a structural score ranging from 1.0 to 8.5. A higher score indicates a greater capacity to sustain load reversals.</p> <p>Wood buildings of all types - 4.5 to 8.5 Steel moment-resisting frames - 3.5 to 4.5 Braced steel frames - 2.5 to 3.0 Light metal buildings - 5.5 to 6.5 Steel frames with cast-in-place concrete shear walls - 3.5 to 4.5 Steel frames with unreinforced masonry infill walls - 1.5 to 3.0 Concrete moment-resisting frames - 2.0 to 4.0 Concrete shear wall buildings - 3.0 to 4.0 Concrete frames with unreinforced masonry infill walls - 1.5 to 3.0 Tilt-up buildings - 2.0 to 3.5 Precast concrete frame buildings - 1.5 to 2.5 Reinforced masonry - 3.0 to 4.0 Unreinforced masonry - 1.0 to 2.5</p> <p>References: <i>FEMA 154 and Physical Security Assessment for the Department of Veterans Affairs Facilities</i></p>	<p>concrete masonry units) with a brick veneer on the outside. Steel framework supports the structure, and exposed columns are enclosed in gypsum wallboard. The roof is a metal deck with gravel on top and insulation underneath. It is slightly angled to allow water to drain. The roof overhangs the front entrance by 8 feet. This provides a covered area for employees to stay dry on rainy days. Cylindrical columns support the overhang.</p>
3.5	<p>Will the structure suffer an unacceptable level of damage resulting from the postulated threat (blast loading or weapon impact)?</p>	<p>The extent of damage to the structure and exterior wall systems from the bomb threat may be related to a protection level. The following is for new buildings:</p> <p>Level of Protection Below Antiterrorism Standards - Severe damage. Frame collapse/massive destruction. Little left standing. Doors and windows fail and result in lethal hazards. Majority</p>	<p>The standard construction techniques used to build the site HIC occupies do not create buildings that withstand explosive blasts. Terrorist threat was not a part of design consideration.</p>

Section	Vulnerability Question	Guidance	Observations
		<p>of personnel suffer fatalities.</p> <p>Very Low Level Protection - Heavy damage. Onset of structural collapse. Major deformation of primary and secondary structural members, but progressive collapse is unlikely. Collapse of non-structural elements. Glazing will break and is likely to be propelled into the building, resulting in serious glazing fragment injuries, but fragments will be reduced. Doors may be propelled into rooms, presenting serious hazards. Majority of personnel suffer serious injuries. There are likely to be a limited number (10 percent to 25 percent) of fatalities.</p> <p>Low Level of Protection - Moderate damage, unrepairable. Major deformation of non-structural elements and secondary structural members and minor deformation of primary structural members, but progressive collapse is unlikely. Glazing will break, but fall within 1 meter of the wall or otherwise not present a significant fragment hazard. Doors may fail, but they will rebound out of their frames, presenting minimal hazards. Majority of personnel suffer significant injuries. There may be a few (<10 percent) fatalities.</p> <p>Medium Level Protection - Minor damage, repairable. Minor deformations of non-structural elements and secondary structural members and no permanent deformation in primary structural members. Glazing will break, but will remain in the window frame. Doors will stay in frames, but will not be reusable. Some minor injuries, but fatalities are unlikely.</p> <p>High Level Protection -</p>	

Section	Vulnerability Question	Guidance	Observations
		<p>Minimal damage, repairable. No permanent deformation of primary and secondary structural members or non-structural elements. Glazing will not break. Doors will be reusable. Only superficial injuries are likely. Reference: <i>DoD UFC 4-010-01</i></p>	
3.10	<p>Will the loading dock design limit damage to adjacent areas and vent explosive force to the exterior of the building?</p>	<p>Design the floor of the loading dock for blast resistance if the area below is occupied or contains critical utilities. Reference: <i>GSA PBS-P100</i></p>	<p>The loading dock is the weakest part of the exterior rear wall. There are no hardened walls between the loading dock and the rest of the building as the plan shows only standard gypboard and metal stud walls.</p> <p>Thus the loading dock will not limit any damage into the building and anything occurring on the loading dock will directly affect the building interior.</p>
4	Building Envelope		
4.1	<p>What is the designed or estimated protection level of the exterior walls against the postulated explosive threat?</p>	<p>The performance of the façade varies to a great extent on the materials. Different construction includes brick or stone with block backup, steel stud walls, precast panels, curtain wall with glass, stone, or metal panel elements.</p> <p>Shear walls that are essential to the lateral and vertical load bearing system and that also function as exterior walls should be considered primary structures and should resist the actual blast loads predicted from the threats specified. Where exterior walls are not designed for the full design loads, special consideration should be given to construction types that reduce the potential for injury.</p> <p>Reference: <i>GSA PBS-P100</i></p>	<p>There was no postulated explosive threat in the original design of the building or site. Thus, it is estimated that the protection level will be very poor for the assessment design basis threat.</p> <p>The exterior walls are made of CMU with a brick veneer on the outside. Steel framework supports the structure</p> <p>Windows are double glazed, 1/4-inch thick annealed glass.</p>

Section	Vulnerability Question	Guidance	Observations
4.2	<p>Is there less than 40 percent fenestration per structural bay?</p> <p>Is the window system design on the exterior façade balanced to mitigate the hazardous effects of flying glazing following an explosive event? (glazing, frames, anchorage to supporting walls, etc.)</p> <p>Do the glazing systems with a ½-inch (¾-inch is better) bite contain an application of structural silicone?</p> <p>Is the glazing laminated or is it protected with an anti-shatter (fragment retention) film?</p> <p>If an anti-shatter film is used, is it a minimum of a 7-mil thick film, or specially manufactured 4-mil thick film?</p>	<p>The performance of the glass will similarly depend on the materials. Glazing may be single pane or double pane, monolithic or laminated, annealed, heat strengthened or fully tempered.</p> <p>The percent fenestration is a balance between protection level, cost, the architectural look of the building within its surroundings, and building codes. One goal is to keep fenestration to below 40 percent of the building envelope vertical surface area, but the process must balance differing requirements. A blast engineer may prefer no windows; an architect may favor window curtain walls; building codes require so much fenestration per square footage of floor area; fire codes require a prescribed window opening area if the window is a designated escape route; and the building owner has cost concerns.</p> <p>Ideally, an owner would want 100 percent of the glazed area to provide the design protection level against the postulated explosive threat (design basis threat– weapon size at the expected stand-off distance). However, economics and geometry may allow 80 percent to 90 percent due to the statistical differences in the manufacturing process for glass or the angle of incidence of the blast wave upon upper story windows (4th floor and higher).</p> <p>Reference: <i>GSA PBS-P100</i></p>	<p>All windows are in the office space area of the building (complete in the front and half of one side). In that area the fenestration is probably more than 40%.</p> <p>Fenster is German for window.</p> <p>The window system is standard commercial construction and thus, the glass, framing, and anchorage are expected to be insufficient for the design basis threat at the available stand-off. One benefit is that there are windows only on two sides of the building.</p>
6	Mechanical Systems (HVAC and CBR)		
6.1	<p>Where are the air intakes and exhaust louvers for the building? (low, high, or midpoint</p>	<p>Air intakes should be located on the roof or as high as possible. Otherwise secure within CPTED-compliant fencing or enclosure. The fencing or</p>	<p>Outside air is brought in through a vent in the wall. The vent is alarmed to prevent intruder access.</p>

Section	Vulnerability Question	Guidance	Observations
	<p>of the building structure)</p> <p>Are the intakes and exhausts accessible to the public?</p>	<p>enclosure should have a sloped roof to prevent the throwing of anything into the enclosure near the intakes.</p> <p>Reference: <i>GSA PBS-P100</i> states that air intakes should be on the fourth floor or higher and, on buildings with three floors or less, they should be on the roof or as high as practical. Locating intakes high on a wall is preferred over a roof location.</p> <p>Reference: <i>DoD UFC 4-010-01</i> states that, for all new inhabited buildings covered by <i>FEMA 426</i>, all air intakes should be located at least 3 meters (10 feet) above the ground.</p> <p>Reference: <i>CDC/NIOSH, Pub 2002-139</i> states: “An extension height of 12 feet (3.7 m) will place the intake out of reach of individuals without some assistance. Also, the entrance to the intake should be covered with a sloped metal mesh to reduce the threat of objects being tossed into the intake. A minimum slope of 45° is generally adequate. Extension height should be increased where existing platforms or building features (i.e., loading docks, retaining walls) might provide access to the outdoor air intakes.”</p> <p>Reference: <i>LBNL Pub 51959</i>: Exhausts are also a concern during an outdoor release, especially if exhaust fans are not in continuous operation, due to wind effects and chimney effects (air movement due to differential temperature).</p>	<p>A screened exhaust duct is on the roof.</p>
6.3	<p>Are there multiple air intake locations?</p>	<p>Single air intakes may feed several air handling units. Indicate if the air intakes are localized or separated. Installing low-leakage dampers is one way</p>	<p>No, there is only one air intake.</p>

Section	Vulnerability Question	Guidance	Observations
		<p>to provide the system separation when necessary.</p> <p>Reference: <i>Physical Security Assessment for the Department of Veterans Affairs Facilities</i></p>	
6.4	<p>What are the types of air filtration? Include the efficiency and number of filter modules for each of the main air handling systems.</p> <p>Is there any collective protection for chemical, biological, and radiological contamination designed into the building?</p>	<p>MERV – Minimum Efficiency Reporting Value</p> <p>HEPA – High Efficiency Particulate Air</p> <p>Activated charcoal for gases</p> <p>Ultraviolet C for biologicals</p> <p>Consider mix of approaches for optimum protection and cost-effectiveness.</p> <p>Reference: <i>CDC/NIOSH Pub 2002-139</i></p>	<p>The air used to heat or cool the building is filtered in the HVAC room using standard industrial grade MERV 8 filters.</p> <p>There is no CBR protection designed into the building.</p>
6.8	<p>How are the air handling systems zoned?</p> <p>What areas and functions do each of the primary air handling systems serve?</p>	<p>Understanding the critical areas of the building that must continue functioning focuses security and hazard mitigation measures.</p> <p>Applying HVAC zones that isolate lobbies, mailrooms, loading docks, and other entry and storage areas from the rest of the building HVAC zones and maintaining negative pressure within these areas will contain CBR releases. Identify common return systems that service more than one zone, effectively making a large single zone.</p> <p>Conversely, emergency egress routes should receive positive pressurization to ensure contamination does not hinder egress. Consider filtering of the pressurization air.</p> <p>Reference: <i>CDC/NIOSH, Pub 2002-139 and LBNL PUB 51959</i></p>	<p>HVAC Supply is split into two zones, one for the Computer Data Center and one for the rest of the building.</p> <p>The Data Center maintains a slight net positive pressure compared to the main office areas.</p> <p>The ducts are divided in half to allow them to serve as supply and return headers. The divider is insulated to minimize heat transfer from one side to the other.</p> <p>Stairwells are not separately pressurized.</p>

Section	Vulnerability Question	Guidance	Observations
6.9	<p>Are there large central air handling units or are there multiple units serving separate zones?</p>	<p>Independent units can continue to operate if damage occurs to limited areas of the building.</p> <p>Reference: <i>Physical Security Assessment for the Department of Veterans Affairs Facilities</i></p>	<p>The Computer Center and the Communications Center use Digital Environmental Managers (DEMs).</p> <p>Cooling (or heat removal) is done by two chillers in the M&E room. Three Trane 100-ton chillers are available; normally only two are needed to cover all heat loads. The chillers remove heat from the chilled water system, and use the condenser water system to send the waste heat to two rooftop cooling towers. The chilled water is then routed from the chillers to air handlers for the majority of the building; cooling for the Computer Center and the Communications Center is done by directing chilled water to the DEMs.</p>
6.13	<p>What is the method of temperature and humidity control?</p> <p>Is it localized or centralized?</p>	<p>Central systems can range from monitoring only to full control. Local control may be available to override central operation.</p> <p>Of greatest concern are systems needed before, during, and after an incident that may be unavailable due to temperature and humidity exceeding operational limits (e.g., main telephone switch room).</p> <p>Reference: <i>DOC CIAO Vulnerability Assessment Framework 1.1</i></p>	<p>The main system for the building has limited humidity control through heating and cooling coils contained air handlers.</p> <p>The Computer Center and the Communications Center use Digital Environmental Managers (DEM) to direct the warm air where it is needed, add or remove humidity from the air, or even cool some areas while warming others.</p>
6.16	<p>Are there any smoke evacuation systems installed?</p> <p>Does it have purge capability?</p>	<p>For an internal blast, a smoke removal system may be essential, particularly in large, open spaces. The equipment should be located away from high-risk areas, the system controls and wiring should be protected, and it should be connected to emergency power. This exhaust capability can be built into areas with significant</p>	<p>No, the building has no specific smoke evacuation or purge capability.</p>

Course Title: **Building Design for Homeland Security: Resident Course**

Unit X-A: Building Design Guidance

Section	Vulnerability Question	Guidance	Observations
		<p>risk on internal events, such as lobbies, loading docks, and mailrooms. Consider filtering of the exhaust to capture CBR contaminants.</p> <p>References: <i>GSA PBS-P100, CDC/NIOSH Pub 2002-139, and LBNL Pub 51959</i></p>	
6.18	<p>Are fire dampers installed at all fire barriers?</p> <p>Are all dampers functional and seal well when closed?</p>	<p>All dampers (fire, smoke, outdoor air, return air, bypass) must be functional for proper protection within the building during an incident.</p> <p>Reference: <i>CDC/NIOSH Pub 2002-139</i></p>	<p>HVAC fire and smoke dampers in the M&E room air handling unit (AHU).</p>
6.20	<p>Do elevators have recall capability and elevator emergency message capability?</p>	<p>Although a life-safety code and fire response requirement, the control of elevators also has benefit during a CBR incident. The elevators generate a piston effect, causing pressure differentials in the elevator shaft and associated floors that can force contamination to flow up or down.</p> <p>Reference: <i>LBNL Pub 51959</i></p>	<p>No elevators in HIC.</p>
6.21	<p>Is access to building information restricted?</p>	<p>Information on building operations, schematics, procedures, plans, and specifications should be strictly controlled and available only to authorized personnel.</p> <p>References: <i>CDC/NIOSH Pub 2002-139 and LBNL Pub 51959</i></p>	<p>No, there is no specific information that the office park management company restricts access to building information.</p>
8	Electrical Systems		
8.1	<p>Are there any transformers or switchgears located outside the building or accessible from the building exterior?</p> <p>Are they vulnerable to</p>	<p>Reference: <i>Physical Security Assessment for the Department of Veterans Affairs Facilities</i></p>	<p>The two 12.47KV feeders lead to two separate transformers outside the building, one near the north side by the loading dock, and the other near the south side by the M&E room.</p> <p>These transformers are in the rear parking lot, accessible to</p>

Section	Vulnerability Question	Guidance	Observations
	<p>public access?</p> <p>Are they secured?</p>		<p>the public and secured only by a heavy duty lock.</p>
8.4	<p>Are critical electrical systems collocated with other building systems?</p> <p>Are critical electrical systems located in areas outside of secured electrical areas?</p> <p>Is security system wiring located separately from electrical and other service systems?</p>	<p>Collocation concerns include rooms, ceilings, raceways, conduits, panels, and risers.</p> <p>Reference: <i>Physical Security Assessment for the Department of Veterans Affairs Facilities</i></p>	<p>Yes, the electrical system is located adjacent to the main telecommunication and server closet. The HVAC room is also located adjacent to the electrical distribution room.</p> <p>Commercial and backup switchgear are both in the M&E room. Wiring is run as inexpensively as possible to minimize rental costs, which means in same pipe chases or adjacent conduit.</p>
8.6	<p>Does emergency backup power exist for all areas within the building or for critical areas only?</p> <p>How is the emergency power distributed?</p> <p>Is the emergency power system independent from the normal electrical service, particularly in critical areas?</p>	<p>There should be no single critical node that allows both the normal electrical service and the emergency backup power to be affected by a single incident. Automatic transfer switches and interconnecting switchgear are the initial concerns.</p> <p>Emergency and normal electrical equipment should be installed separately, at different locations, and as far apart as possible.</p> <p>Reference: <i>GSA PBS-P100</i></p>	<p>Yes, emergency backup power exists and can be routed to all areas of the building. The automatic transfer switch in the M&E room is a single point vulnerability in the system.</p> <p>Critical computer systems are backed up by an UPS (uninterruptible power supply) that is maintained separately from the site's generator back-up power.</p> <p>All individual computers / monitors have small (~750va) UPSs.</p>
9	Fire Alarm Systems		
9.1	<p>Is the building fire alarm system centralized or localized?</p> <p>How are alarms made known, both locally and centrally?</p> <p>Are critical documents and control systems located in a secure yet</p>	<p>Fire alarm systems must first warn building occupants to evacuate for life safety. Then they must inform the responding agency to dispatch fire equipment and personnel.</p> <p>Reference: <i>Physical Security Assessment for the Department of Veterans Affairs Facilities</i></p>	<p>The building fire alarm system is centralized. The fire alarm is routed over the telephone lines directly to the fire department. No intermediate monitoring agency is required for notification. An intermediate monitoring system is only used for the security alarm.</p>

Section	Vulnerability Question	Guidance	Observations
	accessible location?		
9.2	Where are the fire alarm panels located? Do they allow access to unauthorized personnel?	Reference: <i>Physical Security Assessment for the Department of Veterans Affairs Facilities</i>	The fire alarm panels are located in the building portion adjacent to HIC. The HIC security manager has a key to that part of the building for access to the fire alarm panels. However, the panels are accessible to the occupants / tenants of that building portion.
9.3	Is the fire alarm system standalone or integrated with other functions such as security and environmental or building management systems? What is the interface?	Reference: <i>Physical Security Assessment for the Department of Veterans Affairs Facilities</i>	The fire alarm system is standalone and separate from the security system. The system uses the telephone circuits to place a call to the local fire department.
9.5	Is there redundant off-premises fire alarm reporting?	Fire alarms can ring at a fire station, at an intermediary alarm monitoring center, or autodial someone else. See Items 5.21 and 10.5 of the checklist.	Yes, there is redundant off-premises fire alarm reporting through the security alarm service. This will notify an intermediate alarm monitoring center.
10	Communications and IT Systems		
10.1	Where is the main telephone distribution room and where is it in relation to higher-risk areas? Is the main telephone distribution room secure?	One can expect to find voice, data, signal, and alarm systems to be routed through the main telephone distribution room. Reference: <i>FEMA 386-7</i>	The main telephone distribution center is located next to the electrical and HVAC (mechanical). The alarm systems are routed through the telephone room (and circuits). The room is within the interior of the secured building and access is restricted to authorized personnel only. Outside repair contractors are escorted at all times.
10.5	Are there redundant communications systems available?	Critical areas should be supplied with multiple or redundant means of communications. Power outage phones can provide redundancy as they connect directly to the local	No, there are no redundant communication systems available as part of any building system. The only redundant communications are cell phones which

Section	Vulnerability Question	Guidance	Observations
		<p>commercial telephone switch off site and not through the building telephone switch in the main telephone distribution room.</p> <p>A base radio communication system with antenna can be installed in stairwells, and portable sets distributed to floors.</p> <p>References: <i>GSA PBS-P100 and FEMA 386-7</i></p>	<p>operate throughout the building.</p>
10.6	<p>Where are the main distribution facility, data centers, routers, firewalls, and servers located and are they secure?</p> <p>Where are the secondary and/or intermediate distribution facilities and are they secure?</p>	<p>Concern is collateral damage from manmade hazards and redundancy of critical functions.</p> <p>Reference: <i>DOC CIAO Vulnerability Assessment Framework 1.1</i></p>	<p>The Computer Data Center is interior to the building and is behind layers of security. The Communications Center is on an outside wall, but also behind security.</p>
10.8	<p>What type, power rating, and location of the uninterruptible power supply (UPS)? (battery, on-line, filtered)</p> <p>Are the UPS also connected to emergency power?</p>	<p>Consider that UPS should be found at all computerized points from the main distribution facility to individual data closets and at critical personal computers/terminals.</p> <p>Critical LAN sections should also be on backup power.</p> <p>Reference: <i>DOC CIAO Vulnerability Assessment Framework 1.1</i></p>	<p>The UPS system is based on a lead acid battery bank. Currently, there is no exhaust system for the battery bank. The UPS system can be fed from the emergency backup power (generator).</p>
10.12	<p>Where is the disaster recovery/mirroring site?</p>	<p>A site with suitable equipment that allows continuation of operations or that mirrors (operates in parallel to) the existing operation is beneficial if equipment is lost during a natural or manmade disaster. The need is based upon the criticality of the operation and how quickly replacement equipment can be put in place</p>	<p>HIC is the recovery site for many clients.</p> <p>HIC maintains an off-site storage location for clients that require backup data to be stored at a separate site.</p> <p>Classified backup data for certain government clients are stored in a special</p>

Section	Vulnerability Question	Guidance	Observations
		and operated. Reference: <i>DOC CIAO Vulnerability Assessment Framework 1.1</i>	fireproof safe in the Secure Space.
10.15	Is there a mass notification system that reaches all building occupants? (public address, pager, cell phone, computer override, etc.) Will one or more of these systems be operational under hazard conditions? (UPS, emergency power)	Depending upon building size, a mass notification system will provide warning and alert information, along with actions to take before and after an incident if there is redundancy and power. Reference: <i>DoD UFC 4-010-01</i>	The telephone system has a building-wide announcing feature that can be activated by pressing one button at any phone. It reaches all users within audible distance of a phone. This system will continue to operate on the UPS and/or backup generator power.
10.16	Do control centers and their designated alternate locations have equivalent or reduced capability for voice, data, mass notification, etc.? (emergency operations, security, fire alarms, building automation) Do the alternate locations also have access to backup systems, including emergency power?	Reference: <i>GSA PBS-P100</i>	The emergency operations center is the large conference room. There is no designated alternate. The room is equipped with network and telephone connections and cell phones are able to receive a signal.
11	Equipment Operations and Maintenance		
11.8	Is stairway and exit sign lighting operational?	The maintenance program for stairway and exit sign lighting (all egress lighting) should ensure functioning under normal and emergency power conditions. Expect building codes to be updated as emergency egress lighting is moved from upper walls and over doorways to floor level as heat and smoke drive occupants to crawl along the	Yes, standard door or ceiling mounted exit signs and emergency lighting (battery packs) are in place for all six exits from the building.

Section	Vulnerability Question	Guidance	Observations
		<p>floor to get out of the building. Signs and lights mounted high have limited or no benefit when obscured.</p> <p>Reference: <i>FEMA 386-7</i></p>	
13	Security Master Plan		
13.1	<p>Does a written security plan exist for this site or building?</p> <p>When was the initial security plan written and last revised?</p> <p>Who is responsible for preparing and reviewing the security plan?</p>	<p>The development and implementation of a security master plan provides a roadmap that outlines the strategic direction and vision, operational, managerial, and technological mission, goals, and objectives of the organization's security program.</p> <p>Reference: <i>DOC CIAO Vulnerability Assessment Framework 1.1</i></p>	<p>The Security Officer maintains the fire evacuation and response plan and has posted fire evacuation routes in key office hallways and break areas.</p> <p>HIC does not have a mass evacuation plan and rally point.</p>

**Building Design Mitigation Measures
(Suburban Version)**

Asset-Threat/Hazard Pair	Current Risk Rating	Suggested Mitigation Measure	Revised Risk Rating
1. Explosive Blast/Structural	High	FRF film on window	Medium
2. Explosive Blast/Structural	High	Enclose open entrance area	Medium
3. Chemical/Mechanical	High	Extend Air Intake	Medium
4. Biological/Mechanical	High	Extend Air Intake	Medium
5. Radiological/Site	Medium	Mass Evacuation Plan and Rally Point	Low

**UNIT X-B CASE STUDY ACTIVITY:
BUILDING DESIGN GUIDANCE
(Urban Version)**

In this unit, the emphasis will be upon providing a balanced building envelope that is a defensive layer against the terrorist tactic of interest and avoiding situations where one incident affects more than one building system. The **Building Vulnerability Assessment Checklist in FEMA 426 (Table 1-22, pages 1-46 to 1-93)** can be used as a screening tool for preliminary building design vulnerability assessment or for assessment of an existing building. The checklist includes questions that determine if critical and emergency systems will continue to function to enhance deterrence, detection, denial, and damage limitation during and after a threat or hazard situation.

Requirements

Assign sections of the checklist to the group member who is most knowledgeable and qualified to perform an assessment of the assigned area. Refer to the Appendix B Case Study to determine answers to the questions. Then review results as a team to identify vulnerabilities and possible mitigation measures.

1. Complete the following questions of the **Building Vulnerability Assessment Checklist (FEMA 426, Table 1-22, pages 1-46 to 1-93)** which address building design.

Note: There are 49 questions below (**157** in Section 2, **7** in Section 3, **2** in Section 4, **7** in Section 6, **3** in Section 7, **3** in Section 8, **4** in Section 9, **5** in Section 10, **2** in Section 11, and **1** in Section 13), so it is recommended that the team split up the questions among themselves taking 7-9 questions each and review the Appendix B Case Study for answers. Apportion the available time for gathering the answers and then provide each other the answers while performing the two actions below.

2. Upon completion of these portions of the checklist, refer back to the vulnerability ratings determined in the Unit IV Case Study Activity and, based on this more detailed analysis, decide if any vulnerability rating needs adjustment. Adjust the Threat Matrix chart accordingly for vulnerability rating and risk rating.
3. Select mitigation measures to reduce vulnerability and associated risk based upon the building design.
4. Estimate the new risk ratings for high risk asset-threat pairs (as adjusted in step 2 above) based on the recommended mitigation measures.

Section	Vulnerability Question	Guidance	Observations
2	Architectural		
2.5	Do entrances avoid significant queuing?	<p>If queuing will occur within the building footprint, the area should be enclosed in blast-resistant construction. If queuing is expected outside the building, a rain cover should be provided. For manpower and equipment requirements, collocate or combine staff and visitor entrances.</p> <p>Reference: <i>GSA PBS-P100</i></p>	<p>The HazardCorp Building has a spacious lobby that avoids queuing.</p>
2.6	<p>Does security screening cover all public and private areas?</p> <p>Are public and private activities separated?</p> <p>Are public toilets, service spaces, or access to stairs or elevators located in any non-secure areas, including the queuing area before screening at the public entrance?</p>	<p>Retail activities should be prohibited in non-secured areas. However the Public Building Cooperative Use Act of 1976 encourages retail and mixed uses to create open and inviting buildings. Consider separating entryways, controlling access, hardening shared partitions, and special security operational countermeasures.</p> <p>Reference: <i>GSA PBS-P100 and FEMA 386-7</i></p>	<p>The Lobby has open access to retail, atrium, mailroom, and meeting room spaces. Thus, public and private activities are not completely separated.</p> <p>Visitors to controlled floors are instructed to go to the Lobby Reception Desks and call the office to be visited to get an escort. That escort will come to the desk and take the visitor to the office. However, not all floors are controlled, so visitors can get off at those floors to transact business.</p> <p>Security desk as required by tenants are at one or more elevator lobbies at the floors rented by those tenants. Some tenants have a security desk at only one floor, with access to other floors controlled.</p> <p>Designated elevators, including one service elevator, have card readers and PIN (Personal Identification Number) keypads for movement to and from access controlled floors.</p> <p>The building stairways extending into the underground parking have card readers and PIN keypads at each level of underground parking to gain entrance to the</p>

Section	Vulnerability Question	Guidance	Observations
			stairways.
2.7	Is access control provided through main entrance points for employees and visitors? (lobby receptionist, sign-in, staff escorts, issue of visitor badges, checking forms of personal identification, electronic access control systems)	Reference: <i>Physical Security Assessment for the Department of Veterans Affairs Facilities</i>	Electronic access control is set up for building occupants / tenants. Visitor access control is handled at the Lobby Reception Desk for those requiring escort to controlled floors. There is no other control for visitors for retail, lobby, meeting rooms, or floors who do not have specific security needs.
2.8	Is access to private and public space or restricted area space clearly defined through the design of the space, signage, use of electronic security devices, etc.?	Finishes and signage should be designed for visual simplicity. Reference: <i>Physical Security Assessment for the Department of Veterans Affairs Facilities</i>	Currently electronic security is the only indication differentiating private and public space. The only signage is the standard menu board that indicates what tenant is on what floor.
2.9	Is access to elevators distinguished as to those that are designated only for employees and visitors?	Reference: <i>Physical Security Assessment for the Department of Veterans Affairs Facilities</i>	Twenty-eight passenger elevators and three service elevators serve the various levels of the building. Two building elevators provide service to the underground parking levels. The plaza underground parking has two elevators that are located just east of the plaza parking entrance and exit. Designated elevators, including one service elevator, have card readers and PIN (Personal Identification Number) keypads for movement to and from access controlled floors. To get the elevator to move to a specific floor you have to press the floor key, read your card, and enter your PIN. In addition, there is a Duress PIN that alerts building and floor security that an authorized person is moving to a controlled floor with a security problem. Two of the

Section	Vulnerability Question	Guidance	Observations
			<p>designated building elevators with access controls serve the underground parking levels.</p> <p>Visitors are not capable of using the controlled access elevators.</p> <p>The elevators and stairwells serving the underground parking that is not under the building have no access control equipment installed.</p>
2.10	Do public and employee entrances include space for possible future installation of access control and screening equipment?	<p>These include walk-through metal detectors and x-ray devices, identification check, electronic access card, search stations, and turnstiles.</p> <p>Reference: <i>GSA PBS-P100</i></p>	Yes, the Lobby has more than adequate space for reconfiguring to any security format desired for any security equipment needed.
2.11	Do foyers have reinforced concrete walls and offset interior and exterior doors from each other?	<p>Consider for exterior entrances to the building or to access critical areas within the building if explosive blast hazard must be mitigated.</p> <p>Reference: <i>U.S. Army TM 5-853</i></p>	<p>The building has a window curtain wall on the exterior. The Lobby, albeit having stronger glass has fewer structural members to which to transfer blast loading, and will be affected the most by this blast location.</p> <p>There are no exterior doors in the Lobby that are aligned with interior doors.</p> <p>None of the Lobby is hardened and the Lobby atrium is open for the first 3 floors.</p>
2.13	Do circulation routes have unobstructed views of people approaching controlled access points?	<p>This applies to building entrances and to critical areas within the building.</p> <p>References: <i>USAF Installation Force Protection Guide and DoD UFC 4-010-01</i></p>	<p>CCTV is set up at most exterior entrances to the building. CCTV is also at elevator lobbies, especially if secure access is the policy on that floor.</p> <p>Security personnel at the Lobby Reception Desk have full view of the entrances and elevator circulation routes.</p>

Section	Vulnerability Question	Guidance	Observations
2.15	<p>Are critical assets (people, activities, building systems and components) located close to any main entrance, vehicle circulation, parking, maintenance area, loading dock, or interior parking?</p> <p>Are the critical building systems and components hardened?</p>	<p>Critical building components include: Emergency generator including fuel systems, day tank, fire sprinkler, and water supply; Normal fuel storage; Main switchgear; Telephone distribution and main switchgear; Fire pumps; Building control centers; Uninterruptible Power Supply (UPS) systems controlling critical functions; Main refrigeration and ventilation systems if critical to building operation; Elevator machinery and controls; Shafts for stairs, elevators, and utilities; Critical distribution feeders for emergency power. Evacuation and rescue require emergency systems to remain operational during a disaster and they should be located away from potential attack locations. Primary and backup systems should be separated to reduce the risk of both being impacted by a single incident if collocated. Utility systems should be located at least 50 feet from loading docks, front entrances, and parking areas.</p> <p>One way to harden critical building systems and components is to enclose them within hardened walls, floors, and ceilings. Do not place them near high-risk areas where they can receive collateral damage.</p> <p>Reference: <i>GSA PBS-P100</i></p>	<p>Utility entrances into the building are expected to be exposed in the underground parking levels. The loading dock has utility services under it as well as a fuel storage tank. Electrical utilities room is on an outside wall of the first floor with little stand-off and next to an underground vehicle parking ramp.</p> <p>Vertical utility distribution is in separated pipe chases or in elevator shafts.</p> <p>Egress stairwells do not discharge to the outside, but to the loading dock and to the area near the electrical utilities room.</p> <p>None of the critical building systems are hardened.</p>
2.16	<p>Are high-value or critical assets located as far into the interior of the building as possible and separated from the public areas of the building?</p>	<p>Critical assets, such as people and activities, are more vulnerable to hazards when on an exterior building wall or adjacent to uncontrolled public areas inside the building.</p> <p>Reference: <i>GSA PBS-P100</i></p>	<p>This high-rise building uses vertical separation to provide protection to high-value and critical assets.</p> <p>The assets are not well separated from public areas of the building in every case, especially in the underground parking levels under the building. Critical assets are</p>

Section	Vulnerability Question	Guidance	Observations
			also contained on exterior walls: administration and electric utilities room, for example.
2.17	Is high visitor activity away from critical assets?	<p>High-risk activities should also be separated from low-risk activities. Also, visitor activities should be separated from daily activities.</p> <p>Reference: <i>USAF Installation Force Protection Guide</i></p>	<p>Low-risk activities are limited to floors 1 to 3. All visitors enter through the first floor. At times, visitors may be one floor above or below critical assets.</p> <p>Otherwise the security protocols in place keep visitors away from the critical assets as much as can be expected.</p>
2.19	Are loading docks and receiving and shipping areas separated in any direction from utility rooms, utility mains, and service entrances, including electrical, telephone/data, fire detection/alarm systems, fire suppression water mains, cooling and heating mains, etc.?	<p>Loading docks should be designed to keep vehicles from driving into or parking under the building. If loading docks are in close proximity to critical equipment, consider hardening the equipment and service against explosive blast. Consider a 50-foot separation distance in all directions.</p> <p>Reference: <i>GSA PBS-P100</i></p>	<p>No, the loading dock connects directly into interior space, critical functions, and infrastructure, including an egress stairwell and the service elevators.</p> <p>50-foot separation is not present in most cases.</p>
2.20	<p>Are mailrooms located away from building main entrances, areas containing critical services, utilities, distribution systems, and important assets?</p> <p>Is the mailroom located near the loading dock?</p>	<p>The mailroom should be located at the perimeter of the building with an outside wall or window designed for pressure relief.</p> <p>By separating the mailroom and the loading dock, the collateral damage of an incident at one has less impact upon the other. However, this may be the preferred mailroom location.</p> <p>Off-site screening stations or a separate delivery processing building on site may be cost-effective, particularly if several buildings may share one mailroom. A separate delivery processing building reduces risk and simplifies protection measures.</p>	<p>HazardCorp receives mail, packages, and equipment at the loading dock where a recently renovated (per DoD criteria) mailroom/shipping office inspects the items using x-ray and other equipment before distributing to tenants within the building. By agreement, HazardCorp Building accepts deliveries for specific tenants in other buildings in the immediate vicinity (within 2 city blocks) due to this mailroom capability.</p> <p>Mailroom is adjacent to the loading dock and far from other entrances.</p>

Section	Vulnerability Question	Guidance	Observations
		Reference: <i>GSA PBS-P100</i>	
2.22	Are areas of refuge identified, with special consideration given to egress?	Areas of refuge can be safe havens, shelters, or protected spaces for use during specified hazards. Reference: <i>FEMA 386-7</i>	There are no specific safe havens provided by HazardCorp in this building and no information that any of the tenants have a shelter. The Office of Emergency Management (25 th floor) may have shelter capability built-in due to the Emergency Operations Center on this floor supported by extensive backup electric generation.
2.23	Are stairwells required for emergency egress located as remotely as possible from high-risk areas where blast events might occur? Are stairways maintained with positive pressure or are there other smoke control systems?	Consider designing stairs so that they discharge into other than lobbies, parking, or loading areas. Maintaining positive pressure from a clean source of air (may require special filtering) aids in egress by keeping smoke, heat, toxic fumes, etc. out of the stairway. Pressurize exit stairways in accordance with the National Model Building Code. Reference: <i>GSA PBS-P100 and CDC/NIOSH, Pub 2002-139</i>	Stairwell #1 is located on the southwest side (exits near loading dock) and Stairwell #2 is located on the northwest side within the central core (exits near the electrical utilities room and vehicle ramp to underground parking). Both exit stairwells discharge to the building interior at ground level or to the parking levels underneath the building. Per local building code the stairwells are pressurized to keep smoke out during fires.
2.25	Do interior barriers differentiate level of security within a building?	Reference: <i>USAF Installation Force Protection Guide</i>	Electronic controls exist in the form of alarms, door locks, proximity cards, and use of PIN numbers for stairwell and elevator access.
2.26	Are emergency systems located away from high-risk areas?	The intent is to keep the emergency systems out of harm's way, such that one incident takes out all capability – both the regular systems and their backups. Reference: <i>FEMA 386-7</i>	Emergency power generators are on the 4 th floor or higher. However, four fuel tanks are under the loading dock area. Communications have redundancy located away from high-risk areas.
3	Structural Systems		
3.1	What type of construction?	The type of construction provides an indication of the robustness to abnormal loading and load reversals. A reinforced	Steel moment-resisting-frame construction uses steel columns and beams.

Section	Vulnerability Question	Guidance	Observations
	<p>What type of concrete and reinforcing steel?</p> <p>What type of steel?</p> <p>What type of foundation?</p>	<p>concrete moment-resisting frame provides greater ductility and redundancy than a flat-slab or flat-plate construction. The ductility of steel frame with metal deck depends on the connection details and pre-tensioned or post-tensioned construction provides little capacity for abnormal loading patterns and load reversals. The resistance of load-bearing wall structures varies to a great extent, depending on whether the walls are reinforced or unreinforced. A rapid screening process developed by FEMA for assessing structural hazards identifies the following types of construction with a structural score ranging from 1.0 to 8.5. A higher score indicates a greater capacity to sustain load reversals.</p> <p>Wood buildings of all types - 4.5 to 8.5 Steel moment-resisting frames - 3.5 to 4.5 Braced steel frames - 2.5 to 3.0 Light metal buildings - 5.5 to 6.5 Steel frames with cast-in-place concrete shear walls - 3.5 to 4.5 Steel frames with unreinforced masonry infill walls - 1.5 to 3.0 Concrete moment-resisting frames - 2.0 to 4.0 Concrete shear wall buildings - 3.0 to 4.0 Concrete frames with unreinforced masonry infill walls - 1.5 to 3.0 Tilt-up buildings - 2.0 to 3.5 Precast concrete frame buildings - 1.5 to 2.5 Reinforced masonry - 3.0 to 4.0 Unreinforced masonry - 1.0 to 2.5</p> <p>References: <i>FEMA 154 and Physical Security Assessment for the Department of Veterans Affairs Facilities</i></p>	<p>The office floor slab is an electrified composite 3-inch metal deck with 2-1/2- inch normal-weight concrete fill spanning between the steel beams.</p> <p>The underground parking floor slabs are substantial cast-in-place reinforced concrete with reinforced concrete columns that align with steel columns on the first floor and have additional columns to handle the vehicle loading.</p> <p>The lateral load resisting system (for wind loads only) consists of four perimeter moment frames, with a column spacing of approximately 15 feet , one at each exterior wall, augmented by two-story belt trusses between the 4th and 6th floors and the 22nd and 24th floors. There are additional trusses at the north and south elevations below the 4th floor. An interior cross braced core extends from the foundations to the 6th floor. The horizontal shear is transferred into the core at the 4th and 6th floors. The 4th floor diaphragm consists of a 14-inch thick reinforced concrete slab with embedded T-sections. The 6th floor is an 8-inch thick reinforced concrete slab.</p> <p>The building foundations are reinforced concrete caissons. The caissons are needed due to the proximity to the water.</p>

Section	Vulnerability Question	Guidance	Observations
3.3	<p>Are the steel frame connections moment connections?</p> <p>Is the column spacing minimized so that reasonably sized members will resist the design loads and increase the redundancy of the system?</p> <p>What are the floor-to-floor heights?</p>	<p>A practical upper level for column spacing is generally 30 feet. Unless there is an overriding architectural requirement, a practical limit for floor-to-floor heights is generally less than or equal to 16 feet.</p> <p>Reference: <i>GSA PBS-P100</i></p>	<p>The connections for this steel structure are moment connections.</p> <p>The first to third floors is an open atrium and 60 foot transfer trusses at the fourth floor span between the core and girders towards the front of the atrium to provide clear space</p> <p>The lateral load resisting system (for wind loads only) consists of four perimeter moment frames, with a column spacing of approximately 15 feet , one at each exterior wall, augmented by two-story belt trusses between the 4th and 6th floors and the 22nd and 24th floors.</p> <p>Along the four exterior elevations, center-to-center column spacing is approximately 15 feet. Column trees are used at these locations. A column tree is a shop-fabricated column assembly with beam stubs shop-welded to the column flanges.</p> <p>Along the exterior elevations, and within the core up to the 6th floor, the spans are approximately 30 feet. Interior column spacing is approximately 30 feet. At these locations, traditional moment frame construction is used.</p> <p>Some columns below the 6th floor are special large sections or built-up box shapes with plates up to 10 inches thick welded from flange to flange, parallel to the web, to provide the necessary section properties.</p> <p>The floor-to-floor story height</p>

Section	Vulnerability Question	Guidance	Observations
			<p>for office and parking garage floors is 12 feet. The first three floors are 14 feet and the mechanical floors are 16 feet in height.</p>
3.4	<p>Are critical elements vulnerable to failure?</p>	<p>The priority for upgrades should be based on the relative importance of structural or non-structural elements that are essential to mitigating the extent of collapse and minimizing injury and damage.</p> <p>Primary Structural Elements provide the essential parts of the building's resistance to catastrophic blast loads and progressive collapse. These include columns, girders, roof beams, and the main lateral resistance system.</p> <p>Secondary Structural Elements consist of all other load bearing members, such as floor beams, slabs, that are essential for life safety systems or elements which can cause substantial injury if failure occurs, including ceilings or heavy suspended mechanical units.</p> <p>Secondary Non-Structural Elements consist of all elements not covered in primary non-structural elements, such as partitions, furniture, and light fixtures.</p> <p>Reference: <i>GSA PBS-P100</i></p>	<p>The four most prominent elements vulnerable to failure are the canopy at the plaza main entrance, the atrium vertical columns that support transfer girders, the loading dock area, and the columns of the underground parking levels.</p> <p>The canopy must be able to take load reversals, thus hardening is in order.</p> <p>Even though the atrium columns are substantially strengthened, a progressive collapse analysis is needed or these columns must receive additional hardening so that they do not fail under Design Basis Threat blast loads or smaller hand carried weapons.</p> <p>Hardening of the loading dock walls to direct the blast away from the building is also a consideration due to the proximity of the loading dock to egress and critical equipment.</p> <p>The columns and column to floor connections of the underground parking levels are also of concern, especially for that parking below the building.</p> <p>Other Secondary Non-Structural Elements of particular concern due to no consideration in original design are the components of the atrium that would be affected by blast entering at the level of the first three floors.</p>

Section	Vulnerability Question	Guidance	Observations
3.5	Will the structure suffer an unacceptable level of damage resulting from the postulated threat (blast loading or weapon impact)?	<p>The extent of damage to the structure and exterior wall systems from the bomb threat may be related to a protection level. The following is for new buildings:</p> <p>Level of Protection Below Antiterrorism Standards - Severe damage. Frame collapse/massive destruction. Little left standing. Doors and windows fail and result in lethal hazards. Majority of personnel suffer fatalities.</p> <p>Very Low Level Protection - Heavy damage. Onset of structural collapse. Major deformation of primary and secondary structural members, but progressive collapse is unlikely. Collapse of non-structural elements. Glazing will break and is likely to be propelled into the building, resulting in serious glazing fragment injuries, but fragments will be reduced. Doors may be propelled into rooms, presenting serious hazards. Majority of personnel suffer serious injuries. There are likely to be a limited number (10 percent to 25 percent) of fatalities.</p> <p>Low Level of Protection - Moderate damage, unrepairable. Major deformation of non-structural elements and secondary structural members and minor deformation of primary structural members, but progressive collapse is unlikely. Glazing will break, but fall within 1 meter of the wall or otherwise not present a significant fragment hazard. Doors may fail, but they will rebound out of their frames, presenting minimal hazards. Majority of personnel suffer significant injuries. There may be a few (<10 percent) fatalities.</p> <p>Medium Level Protection -</p>	<p>Progressive collapse is a concern because the first to third floors is an open atrium and 60 foot transfer trusses at the fourth floor span between the core and girders towards the front of the atrium to provide clear space.</p> <p>The building exterior is clad with an aluminum/glass curtain wall attached to the face of the building structure. Typical glazing is 1/4 inch or 3/8 inch annealed single pane double strength glass. The first three floors are 3/8 inch thermally tempered single-pane glass.</p> <p>In the urban environment without significant stand-off and the design used for this building, the estimated damage level will be very high.</p>

Section	Vulnerability Question	Guidance	Observations
		<p>Minor damage, repairable. Minor deformations of non-structural elements and secondary structural members and no permanent deformation in primary structural members. Glazing will break, but will remain in the window frame. Doors will stay in frames, but will not be reusable. Some minor injuries, but fatalities are unlikely.</p> <p>High Level Protection - Minimal damage, repairable. No permanent deformation of primary and secondary structural members or non-structural elements. Glazing will not break. Doors will be reusable. Only superficial injuries are likely.</p> <p>Reference: <i>DoD UFC 4-010-01</i></p>	
3.8	<p>Are there transfer girders supported by columns within unscreened public spaces or at the exterior of the building?</p>	<p>Transfer girders allow discontinuities in columns between roof and foundation. This design has inherent difficulty in transferring load to redundant paths upon loss of a column or the girder. Transfer beams and girders that, if lost, may cause progressive collapse are therefore highly discouraged.</p> <p>Reference: <i>GSA PBS-P100</i></p>	<p>The open 3-story atrium has transfer girders on the fourth floor to handle the columns in the 47 stories above. These columns are in the unscreened public area of the building and are on the first layer of columns inside the building on the plaza main entrance side.</p>
3.10	<p>Will the loading dock design limit damage to adjacent areas and vent explosive force to the exterior of the building?</p>	<p>Design the floor of the loading dock for blast resistance if the area below is occupied or contains critical utilities.</p> <p>Reference: <i>GSA PBS-P100</i></p>	<p>The loading dock area has hardening only in those areas affected by the renovation of the mailroom for upgraded security.</p> <p>There is significant critical infrastructure underneath the loading dock area that requires hardening and the remaining standard construction walls need hardening to direct blast away from the building without any other impact. This includes adjacent column hardening.</p>

Section	Vulnerability Question	Guidance	Observations
3.11	Are mailrooms, where packages are received and opened for inspection, and unscreened retail spaces designed to mitigate the effects of a blast on primary vertical or lateral bracing members?	<p>Where mailrooms and unscreened retail spaces are located in occupied areas or adjacent to critical utilities, walls, ceilings, and floors, they should be blast- and fragment-resistant.</p> <p>Methods to facilitate the venting of explosive forces and gases from the interior spaces to the outside of the structure may include blow-out panels and window system designs that provide protection from blast pressure applied to the outside, but that readily fail and vent if exposed to blast pressure on the inside.</p> <p>Reference: <i>GSA PBS-P100</i></p>	<p>HazardCorp receives mail, packages, and equipment at the loading dock where a recently renovated (per DoD criteria) mailroom/shipping office inspects the items using x-ray and other equipment before distributing to tenants within the building. By agreement, HazardCorp Building accepts deliveries for specific tenants in other buildings in the immediate vicinity (within 2 city blocks) due to this mailroom capability.</p> <p>Retail space is another matter as it is unscreened and has access to the Lobby. The retail space has no hardening of shared walls. As a minimum the doors entering the Lobby should be used as emergency exits only with crash bars and alarms.</p>
4	Building Envelope		
4.1	What is the designed or estimated protection level of the exterior walls against the postulated explosive threat?	<p>The performance of the façade varies to a great extent on the materials. Different construction includes brick or stone with block backup, steel stud walls, precast panels, curtain wall with glass, stone, or metal panel elements.</p> <p>Shear walls that are essential to the lateral and vertical load bearing system and that also function as exterior walls should be considered primary structures and should resist the actual blast loads predicted from the threats specified. Where exterior walls are not designed for the full design loads, special consideration should be given to construction types that reduce the potential for injury.</p> <p>Reference: <i>GSA PBS-P100</i></p>	<p>A window curtain wall of aluminum and glass, even slightly thicker thermally tempered glass will not provide the desired level of protection without additional hardening. Hardening the glass is one concern, but hardening the framing of the curtain wall is of greater concern as blast resistant curtain wall design was not available when this building was originally built.</p> <p>A blast analysis would be in order to specify the type and level of hardening required.</p>

Section	Vulnerability Question	Guidance	Observations
4.2	<p>Is there less than 40 percent fenestration per structural bay?</p> <p>Is the window system design on the exterior façade balanced to mitigate the hazardous effects of flying glazing following an explosive event? (glazing, frames, anchorage to supporting walls, etc.)</p> <p>Do the glazing systems with a 1/2-inch (3/4-inch is better) bite contain an application of structural silicone?</p> <p>Is the glazing laminated or is it protected with an anti-shatter (fragment retention) film?</p> <p>If an anti-shatter film is used, is it a minimum of a 7-mil thick film, or specially manufactured 4-mil thick film?</p>	<p>The performance of the glass will similarly depend on the materials. Glazing may be single pane or double pane, monolithic or laminated, annealed, heat strengthened or fully tempered.</p> <p>The percent fenestration is a balance between protection level, cost, the architectural look of the building within its surroundings, and building codes. One goal is to keep fenestration to below 40 percent of the building envelope vertical surface area, but the process must balance differing requirements. A blast engineer may prefer no windows; an architect may favor window curtain walls; building codes require so much fenestration per square footage of floor area; fire codes require a prescribed window opening area if the window is a designated escape route; and the building owner has cost concerns.</p> <p>Ideally, an owner would want 100 percent of the glazed area to provide the design protection level against the postulated explosive threat (design basis threat– weapon size at the expected stand-off distance). However, economics and geometry may allow 80 percent to 90 percent due to the statistical differences in the manufacturing process for glass or the angle of incidence of the blast wave upon upper story windows (4th floor and higher).</p> <p>Reference: <i>GSA PBS-P100</i></p>	<p>Window curtain walls have almost 100 percent glazing or windows per structural bay (the distance between two exterior columns). Most of the glazing is optical, but the glazing that covers the structural components above the lower drop ceiling to the floor above is called spandrel glass.</p> <p>Fenster is German for window.</p> <p>The framing of window curtain walls is weaker that can be designed for windows connected to more substantial wall material. Recent testing shows that window curtain walls can be hardened and, with their inherent flexibility, can survive higher blast loadings.</p> <p>The strongest glass in the building is 3/8-inch thermally tempered on the first three floors. The remaining glass is 1/4-inch or 3/8-inch annealed double strength. All glass is single pane without any other hardening.</p>
6	Mechanical Systems (HVAC and CBR)		
6.1	<p>Where are the air intakes and exhaust louvers for the building? (low, high, or midpoint</p>	<p>Air intakes should be located on the roof or as high as possible. Otherwise secure within CPTED-compliant fencing or enclosure. The fencing or</p>	<p>The air used to heat and cool the HazardCorp Building is filtered in the various mechanical rooms using standard industrial grade</p>

Section	Vulnerability Question	Guidance	Observations
	<p>of the building structure)</p> <p>Are the intakes and exhausts accessible to the public?</p>	<p>enclosure should have a sloped roof to prevent the throwing of anything into the enclosure near the intakes.</p> <p>Reference: <i>GSA PBS-P100</i> states that air intakes should be on the fourth floor or higher and, on buildings with three floors or less, they should be on the roof or as high as practical. Locating intakes high on a wall is preferred over a roof location.</p> <p>Reference: <i>DoD UFC 4-010-01</i> states that, for all new inhabited buildings covered by <i>FEMA 426</i>, all air intakes should be located at least 3 meters (10 feet) above the ground.</p> <p>Reference: <i>CDC/NIOSH, Pub 2002-139</i> states: “An extension height of 12 feet (3.7 m) will place the intake out of reach of individuals without some assistance. Also, the entrance to the intake should be covered with a sloped metal mesh to reduce the threat of objects being tossed into the intake. A minimum slope of 45° is generally adequate. Extension height should be increased where existing platforms or building features (i.e., loading docks, retaining walls) might provide access to the outdoor air intakes.”</p> <p>Reference: <i>LBNL Pub 51959</i>: Exhausts are also a concern during an outdoor release, especially if exhaust fans are not in continuous operation, due to wind effects and chimney effects (air movement due to differential temperature).</p>	<p>MERV 8 filters. Outside make-up air is brought in through vents in the wall located at the associated mechanical room floor, with the lowest vent being on the 4th floor. The main mechanical rooms are located on the 26th, 49th, and 50th floors.</p> <p>Screened exhaust ducts are located at the mechanical floor level or are extended to the roof.</p> <p>Thus, the intakes and exhausts are not accessible to the public.</p>
6.3	<p>Are there multiple air intake locations?</p>	<p>Single air intakes may feed several air handling units. Indicate if the air intakes are localized or separated. Installing low-leakage dampers is one way</p>	<p>There are multiple air intake locations – one or more on every mechanical floor and other additional smaller units on other floors.</p>

Section	Vulnerability Question	Guidance	Observations
		<p>to provide the system separation when necessary.</p> <p>Reference: <i>Physical Security Assessment for the Department of Veterans Affairs Facilities</i></p>	
6.4	<p>What are the types of air filtration? Include the efficiency and number of filter modules for each of the main air handling systems.</p> <p>Is there any collective protection for chemical, biological, and radiological contamination designed into the building?</p>	<p>MERV – Minimum Efficiency Reporting Value</p> <p>HEPA – High Efficiency Particulate Air</p> <p>Activated charcoal for gases</p> <p>Ultraviolet C for biologicals</p> <p>Consider mix of approaches for optimum protection and cost-effectiveness.</p> <p>Reference: <i>CDC/NIOSH Pub 2002-139</i></p>	<p>The air used to heat and cool the HazardCorp Building is filtered in the various mechanical rooms using standard industrial grade MERV 8 filters.</p> <p>There is no CBR protection designed into the building.</p>
6.5	<p>Is there space for larger filter assemblies on critical air handling systems?</p>	<p>Air handling units serving critical functions during continued operation may be retrofitted to provide enhanced protection during emergencies. However, upgraded filtration may have negative effects upon the overall air handling system operation, such as increased pressure drop.</p> <p>Reference: <i>CDC/NIOSH, Pub 2002-139</i></p>	<p>The ductwork for return air from conditioned spaces has sufficient room inside the ductwork and mechanical room area for equipment under control of Building Management to incorporate additional filters and equipment. HVAC systems within tenant spaces usually have much less space for making changes</p>
6.8	<p>How are the air handling systems zoned?</p> <p>What areas and functions do each of the primary air handling systems serve?</p>	<p>Understanding the critical areas of the building that must continue functioning focuses security and hazard mitigation measures.</p> <p>Applying HVAC zones that isolate lobbies, mailrooms, loading docks, and other entry and storage areas from the rest of the building HVAC zones and maintaining negative pressure within these areas will contain CBR releases. Identify common return systems that service more than one zone, effectively making a large single zone.</p>	<p>A zoned, smoke control system is provided in the building. This system is designed to pressurize the floors above and below the floor of alarm and exhaust the floor of alarm to limit smoke and heat spread. Thus, the building is separated into many zones that can be controlled independently.</p> <p>The mailroom is the only part of the building designed as a separate zone during its renovation.</p> <p>The egress stairwells were built</p>

Section	Vulnerability Question	Guidance	Observations
		<p>Conversely, emergency egress routes should receive positive pressurization to ensure contamination does not hinder egress. Consider filtering of the pressurization air.</p> <p>Reference: <i>CDC/NIOSH, Pub 2002-139 and LBNL PUB 51959</i></p>	<p>of fire-rated construction using gypsum wall board and are pressurized to keep smoke out of the stairwells during a fire per local building code.</p>
6.14	<p>Where are the building automation control centers and cabinets located?</p> <p>Are they in secure areas?</p> <p>How is the control wiring routed?</p>	<p>Access to any component of the building automation and control system could compromise the functioning of the system, increasing vulnerability to a hazard or precluding their proper operation during a hazard incident.</p> <p>The HVAC and exhaust system controls should be in a secure area that allows rapid shutdown or other activation based upon location and type of attack.</p> <p>Reference: <i>FEMA 386-7, DOC CIAO Vulnerability Assessment Framework 1.1, and LBNL PUB 51959</i></p>	<p>Building Management has SCADA (Supervisory Control and Data Acquisition), EMCS (Energy Management and Control System), and Building Security systems coordinated with the tenants needs and the building overall. Note that the Building Management Systems are connected to the internet for alarms / monitoring / adjustment by engineering/security personnel from home. Building Management is collocated with the Building Security Center / Fire Control Center.</p> <p>Administration, electrical, and utilities, along with the utility risers have controlled access, either key lock, electronic lock using proximity card, and/or balanced magnetic switch with fixed Black and White CCTV (Closed Circuit Television) coverage.</p> <p>More than one vertical riser/pipe chase is used to run any system.</p>
7	Plumbing and Gas Systems		
7.1	<p>What is the method of water distribution?</p>	<p>Central shaft locations for piping are more vulnerable than multiple riser locations.</p> <p>Reference: <i>Physical Security Assessment for Department of Veterans Affairs Facilities</i></p>	<p>The primary water supply is provided by a dedicated fire yard main looped around the complex. This main is supplied directly from the municipal water supply.</p> <p>There are water tanks on each mechanical floor (4th, 26th, and</p>

Section	Vulnerability Question	Guidance	Observations
			<p>50th). The tanks are 2,000 gallons for potable water and 3,000 gallons for sprinkler systems. There are two water service lines, one coming into the building from the west side and one coming from the south (under the loading dock). Electric pumps at various levels pump water from the street level to the tanks for distribution throughout the building.</p> <p>The white blocks in the core of Figure 9 contain the toilets, air conditioning ducts, and risers for electrical, telecom, computer, fire protection, and plumbing unless indicated elsewhere.</p>
7.3	Is there redundancy to the main piping distribution?	<p>Looping of piping and use of section valves provide redundancies in the event sections of the system are damaged.</p> <p>Reference: <i>Physical Security Assessment for Department of Veterans Affairs Facilities</i></p>	
7.4	<p>What is the method of heating domestic water?</p> <p>What fuel(s) is used?</p>	<p>Single source of hot water with one fuel source is more vulnerable than multiple sources and multiple fuel types. Domestic hot water availability is an operational concern for many building occupancies.</p> <p>Reference: <i>Physical Security Assessment for Department of Veterans Affairs Facilities</i></p>	
8	Electrical Systems		
8.1	Are there any transformers or switchgears located outside the building or accessible from the building exterior?	Reference: <i>Physical Security Assessment for the Department of Veterans Affairs Facilities</i>	<p>Only electrical service entrances are accessible in the underground parking levels, vulnerable to public access, and not secured.</p> <p>Once inside the building, all transformers and equipment</p>

Section	Vulnerability Question	Guidance	Observations
	<p>Are they vulnerable to public access?</p> <p>Are they secured?</p>		are not accessible, have limited vulnerability, and are secure.
8.3	How are the electrical rooms secured and where are they located relative to other higher risk areas, starting with the main electrical distribution room at the service entrance?	Reference: <i>Physical Security Assessment for Department of Veterans Affairs Facilities</i>	<p>Administration, electrical, and utilities, along with the utility risers have controlled access, either key lock, electronic lock using proximity card, and/or balanced magnetic switch with fixed Black and White CCTV (Closed Circuit Television) coverage.</p> <p>There are two service entrances to transformers on the 4th floor. The electrical utility room on the first floor is the most vulnerable component as it is on an exterior wall with little stand-off.</p>
8.4	<p>Are critical electrical systems collocated with other building systems?</p> <p>Are critical electrical systems located in areas outside of secured electrical areas?</p> <p>Is security system wiring located separately from electrical and other service systems?</p>	<p>Collocation concerns include rooms, ceilings, raceways, conduits, panels, and risers.</p> <p>Reference: <i>Physical Security Assessment for the Department of Veterans Affairs Facilities</i></p>	<p>While there is some collocation of critical electrical systems, such as backup generators and automatic transfer switches, there has been an effort to provide multiple paths in separate risers to provide some level of redundancy.</p> <p>The same can be said for security system wiring which may also run in risers with other utility systems.</p>
8.6	<p>Does emergency backup power exist for all areas within the building or for critical areas only?</p> <p>How is the emergency power distributed?</p> <p>Is the emergency power system independent from</p>	<p>There should be no single critical node that allows both the normal electrical service and the emergency backup power to be affected by a single incident. Automatic transfer switches and interconnecting switchgear are the initial concerns.</p> <p>Emergency and normal electrical equipment should be installed separately, at different locations,</p>	<p>Building Management provides backup generator and systems for life-safety code requirements. Tenants provide their own backup generator for their critical needs. Thus, critical loads are only supplied, not the whole building.</p> <p>Emergency power has generators distributed</p>

Section	Vulnerability Question	Guidance	Observations
	<p>the normal electrical service, particularly in critical areas?</p>	<p>and as far apart as possible.</p> <p>Reference: <i>GSA PBS-P100</i></p>	<p>throughout the building on various floors to support those tenants that need backup power. A fairly good job has been done to make the emergency power system independent of the normal electrical service wherever possible.</p> <p>The weakest link in the emergency power system is the fuel distribution system based upon the location of tanks relative to generation and how the fuel is supplied or replenished.</p>
9	Fire Alarm Systems		
9.1	<p>Is the building fire alarm system centralized or localized?</p> <p>How are alarms made known, both locally and centrally?</p> <p>Are critical documents and control systems located in a secure yet accessible location?</p>	<p>Fire alarm systems must first warn building occupants to evacuate for life safety. Then they must inform the responding agency to dispatch fire equipment and personnel.</p> <p>Reference: <i>Physical Security Assessment for the Department of Veterans Affairs Facilities</i></p>	<p>The building fire alarm system is centralized with a Fire Control Center collocated with Building Security.</p> <p>Monitoring of the fire-alarm control panel for the building is provided independently at a central station.</p> <p>There is also a Fire Watch phone in each stairwell on each floor that provides communications with the Building Security Office/Fire Control Center. It is a copper wire system powered from the Fire Control Center that provides a backup to other communications for the trained Fire Watch personnel on each floor.</p> <p>As with other systems, the fire alarm systems are accessible where needed or secure where necessary.</p> <p>Critical documents are the responsibility of respective tenants or Building Management as appropriate.</p>

Section	Vulnerability Question	Guidance	Observations
9.2	Where are the fire alarm panels located? Do they allow access to unauthorized personnel?	Reference: <i>Physical Security Assessment for the Department of Veterans Affairs Facilities</i>	The Fire Control Center in the Administration area of the first floor is where the fire alarm panels are located. The Administration area is under access control.
9.3	Is the fire alarm system standalone or integrated with other functions such as security and environmental or building management systems? What is the interface?	Reference: <i>Physical Security Assessment for the Department of Veterans Affairs Facilities</i>	The fire alarm system is standalone and separate from other systems. Note that most other building management systems have internet connections for convenience.
9.5	Is there redundant off-premises fire alarm reporting?	Fire alarms can ring at a fire station, at an intermediary alarm monitoring center, or autodial someone else. See Items 5.21 and 10.5 of the checklist.	Yes, monitoring of the fire-alarm control panel for the building is provided independently at a central station.
10	Communications and IT Systems		
10.1	Where is the main telephone distribution room and where is it in relation to higher-risk areas? Is the main telephone distribution room secure?	One can expect to find voice, data, signal, and alarm systems to be routed through the main telephone distribution room. Reference: <i>FEMA 386-7</i>	Each tenant and Building Management have different voice telecommunication providers. Some tenants use VOIP (Voice Over Internet Protocol) voice providers and others use separate copper or fiber service to analog or digital telephone service providers. One tenant has a satellite communications dish that has two voice circuits built in for trouble shooting satellite connectivity. There are multiple telephone service entrances (3 total) and each tenant has a separate telephone distribution room. Telecommunications has same security and access control throughout building as other utilities.

Section	Vulnerability Question	Guidance	Observations
10.2	Does the telephone system have an UPS (uninterruptible power supply)? -- What is its type, power rating, operational duration under load, and location? (battery, on-line, filtered)	<p>Many telephone systems are now computerized and need an UPS to ensure reliability during power fluctuations. The UPS is also needed to await any emergency power coming on line or allow orderly shutdown.</p> <p>Reference: <i>DOC CIAO Vulnerability Assessment Framework 1.1</i></p>	<p>Building Management uses VOIP as their main voice telecom service and ensures there are Uninterruptible Power Supplies (UPS) on all powered connection points and that these points are also on backup generator power.</p> <p>The tenants have their own systems that may or may not have UPS installed.</p>
10.5	Are there redundant communications systems available?	<p>Critical areas should be supplied with multiple or redundant means of communications. Power outage phones can provide redundancy as they connect directly to the local commercial telephone switch off site and not through the building telephone switch in the main telephone distribution room.</p> <p>A base radio communication system with antenna can be installed in stairwells, and portable sets distributed to floors.</p> <p>References: <i>GSA PBS-P100 and FEMA 386-7</i></p>	<p>Each tenant and Building Management has different voice telecommunication providers. Some tenants use VOIP (Voice Over Internet Protocol) voice providers and others use separate copper or fiber service to analog or digital telephone service providers. One tenant has a satellite communications dish that has two voice circuits built in for trouble shooting satellite connectivity.</p> <p>Building Management uses VOIP as their main voice telecom service and ensures there are Uninterruptible Power Supplies (UPS) on all powered connection points and that these points are also on backup generator power. The Building Security Office/Fire Control Center on the first floor has a “red” phone copper landline connection to a telephone central office as backup communications to the VOIP. Certain tenants also use this system as backup.</p> <p>Cell phones work in various portions of the building.</p> <p>There are repeaters for Building Security’s handheld radios positioned throughout the building to ensure coverage in any location for use by</p>

Section	Vulnerability Question	Guidance	Observations
			<p>security and maintenance personnel. The Building Security Office has spare radios to issue as necessary. The repeaters are on UPS and connected to backup generator power. The repeaters also support the fire department and police department hand held frequencies for both transmission and reception. These frequencies are tested by respective department personnel once a quarter.</p>
10.15	<p>Is there a mass notification system that reaches all building occupants? (public address, pager, cell phone, computer override, etc.)</p> <p>Will one or more of these systems be operational under hazard conditions? (UPS, emergency power)</p>	<p>Depending upon building size, a mass notification system will provide warning and alert information, along with actions to take before and after an incident if there is redundancy and power.</p> <p>Reference: <i>DoD UFC 4-010-01</i></p>	<p>Speakers for voice evacuation announcements are located throughout the building and are activated manually at the Fire Control Center (FCC).</p>
10.16	<p>Do control centers and their designated alternate locations have equivalent or reduced capability for voice, data, mass notification, etc.? (emergency operations, security, fire alarms, building automation)</p> <p>Do the alternate locations also have access to backup systems, including emergency power?</p>	<p>Reference: <i>GSA PBS-P100</i></p>	<p>The Building Security Center, Fire Control Center, and Building Management Control Center are all collocated in the Administration area on the first floor. There is no backup location.</p>

Section	Vulnerability Question	Guidance	Observations
11	Equipment Operations and Maintenance		
11.7	Are backup power systems periodically tested under load?	<p>Loading should be at or above maximum connected load to ensure available capacity and automatic sensors should be tested at least once per year. -- Periodically (once a year as a minimum) check the duration of capacity of backup systems by running them for the expected emergency duration or estimating operational duration through fuel consumption, water consumption, or voltage loss.</p> <p>Reference: <i>FEMA 386-7</i></p>	<p>Testing of generators is done by each respective tenant for their systems. The Building Management generators are run once every three months for 2 hours, exercising all components of the system under near maximum load conditions. If the 2 hour test fails, then repairs are made and another test is coordinated within 2 weeks and so on until the system runs successfully for 2 hours.</p> <p>Uninterruptible Power Supplies for tenant data computer systems are varied based upon the needs of the tenants and the available space in their rented area. Capacity varies from 10 minutes to 2 hours. Actual testing to confirm these capacities is unknown.</p> <p>In addition to the emergency generators, the existing uninterruptible power supply (UPS) provides 4 hours of full operation for the fire alarm system and 212 hours of standby operation.</p> <p>Again, testing to confirm these durations is unknown.</p>
11.8	Is stairway and exit sign lighting operational?	<p>The maintenance program for stairway and exit sign lighting (all egress lighting) should ensure functioning under normal and emergency power conditions.</p> <p>Expect building codes to be updated as emergency egress lighting is moved from upper walls and over doorways to floor level as heat and smoke drive occupants to crawl along the floor to get out of the building.</p>	<p>Emergency power generators are located on various levels and provide back-up power for emergency lighting in corridors and stairwells. Emergency lighting units in the exit stairwells, elevator lobbies and elevator cabs are equipped with individual backup batteries.</p> <p>Battery operated emergency lighting is provided in the stairwells and photo-</p>

Section	Vulnerability Question	Guidance	Observations
		<p>Signs and lights mounted high have limited or no benefit when obscured.</p> <p>Reference: <i>FEMA 386-7</i></p>	<p>luminescent paint is placed on the edge of the stair treads to facilitate emergency exits. In addition to the battery-powered lighting, the stairs also have emergency system lighting powered by the generators.</p> <p>While installed, there is no indication that these systems are on a maintenance program or that they are tested periodically.</p>
13	Security Master Plan		
13.1	<p>Does a written security plan exist for this site or building?</p> <p>When was the initial security plan written and last revised?</p> <p>Who is responsible for preparing and reviewing the security plan?</p>	<p>The development and implementation of a security master plan provides a roadmap that outlines the strategic direction and vision, operational, managerial, and technological mission, goals, and objectives of the organization's security program.</p> <p>Reference: <i>DOC CIAO Vulnerability Assessment Framework 1.1</i></p>	<p>The HazardCorp Building has a Building Security Committee made up of security representatives from each tenant. Building Management heads this committee with the Building Security Chief as the chairman. The committee coordinates the specific and general security needs of the tenants with each other and for the building as a whole.</p> <p>The Building Security Committee maintains the fire evacuation and response plan for the building, coordinated with the fire evacuation and response plan for each tenant.</p>

**Building Design Mitigation Measures
(Urban Version)**

Asset-Threat/Hazard Pair	Current Risk Rating	Suggested Mitigation Measure	Revised Risk Rating
1. Envelope Systems / Vehicle Bomb	High	Harden windows and window curtain wall framing after blast analysis	Medium
2. Structural Systems / Vehicle Bomb	High	Harden atrium columns and use architectural stand-off to add protection. Harden underground parking columns and control access to underground parking under the building to tenants only.	Medium
3. Mechanical Systems / CBR Attack (Chemical)	High	Upgrade filters to MERV 11 or 2 stage filters with HEPA as second filter. Add sensors to switch in activated charcoal filters. Consider on critical floors.	Medium
4. Mechanical Systems / CBR Attack (Mechanical)	High	Add UVGI to HVAC system on critical floors	Medium
5. Mechanical Systems / CBR Attack (Radiological)	Medium	Upgrade filters to MERV 11 or 2 stage filters with HEPA as second filter	Low