


Shoreline Management Plan

Georgia & South Carolina

DP 1120-2-10
Revised 01
1 June 1998

EXHIBIT VI

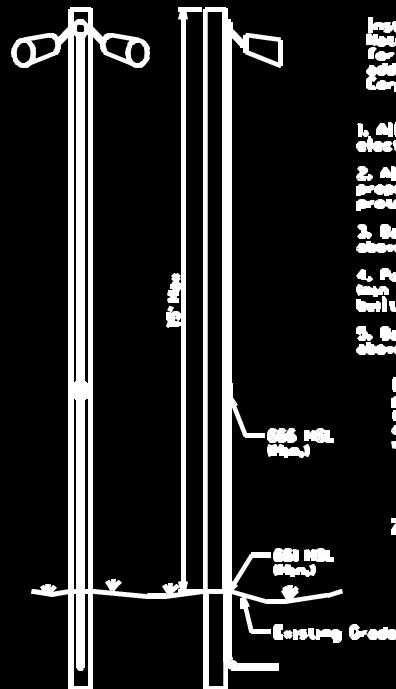

Installation must meet or exceed National Electrical Code standard for wet locations and any additional requirements set by the Corps of Engineers as listed below.

1. All wiring on the pole must be in electrical conduit.
2. All electrical lines on public property must have ground fault protection.
3. Base of power pole must be at or above 651 MSL.
4. Pole is to be metal, treated wood (max 4" x 4") or a commercially built power pole.
5. Base of receptacle must be at or above 655 MSL.

I certify that the wiring, light pole, and fixtures are installed or will be installed and maintained in accordance with this plan.

Applicant's Signature and Date