


### Davis-Besse

#### 2Q/2000 Performance Indicators

Licensee's General Comments: Revised Barrier Integrity Performance Indicators for April 2000 to show NA due to no data collected during 12th Refueling Outage

#### Unplanned Scrams per 7000 Critical Hrs

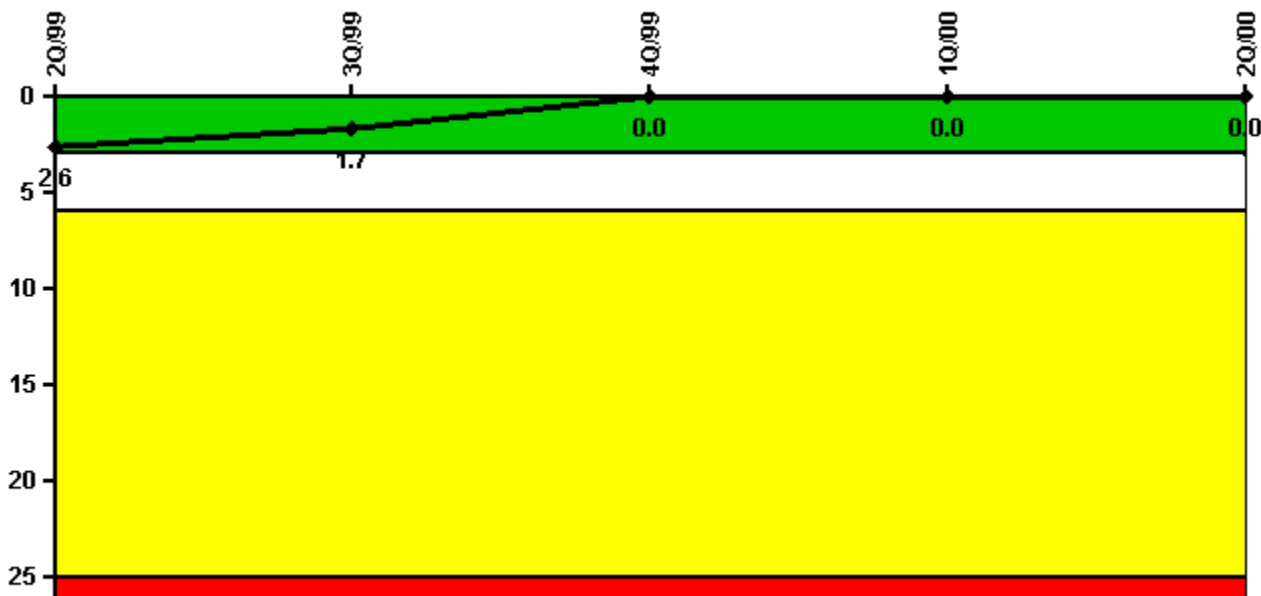

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0


#### Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Unplanned scrams	0	0	0	0	0
Critical hours	1798.3	2208.0	2209.0	2184.0	1067.6
Indicator value	2.6	1.7	0	0	0

Licensee Comments:

2Q/00: Corrected data entry error for 2Q2000 for the number of hours of critical operation. This correction did not result in a change to any PI color.

### Scrams with Loss of Normal Heat Removal

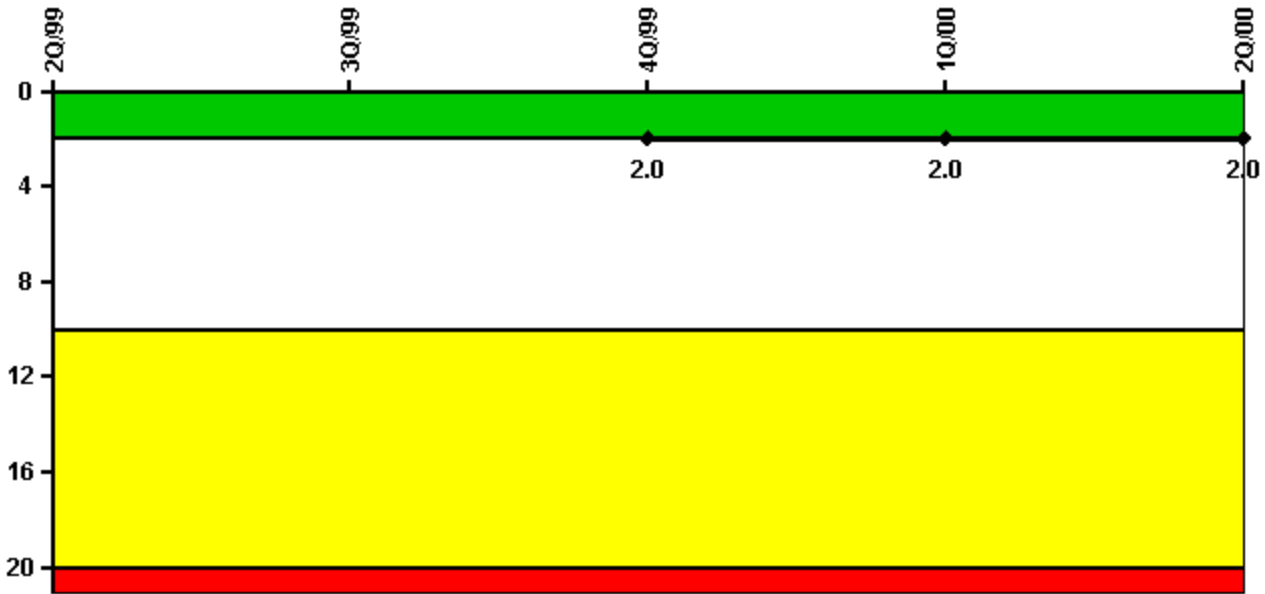


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

#### Notes

Scrams with Loss of Normal Heat Removal	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Scrams	0	0	0	0	0
Indicator value			2.0	2.0	2.0

Licensee Comments: none

### Unplanned Power Changes per 7000 Critical Hrs

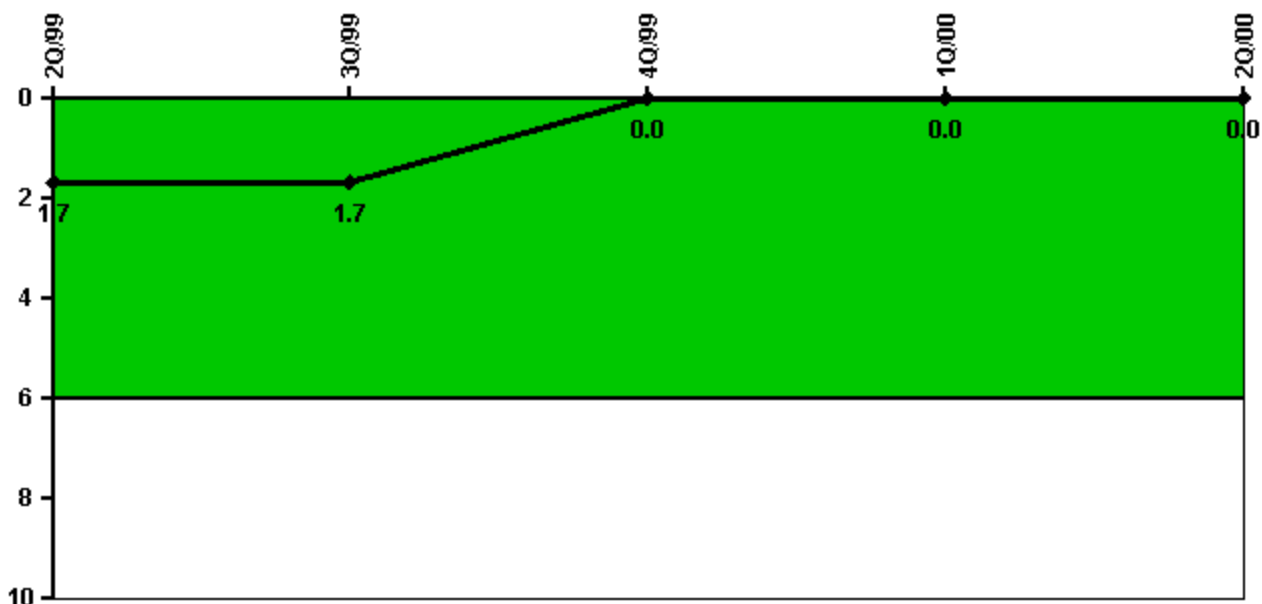

Thresholds: White > 6.0


#### Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Unplanned power changes	0	0	0	0	0
Critical hours	1798.3	2208.0	2209.0	2184.0	1067.6
<b>Indicator value</b>	<b>1.7</b>	<b>1.7</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments:

2Q/00: Corrected data entry error for 2Q2000 for the number of hours of critical operation. This correction did not result in a change to any PI color.

### Safety System Unavailability, Emergency AC Power

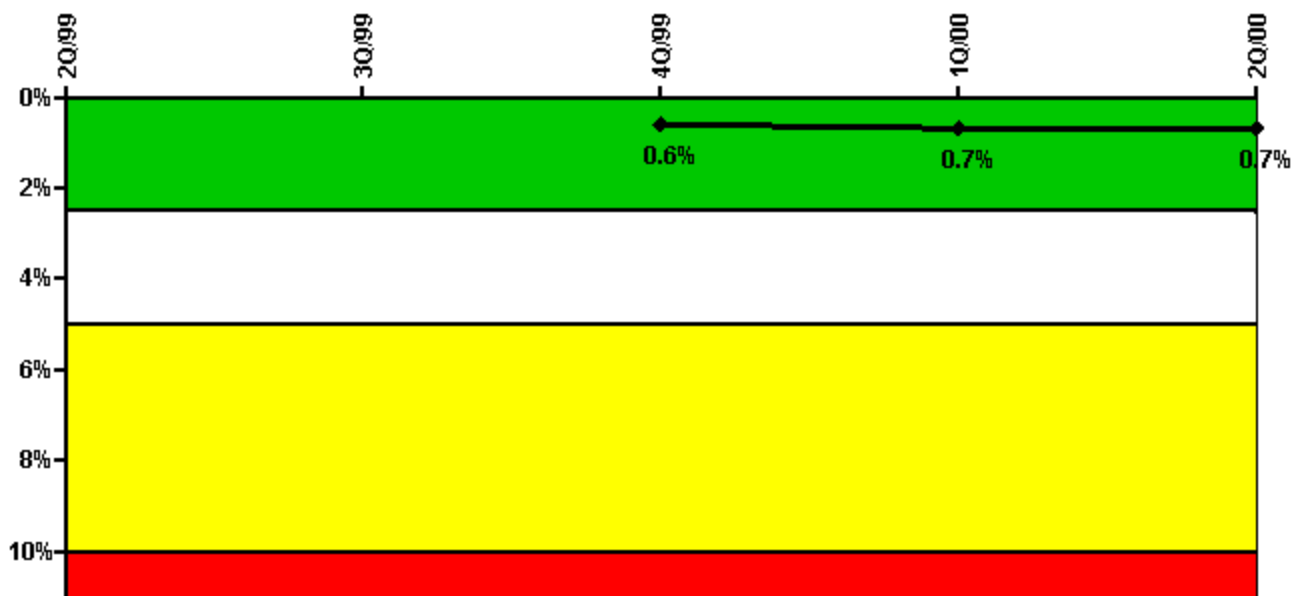

Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%


#### Notes

Safety System Unavailability, Emergency AC Power	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
<b>Train 1</b>					
Planned unavailable hours	0.90	22.50	0.93	18.18	2.95
Unplanned unavailable hours	0	7.20	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	1490.20
<b>Train 2</b>					
Planned unavailable hours	115.80	1.40	24.35	0.77	2.85
Unplanned unavailable hours	15.10	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	1591.70
<b>Indicator value</b>			<b>0.6%</b>	<b>0.7%</b>	<b>0.7%</b>

Licensee Comments:

4Q/98: Hours trains required revised to reflect Daylight Savings Time (i.e. from 2208 to 2209 hours)

### Safety System Unavailability, High Pressure Injection System (HPSI)

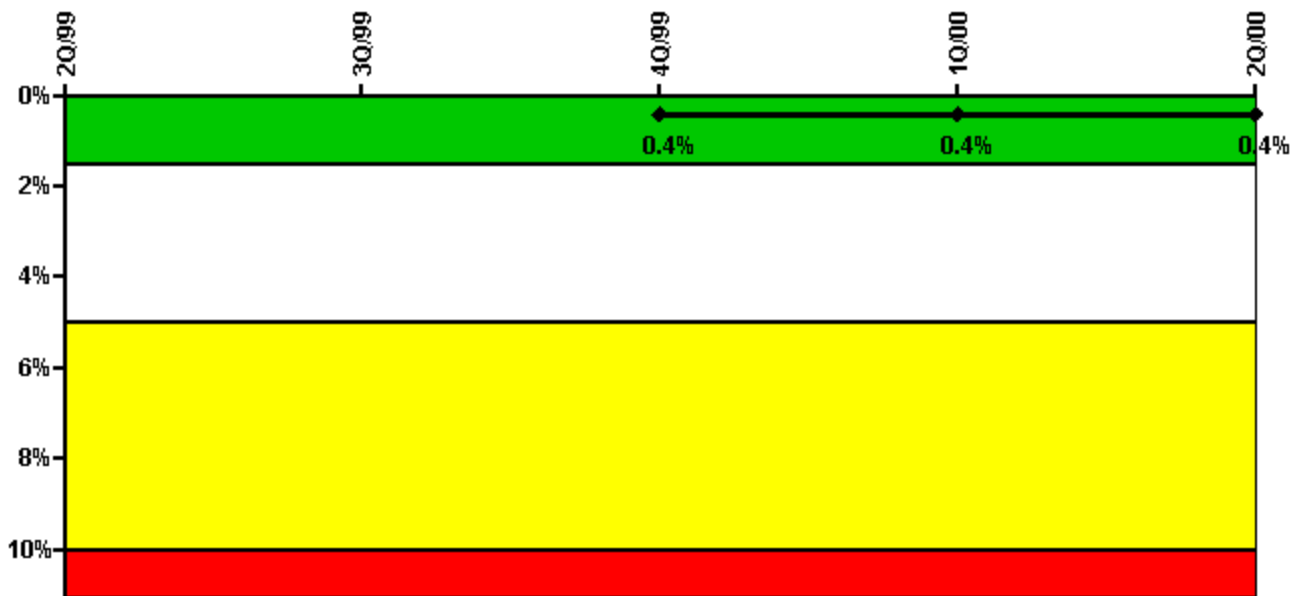

Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

**Notes**

Safety System Unavailability, High Pressure Injection System (HPSI)	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
<b>Train 1</b>					
Planned unavailable hours	1.80	15.63	12.17	12.83	7.13
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1868.82	2208.00	2209.00	2184.00	1159.47
<b>Train 2</b>					
Planned unavailable hours	2.30	5.50	7.31	21.37	12.05
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1868.82	2208.00	2209.00	2184.00	1159.47
<b>Indicator value</b>			<b>0.4%</b>	<b>0.4%</b>	<b>0.4%</b>

Licensee Comments: none

### Safety System Unavailability, Heat Removal System (AFW)




Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%

#### Notes

Safety System Unavailability, Heat Removal System (AFW)	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
<b>Train 1</b>					
Planned unavailable hours	4.12	0	46.60	3.47	10.60
Unplanned unavailable hours	0	0	0	1.17	0
Fault exposure hours	0	0	0	0	168.00
Effective Reset hours	0	0	0	0	0
Required hours	1861.00	2208.00	2209.00	2184.00	1159.58
<b>Train 2</b>					
Planned unavailable hours	0	0	9.45	2.54	0
Unplanned unavailable hours	5.30	0	0	0	3.10
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1861.00	2208.00	2209.00	2184.00	1159.58
<b>Train 3</b>					
Planned unavailable hours	3.00	0	0	2.23	1.50
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1861.00	2208.00	2209.00	2184.00	1159.58
<b>Indicator value</b>			1.1%	1.1%	1.3%

Licensee Comments: none

### Safety System Unavailability, Residual Heat Removal System

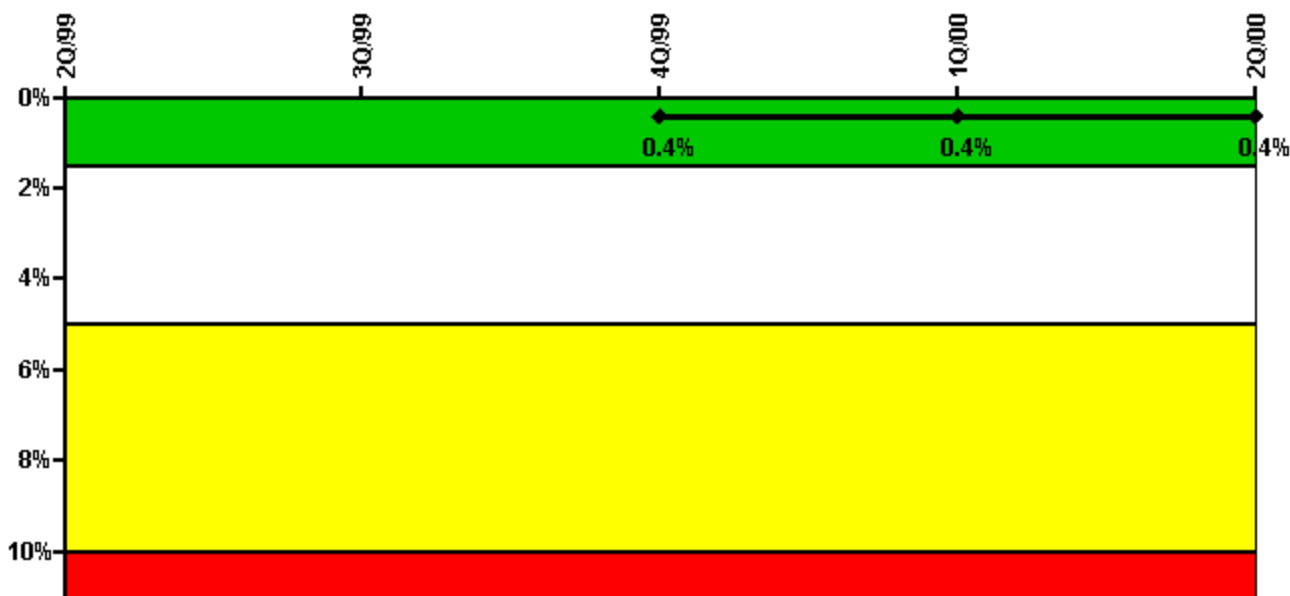

Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Residual Heat Removal System	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
<b>Train 1</b>					
Planned unavailable hours	7.50	13.47	13.02	19.11	2.67
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	1892.50
<b>Train 2</b>					
Planned unavailable hours	31.90	6.90	2.97	26.33	6.77
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	1892.50
<b>Indicator value</b>			0.4%	0.4%	0.4%


Licensee Comments:

2Q/99: Corrected data entry error for hours required for service for 2Q1999. This minor change did not affect the color of the indicator.

4Q/98: Corrected data entry errors for planned unavailable hours for 4Q1998. These minor changes did not affect the color of the indicator.

2Q/98: Corrected due to reporting more hours unavailable during refueling outage in 2Q1998 than required per NEI 99-02. This change did not affect the color of the indicator.

### Safety System Functional Failures (PWR)

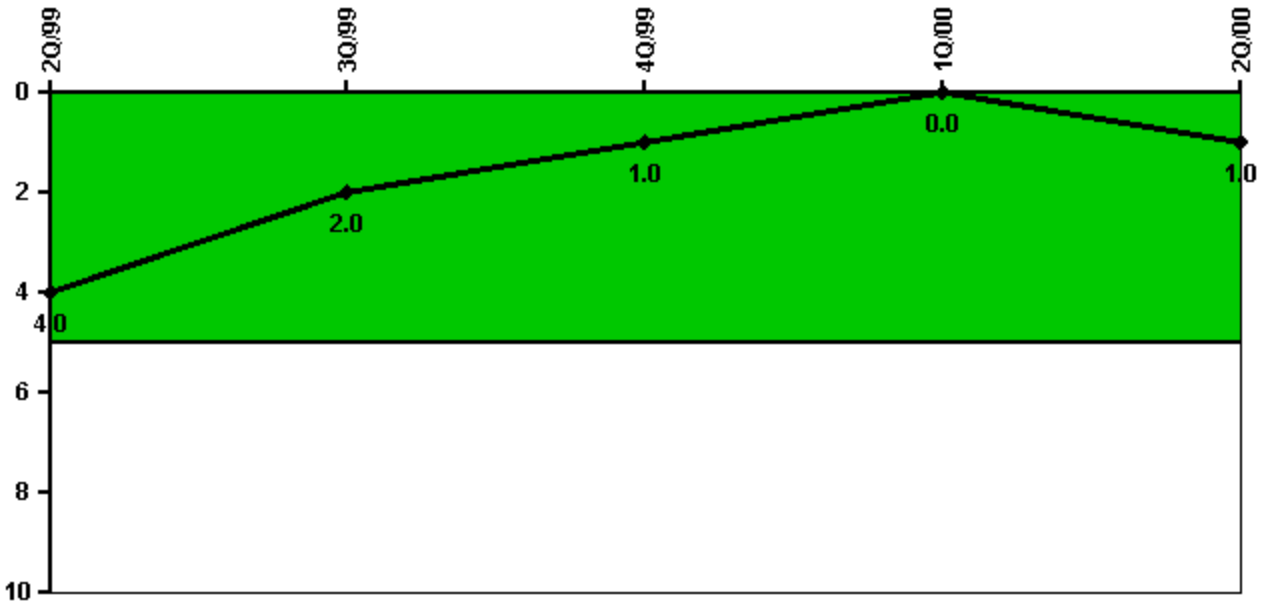

Thresholds: White > 5.0


#### Notes

Safety System Functional Failures (PWR)	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Safety System Functional Failures	0	0	0	0	1
Indicator value	4	2	1	0	1

Licensee Comments: none



### Reactor Coolant System Activity

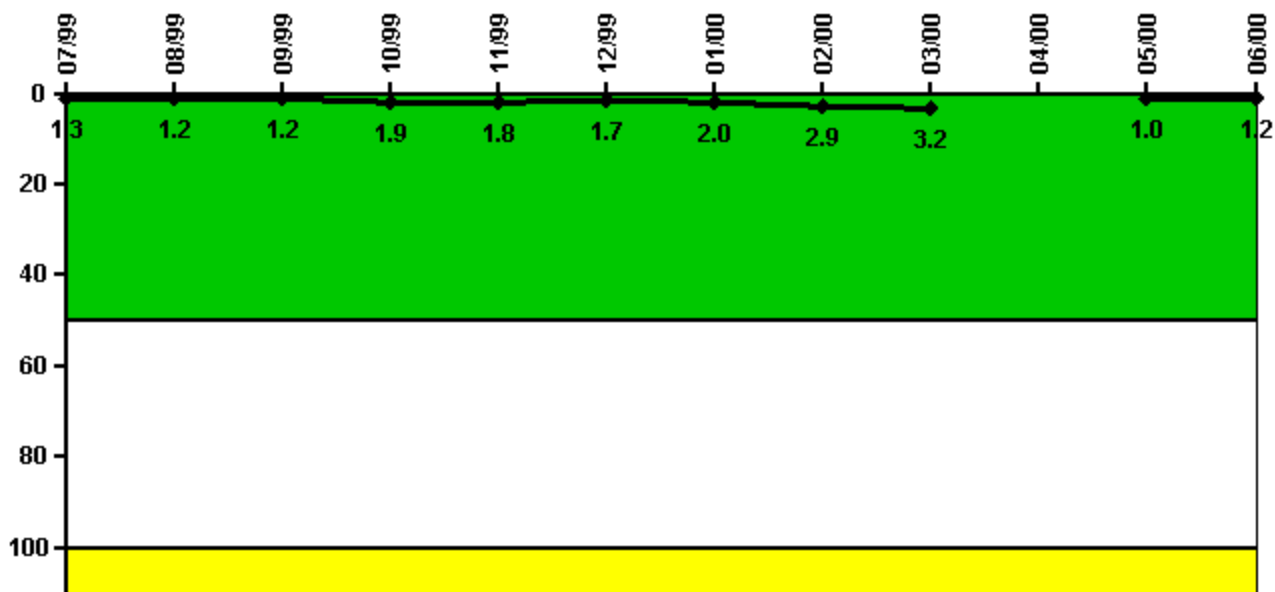

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


Reactor Coolant System Activity	7/99	8/99	9/99	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00
Maximum activity	0.013100	0.011900	0.012100	0.019000	0.018000	0.017000	0.020200	0.029250	0.032100	N/A	0.010100	0.011700
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	1.3	1.2	1.2	1.9	1.8	1.7	2.0	2.9	3.2	N/A	1.0	1.2

Licensee Comments:

6/00: No data for 4/2000 due to refueling outage.

6/00: No data for 4/2000 due to refueling outage.

### Reactor Coolant System Leakage

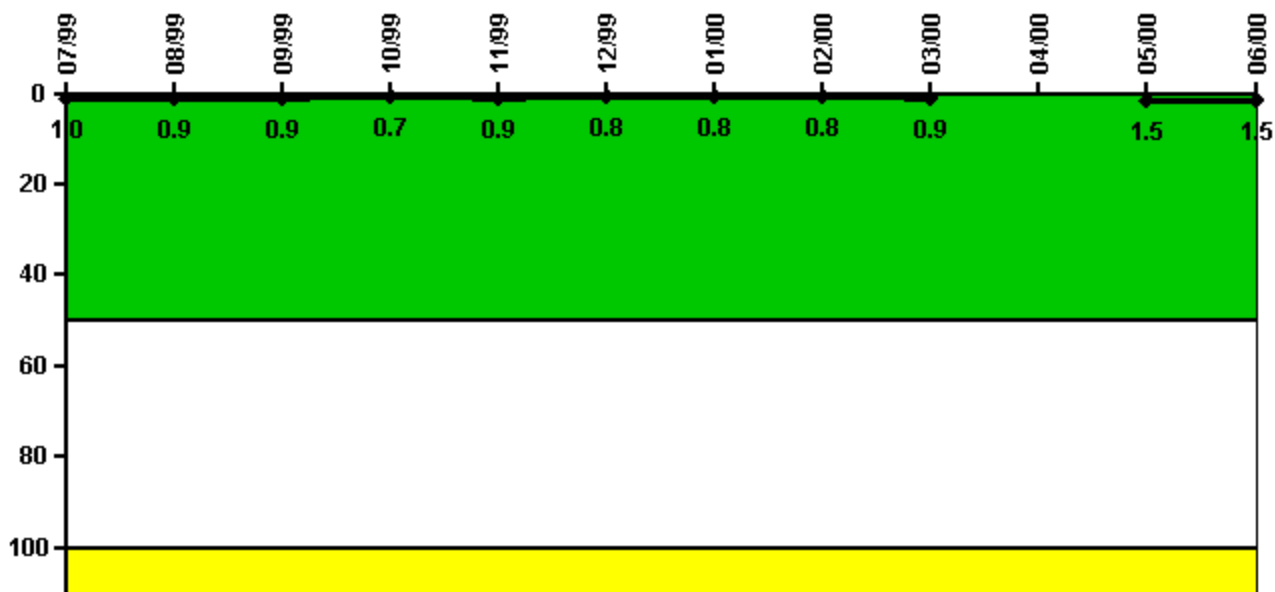

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


Reactor Coolant System Leakage	7/99	8/99	9/99	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00
Maximum leakage	0.100	0.090	0.090	0.070	0.090	0.080	0.076	0.075	0.094	N/A	0.146	0.150
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.0	0.9	0.9	0.7	0.9	0.8	0.8	0.8	0.9	N/A	1.5	1.5

Licensee Comments:

6/00: No data for 4/2000 due to refueling outage.

6/00: No data for 4/2000 due to refueling outage.

### Drill/Exercise Performance

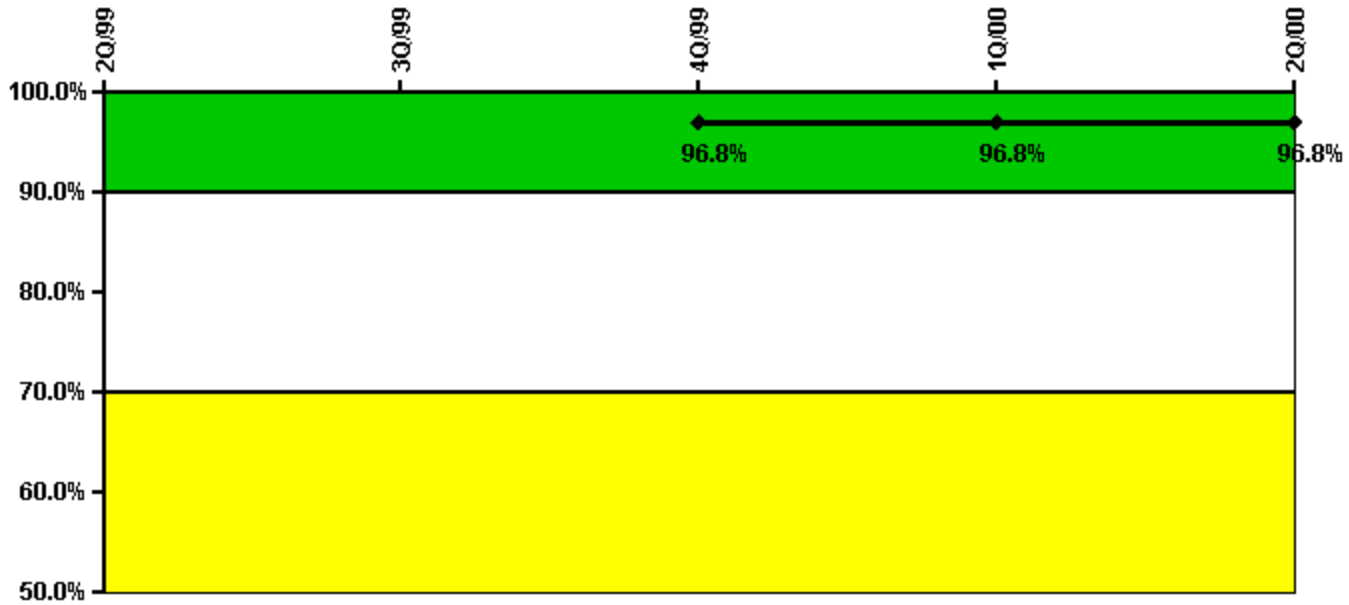


Thresholds: White < 90.0% Yellow < 70.0%

#### Notes

Drill/Exercise Performance	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Successful opportunities	18.0	0	49.0	0	2.0
Total opportunities	18.0	0	50.0	0	2.0
Indicator value			96.8%	96.8%	96.8%

Licensee Comments: none

### ERO Drill Participation

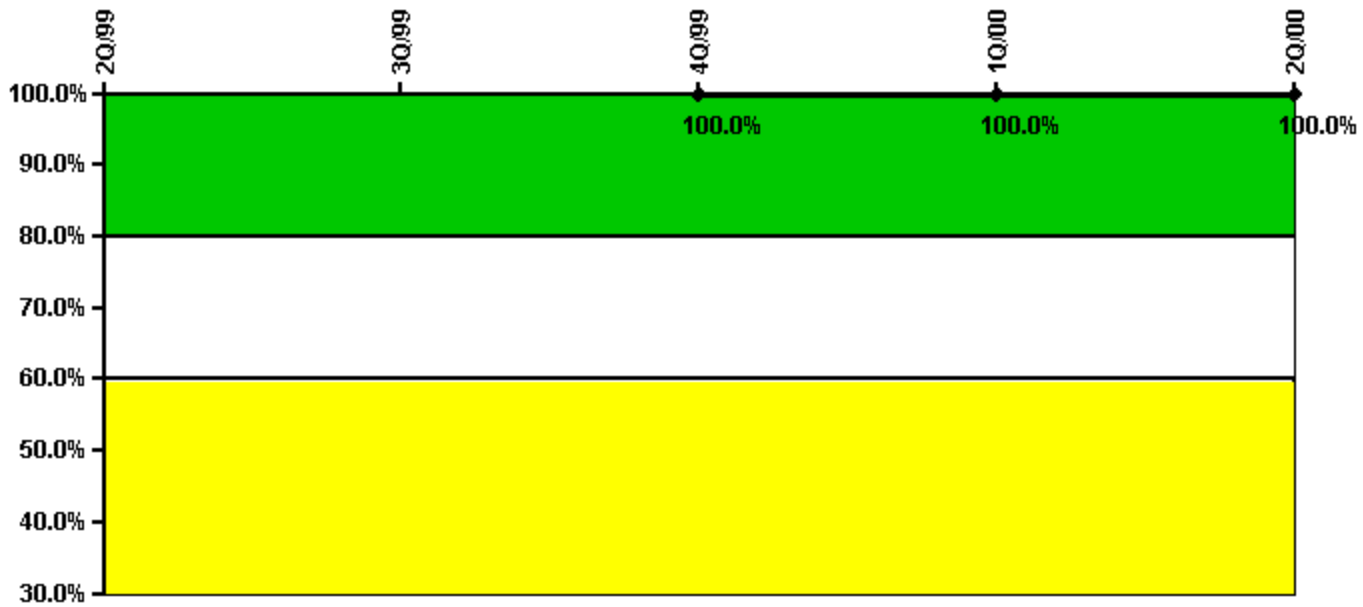


Thresholds: White < 80.0% Yellow < 60.0%

#### Notes

ERO Drill Participation	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Participating Key personnel			68.0	68.0	69.0
Total Key personnel			68.0	68.0	69.0
<b>Indicator value</b>			<b>100.0%</b>	<b>100.0%</b>	<b>100.0%</b>

Licensee Comments: none

### Alert & Notification System

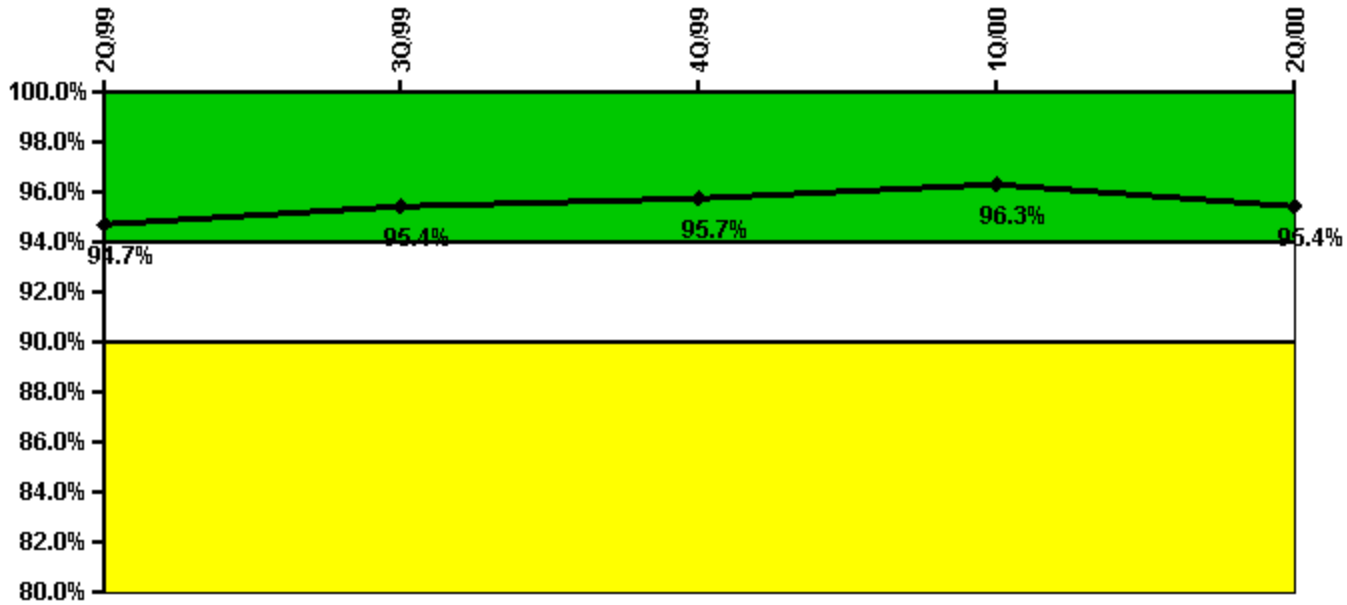

Thresholds: White < 94.0% Yellow < 90.0%

#### Notes


Alert & Notification System	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Successful siren-tests	156	154	155	159	150
Total sirens-tests	162	162	162	162	162
Indicator value	94.7%	95.4%	95.7%	96.3%	95.4%

#### Licensee Comments:

2Q/00: Corrected data entry error for 4Q1999 for the number of ANS sirens tested during quarter. This correction did not result in a change to the PI color.

4Q/99: 4Q1999: Corrected data entry error for number of ANS sirens tested during quarter. This correction did not result in a change to the PI color.

### Occupational Exposure Control Effectiveness

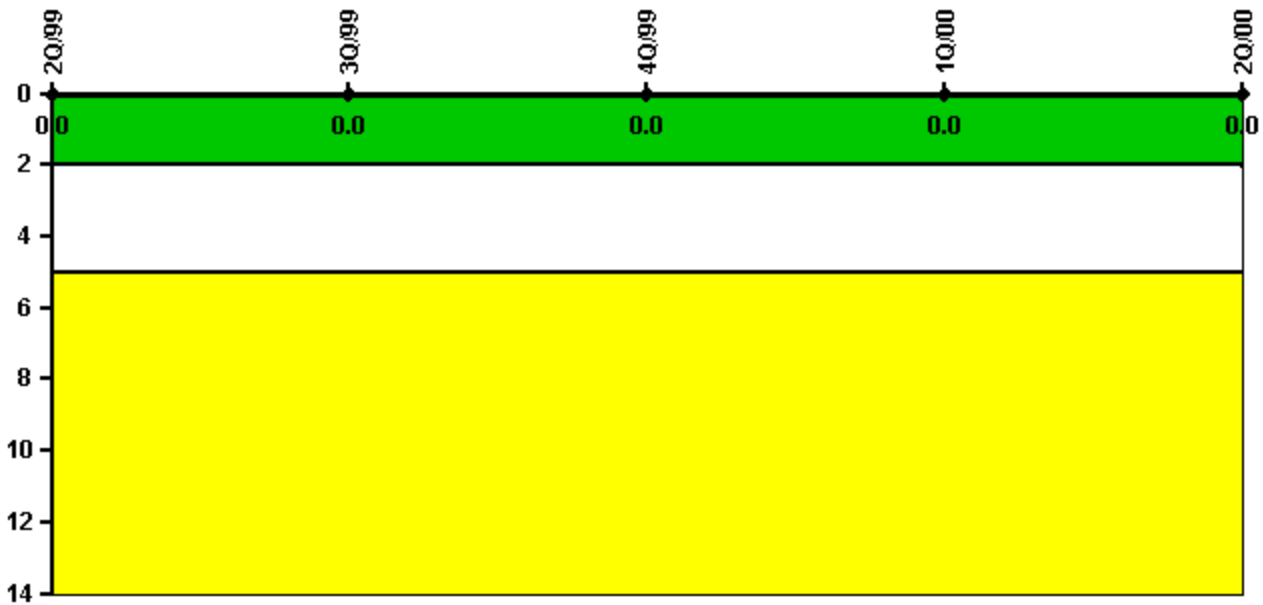

Thresholds: White > 2.0 Yellow > 5.0

#### Notes

Occupational Exposure Control Effectiveness	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
High radiation area occurrences	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### RETS/ODCM Radiological Effluent




Thresholds: White > 1.0 Yellow > 3.0

#### Notes

RETS/ODCM Radiological Effluent	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
RETS/ODCM occurrences	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

### Protected Area Security Performance Index

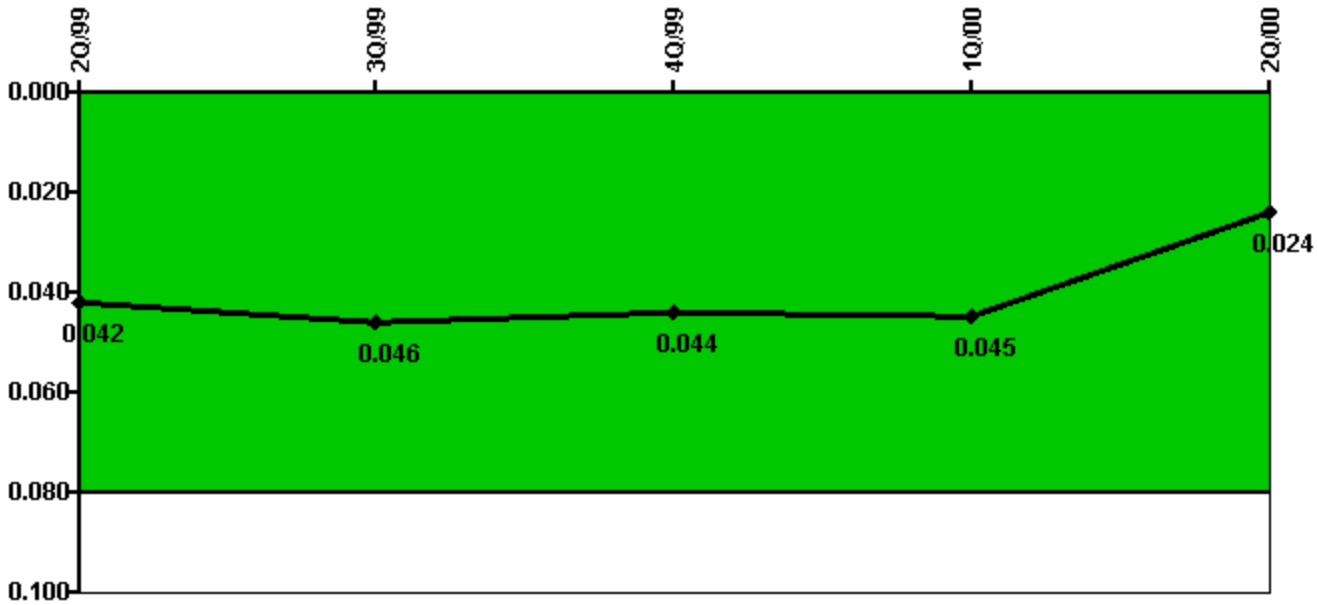

Thresholds: White > 0.080

#### Notes

Protected Area Security Performance Index	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
IDS compensatory hours	26.60	146.10	40.40	157.30	61.00
CCTV compensatory hours	411.3	2.5	8.0	0	4.8
IDS normalization factor	1.00	1.00	1.00	1.00	1.00
CCTV normalization factor	1.0	1.0	1.0	1.0	1.0
<b>Index Value</b>	<b>0.042</b>	<b>0.046</b>	<b>0.044</b>	<b>0.045</b>	<b>0.024</b>

Licensee Comments: none



### Personnel Screening Program



Thresholds: White > 2.0 Yellow > 5.0

#### Notes

Personnel Screening Program	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Program failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

### FFD/Personnel Reliability



Thresholds: White > 2.0 Yellow > 5.0

#### Notes

FFD/Personnel Reliability	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Program Failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

[PI Summary](#) | [Inspection Findings Summary](#) | [Reactor Oversight Process](#)

Last Modified: April 1, 2002