


Arkansas Nuclear 1

3Q/2000 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

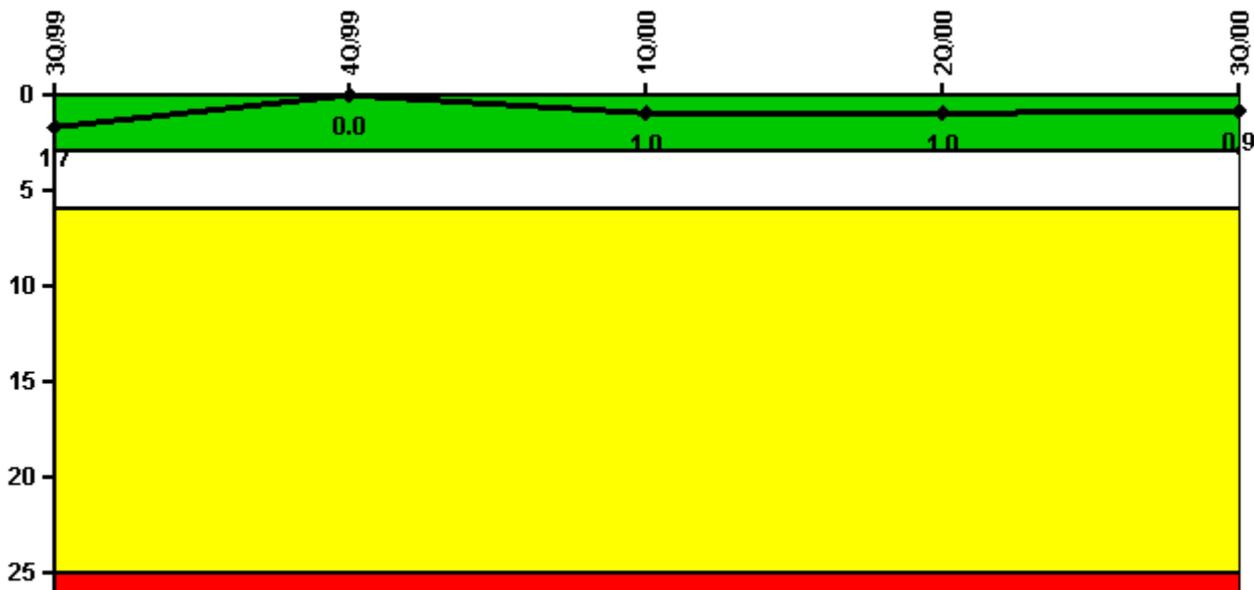


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Unplanned scrams	0	0	1.0	0	0
Critical hours	1728.9	2004.8	1186.3	2183.0	2208.0
Indicator value	1.7	0	1.0	1.0	0.9

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

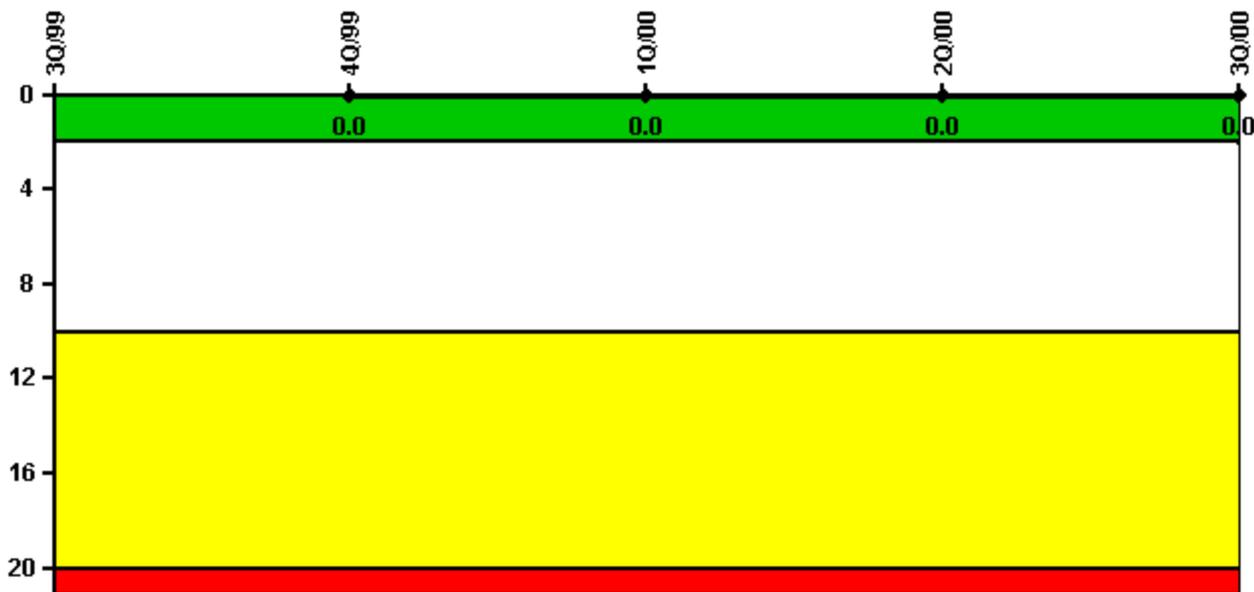

Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0


Notes

Scrams with Loss of Normal Heat Removal	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Scrams	0	0	0	0	0
Indicator value		0	0	0	0

Licensee Comments:

4Q/98: The scram with loss of heat removal event that was originally reported for 4Q/1998 has been rescinded after subsequent internal review. The scram that occurred on 12/25/98 included a "partial loss" of condenser vacuum and was conservatively reported as a loss of heat removal event. After reviewing NEI 99-02 Rev. 0 and recent FAQ's, an internal review concluded that this event did not meet the definitions for "loss of normal heat removal." This change did not result in a threshold color change.

Unplanned Power Changes per 7000 Critical Hrs

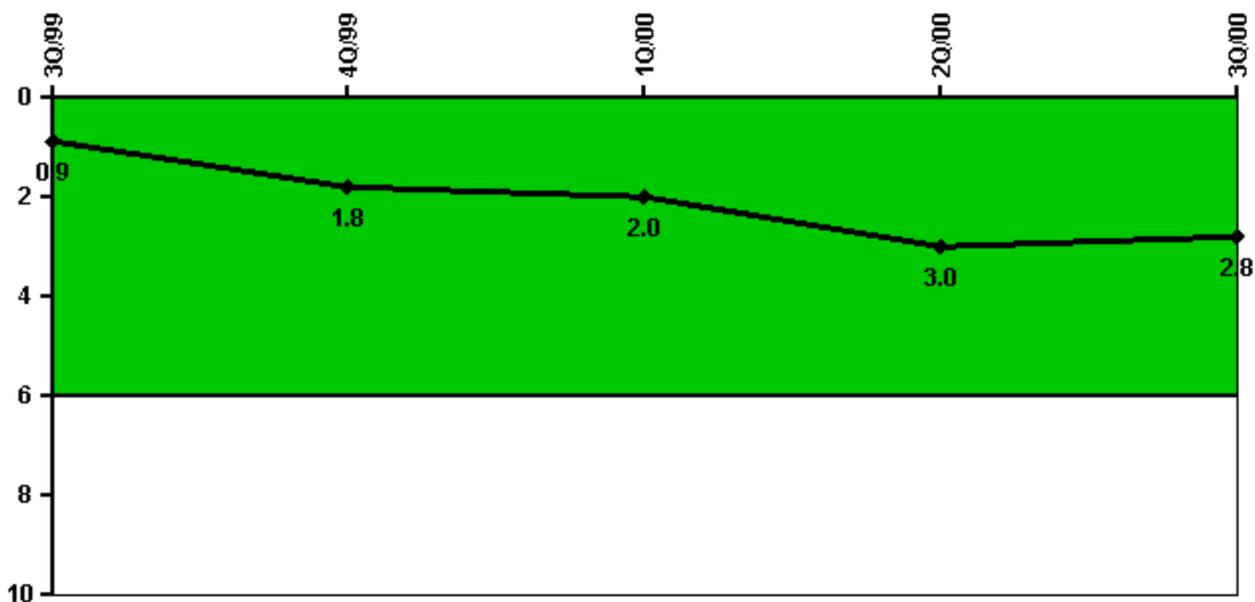


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Unplanned power changes	0	1.0	1.0	1.0	0
Critical hours	1728.9	2004.8	1186.3	2183.0	2208.0
Indicator value	0.9	1.8	2.0	3.0	2.8

Licensee Comments: none

Safety System Unavailability, Emergency AC Power

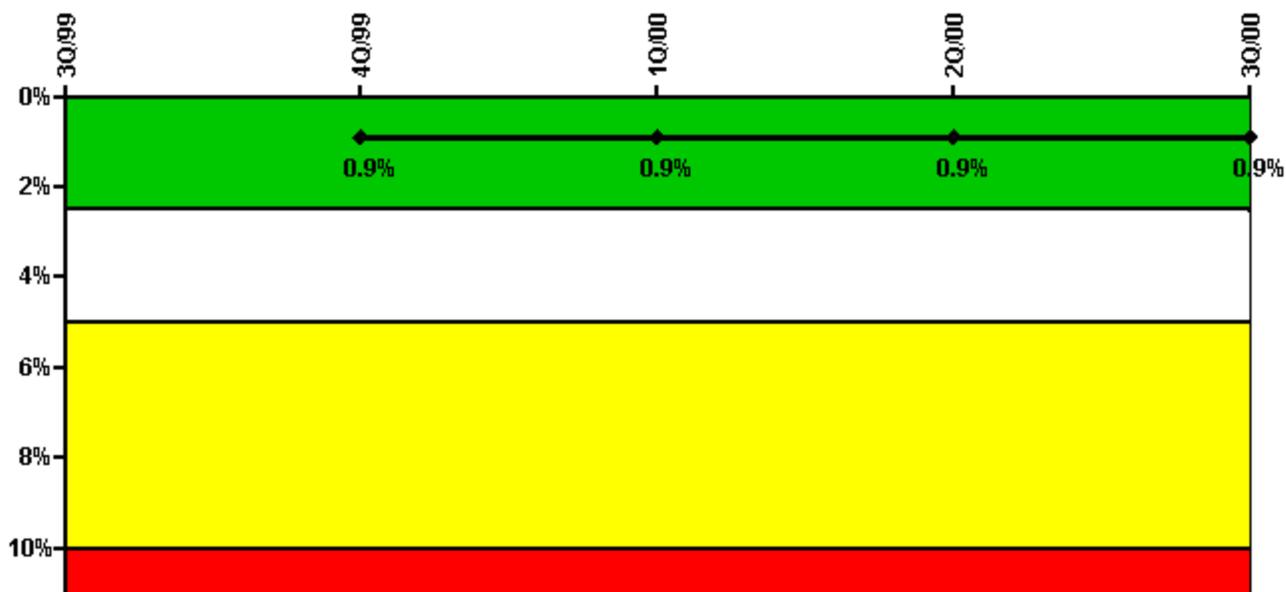


Thresholds: **White** > 2.5% **Yellow** > 5.0% **Red** > 10.0%

Notes

Safety System Unavailability, Emergency AC Power	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Train 1					
Planned unavailable hours	0	0	0.83	0.62	0.65
Unplanned unavailable hours	1.00	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1774.00	2041.00	2184.00	2183.00	2208.00
Train 2					
Planned unavailable hours	5.50	0	0.80	1.08	0.83
Unplanned unavailable hours	178.80	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1774.00	2041.00	2184.00	2183.00	2208.00
Indicator value		0.9%	0.9%	0.9%	0.9%

Licensee Comments: none

Safety System Unavailability, High Pressure Injection System (HPSI)

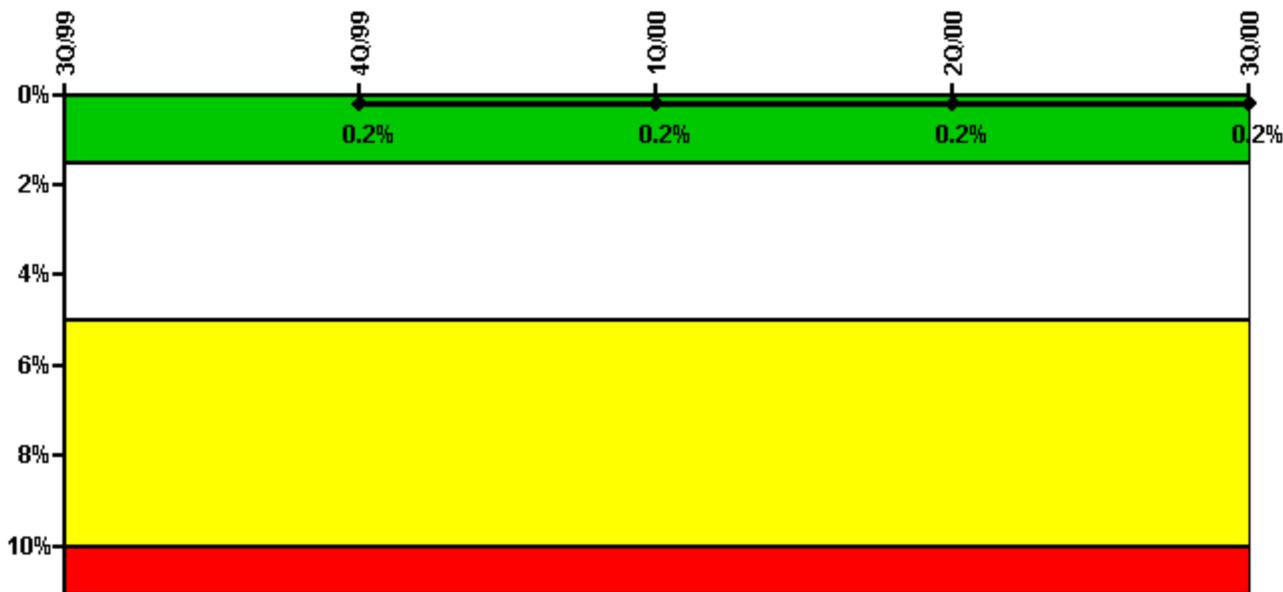


Thresholds: **White** > 1.5% **Yellow** > 5.0% **Red** > 10.0%

Notes

Safety System Unavailability, High Pressure Injection System (HPSI)	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Train 1					
Planned unavailable hours	0	0	0	5.58	13.75
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1913.00	2033.00	1326.40	2183.00	2208.00
Train 2					
Planned unavailable hours	9.00	0	0	0	10.88
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1913.00	2033.00	1326.40	2183.00	2208.00
Indicator value		0.2%	0.2%	0.2%	0.2%

Licensee Comments: none

Safety System Unavailability, Heat Removal System (AFW)

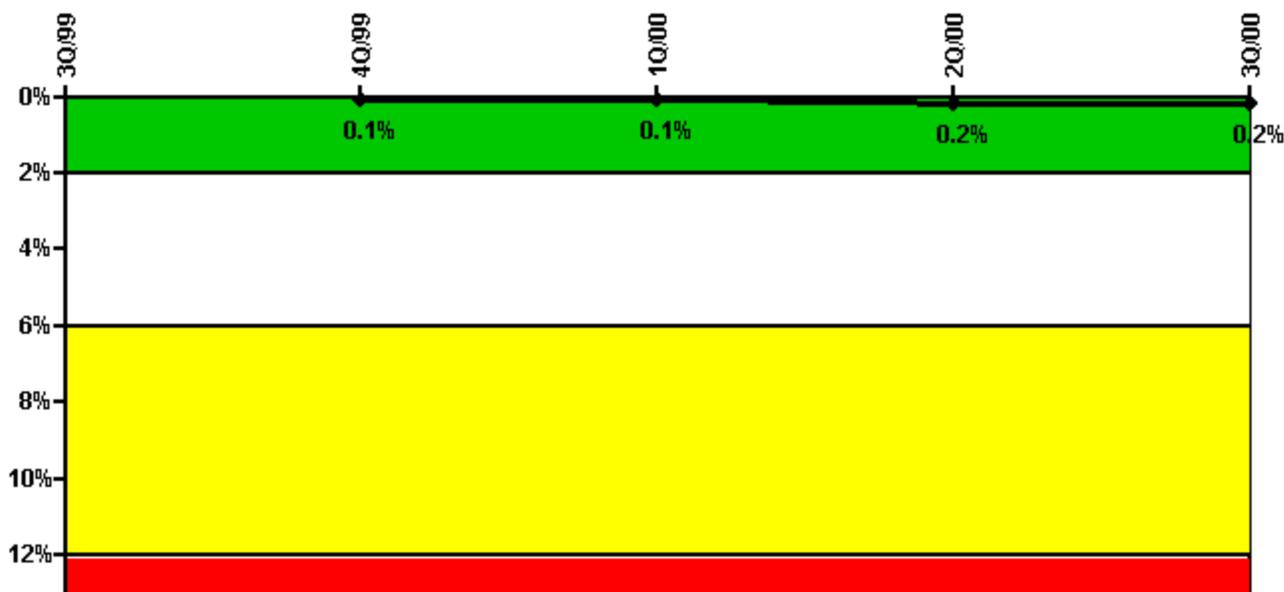


Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%

Notes

Safety System Unavailability, Heat Removal System (AFW)	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Train 1					
Planned unavailable hours	0	12.23	12.50	17.50	0.20
Unplanned unavailable hours	0	0	0	9.30	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1780.50	2001.10	1328.00	2183.00	2208.00
Train 2					
Planned unavailable hours	0	0	0	5.50	11.20
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1780.50	2001.10	1431.70	2183.00	2208.00
Indicator value		0.1%	0.1%	0.2%	0.2%

Licensee Comments: none

Safety System Unavailability, Residual Heat Removal System

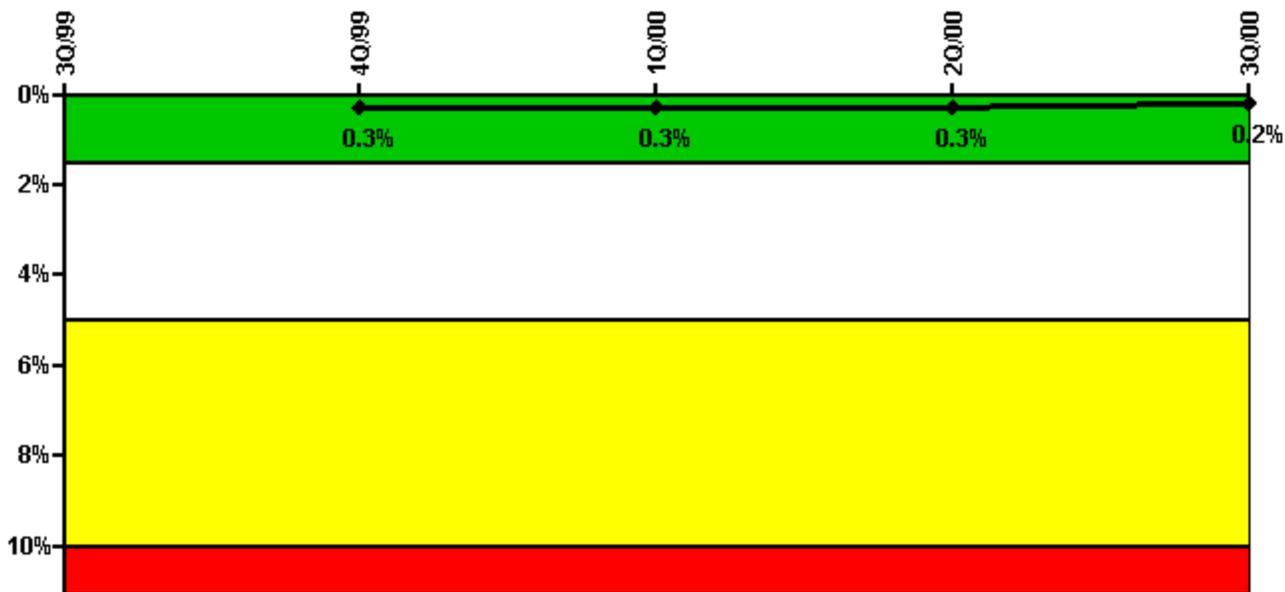


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Residual Heat Removal System	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Train 1					
Planned unavailable hours	0	0	15.10	0	0
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2112.00	2209.00	2184.00	2183.00	2208.00
Train 2					
Planned unavailable hours	16.30	0	0	0.10	18.60
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2112.00	2209.00	2184.00	2183.00	2208.00
Indicator value		0.3%	0.3%	0.3%	0.2%

Licensee Comments: none

Safety System Functional Failures (PWR)

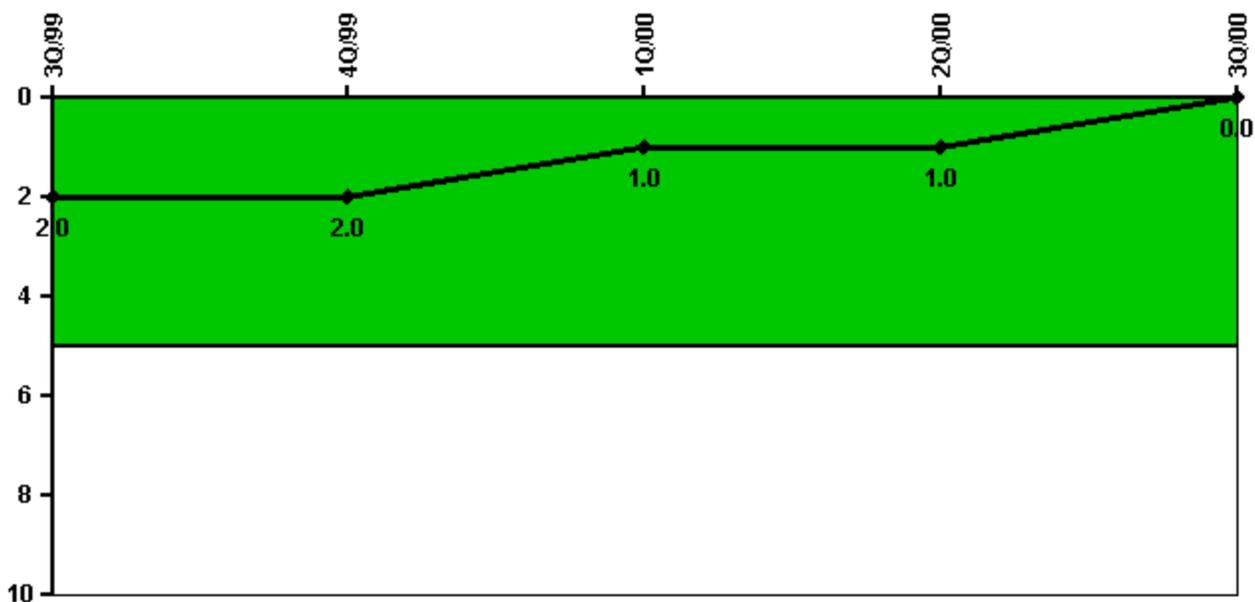


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Safety System Functional Failures	1	0	0	0	0
Indicator value	2	2	1	1	0

Licensee Comments: none

Reactor Coolant System Activity

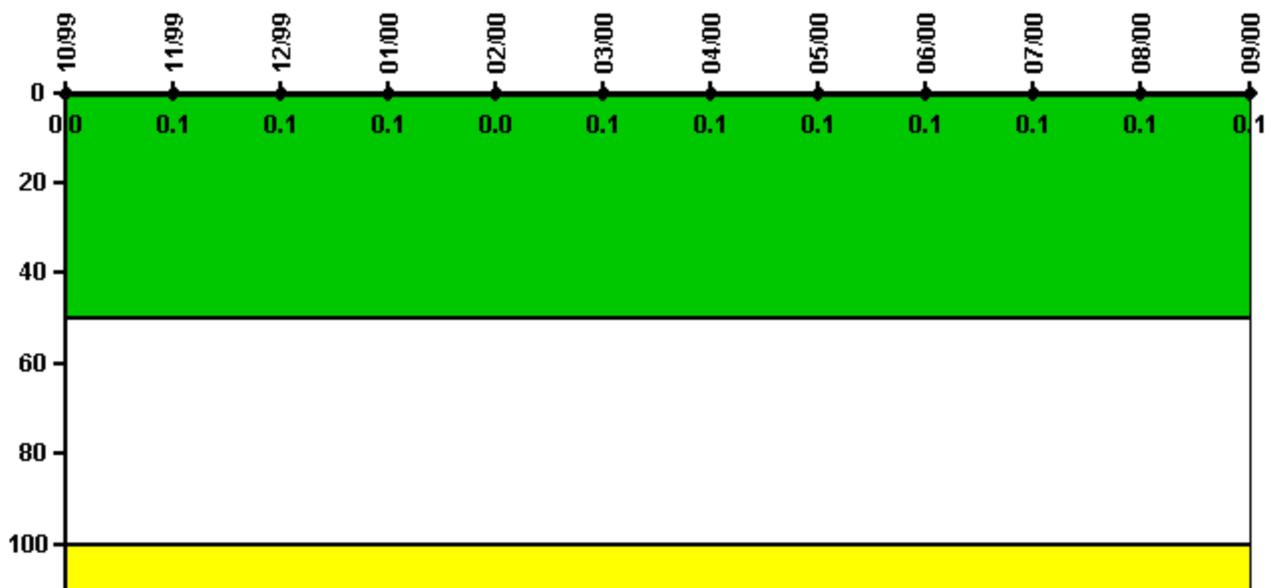


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00	7/00	8/00	9/00
Maximum activity	0.001710	0.001770	0.001900	0.001910	0.001440	0.002030	0.002040	0.002300	0.002360	0.002420	0.002610	0.002780
Technical specification limit	3.5	3.5	3.5	3.5	3.5	3.5	3.5	3.5	3.5	3.5	3.5	3.5
Indicator value	0	0.1	0.1	0.1	0	0.1	0.1	0.1	0.1	0.1	0.1	0.1

Licensee Comments: none

Reactor Coolant System Leakage

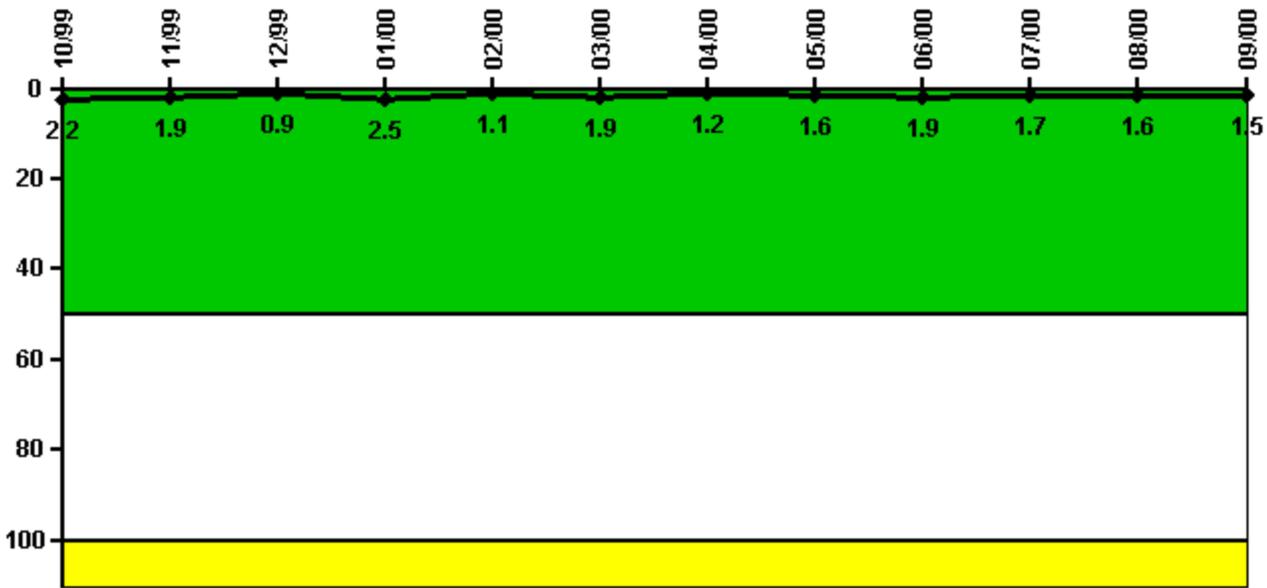


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00	7/00	8/00	9/00
Maximum leakage	0.221	0.188	0.089	0.250	0.110	0.190	0.116	0.162	0.190	0.167	0.158	0.149
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	2.2	1.9	0.9	2.5	1.1	1.9	1.2	1.6	1.9	1.7	1.6	1.5

Licensee Comments: none

Drill/Exercise Performance

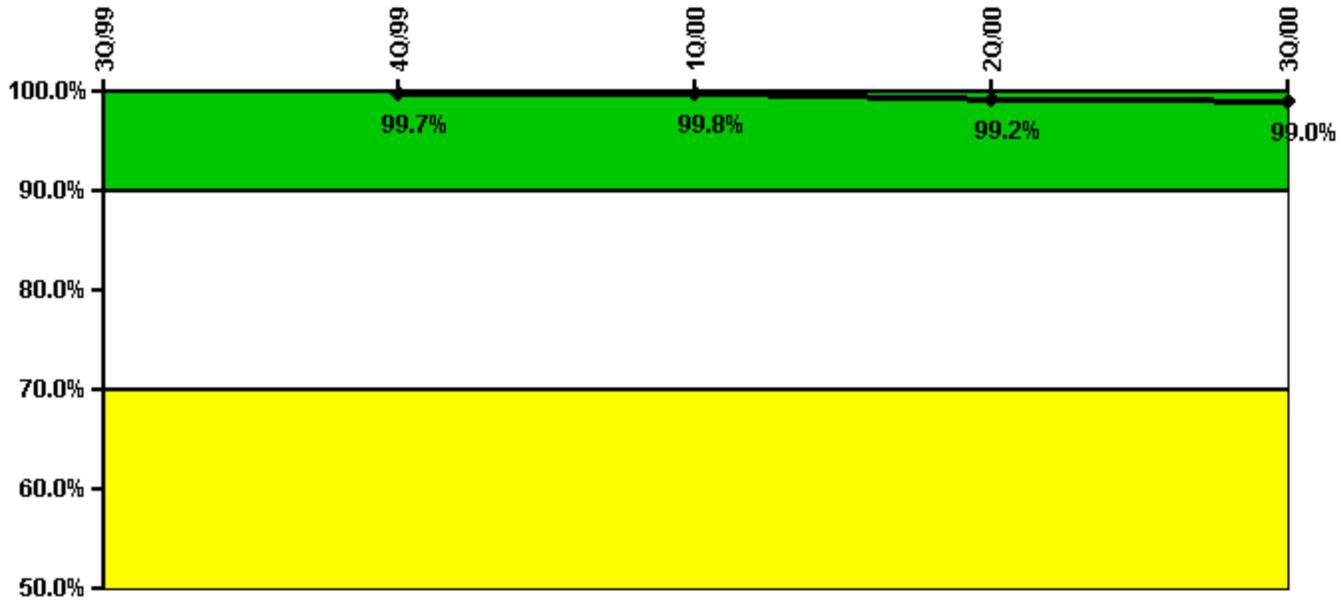


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Successful opportunities	67.0	35.0	96.0	82.0	55.0
Total opportunities	67.0	35.0	96.0	85.0	56.0
Indicator value		99.7%	99.8%	99.2%	99.0%

Licensee Comments: none

ERO Drill Participation

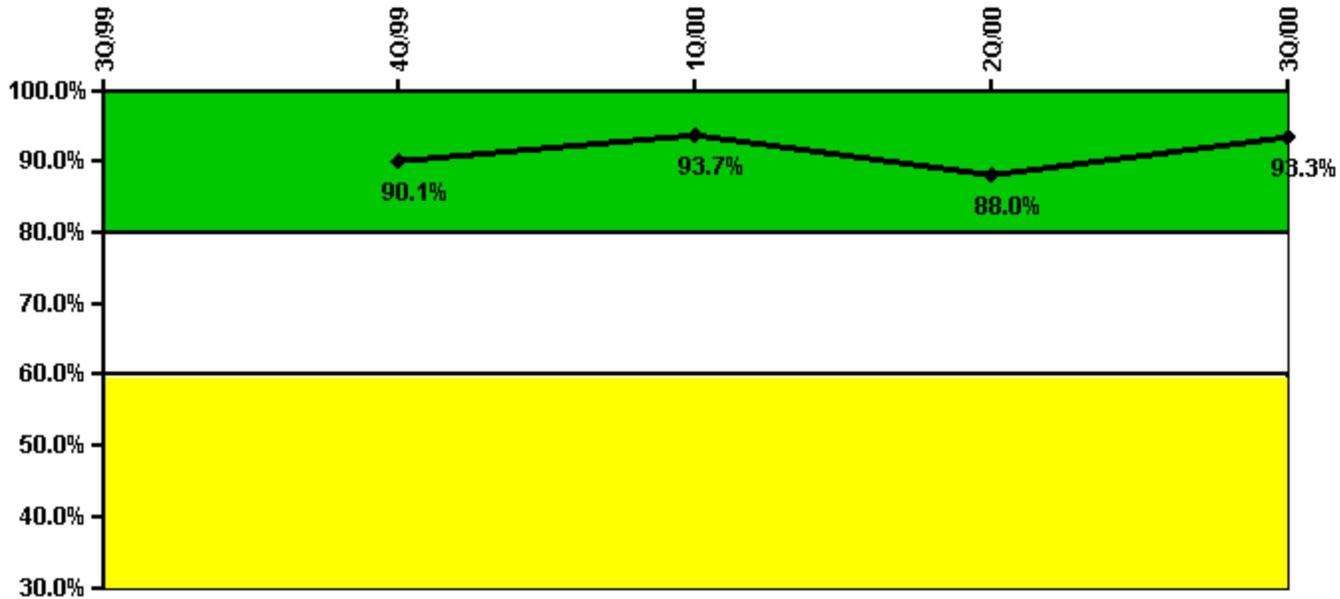

Thresholds: White < 80.0% Yellow < 60.0%

Notes


ERO Drill Participation	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Participating Key personnel		109.0	118.0	88.0	98.0
Total Key personnel		121.0	126.0	100.0	105.0
Indicator value		90.1%	93.7%	88.0%	93.3%

Licensee Comments:

3Q/00: After internal assessment and review, Q3/2000 data was revised from 103 to 98 ERO members participating. This change did not affect the indicator color.

2Q/00: After internal assessment and review, Q2/2000 data was revised from 92 to 88 ERO members participating. This change did not affect the indicator color.

Alert & Notification System

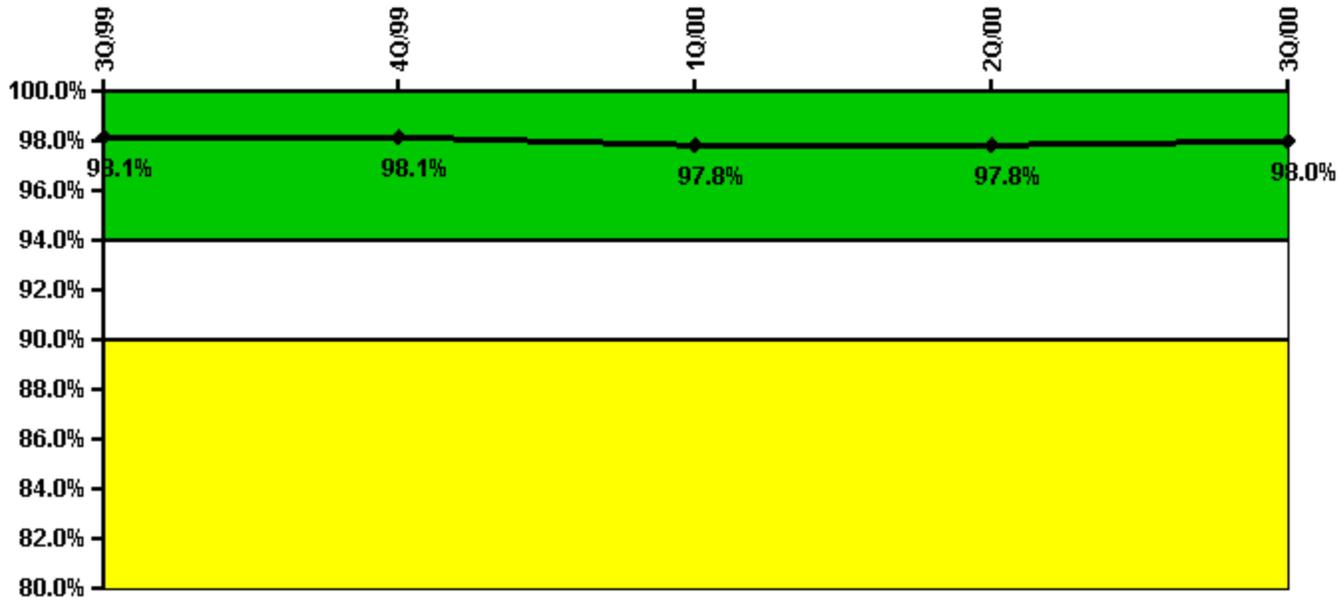


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Successful siren-tests	143	143	144	145	144
Total sirens-tests	147	147	147	147	147
Indicator value	98.1%	98.1%	97.8%	97.8%	98.0%

Licensee Comments: none

Occupational Exposure Control Effectiveness

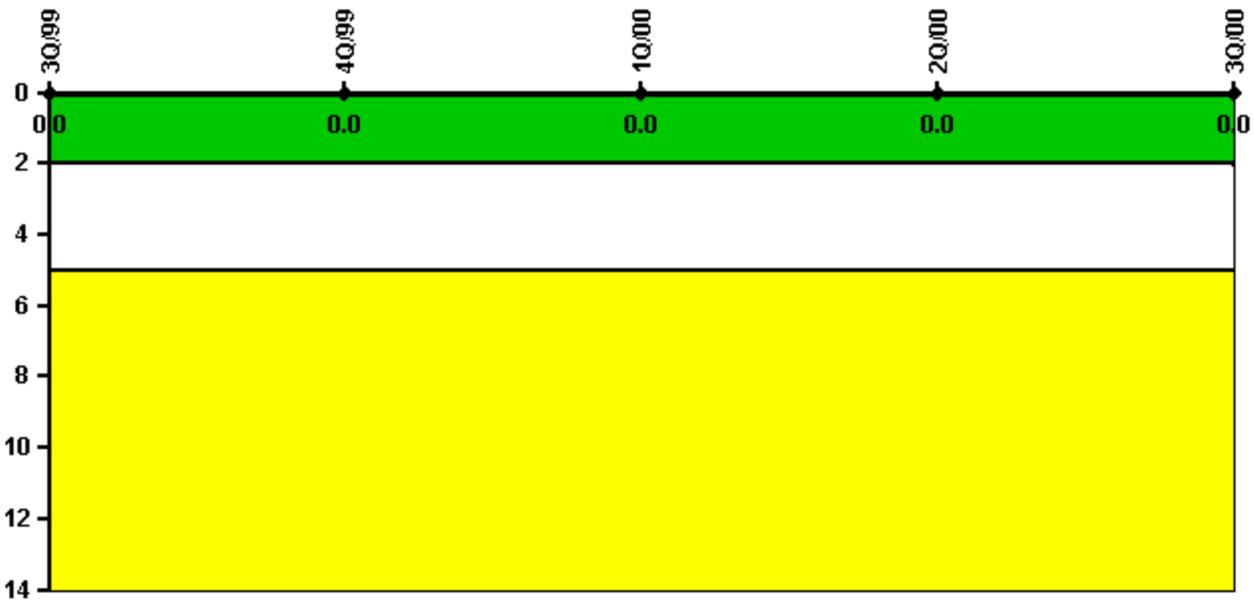


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
High radiation area occurrences	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

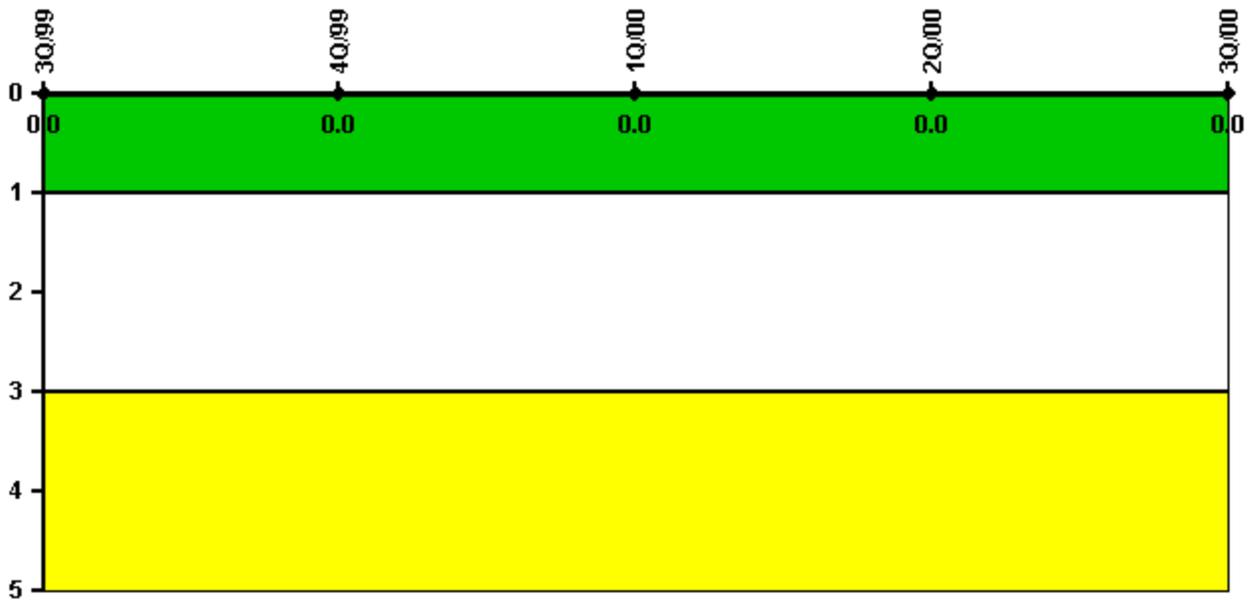


Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
RETS/ODCM occurrences	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

Protected Area Security Performance Index

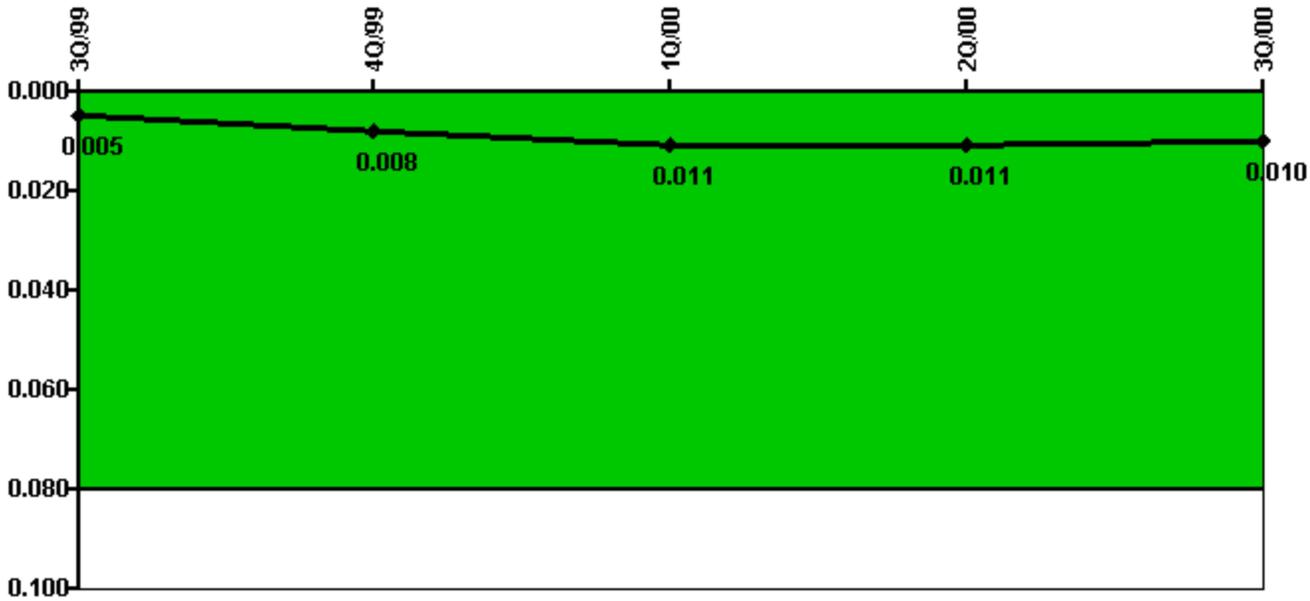

Thresholds: White > 0.080


Notes

Protected Area Security Performance Index	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
IDS compensatory hours	60.70	106.30	63.20	17.90	21.60
CCTV compensatory hours	19.7	13.9	14.5	1.5	27.0
IDS normalization factor	1.65	1.65	1.70	1.70	1.70
CCTV normalization factor	1.0	1.0	1.1	1.1	1.1
Index Value	0.005	0.008	0.011	0.011	0.010

Licensee Comments:

3Q/00: After internal assessment and review, the Q3/2000 data was revised to include 5.5 IDS hours in July, an added 2 hours IDS in August, and an added 11 CCTV hours in August. These changes did not affect indicator color.

Personnel Screening Program

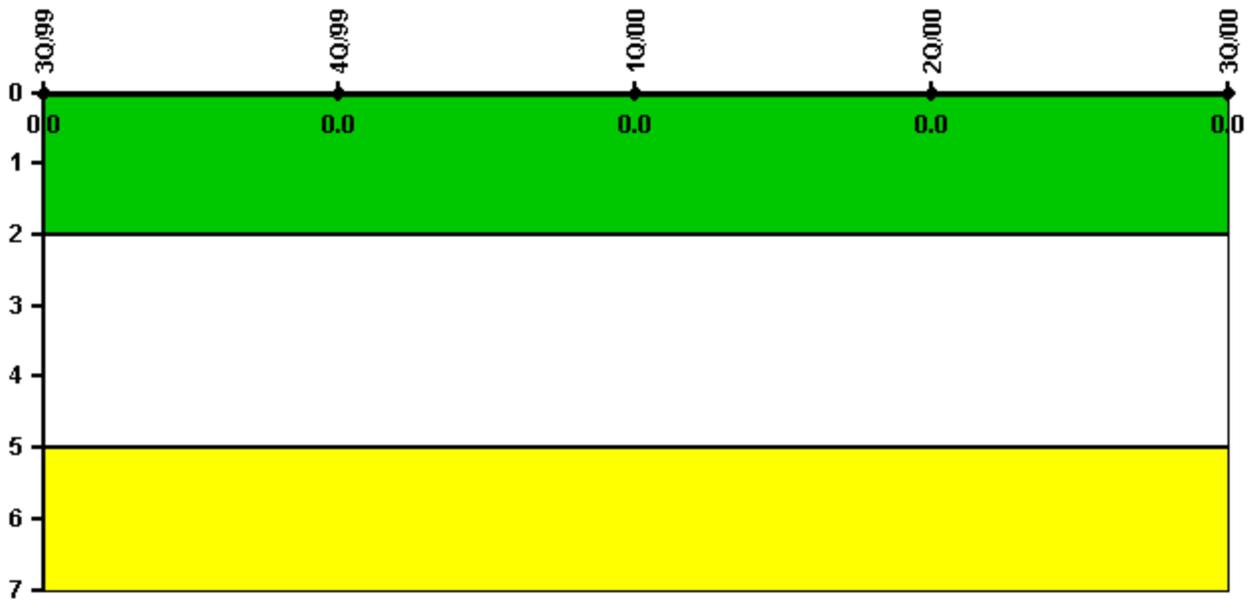


Thresholds: White > 2.0 Yellow > 5.0

Notes

Personnel Screening Program	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Program failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

FFD/Personnel Reliability

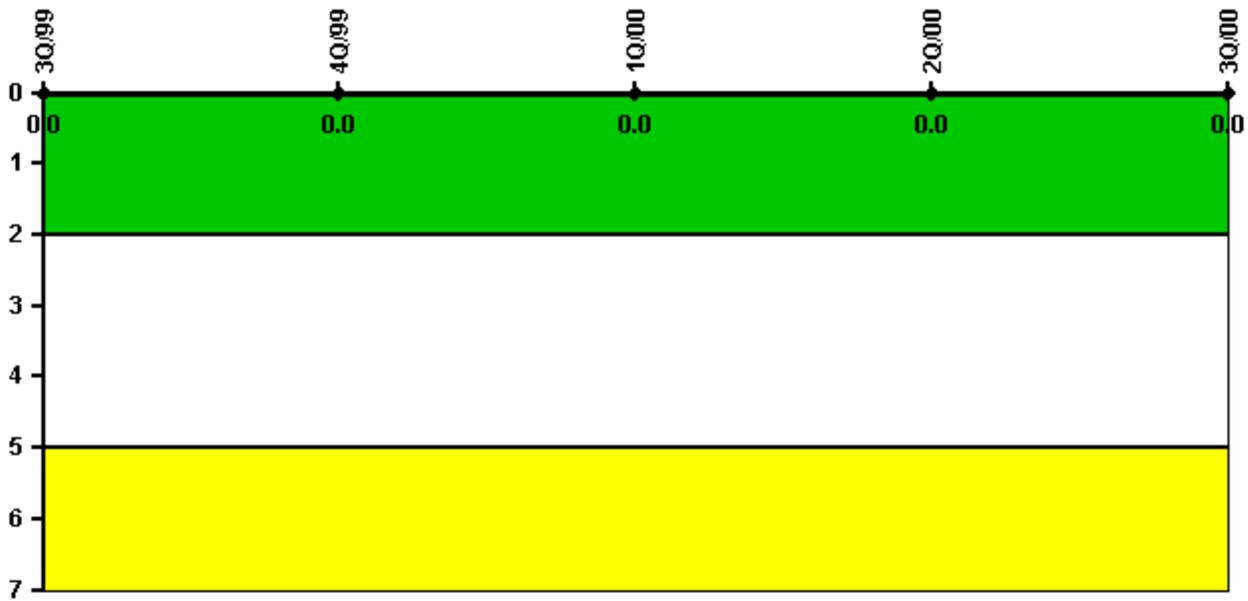

Thresholds: White > 2.0 Yellow > 5.0

Notes

FFD/Personnel Reliability	3Q/99	4Q/99	1Q/00	2Q/00	3Q/00
Program Failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

▲ [PI Summary](#) | [Inspection Findings Summary](#) | [Reactor Oversight Process](#)

Last Modified: March 29, 2002