


Diablo Canyon 2

1Q/2001 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

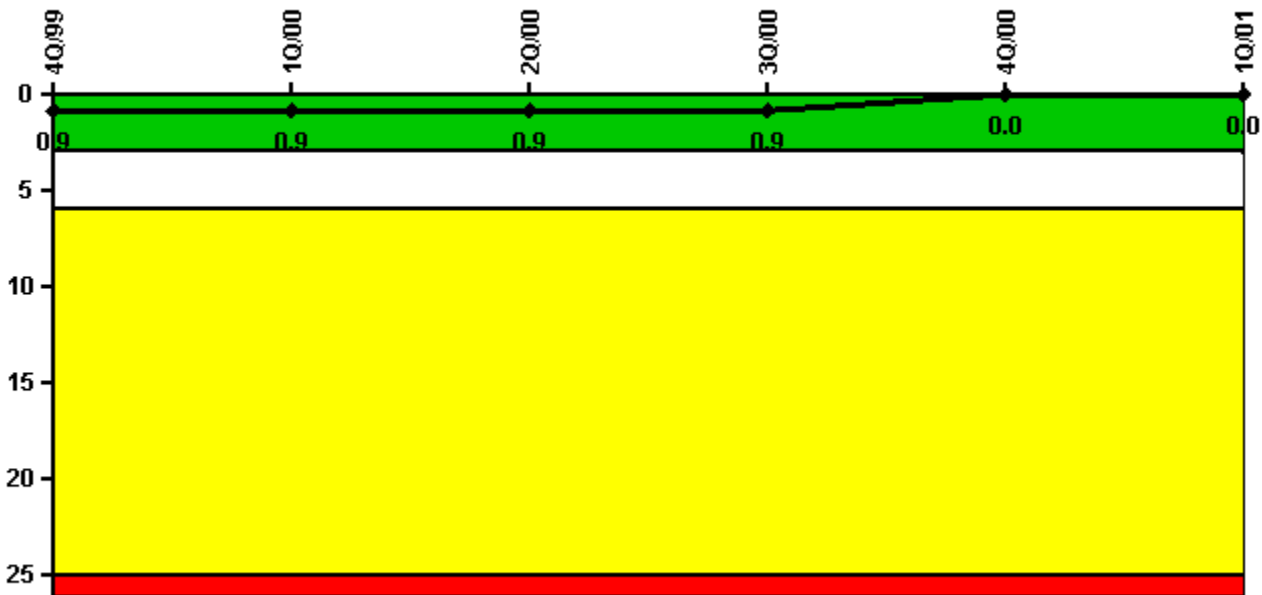


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01
Unplanned scrams	1.0	0	0	0	0	0
Critical hours	1516.8	2184.0	2183.0	1983.3	2209.0	2160.0
Indicator value	0.9	0.9	0.9	0.9	0	0

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

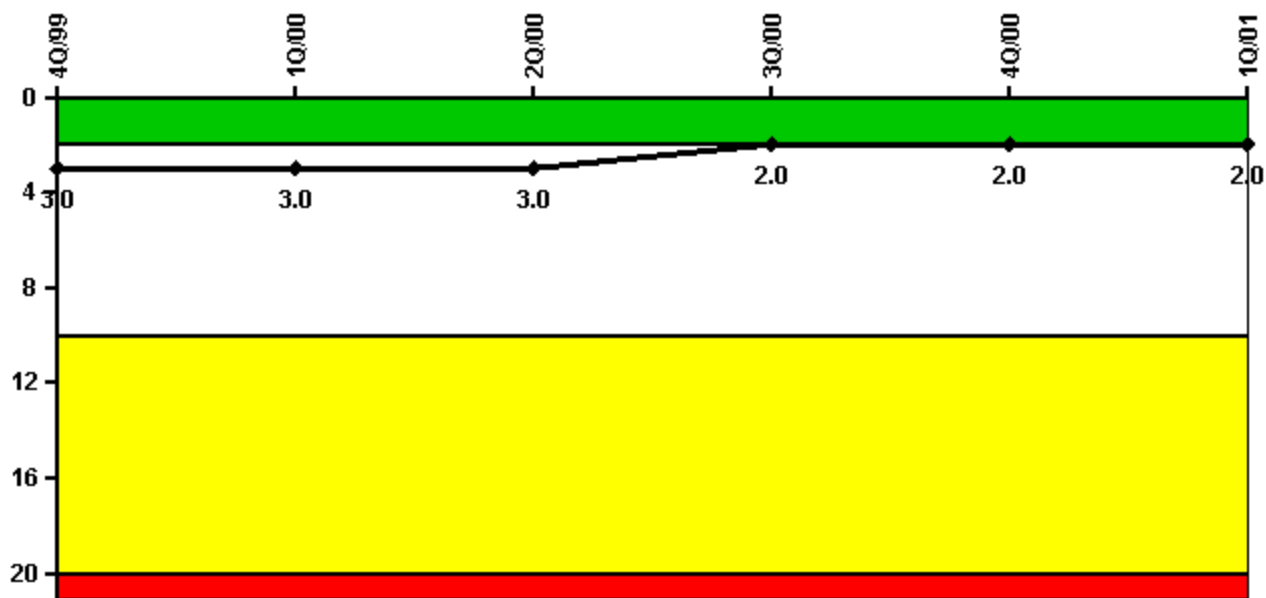


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01
Scrams	1.0	0	0	0	0	0
Indicator value	3.0	3.0	3.0	2.0	2.0	2.0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

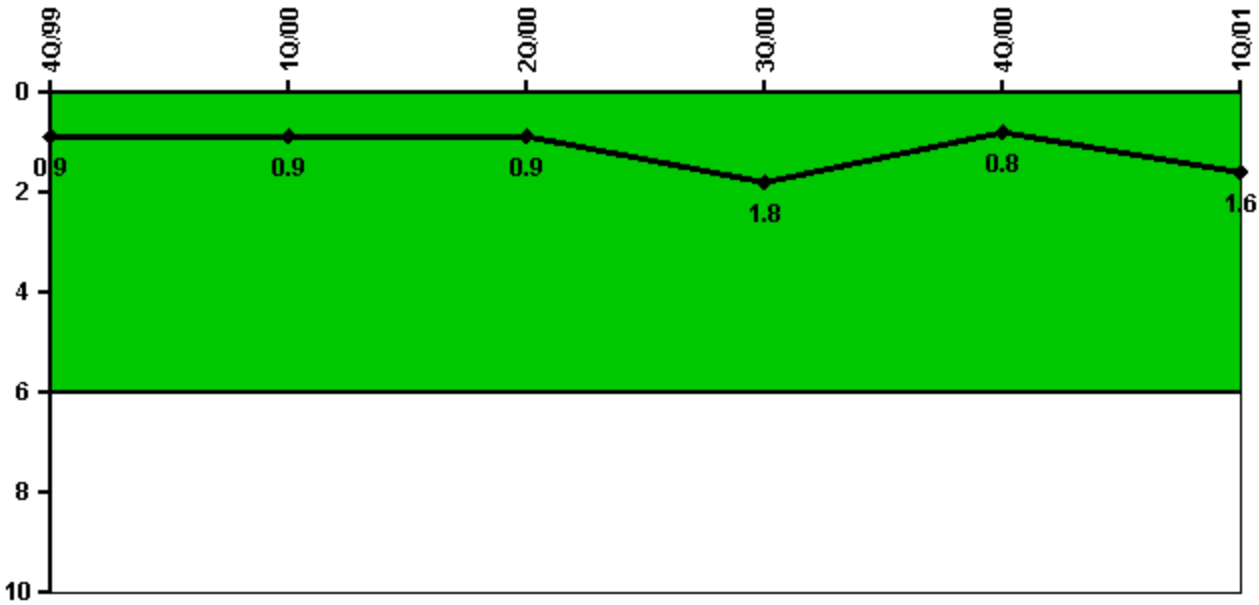

Thresholds: White > 6.0


Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01
Unplanned power changes	1.0	0	0	1.0	0	1.0
Critical hours	1516.8	2184.0	2183.0	1983.3	2209.0	2160.0
Indicator value	0.9	0.9	0.9	1.8	0.8	1.6

Licensee Comments:

4Q/00: The PI value for 4Q00 was reduced from 1 to 0 based on the deletion of a 12/22/00 power change that need not be counted under this PI per FAQ #274. The change does not affect any other periods, and does not affect the color of the PI.

Safety System Unavailability, Emergency AC Power, >2EDG

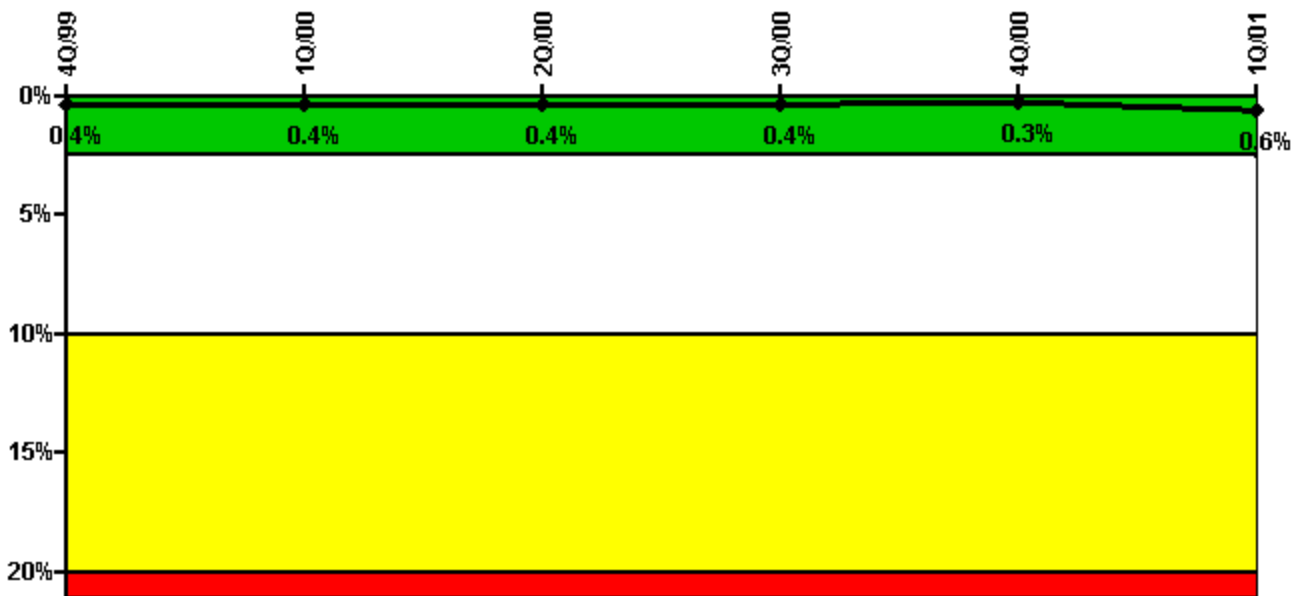

Thresholds: White > 2.5% Yellow > 10.0% Red > 20.0%

Notes

Safety System Unavailability, Emergency AC Power, >2EDG	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01
Train 1						
Planned unavailable hours	0.50	32.02	0.10	1.80	0.20	59.10
Unplanned unavailable hours	0	0	0	0	0	15.30
Fault exposure hours	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00	2160.00
Train 2						
Planned unavailable hours	0.30	34.73	0.10	1.30	0.10	66.20
Unplanned unavailable hours	0	0	0	0	0	6.10
Fault exposure hours	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00	2160.00
Train 3						
Planned unavailable hours	0.10	25.47	0.10	1.30	0.10	85.60
Unplanned unavailable hours	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0
Required hours	2209.00	2184.00	2183.00	2208.00	2209.00	2160.00
Indicator value	0.4%	0.4%	0.4%	0.4%	0.3%	0.6%

Licensee Comments:

1Q/01: The Train 2 unavailability hours were increased from 0 to 6.1 to account for a period of EDG unavailability that occurred during electrical bus inspection activities. During the inspection, the EDG control switch had been placed in manual that resulted in the unavailability of the EDG to perform its required automatic functions. This unavailability period was inadvertently omitted from the 1Q01 PI data submittal. This change does not affect any other quarters or the color of the PI.

Safety System Unavailability, High Pressure Injection System (HPSI)



Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%


Notes

Safety System Unavailability, High Pressure Injection System (HPSI)	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01
Train 1						
Planned unavailable hours	0	39.83	31.50	18.60	0	22.60
Unplanned unavailable hours	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0
Required hours	1516.80	2184.00	2183.00	1983.30	2209.00	2160.00
Train 2						
Planned unavailable hours	0	33.80	0	0	12.30	0.10
Unplanned unavailable hours	0	0.77	0	0	0	0
Fault exposure hours	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0
Required hours	1516.80	2184.00	2183.00	1983.30	2209.00	2160.00
Train 3						
Planned unavailable hours	0.20	11.82	10.30	0.20	21.80	0
Unplanned unavailable hours	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0
Required hours	1516.80	2184.00	2183.00	1983.30	2209.00	2160.00
Train 4						
Planned unavailable hours	0.10	3.23	11.20	12.20	0.10	24.00
Unplanned unavailable hours	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0

Required hours	1516.80	2184.00	2183.00	1983.30	2209.00	2160.00
Indicator value	0.8%	0.8%	0.8%	0.8%	0.8%	0.6%

Licensee Comments: none

Safety System Unavailability, Heat Removal System (AFW)

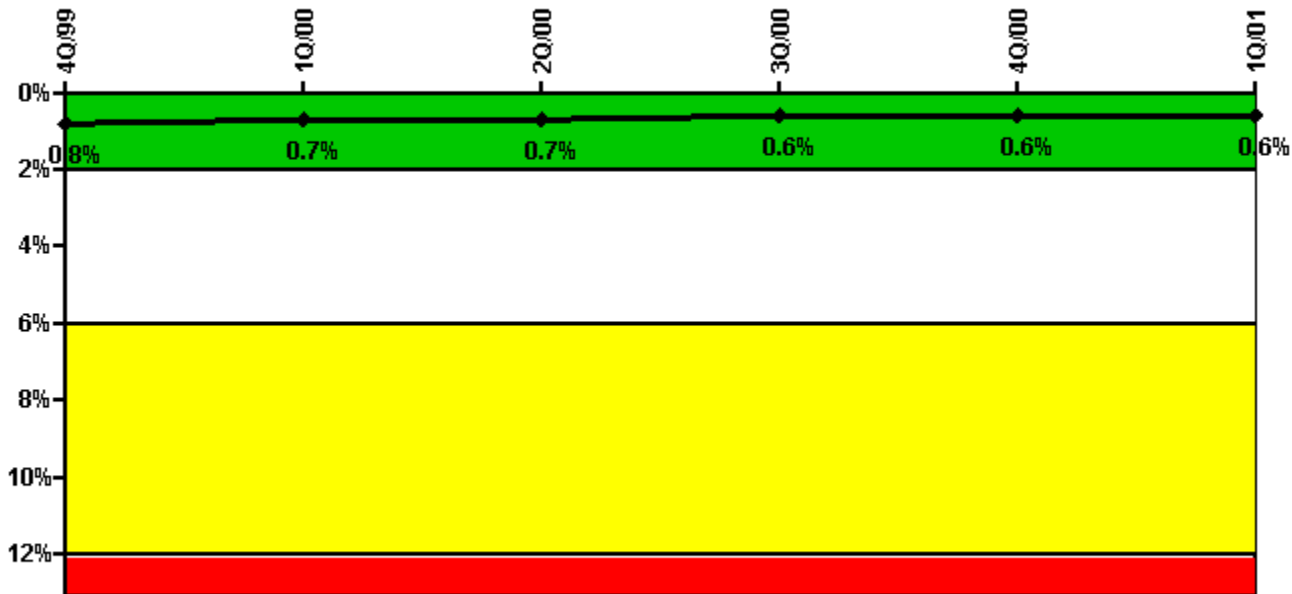

Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%


Notes

Safety System Unavailability, Heat Removal System (AFW)	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01
Train 1						
Planned unavailable hours	30.50	0.90	19.50	16.50	15.50	1.80
Unplanned unavailable hours	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0
Required hours	1516.80	2184.00	2183.00	1983.30	2209.00	2160.00
Train 2						
Planned unavailable hours	1.20	14.27	0.70	14.20	1.60	20.80
Unplanned unavailable hours	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0
Required hours	1516.80	2184.00	2183.00	1983.30	2209.00	2160.00
Train 3						
Planned unavailable hours	1.30	9.42	0.90	0.80	12.90	1.70
Unplanned unavailable hours	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0

Effective Reset hours	0	0	0	0	0	0
Required hours	1516.80	2184.00	2183.00	1983.30	2209.00	2160.00
Indicator value	0.8%	0.7%	0.7%	0.6%	0.6%	0.6%

Licensee Comments: none

Safety System Unavailability, Residual Heat Removal System

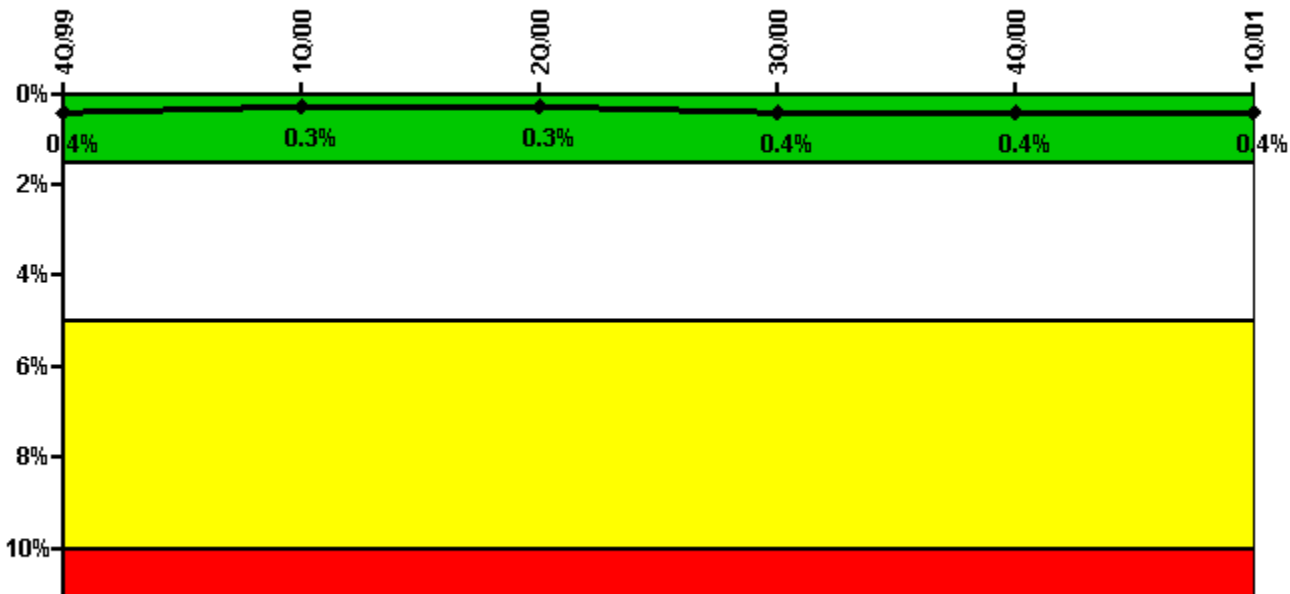

Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%


Notes

Safety System Unavailability, Residual Heat Removal System	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01
Train 1						
Planned unavailable hours	1.40	17.47	0.40	11.30	0.40	1.30
Unplanned unavailable hours	0	0	0	0	9.00	0
Fault exposure hours	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0
Required hours	1516.80	2184.00	2183.00	2208.00	2209.00	2160.00
Train 2						
Planned unavailable hours	0.80	19.95	0.80	0.10	14.60	0.90
Unplanned unavailable hours	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0
Required hours	1516.80	2184.00	2183.00	2208.00	2209.00	2160.00
Indicator value	0.4%	0.3%	0.3%	0.4%	0.4%	0.4%

Licensee Comments:

4Q/98: The hours required for service for Train 1 and Train 2 were increased from 2208 to 2209. The increase was due to failure to account in the original submittal for the change from Pacific Daylight Time to Pacific Standard Time. This change does not affect any other quarters or the color of the PI.

Safety System Functional Failures (PWR)

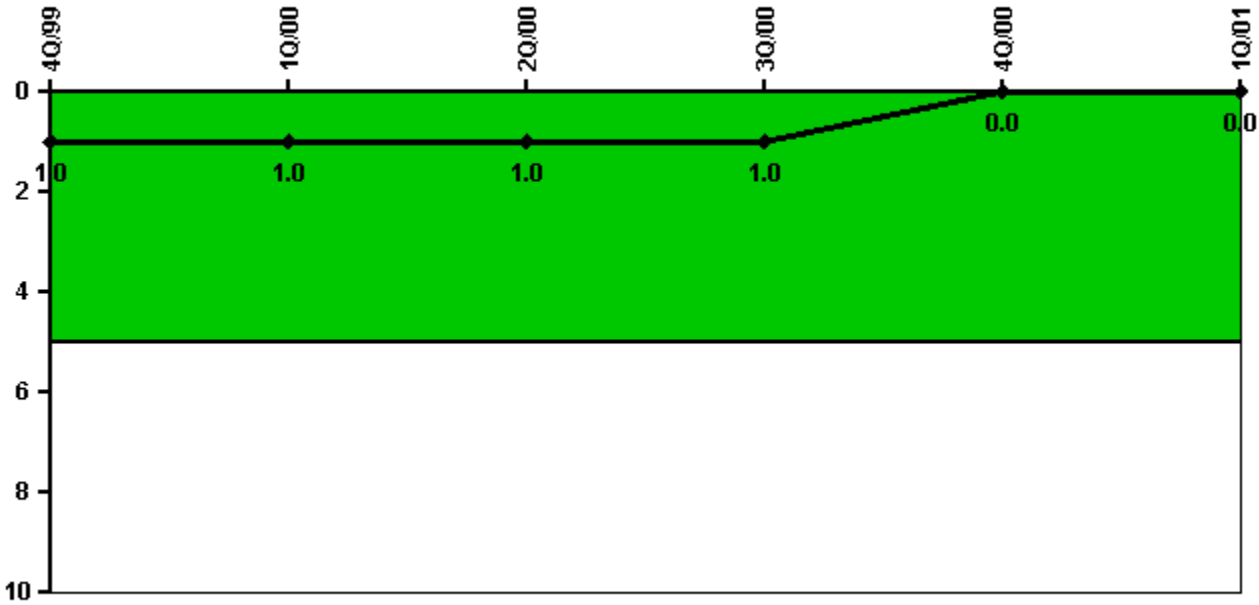


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01
Safety System Functional Failures	1	0	0	0	0	0
Indicator value	1	1	1	1	0	0

Licensee Comments: none

Reactor Coolant System Activity

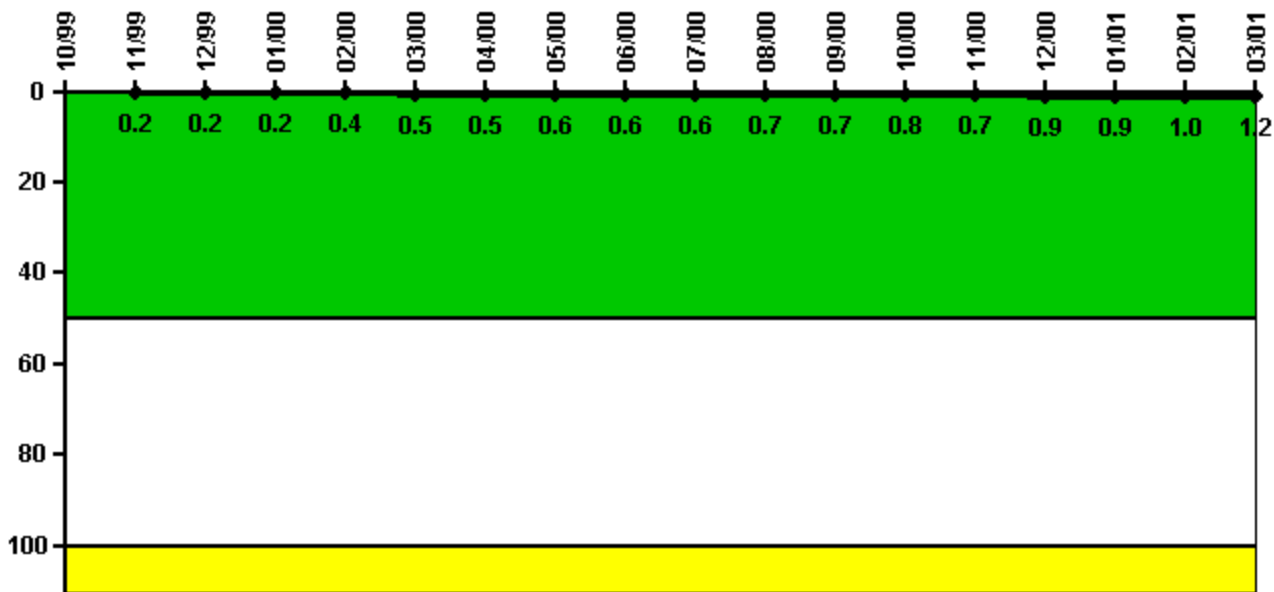

Thresholds: White > 50.0 Yellow > 100.0

Notes


Reactor Coolant System Activity	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00	7/00	8/00	9/00
Maximum activity	N/A	0.001510	0.001680	0.002050	0.004440	0.004900	0.004680	0.005500	0.005910	0.004390	0.004800	0.004900
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	0.7	0.7	0.7
Indicator value	N/A	0.2	0.2	0.2	0.4	0.5	0.5	0.6	0.6	0.6	0.7	0.7

Reactor Coolant System Activity	10/00	11/00	12/00	1/01	2/01	3/01
Maximum activity	0.005530	0.005320	0.006130	0.006110	0.006920	0.005550
Technical specification limit	0.7	0.7	0.7	0.7	0.7	0.5
Indicator value	0.8	0.7	0.9	0.9	1.0	1.2

Licensee Comments:

3/01: The limits for RCS dose equivalent I-131 specific activity are being administratively controlled at lower values (varies based on RCS letdown flow rate) than the Technical Specification limit of 1.0 micro Curies per gram. The reduced limits are to compensate for nonconservatism identified in a vendor's calculation for iodine appearance rates utilized in accident dose analyses. The reduced limits will remain in effect until affected analyses are revised.

Reactor Coolant System Leakage

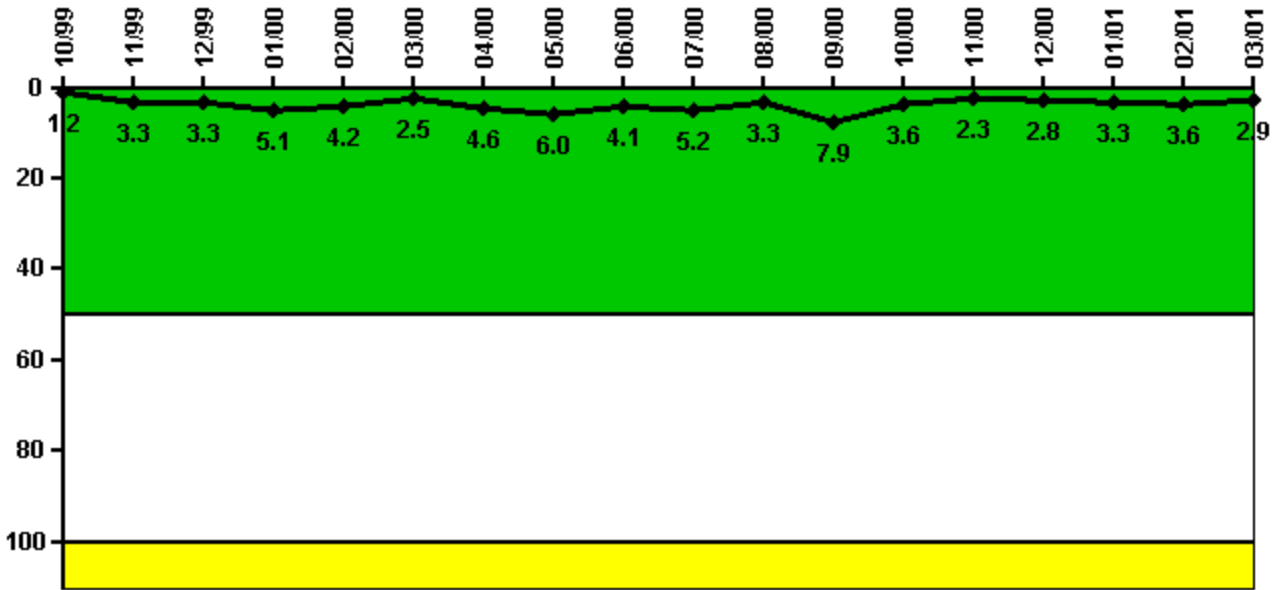

Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00	7/00	8/00	9/00
Maximum leakage	0.123	0.325	0.332	0.508	0.417	0.247	0.458	0.595	0.411	0.515	0.325	0.785
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.2	3.3	3.3	5.1	4.2	2.5	4.6	6.0	4.1	5.2	3.3	7.9

Reactor Coolant System Leakage	10/00	11/00	12/00	1/01	2/01	3/01
Maximum leakage	0.364	0.226	0.282	0.328	0.362	0.291
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	3.6	2.3	2.8	3.3	3.6	2.9

Licensee Comments:


3/01: Each RCS leakage flow rate value has been increased by 0.035 gpm to account for zinc acetate flow that is periodically injected into the RCS for corrosion control purposes. This flow rate was inadvertently excluded from the PI calculation methodology. This change affects all data submittals for this PI and is therefore being incorporated into each PI data submittal since the start of the ROP in April 2000. The change did not result in a color change for this PI for any quarter.

12/00: Each RCS leakage flow rate value has been increased by 0.035 gpm to account for zinc acetate flow that is periodically injected into the RCS for corrosion control purposes. This flow rate was inadvertently excluded from the PI calculation methodology. This change affects all data submittals for this PI and is therefore being incorporated into each PI data submittal since the start of the ROP in April 2000. The change did not result in a color change for this PI for any quarter.

9/00: Each RCS leakage flow rate value has been increased by 0.035 gpm to account for zinc acetate flow that is periodically injected into the RCS for corrosion control purposes. This flow rate was inadvertently excluded from the PI calculation methodology. This change affects all data submittals for this PI and is therefore being incorporated into each PI data submittal since the start of the ROP in April 2000. The change did not result in a color change for this PI for any quarter.

6/00: Each RCS leakage flow rate value has been increased by 0.035 gpm to account for zinc acetate flow that is periodically injected into the RCS for corrosion control purposes. This flow rate was inadvertently excluded from the PI calculation methodology. This change affects all data submittals for this PI and is therefore being incorporated into each PI data submittal since the start of the ROP in April 2000. The change did not result in a color change for this PI for any quarter.

Drill/Exercise Performance

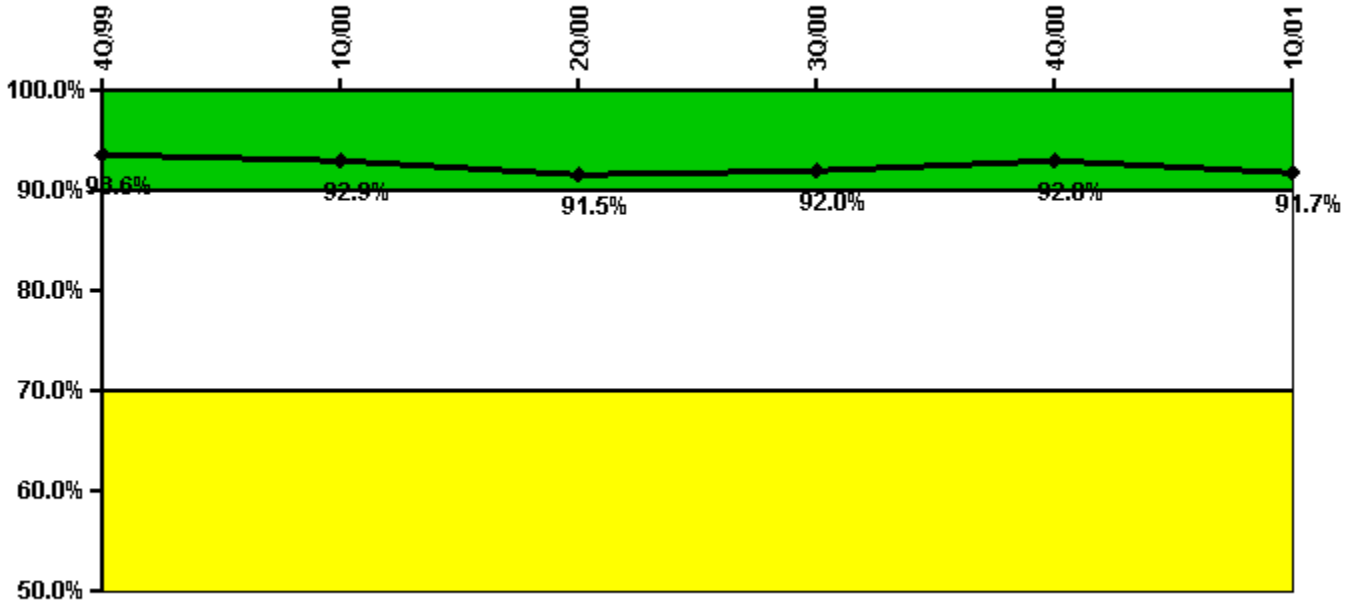

Thresholds: White < 90.0% Yellow < 70.0%


Notes

Drill/Exercise Performance	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01
Successful opportunities	10.0	24.0	28.0	21.0	10.0	36.0
Total opportunities	10.0	27.0	33.0	23.0	10.0	40.0
Indicator value	93.6%	92.9%	91.5%	92.0%	92.8%	91.7%

Licensee Comments:

1Q/01: The 1Q01 ERO drill/exercise performance data are being revised to include data from operations simulator drills that were performed during 1Q01 but not available for inclusion in the 1Q01 data submittal. Operations simulator drills performed in subsequent quarters will be included in that quarter's data. The change does not affect the color of the PI.

ERO Drill Participation

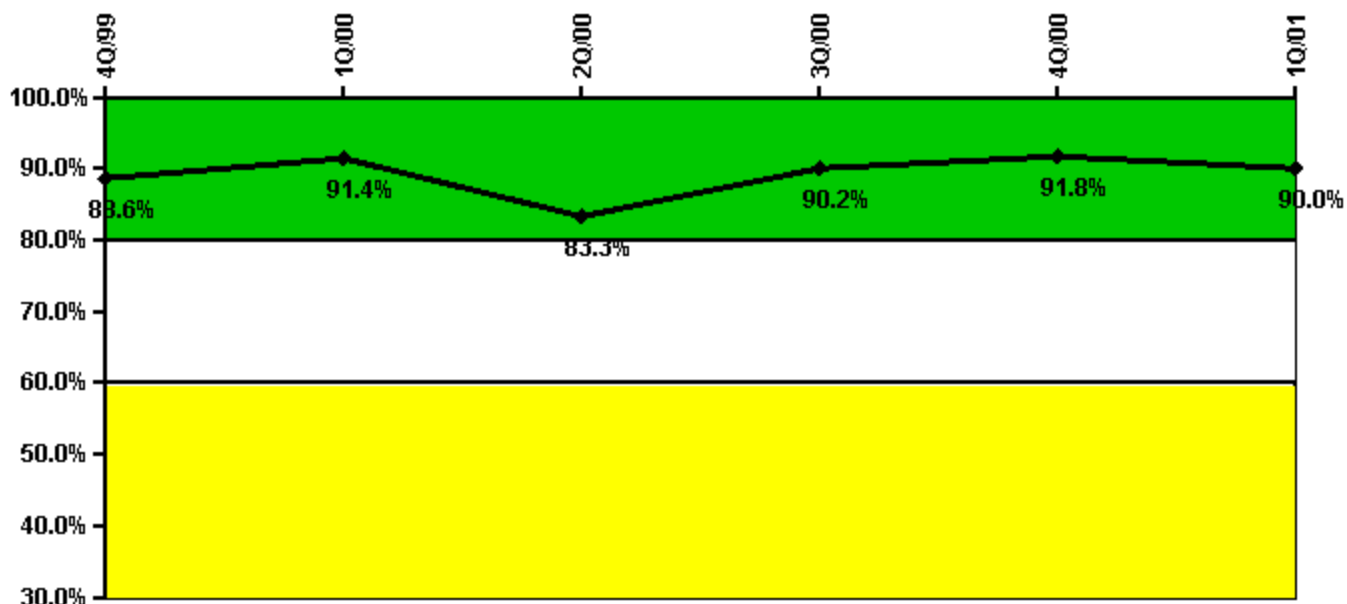


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01
Participating Key personnel	62.0	53.0	50.0	55.0	56.0	54.0
Total Key personnel	70.0	58.0	60.0	61.0	61.0	60.0
Indicator value	88.6%	91.4%	83.3%	90.2%	91.8%	90.0%

Licensee Comments: none

Alert & Notification System

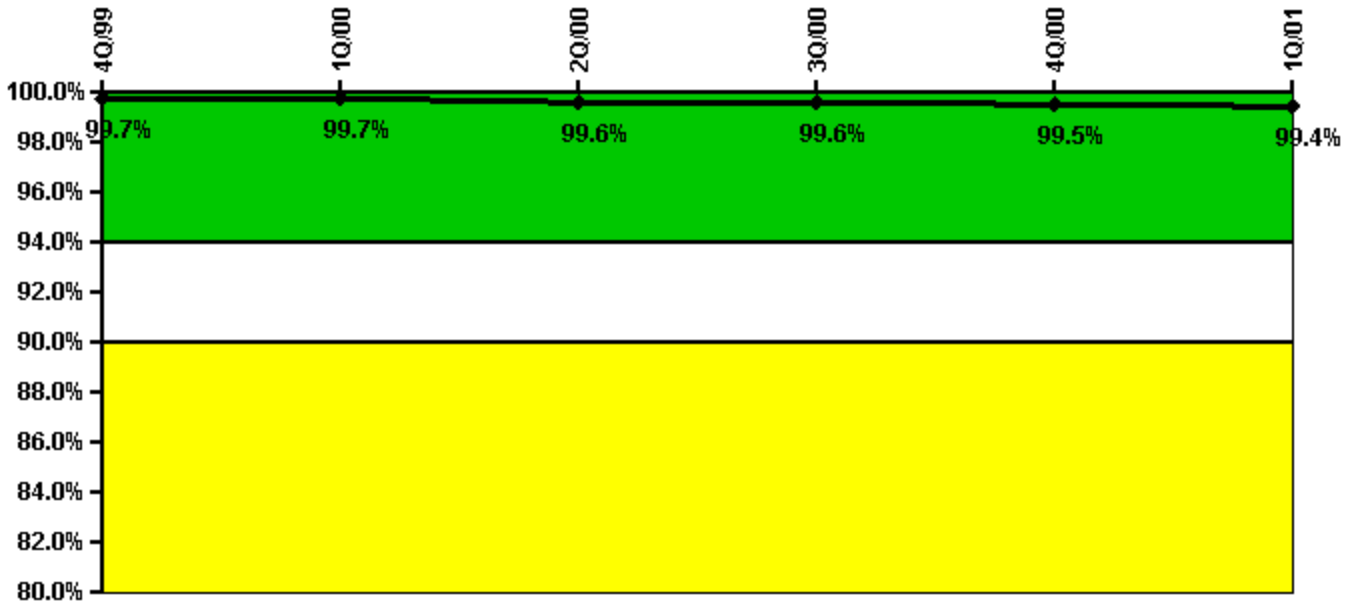

Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01
Successful siren-tests	1179	912	1040	1175	1044	909
Total sirens-tests	1179	917	1048	1179	1048	917
Indicator value	99.7%	99.7%	99.6%	99.6%	99.5%	99.4%

Licensee Comments:

1Q/01: The 1Q01 Alert and Notification System Reliability PI data are being revised to include data from a January 9, 2001 siren silent test that was not included in the 1Q01 PI data submittal due to a data entry error. The change does not affect any other periods, and does not affect the color of the PI.

Occupational Exposure Control Effectiveness



Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01
High radiation area occurrences	0	0	0	0	0	1
Very high radiation area occurrences	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0
Indicator value	0	0	0	0	0	1

Licensee Comments: none

RETS/ODCM Radiological Effluent




Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01
RETS/ODCM occurrences	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0

Licensee Comments: none

Protected Area Security Performance Index

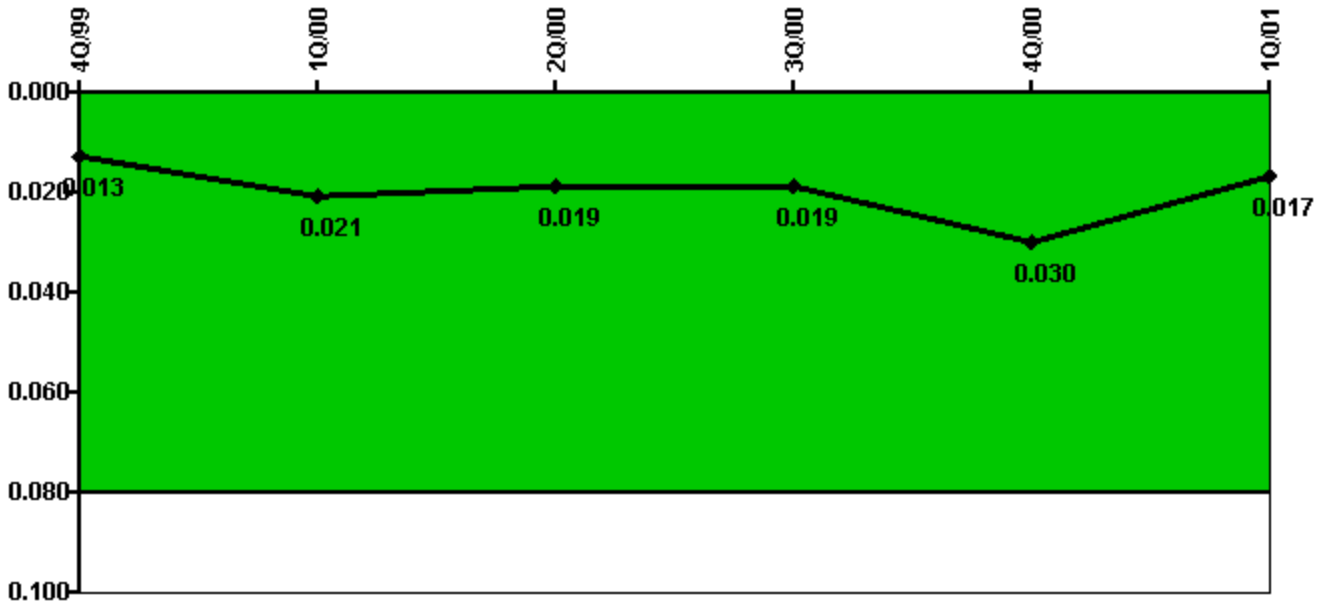


Thresholds: White > 0.080

Notes

Protected Area Security Performance Index	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01
IDS compensatory hours	67.00	573.00	35.75	51.87	31.37	3.87
CCTV compensatory hours	0	0	0	14.9	267.1	22.4
IDS normalization factor	2.25	2.30	2.30	2.30	2.30	2.30
CCTV normalization factor	1.2	1.2	1.2	1.2	1.2	1.2
Index Value	0.013	0.021	0.019	0.019	0.030	0.017

Licensee Comments: none

Personnel Screening Program

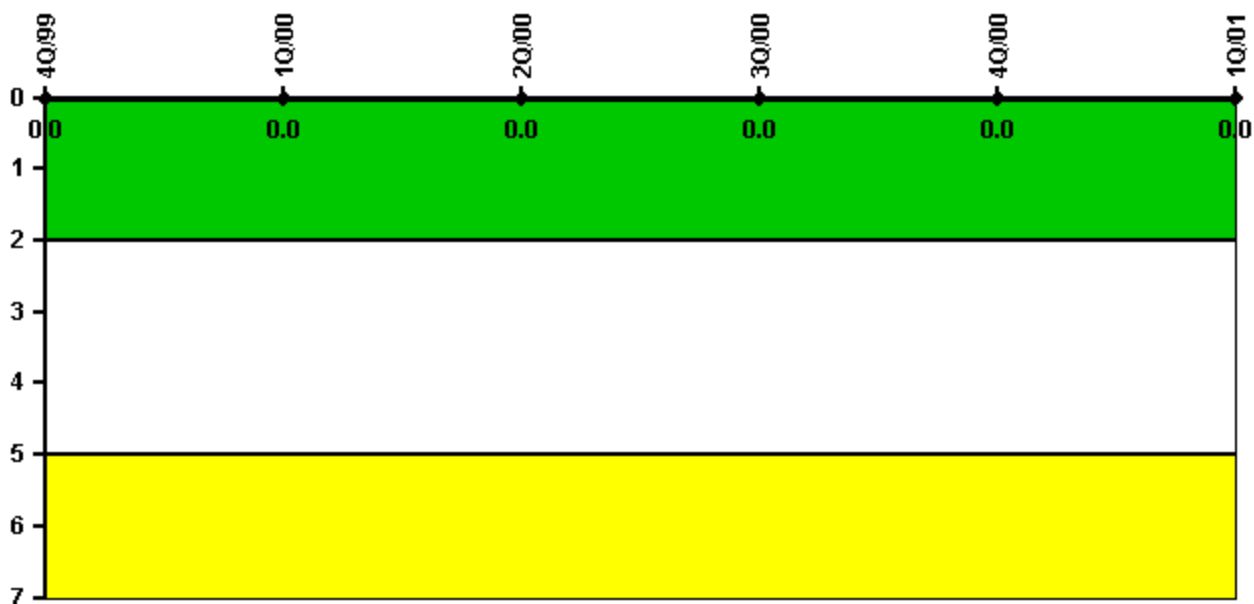

Thresholds: White > 2.0 Yellow > 5.0

Notes

Personnel Screening Program	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01
Program failures	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0

Licensee Comments: none

FFD/Personnel Reliability



Thresholds: White > 2.0 Yellow > 5.0

Notes

FFD/Personnel Reliability	4Q/99	1Q/00	2Q/00	3Q/00	4Q/00	1Q/01
Program Failures	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0

Licensee Comments: none

▲ [PI Summary](#) | [Inspection Findings Summary](#) | [Action Matrix Summary](#) | [Reactor Oversight Process](#)

Last Modified: March 28, 2002