


Comanche Peak 2

1Q/2002 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

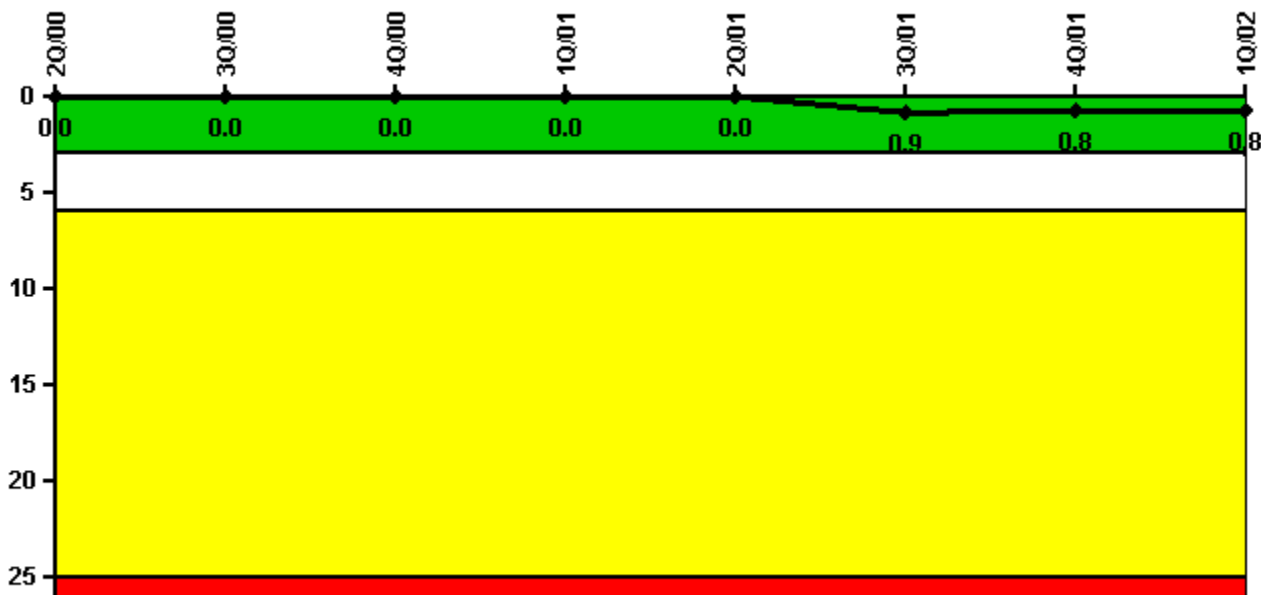


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Unplanned scrams	0	0	0	0	0	1.0	0	0
Critical hours	2183.0	2195.5	1392.5	2160.0	2183.0	2188.6	2209.0	2123.8
Indicator value	0	0	0	0	0	0.9	0.8	0.8

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

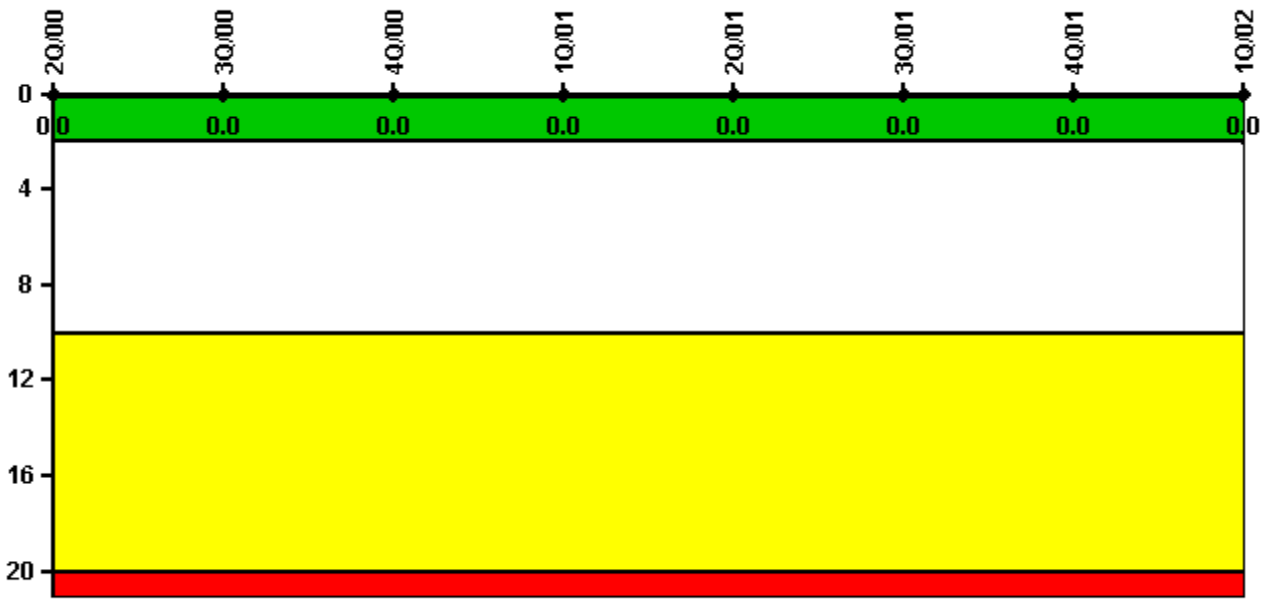


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Scrams	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

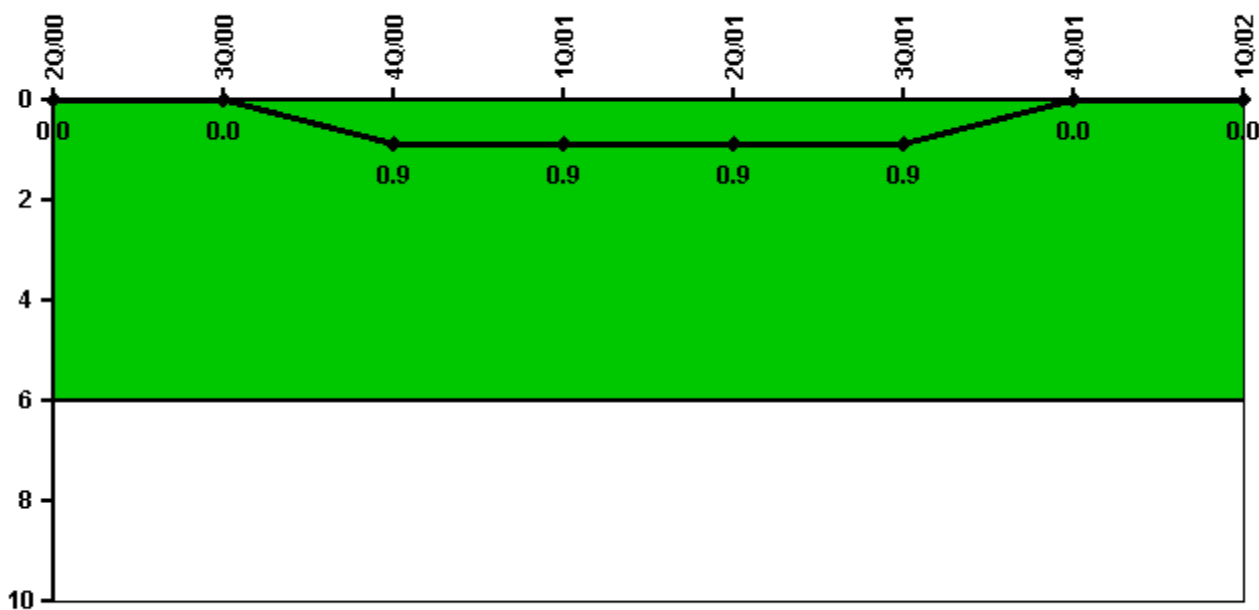


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Unplanned power changes	0	0	1.0	0	0	0	0	0
Critical hours	2183.0	2195.5	1392.5	2160.0	2183.0	2188.6	2209.0	2123.8
Indicator value	0	0	0.9	0.9	0.9	0.9	0	0

Licensee Comments: none

Safety System Unavailability, Emergency AC Power

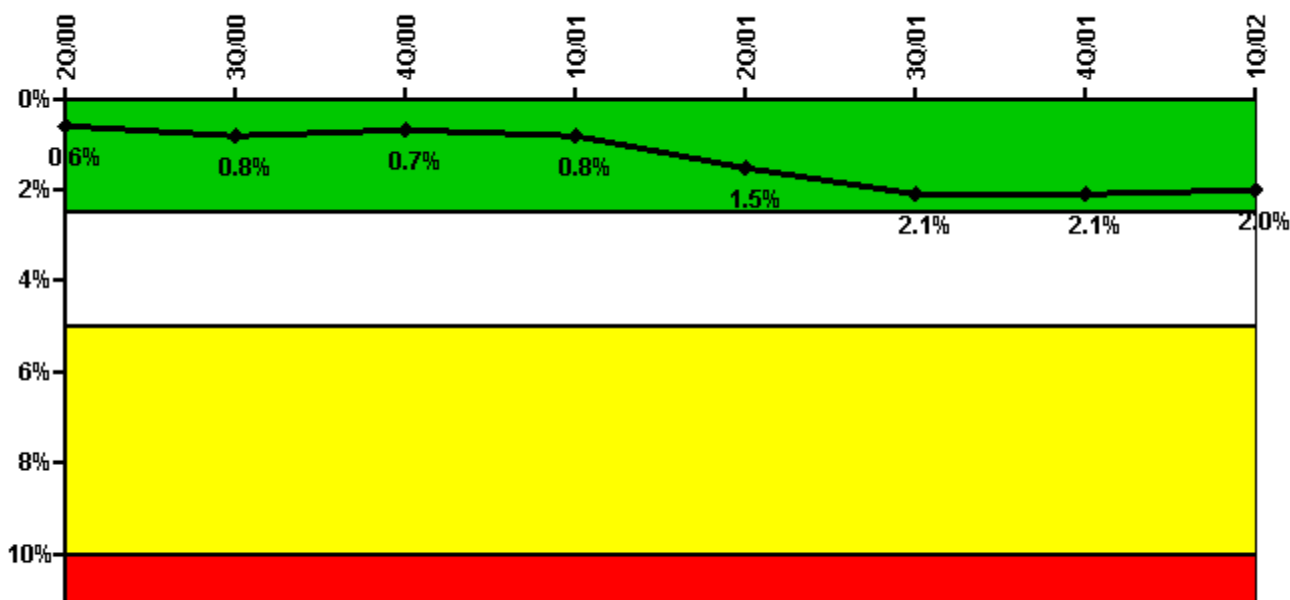


Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Emergency AC Power	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Train 1								
Planned unavailable hours	17.00	19.00	3.90	6.50	2.80	2.50	5.70	9.00
Unplanned unavailable hours	7.20	0	20.80	6.00	32.50	18.40	0	0
Fault exposure hours	0	0	0	0	334.30	333.80	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00	2160.00
Train 2								
Planned unavailable hours	17.60	2.40	3.60	19.40	19.30	5.80	5.50	13.80
Unplanned unavailable hours	0	64.90	0	5.30	4.80	1.00	0	14.40
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00	2160.00
Indicator value	0.6%	0.8%	0.7%	0.8%	1.5%	2.1%	2.1%	2.0%

Licensee Comments: none

Safety System Unavailability, High Pressure Injection System (HPSI)

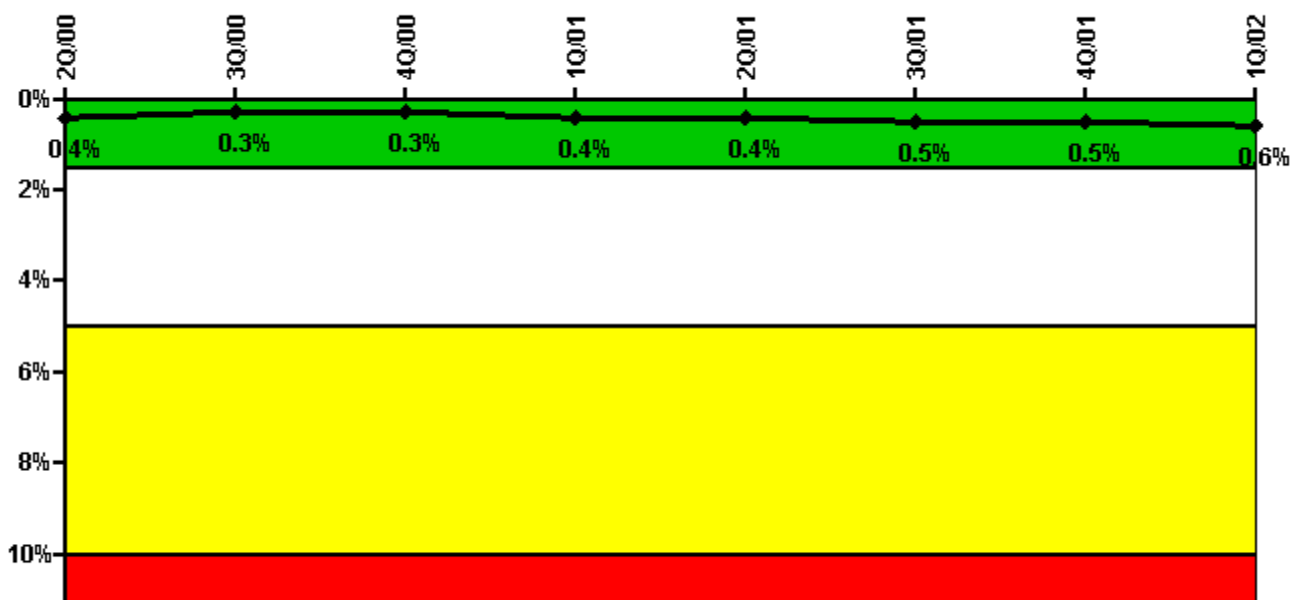

Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%


Notes

Safety System Unavailability, High Pressure Injection System (HPSI)	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Train 1								
Planned unavailable hours	17.50	3.10	11.50	20.30	1.60	56.20	5.10	19.00
Unplanned unavailable hours	0.50	12.70	0	6.00	0	0	0	6.60
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2195.50	1392.50	2160.00	2183.00	2188.60	2209.00	2123.80
Train 2								
Planned unavailable hours	9.30	1.50	0.80	39.80	19.00	9.90	10.70	6.50
Unplanned unavailable hours	0	0.10	0	0	6.40	1.60	6.40	13.20
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2195.50	1392.50	2160.00	2183.00	2188.60	2209.00	2123.80
Train 3								
Planned unavailable hours	6.10	0	0	25.00	0.60	49.60	4.90	6.30
Unplanned unavailable hours	0.50	2.60	0	6.40	0	0	0	6.60
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2195.50	1392.50	2160.00	2183.00	2188.60	2209.00	2123.80
Train 4								
Planned unavailable hours	7.40	0	0	16.30	4.90	7.40	9.30	6.00
Unplanned unavailable hours	0	0.70	0	0	6.40	1.60	6.40	13.20
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2195.50	1392.50	2160.00	2183.00	2188.60	2209.00	2123.80
Indicator value	0.4%	0.3%	0.3%	0.4%	0.4%	0.5%	0.5%	0.6%

Licensee Comments:

1Q/02: CCP 2-01 & SIP 2-01 each had 19.2 (T/2) Fault Exposure Hours in March 2002 due to Component Cooling Water Pump Failure (Indirect Support Sys).

Safety System Unavailability, Heat Removal System (AFW)

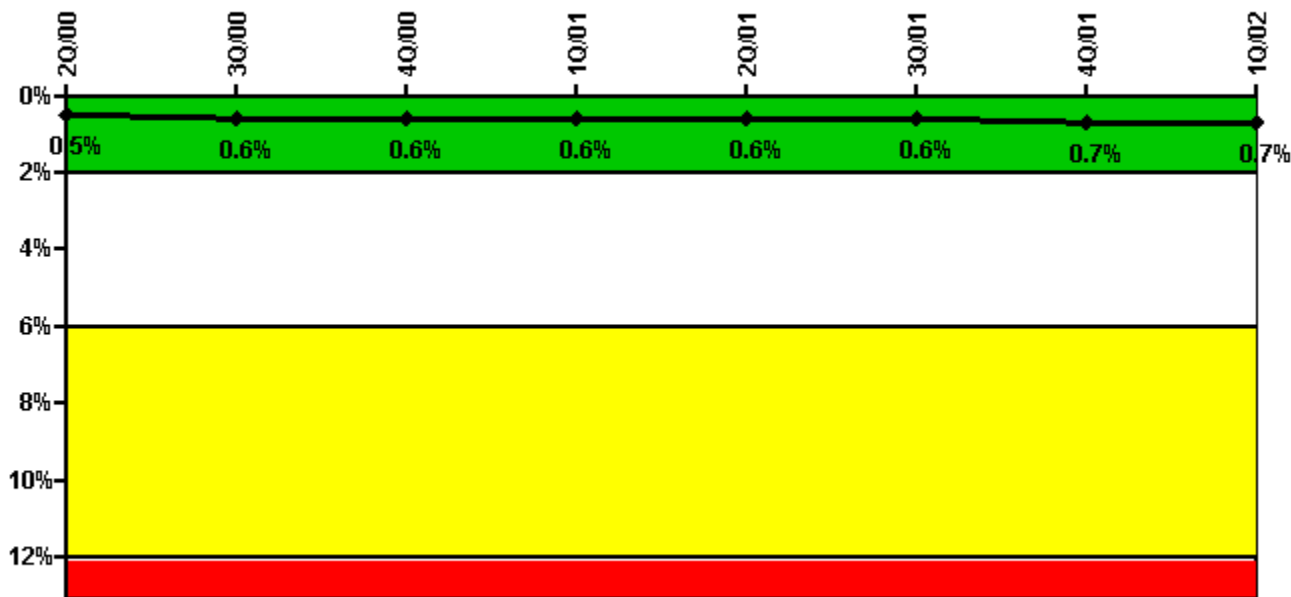

Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%


Notes

Safety System Unavailability, Heat Removal System (AFW)	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Train 1								
Planned unavailable hours	11.20	40.60	30.60	4.30	13.00	5.80	17.70	29.70
Unplanned unavailable hours	0.20	15.80	0	0	3.30	1.10	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2195.50	1392.50	2160.00	2183.00	2188.60	2209.00	2123.80
Train 2								
Planned unavailable hours	1.70	17.90	1.70	19.80	2.20	52.50	22.60	8.40
Unplanned unavailable hours	0.20	0	0	6.00	0	0	0	6.60
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2195.50	1392.50	2160.00	2183.00	2188.60	2209.00	2123.80
Train 3								
Planned unavailable hours	7.50	2.50	1.50	5.80	6.60	9.50	13.00	17.60
Unplanned unavailable hours	0	13.60	0	0	6.60	1.60	6.40	15.20
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2195.50	1392.50	2160.00	2183.00	2188.60	2209.00	2123.80
Indicator value	0.5%	0.6%	0.6%	0.6%	0.6%	0.6%	0.7%	0.7%

Licensee Comments:

1Q/02: MDAFWP 2-01 had 19.2 (T/2) Fault Exposure Hours in March 2002 due to Component Cooling Water Pump Failure (Indirect Support System).

Safety System Unavailability, Residual Heat Removal System

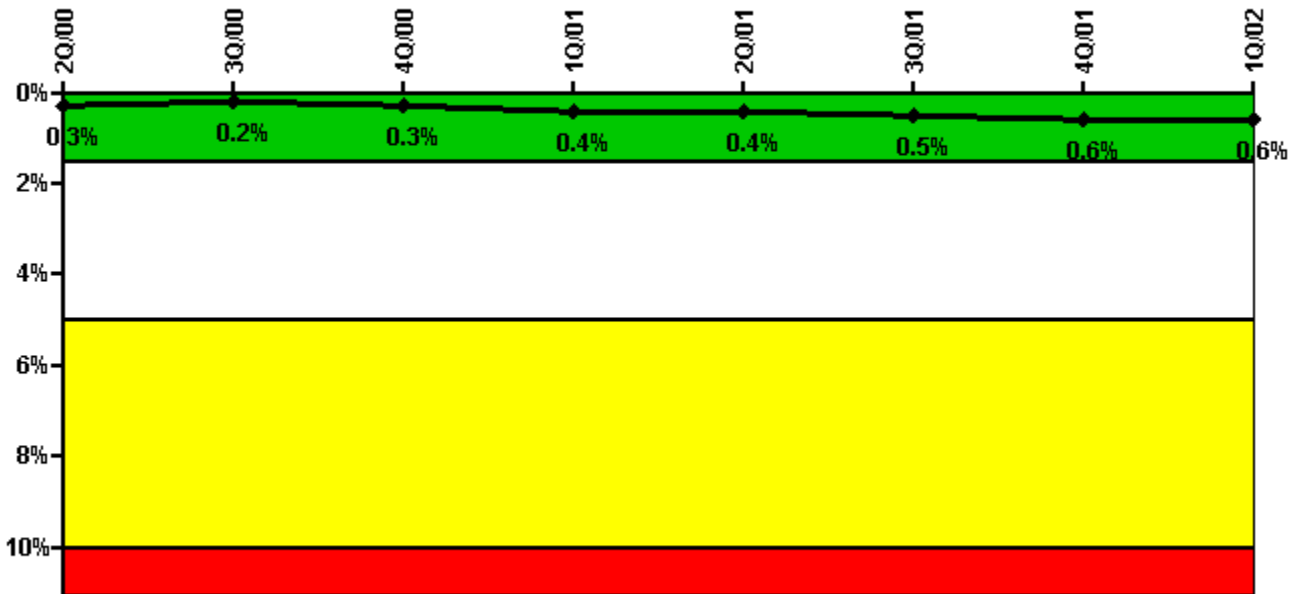

Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%


Notes

Safety System Unavailability, Residual Heat Removal System	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Train 1								
Planned unavailable hours	2.40	9.80	8.00	30.00	12.70	53.30	16.80	4.40
Unplanned unavailable hours	0	0	0	6.00	17.40	0	0	6.60
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00	2160.00
Train 2								
Planned unavailable hours	19.00	1.30	35.40	10.40	5.40	24.40	20.30	6.60
Unplanned unavailable hours	0	0	0	0	6.40	1.60	6.40	13.20
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00	2160.00
Indicator value	0.3%	0.2%	0.3%	0.4%	0.4%	0.5%	0.6%	0.6%

Licensee Comments:

1Q/02: RHR 2-01 had 19.2 (T/2) Fault Exposure Hours in March 2002 due to Component Cooling Water Pump Failure (Direct Support System).

Safety System Functional Failures (PWR)

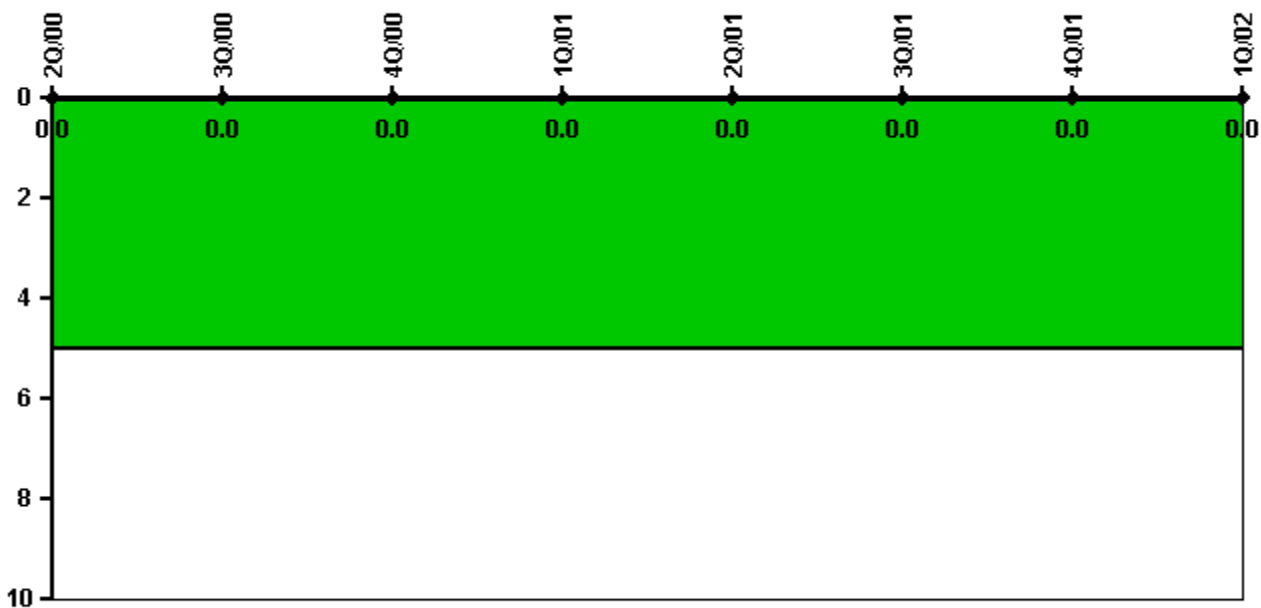


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Activity

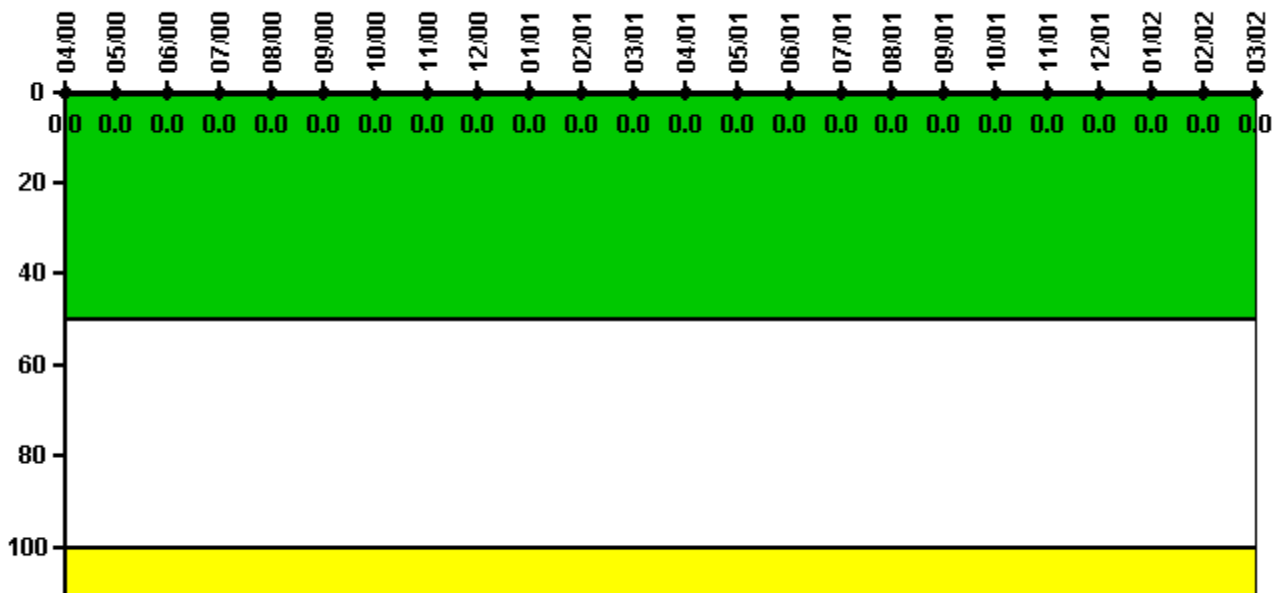

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	4/00	5/00	6/00	7/00	8/00	9/00	10/00	11/00	12/00	1/01	2/01	3/01
Maximum activity	0.000184	0.000192	0.000186	0.000181	0.000211	0.000226	0	0.000105	0.000105	0.000110	0.000119	0.000120
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	4/01	5/01	6/01	7/01	8/01	9/01	10/01	11/01	12/01	1/02	2/02	3/02
Maximum activity	0.000119	0.000141	0.000128	0.000126	0.000134	0.000143	0.000145	0.000142	0.000154	0.000166	0.000140	0.000185
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

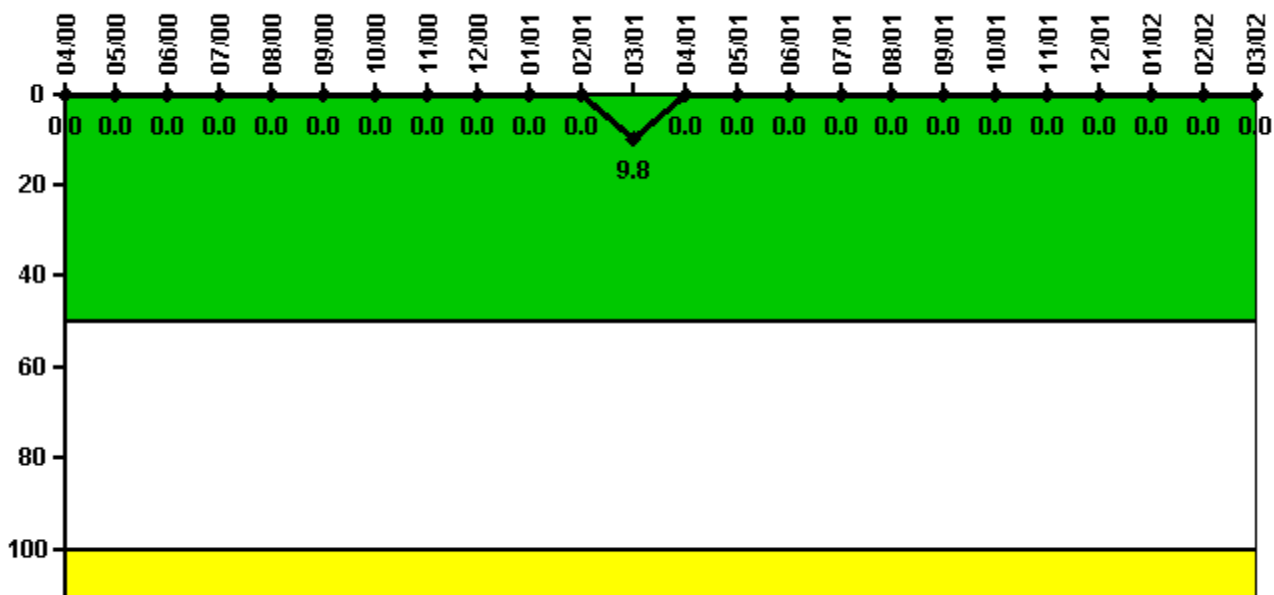

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	4/00	5/00	6/00	7/00	8/00	9/00	10/00	11/00	12/00	1/01	2/01	3/01
Maximum leakage	0	0	0	0	0	0	0	0	0	0	0	0.976
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	9.8

Reactor Coolant System Leakage	4/01	5/01	6/01	7/01	8/01	9/01	10/01	11/01	12/01	1/02	2/02	3/02
Maximum leakage	0	0	0	0	0	0	0	0	0	0	0	0
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Drill/Exercise Performance

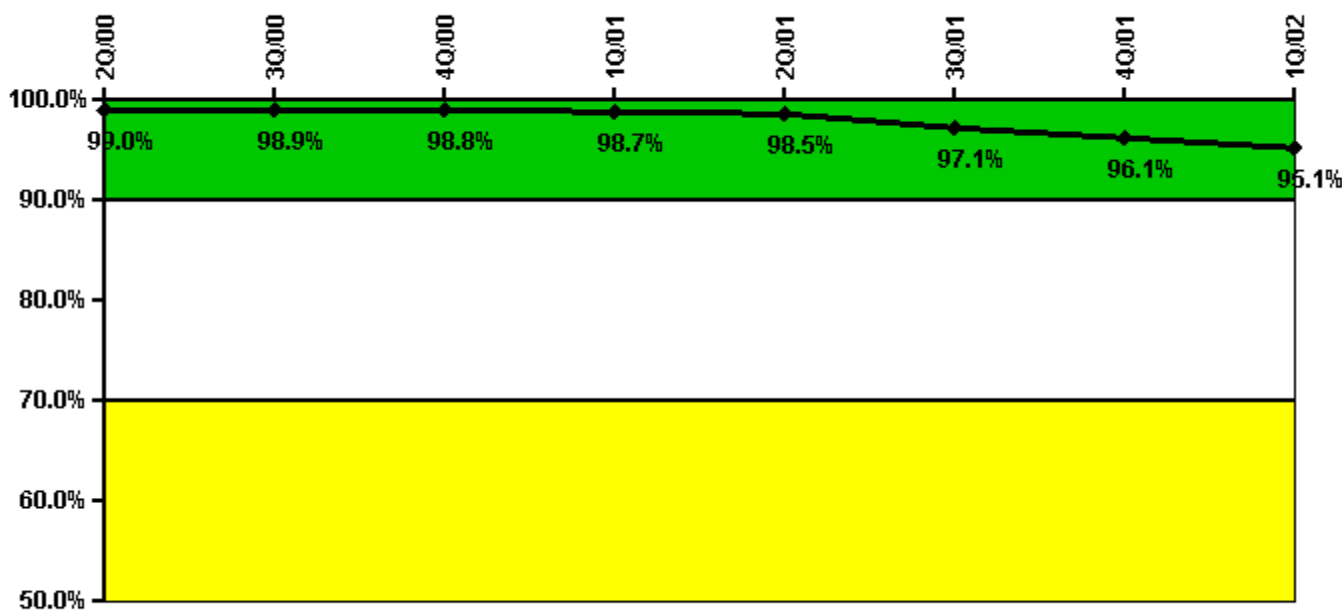

Thresholds: White < 90.0% Yellow < 70.0%


Notes

Drill/Exercise Performance	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Successful opportunities	7.0	87.0	0	0	0	47.0	29.0	5.0
Total opportunities	8.0	88.0	0	0	0	50.0	32.0	6.0
Indicator value	99.0%	98.9%	98.8%	98.7%	98.5%	97.1%	96.1%	95.1%

Licensee Comments:

4Q/01: Minor data correction is due to an internal review of the data. There is no impact to the PI or the color of the indicator.

ERO Drill Participation

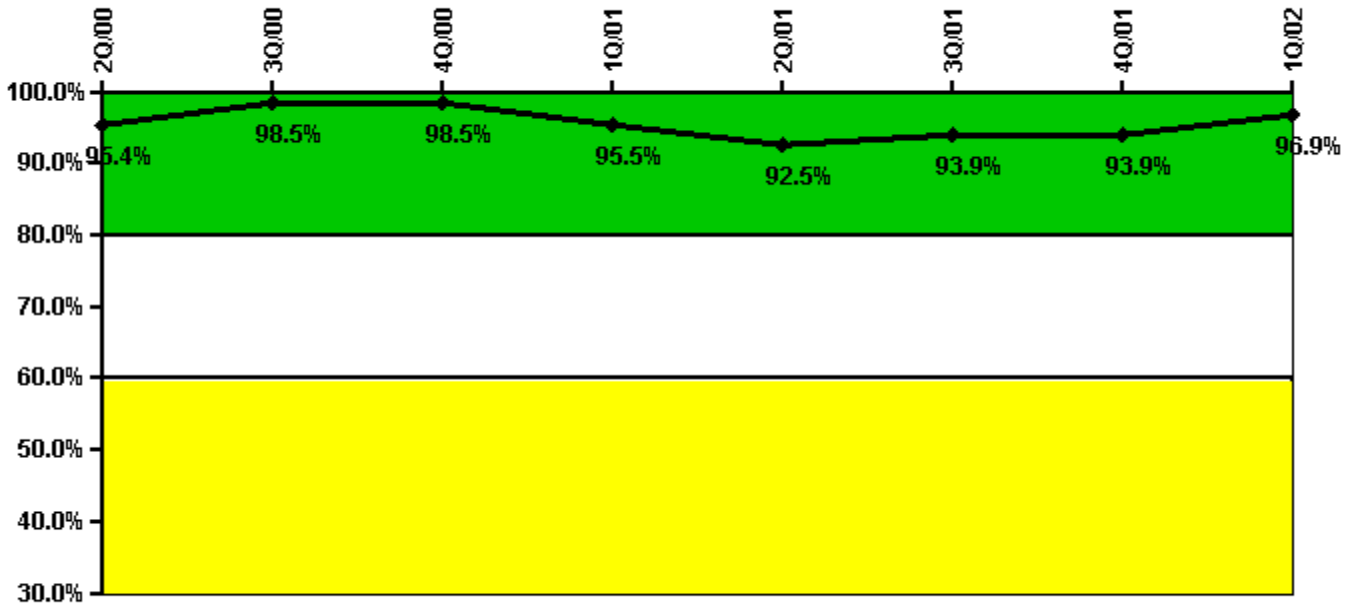

Thresholds: White < 80.0% Yellow < 60.0%


Notes

ERO Drill Participation	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Participating Key personnel	62.0	65.0	65.0	63.0	62.0	62.0	62.0	62.0
Total Key personnel	65.0	66.0	66.0	66.0	67.0	66.0	66.0	64.0
Indicator value	95.4%	98.5%	98.5%	95.5%	92.5%	93.9%	93.9%	96.9%

Licensee Comments:

3Q/01: Minor data correction is due to an internal review of the data. There is no impact to the PI or the color of the indicator.

Alert & Notification System

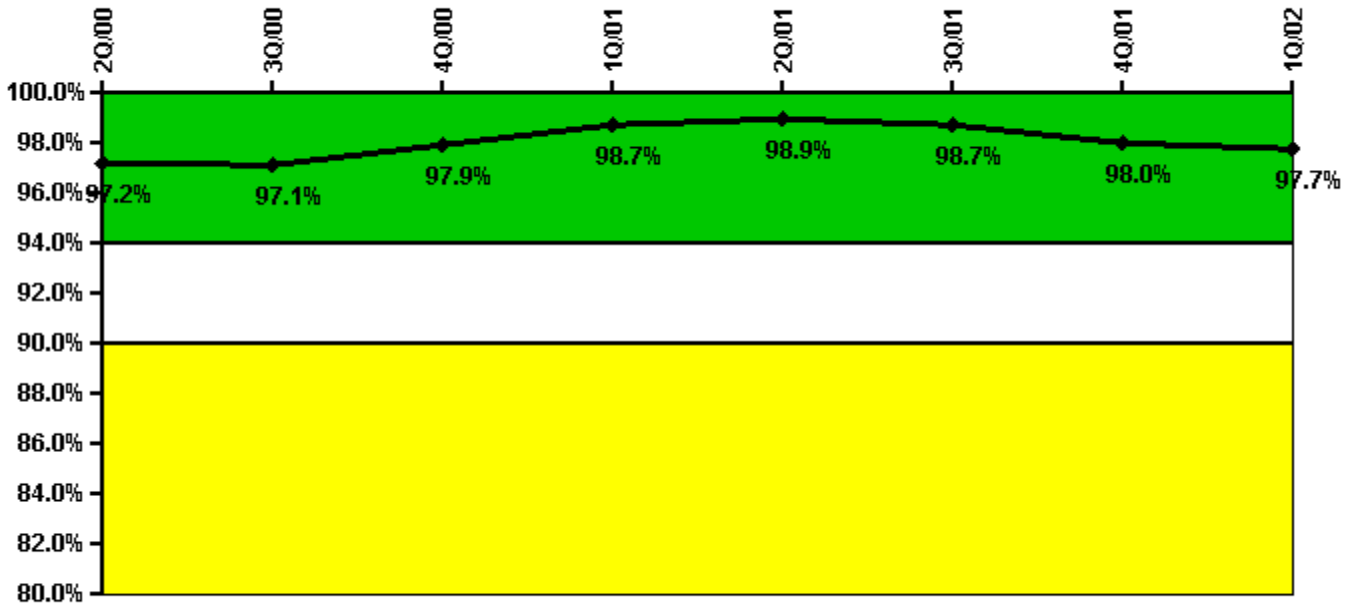


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Successful siren-tests	194	195	197	196	195	194	191	194
Total sirens-tests	198	198	198	198	198	198	198	198
Indicator value	97.2%	97.1%	97.9%	98.7%	98.9%	98.7%	98.0%	97.7%

Licensee Comments: none

Occupational Exposure Control Effectiveness

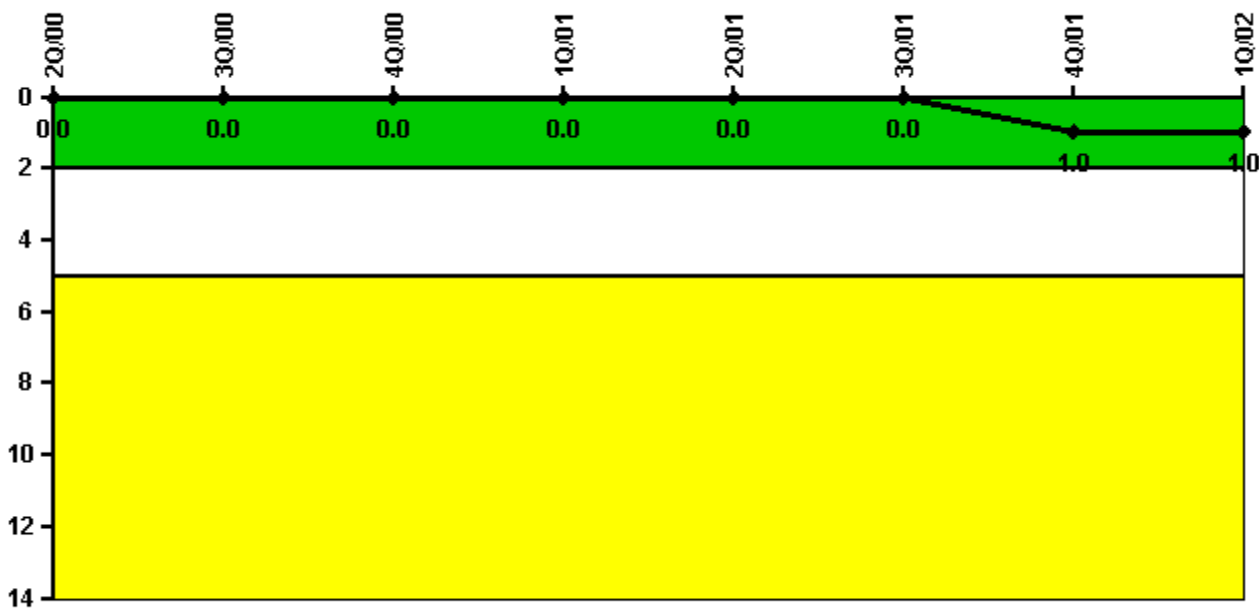

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
High radiation area occurrences	0	0	0	0	0	0	1	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	1	1

Licensee Comments: none

RETS/ODCM Radiological Effluent




Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Protected Area Security Performance Index

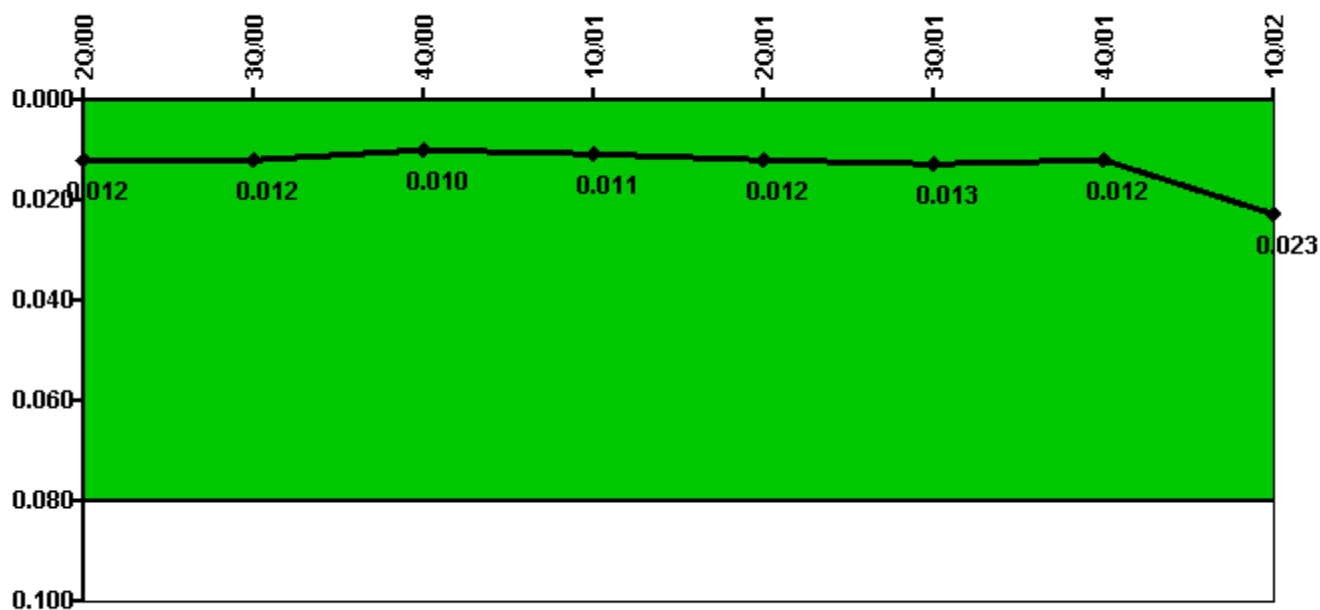


Thresholds: White > 0.080

Notes

Protected Area Security Performance Index	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
IDS compensatory hours	73.70	67.90	83.90	142.10	98.60	28.00	64.30	550.50
CCTV compensatory hours	8.3	11.0	5.8	4.7	29.9	49.5	2.6	12.2
IDS normalization factor	2.15	2.15	2.15	2.15	2.15	2.15	2.15	2.15
CCTV normalization factor	1.5	1.5	1.5	1.5	1.5	1.5	1.5	1.5
Index Value	0.012	0.012	0.010	0.011	0.012	0.013	0.012	0.023

Licensee Comments: none

Personnel Screening Program

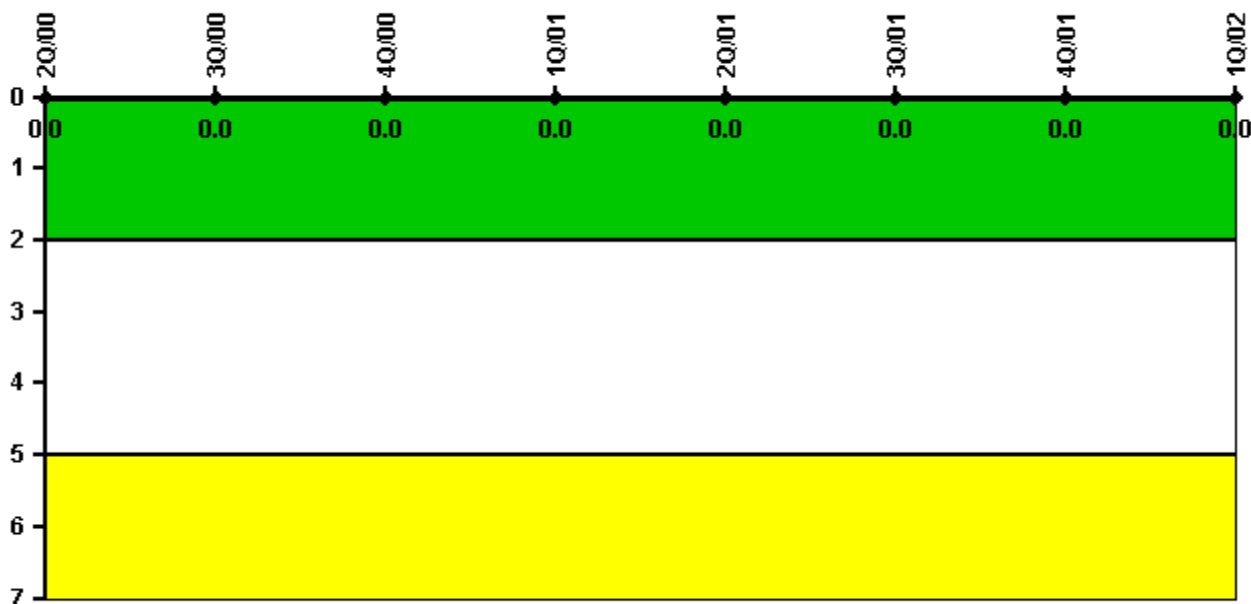


Thresholds: White > 2.0 Yellow > 5.0

Notes

Personnel Screening Program	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Program failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

FFD/Personnel Reliability

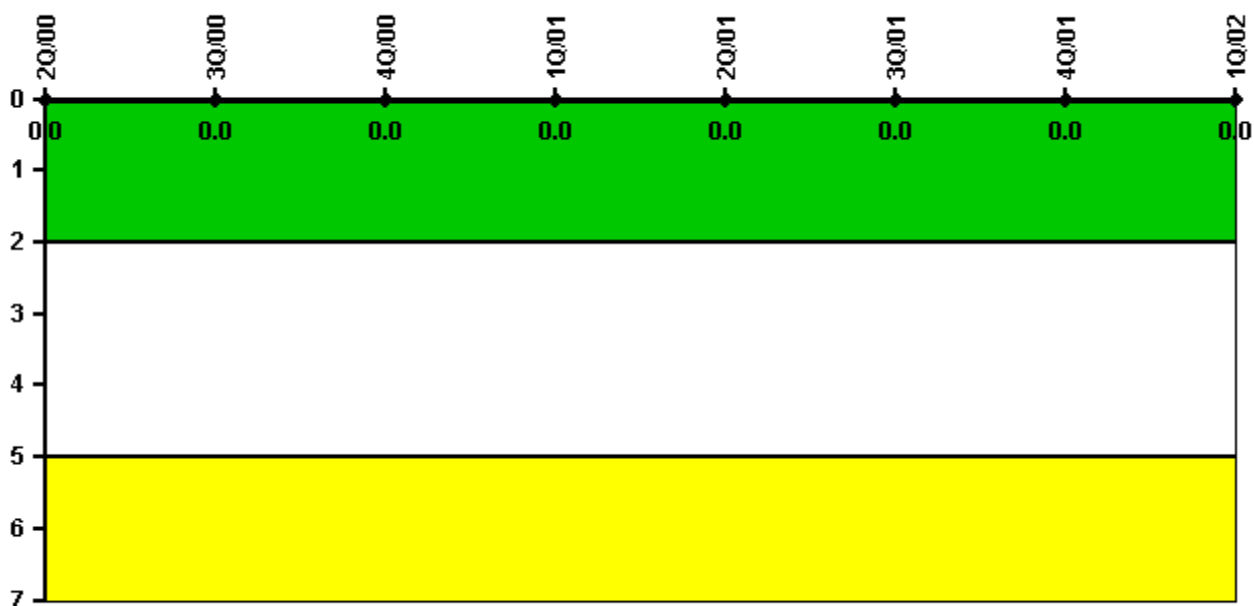

Thresholds: White > 2.0 Yellow > 5.0

Notes

FFD/Personnel Reliability	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Program Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

▲ [PI Summary](#) | [Inspection Findings Summary](#) | [Reactor Oversight Process](#)

Last Modified: May 1, 2002