


La Salle 1

1Q/2002 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

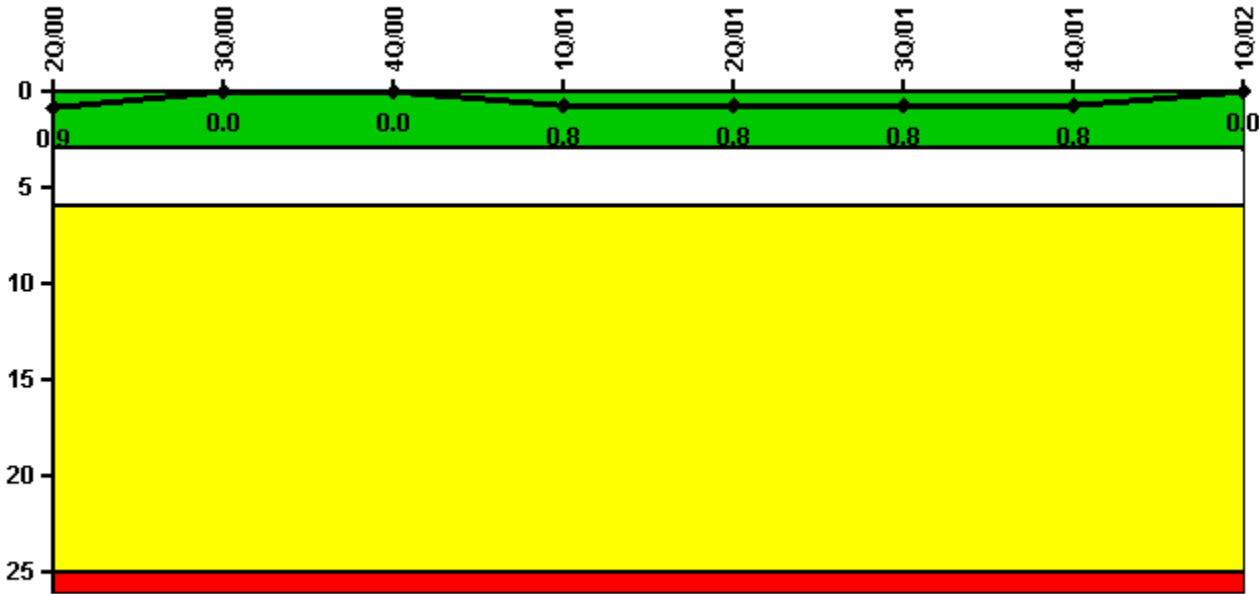


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Unplanned scrams	0	0	0	1.0	0	0	0	0
Critical hours	2183.0	2208.0	2209.0	2123.4	2183.0	2208.0	2209.0	1585.9
Indicator value	0.9	0	0	0.8	0.8	0.8	0.8	0

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

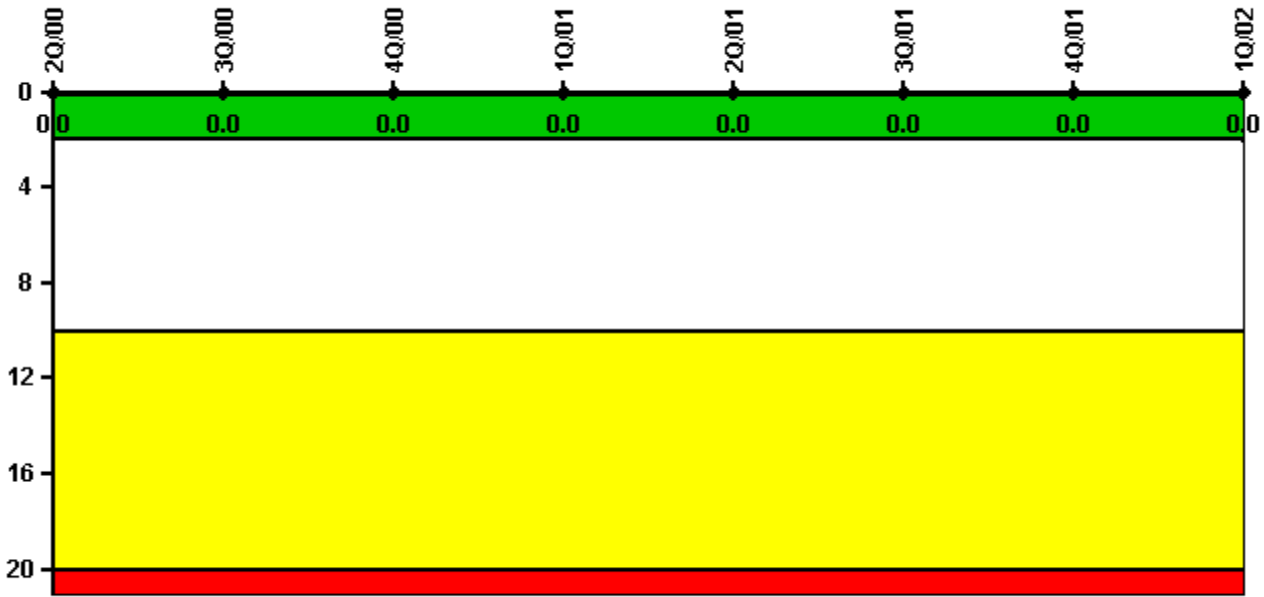


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Scrams	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

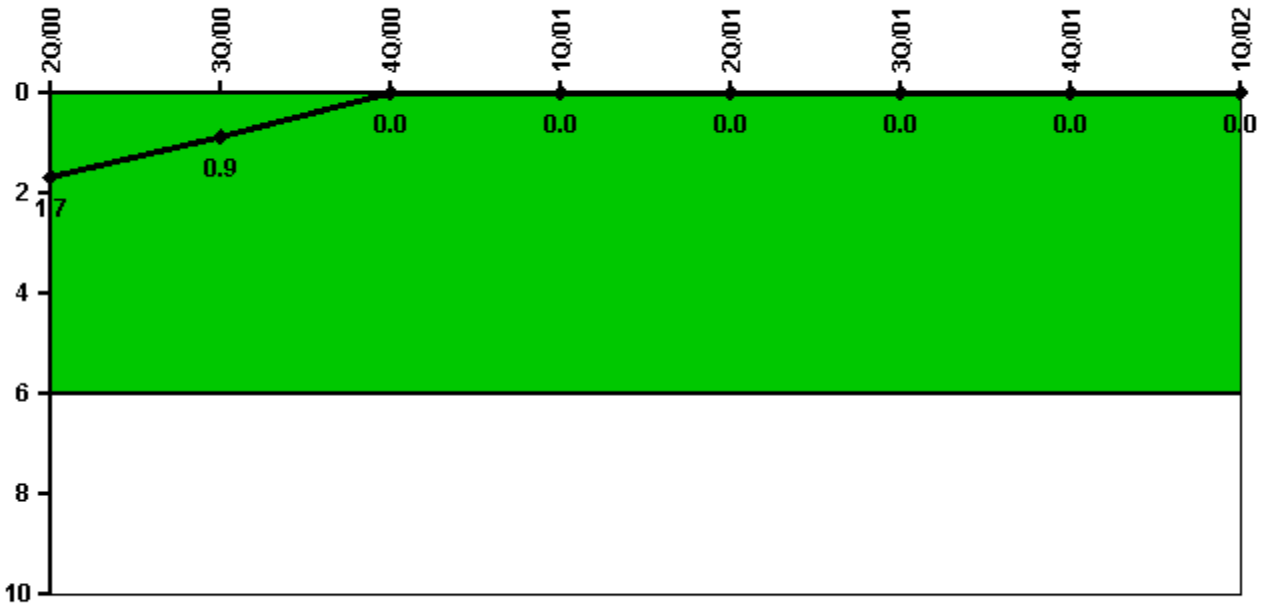


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2183.0	2208.0	2209.0	2123.4	2183.0	2208.0	2209.0	1585.9
Indicator value	1.7	0.9	0	0	0	0	0	0

Licensee Comments: none

Safety System Unavailability, Emergency AC Power, >2EDG

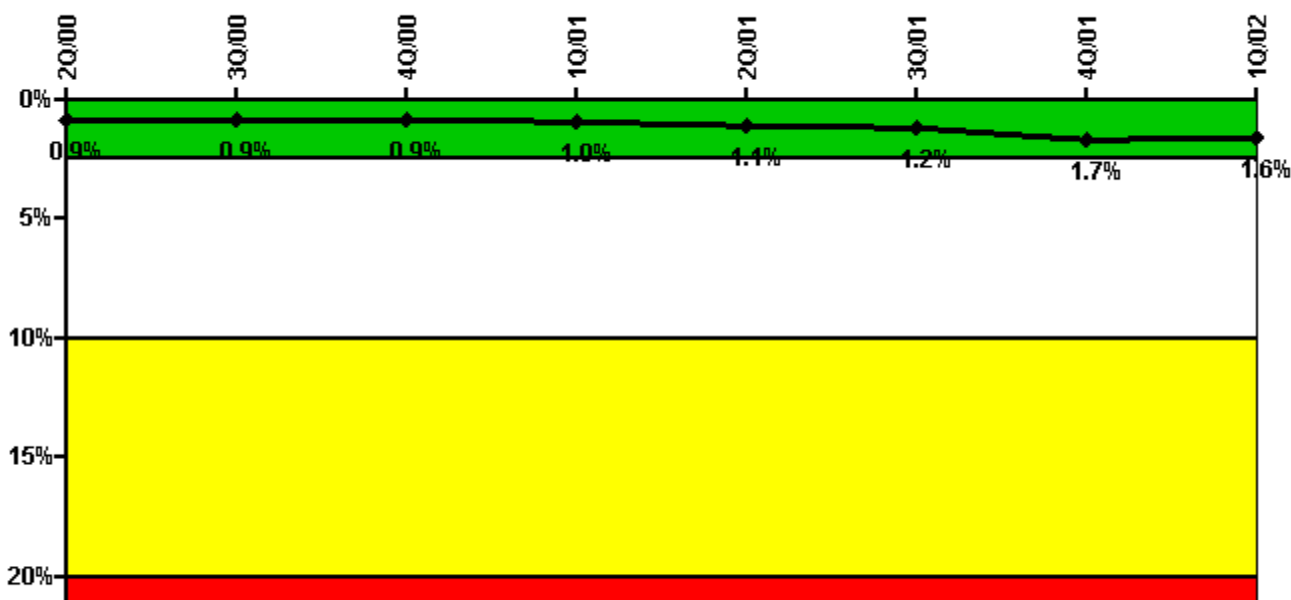


Thresholds: White > 2.5% Yellow > 10.0% Red > 20.0%

Notes

Safety System Unavailability, Emergency AC Power, >2EDG	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Train 1								
Planned unavailable hours	0.85	9.73	18.22	26.20	0.75	0.85	61.00	0.50
Unplanned unavailable hours	17.00	0	0.75	23.43	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	336.00	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00	2160.00
Train 2								
Planned unavailable hours	1.05	5.93	1.00	30.63	0.75	1.25	24.05	0.75
Unplanned unavailable hours	0	0	0	0	0	0	13.40	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00	2160.00
Train 3								
Planned unavailable hours	43.90	0.75	2.31	35.55	29.52	54.98	2.13	11.17
Unplanned unavailable hours	0	0	0	0	0	22.27	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00	2160.00
Indicator value	0.9%	0.9%	0.9%	1.0%	1.1%	1.2%	1.7%	1.6%

Licensee Comments: none

Safety System Unavailability, High Pressure Injection System (HPCS)

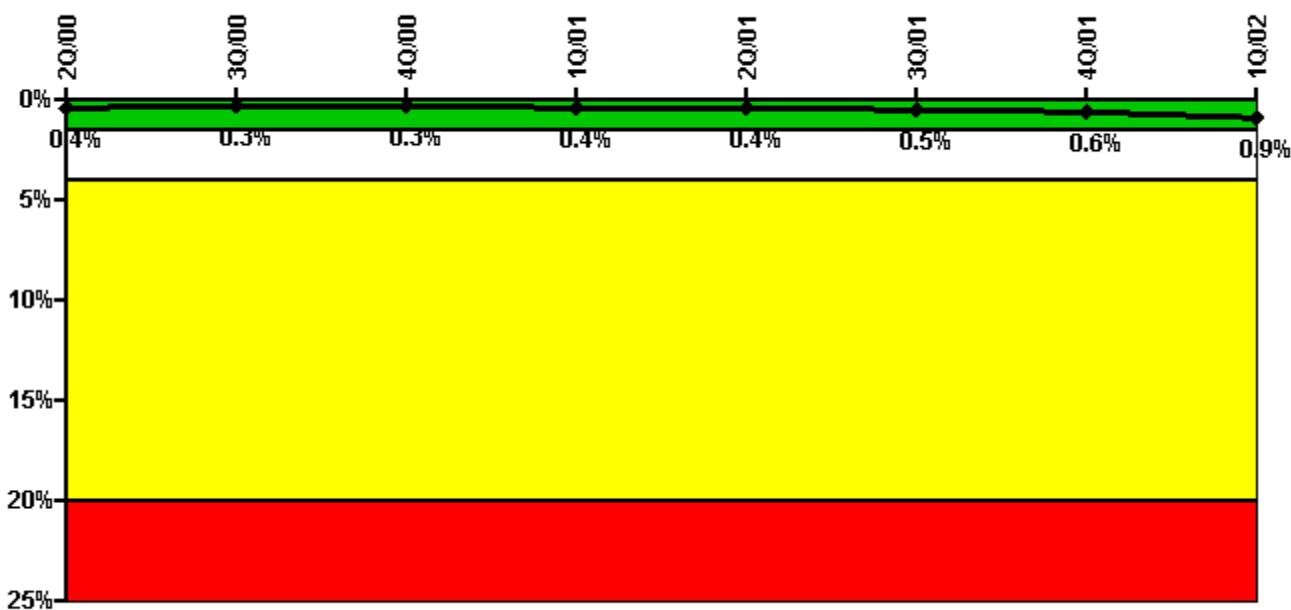


Thresholds: White > 1.5% Yellow > 4.0% Red > 20.0%

Notes

Safety System Unavailability, High Pressure Injection System (HPCS)	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Train 1								
Planned unavailable hours	4.60	2.70	2.70	19.40	23.60	24.50	28.33	78.75
Unplanned unavailable hours	0	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2123.40	2183.00	2208.00	2209.00	1585.90
Indicator value	0.4%	0.3%	0.3%	0.4%	0.4%	0.5%	0.6%	0.9%

Licensee Comments: none

Safety System Unavailability, Heat Removal System (RCIC)

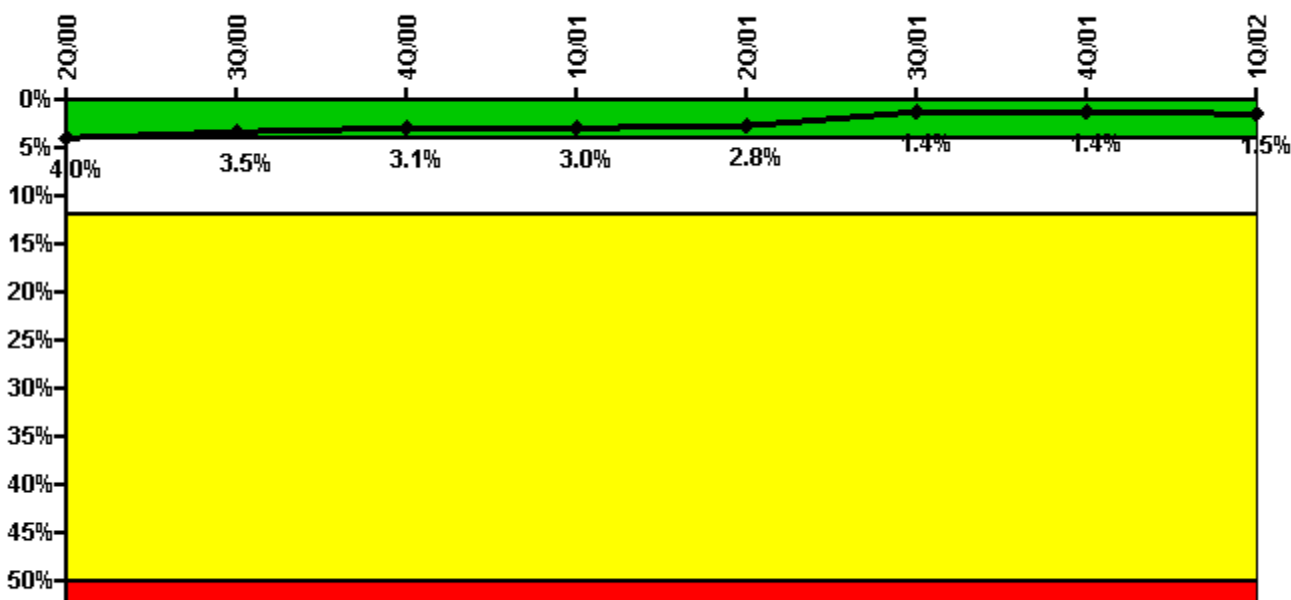

Thresholds: White > 4.0% Yellow > 12.0% Red > 50.0%


Notes

Safety System Unavailability, Heat Removal System (RCIC)	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Train 1								
Planned unavailable hours	92.30	6.50	1.80	32.30	11.60	1.90	59.30	23.90
Unplanned unavailable hours	20.40	0	0	0	0	0	0	0
Fault exposure hours	5.40	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2123.40	2183.00	2208.00	2209.00	1585.90
Indicator value	4.0%	3.5%	3.1%	3.0%	2.8%	1.4%	1.4%	1.5%

Licensee Comments:

2Q/01: Procedure LIS-RI-115 was previously performed during outages. The procedure was performed on-line for the first time and subsequently reviewed for its effect on RCIC operability. It was determined that performance of the procedure caused RCIC to be unavailable for 8.5 hours.

Safety System Unavailability, Residual Heat Removal System

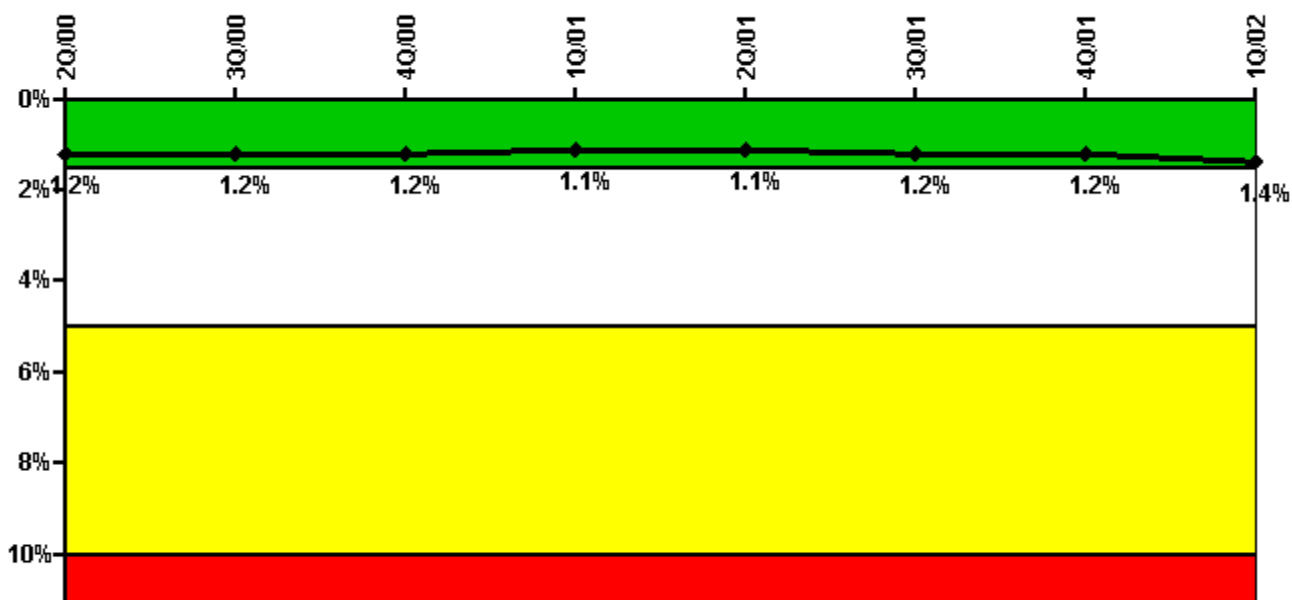


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Residual Heat Removal System	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Train 1								
Planned unavailable hours	39.40	2.60	0	41.40	0	0	8.50	0
Unplanned unavailable hours	0	0	0	30.70	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00	2160.00
Train 2								
Planned unavailable hours	9.10	0.70	0	20.80	0	24.30	9.90	98.50
Unplanned unavailable hours	0	4.60	0	0	0	5.90	12.80	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00	2160.00
Indicator value	1.2%	1.2%	1.2%	1.1%	1.1%	1.2%	1.2%	1.4%

Licensee Comments: none

Safety System Functional Failures (BWR)

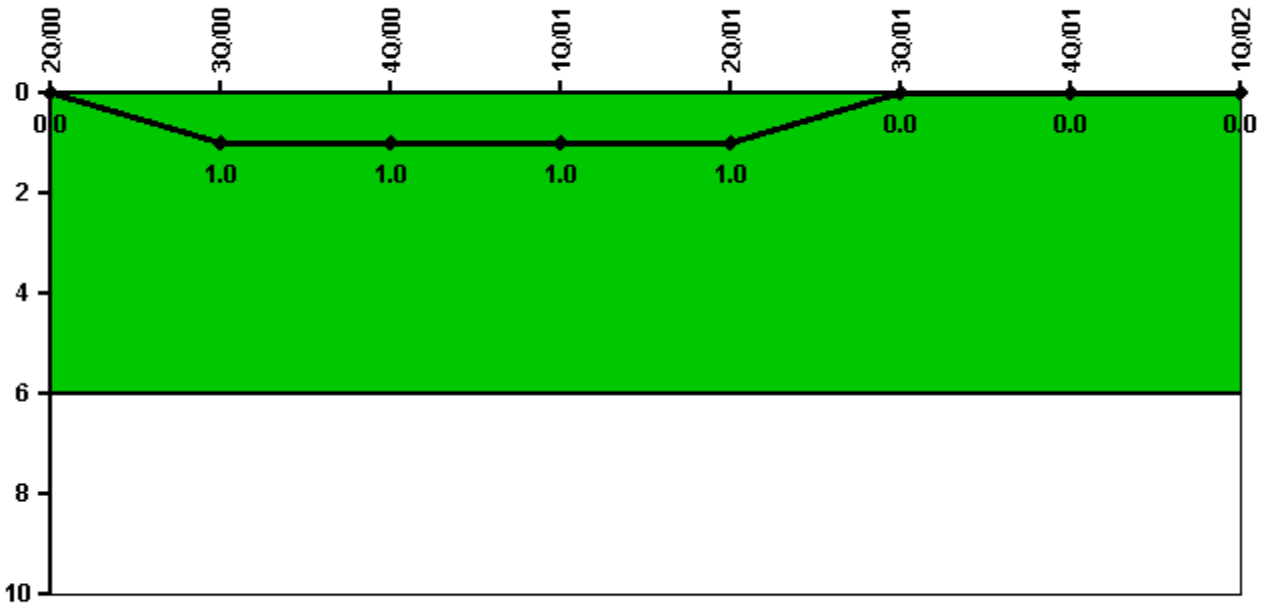


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Safety System Functional Failures	0	1	0	0	0	0	0	0
Indicator value	0	1	1	1	1	0	0	0

Licensee Comments: none

Reactor Coolant System Activity

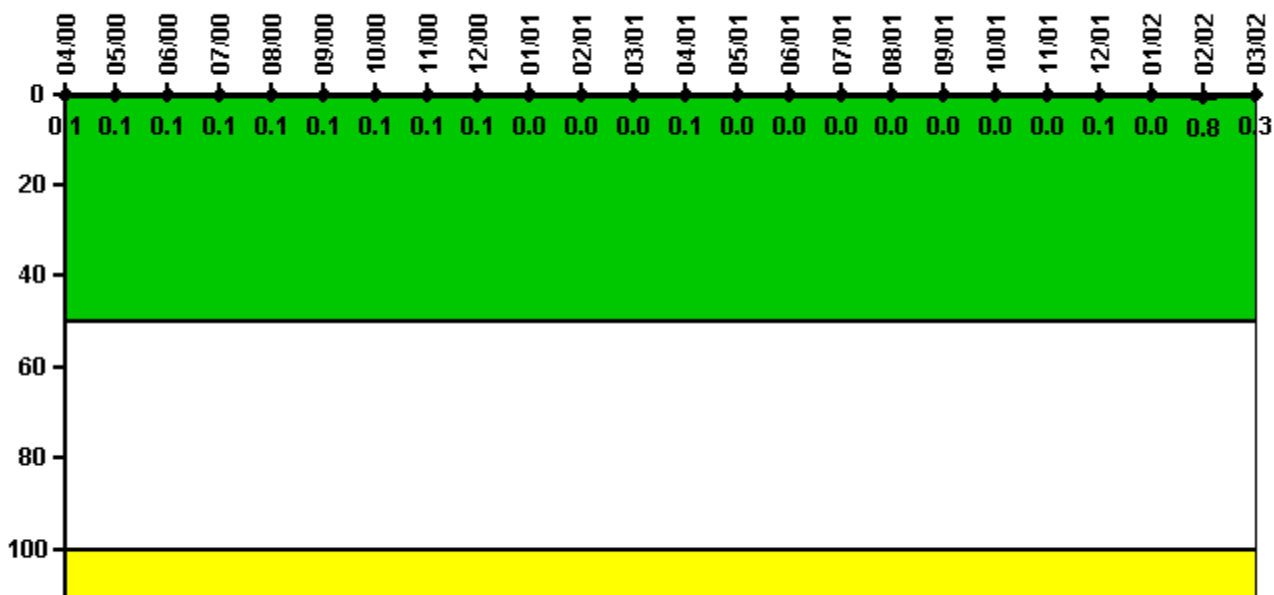

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	4/00	5/00	6/00	7/00	8/00	9/00	10/00	11/00	12/00	1/01	2/01	3/01
Maximum activity	0.000250	0.000150	0.000200	0.000120	0.000120	0.000130	0.000100	0.000100	0.000100	0.000087	0.000086	0.000095
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0	0	0

Reactor Coolant System Activity	4/01	5/01	6/01	7/01	8/01	9/01	10/01	11/01	12/01	1/02	2/02	3/02
Maximum activity	0.000110	0.000096	0.000096	0.000069	0.000075	0.000076	0.000089	0.000087	0.000110	0.000093	0.001690	0.000678
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.1	0	0	0	0	0	0	0	0.1	0	0.8	0.3

Licensee Comments: none

Reactor Coolant System Leakage

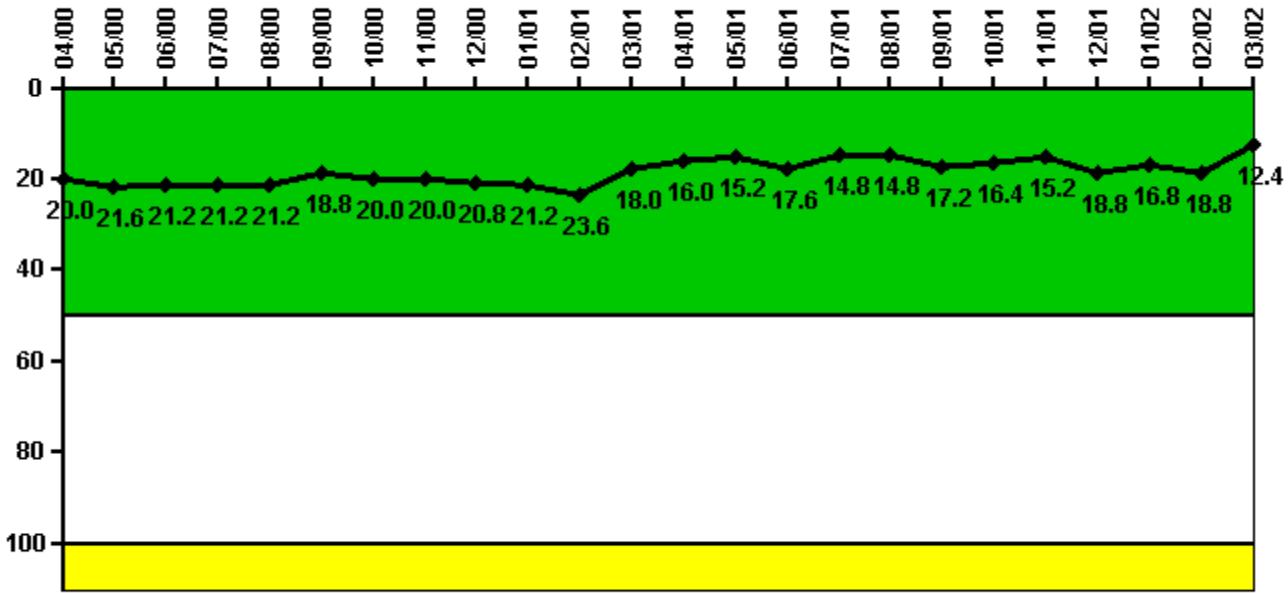

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	4/00	5/00	6/00	7/00	8/00	9/00	10/00	11/00	12/00	1/01	2/01	3/01
Maximum leakage	5.000	5.400	5.300	5.300	5.300	4.700	5.000	5.000	5.200	5.300	5.900	4.500
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	20.0	21.6	21.2	21.2	21.2	18.8	20.0	20.0	20.8	21.2	23.6	18.0

Reactor Coolant System Leakage	4/01	5/01	6/01	7/01	8/01	9/01	10/01	11/01	12/01	1/02	2/02	3/02
Maximum leakage	4.000	3.800	4.400	3.700	3.700	4.300	4.100	3.800	4.700	4.200	4.700	3.100
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	16.0	15.2	17.6	14.8	14.8	17.2	16.4	15.2	18.8	16.8	18.8	12.4

Licensee Comments: none

Drill/Exercise Performance

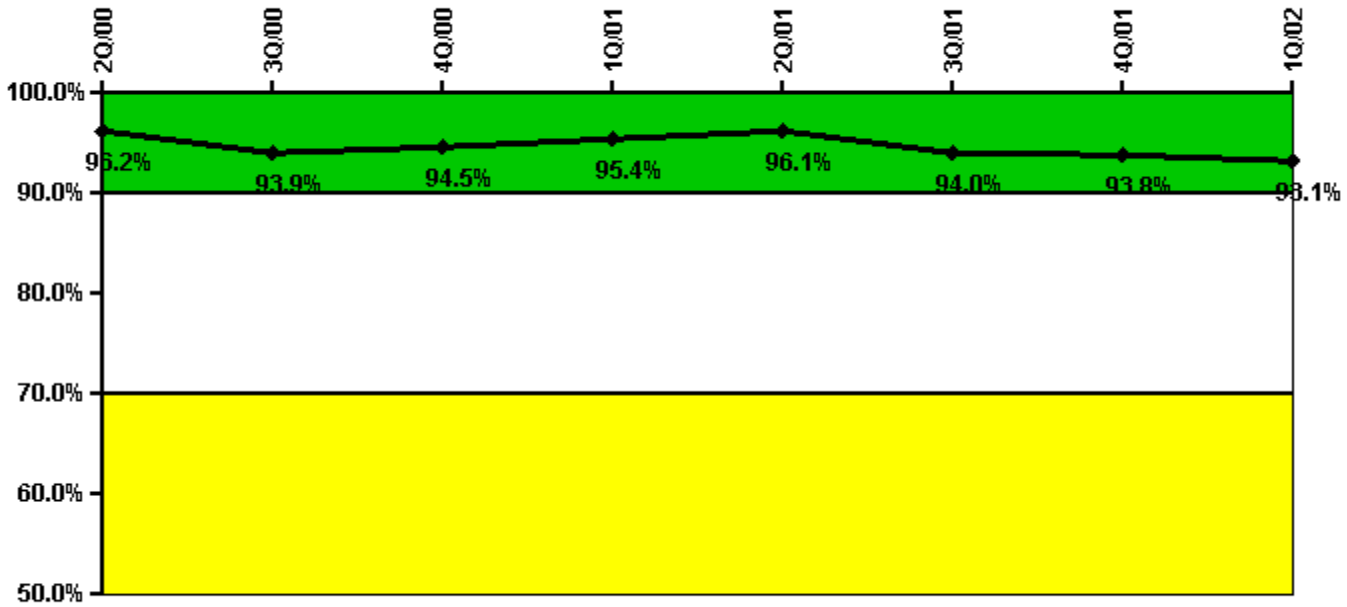


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Successful opportunities	19.0	42.0	14.0	20.0	11.0	30.0	9.0	18.0
Total opportunities	20.0	46.0	14.0	20.0	11.0	34.0	10.0	20.0
Indicator value	96.2%	93.9%	94.5%	95.4%	96.1%	94.0%	93.8%	93.1%

Licensee Comments: none

ERO Drill Participation

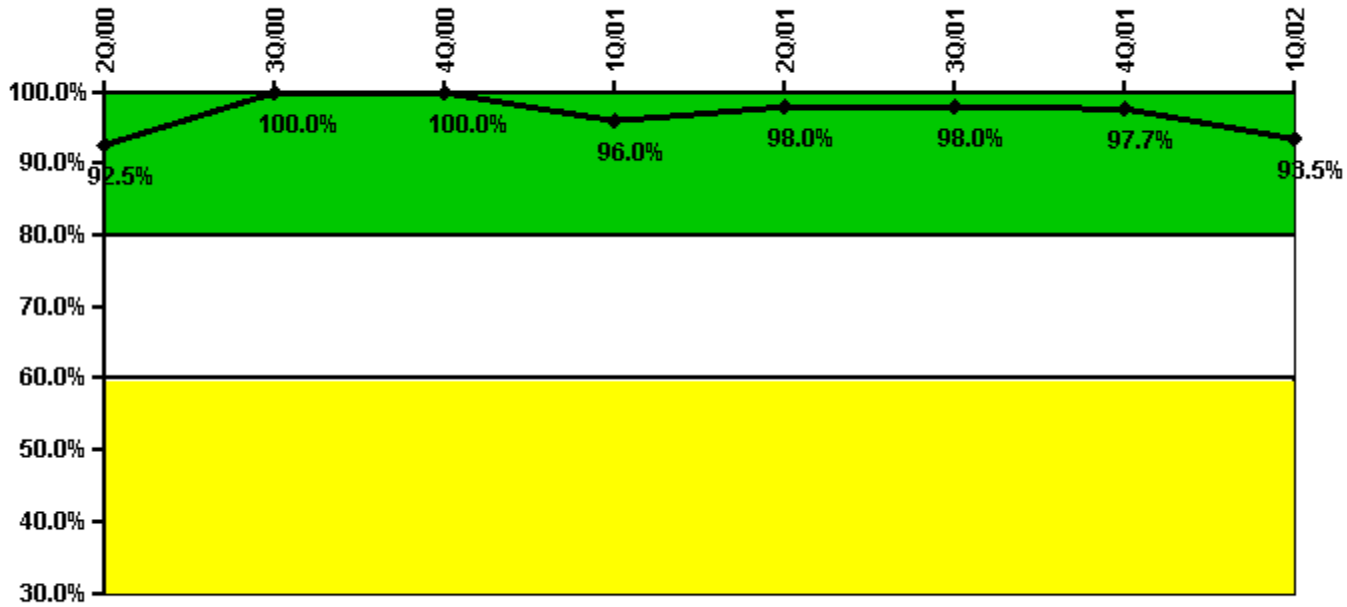


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Participating Key personnel	49.0	56.0	51.0	48.0	48.0	49.0	43.0	43.0
Total Key personnel	53.0	56.0	51.0	50.0	49.0	50.0	44.0	46.0
Indicator value	92.5%	100.0%	100.0%	96.0%	98.0%	98.0%	97.7%	93.5%

Licensee Comments: none

Alert & Notification System

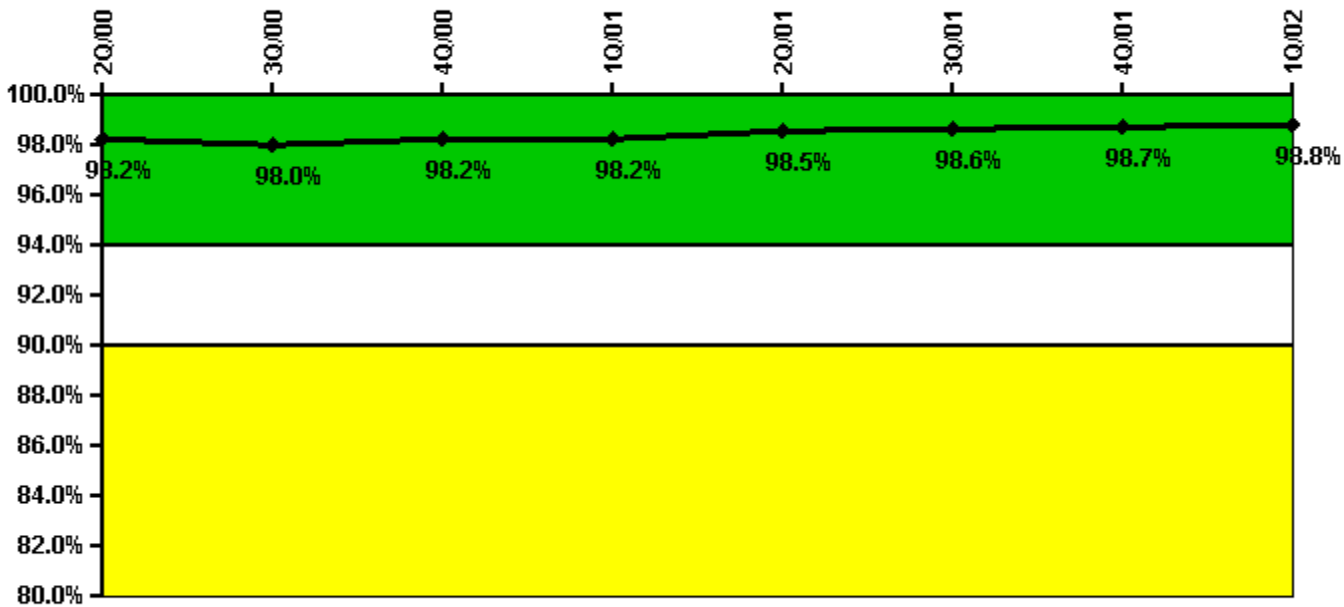

Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Successful siren-tests	2129	2093	2117	2240	2254	2202	2160	2120
Total sirens-tests	2176	2142	2142	2278	2278	2244	2176	2142
Indicator value	98.2%	98.0%	98.2%	98.2%	98.5%	98.6%	98.7%	98.8%

Licensee Comments:


4Q/01: A revision has been made to previously submitted data for the Alert and Notification System (ANS) Reliability indicator that was collected under the Exelon Mid-West Regional Operating Group standard testing program. It was determined there was one day each month where both a full test and a silent test of ANS sirens was performed; however, only one of these tests had been reported. Ten months of data in 2001 were affected and have been revised (1-01, 2-01, 3-01, 4-01, 5-01, 6-01, 7-01, 8-01, 9-01, and 11-01). The change to the data does not affect the color of the indicator.

3Q/01: A revision has been made to previously submitted data for the Alert and Notification System (ANS) Reliability indicator that was collected under the Exelon Mid-West Regional Operating Group standard testing program. It was determined there was one day each month where both a full test and a silent test of ANS sirens was performed; however, only one of these tests had been reported. Ten months of data in 2001 were affected and have been revised (1-01, 2-01, 3-01, 4-01, 5-01, 6-01, 7-01, 8-01, 9-01, and 11-01). The change to the data does not affect the color of the indicator.

2Q/01: A revision has been made to previously submitted data for the Alert and Notification System (ANS) Reliability indicator that was collected under the Exelon Mid-West Regional Operating Group standard testing program. It was determined there was one day each month where both a full test and a silent test of ANS sirens was performed; however, only one of these tests had been reported. Ten months of data in 2001 were affected and have been revised (1-01, 2-01, 3-01, 4-01, 5-01, 6-01, 7-01, 8-01, 9-01, and 11-01). The change to the data does not affect the color of the indicator.

1Q/01: A revision has been made to previously submitted data for the Alert and Notification System (ANS) Reliability indicator that was collected under the Exelon Mid-West Regional Operating Group standard testing program. It was determined there was one day each month where both a full test and a silent test of ANS sirens was performed; however, only one of these tests had been reported. Ten months of data in 2001 were affected and have been revised (1-01, 2-01, 3-01, 4-01, 5-01, 6-01, 7-01, 8-01, 9-01, and 11-01). The change to the data does not affect the color of the indicator.

Occupational Exposure Control Effectiveness

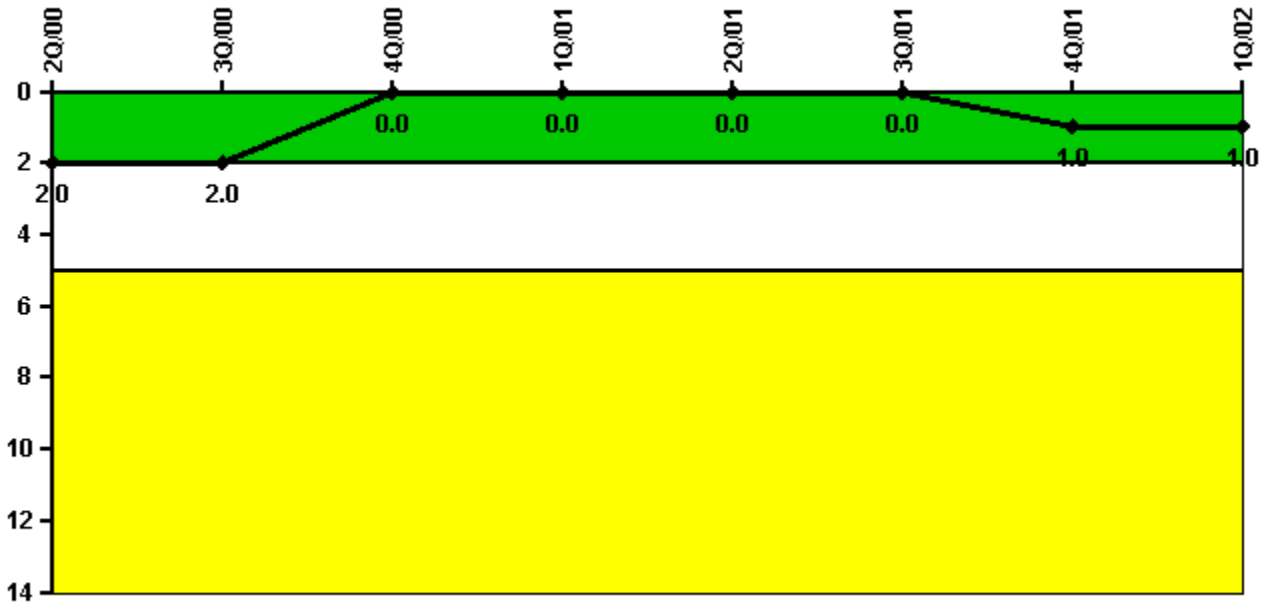

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
High radiation area occurrences	0	0	0	0	0	0	1	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	2	2	0	0	0	0	1	1

Licensee Comments: none

RETS/ODCM Radiological Effluent




Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Protected Area Security Performance Index

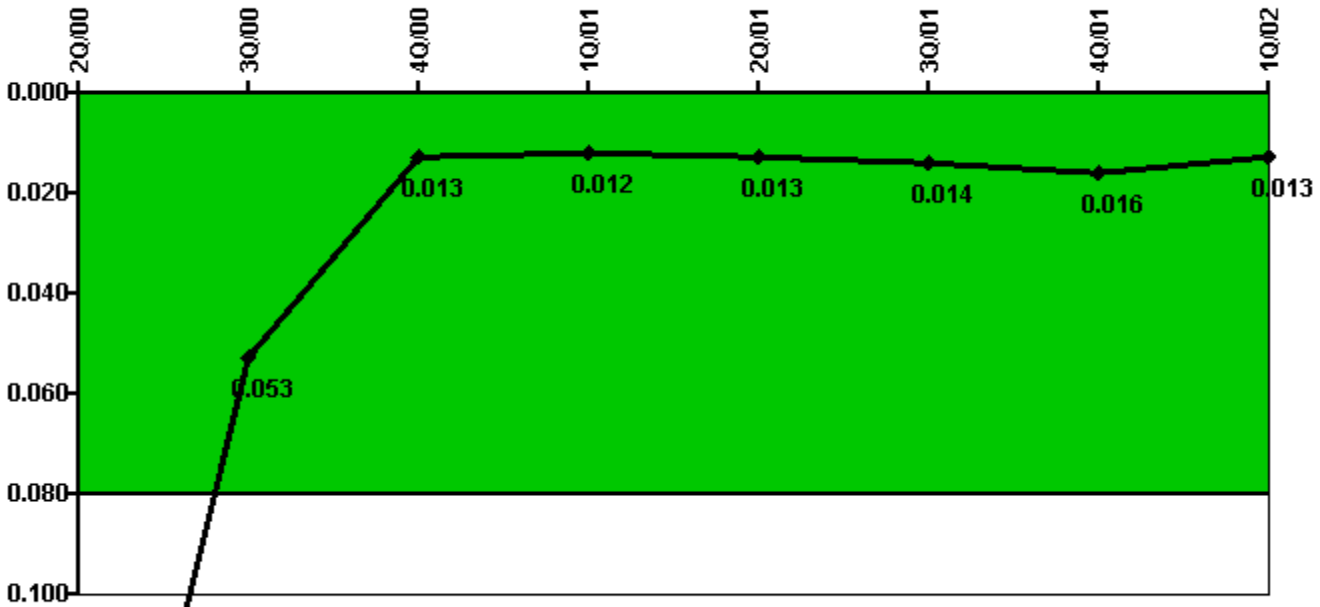

Thresholds: White > 0.080

Notes

Protected Area Security Performance Index	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
IDS compensatory hours	12.60	30.50	31.30	75.10	51.60	95.90	68.40	10.80
CCTV compensatory hours	32.0	30.7	20.0	0	17.6	0.4	24.6	0
IDS normalization factor	1.20	1.20	1.20	1.20	1.20	1.20	1.20	1.20
CCTV normalization factor	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Index Value	0.190	0.053	0.013	0.012	0.013	0.014	0.016	0.013

Licensee Comments: none

Personnel Screening Program



Thresholds: White > 2.0 Yellow > 5.0

Notes

Personnel Screening Program	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Program failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

FFD/Personnel Reliability



Thresholds: White > 2.0 Yellow > 5.0

Notes

FFD/Personnel Reliability	2Q/00	3Q/00	4Q/00	1Q/01	2Q/01	3Q/01	4Q/01	1Q/02
Program Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

▲ [PI Summary](#) | [Inspection Findings Summary](#) | [Reactor Oversight Process](#)

Last Modified: May 1, 2002