


# North Anna 1

## 1Q/2002 Performance Indicators

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

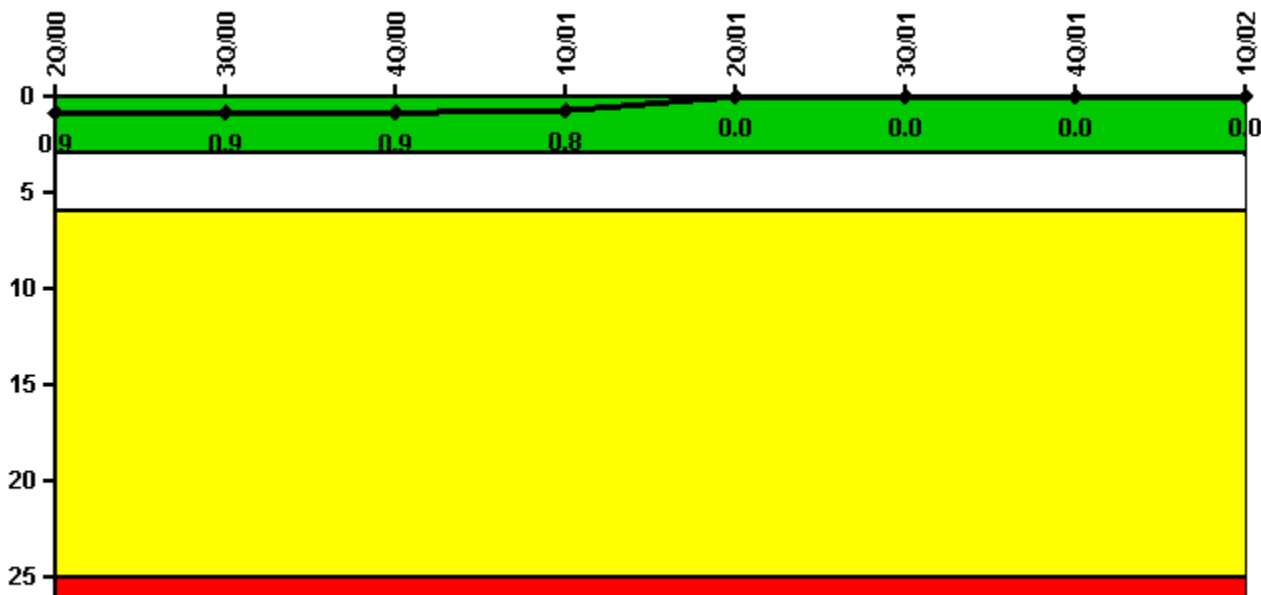


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

| Unplanned Scrams per 7000 Critical Hrs | 2Q/00  | 3Q/00  | 4Q/00  | 1Q/01  | 2Q/01  | 3Q/01  | 4Q/01  | 1Q/02  |
|--|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned scrams                       | 1.0    | 0      | 0      | 0      | 0      | 0      | 0      | 0      |
| Critical hours                         | 1959.7 | 2208.0 | 2209.0 | 2160.0 | 2183.0 | 1681.6 | 2003.8 | 2160.0 |
| Indicator value                        | 0.9    | 0.9    | 0.9    | 0.8    | 0      | 0      | 0      | 0      |

Licensee Comments: none

### Scrams with Loss of Normal Heat Removal

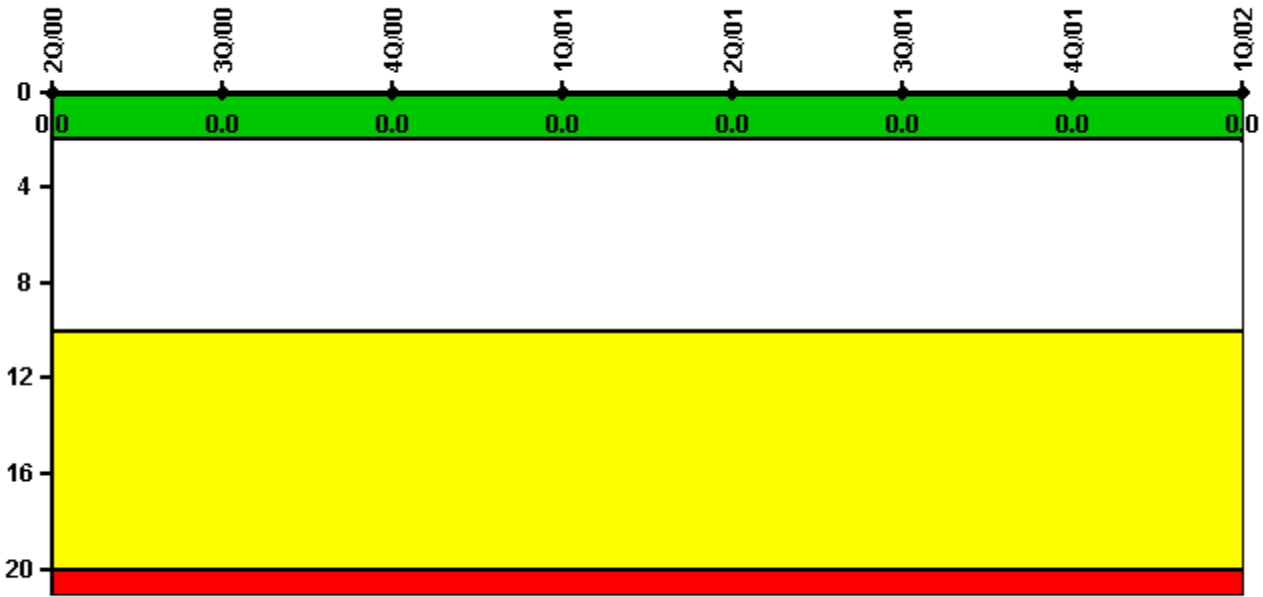


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

#### Notes

| Scrams with Loss of Normal Heat Removal | 2Q/00 | 3Q/00 | 4Q/00 | 1Q/01 | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 |
|---|-------|-------|-------|-------|-------|-------|-------|-------|
| Scrams                                  | 0     | 0     | 0     | 0     | 0     | 0     | 0     | 0     |
|   |       |       |       |       |       |       |       |       |
| Indicator value                         | 0     | 0     | 0     | 0     | 0     | 0     | 0     | 0     |

Licensee Comments: none

### Unplanned Power Changes per 7000 Critical Hrs

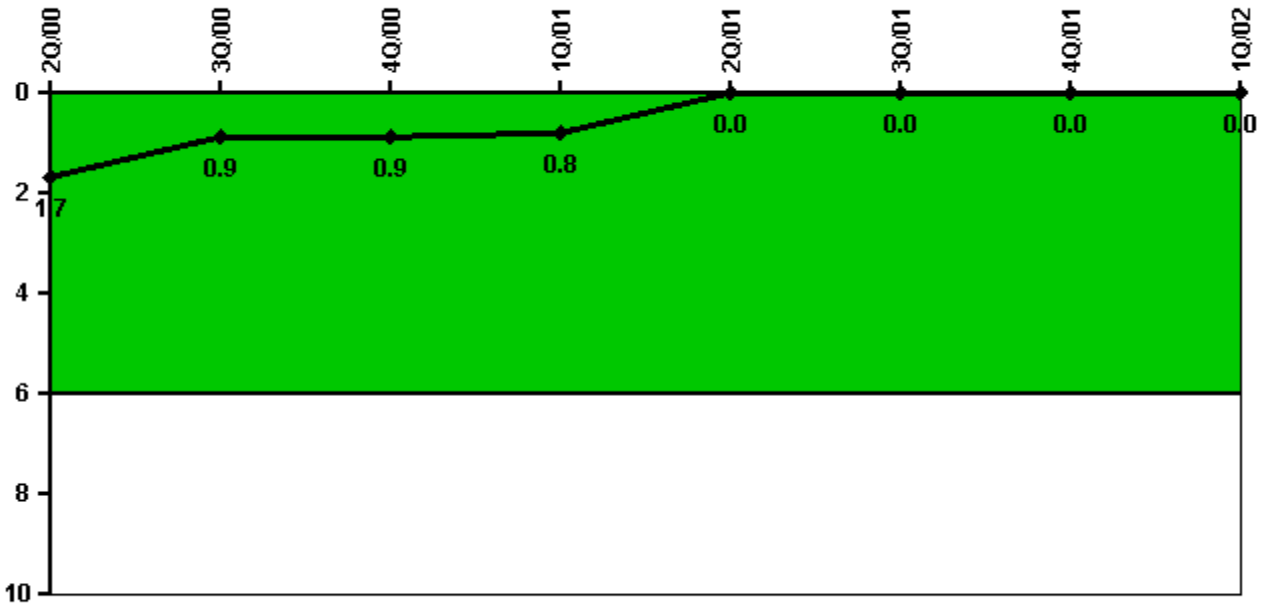


Thresholds: White > 6.0

#### Notes

| Unplanned Power Changes per 7000 Critical Hrs | 2Q/00  | 3Q/00  | 4Q/00  | 1Q/01  | 2Q/01  | 3Q/01  | 4Q/01  | 1Q/02  |
|---|--------|--------|--------|--------|--------|--------|--------|--------|
| Unplanned power changes                       | 1.0    | 0      | 0      | 0      | 0      | 0      | 0      | 0      |
| Critical hours                                | 1959.7 | 2208.0 | 2209.0 | 2160.0 | 2183.0 | 1681.6 | 2003.8 | 2160.0 |
|   |        |        |        |        |        |        |        |        |
| Indicator value                               | 1.7    | 0.9    | 0.9    | 0.8    | 0      | 0      | 0      | 0      |

Licensee Comments: none

### Safety System Unavailability, Emergency AC Power

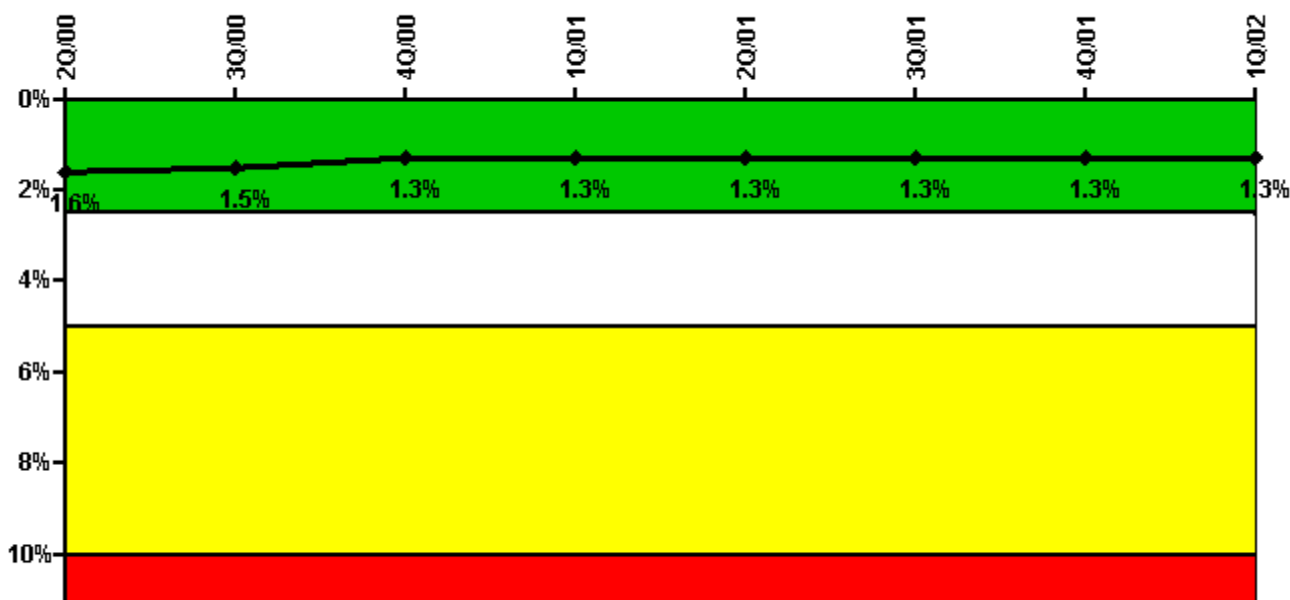


Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%

#### Notes

| Safety System Unavailability, Emergency AC Power | 2Q/00   | 3Q/00   | 4Q/00   | 1Q/01   | 2Q/01   | 3Q/01   | 4Q/01   | 1Q/02   |
|--|---------|---------|---------|---------|---------|---------|---------|---------|
| <b>Train 1</b>                                   |         |         |         |         |         |         |         |         |
| Planned unavailable hours                        | 7.73    | 23.33   | 45.15   | 8.10    | 60.71   | 12.97   | 7.19    | 5.81    |
| Unplanned unavailable hours                      | 0.30    | 0       | 0       | 0       | 5.33    | 0       | 0       | 4.13    |
| Fault exposure hours                             | 3.92    | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Effective Reset hours                            | 0       | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Required hours                                   | 2054.74 | 2208.00 | 2209.00 | 2160.00 | 2183.00 | 1952.00 | 2119.13 | 2160.00 |
| <b>Train 2</b>                                   |         |         |         |         |         |         |         |         |
| Planned unavailable hours                        | 14.00   | 9.23    | 48.38   | 6.32    | 10.40   | 9.01    | 11.94   | 20.06   |
| Unplanned unavailable hours                      | 8.92    | 0       | 0       | 34.00   | 0       | 0       | 0       | 0       |
| Fault exposure hours                             | 0       | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Effective Reset hours                            | 0       | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Required hours                                   | 2179.08 | 2208.00 | 2209.00 | 2160.00 | 2183.00 | 1952.00 | 2119.13 | 2160.00 |
|  |         |         |         |         |         |         |         |         |
| Indicator value                                  | 1.6%    | 1.5%    | 1.3%    | 1.3%    | 1.3%    | 1.3%    | 1.3%    | 1.3%    |

Licensee Comments: none

### Safety System Unavailability, High Pressure Injection System (HPSI)

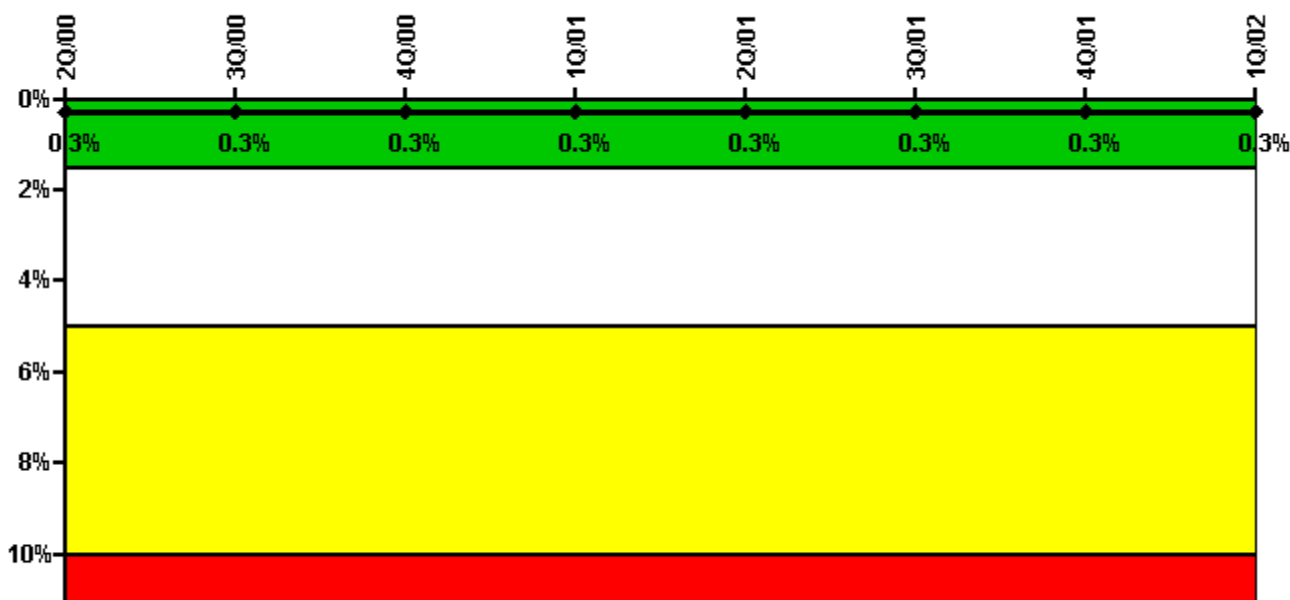


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

#### Notes

| Safety System Unavailability, High Pressure Injection System (HPSI) | 2Q/00   | 3Q/00   | 4Q/00   | 1Q/01   | 2Q/01   | 3Q/01   | 4Q/01   | 1Q/02   |
|---|---------|---------|---------|---------|---------|---------|---------|---------|
| <b>Train 1</b>  |         |         |         |         |         |         |         |         |
| Planned unavailable hours   | 6.52    | 6.37    | 4.08    | 0.93    | 0.79    | 3.53    | 0       | 3.27    |
| Unplanned unavailable hours   | 39.11   | 0.95    | 0       | 0       | 0       | 0       | 0       | 0       |
| Fault exposure hours  | 0       | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Effective Reset hours   | 0       | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Required hours  | 2101.73 | 2208.00 | 2209.00 | 2160.00 | 2183.00 | 1693.25 | 2027.23 | 2160.00 |
| <b>Train 2</b>  |         |         |         |         |         |         |         |         |
| Planned unavailable hours   | 7.07    | 2.73    | 3.80    | 0.12    | 3.22    | 1.30    | 0.37    | 0.75    |
| Unplanned unavailable hours   | 33.46   | 0.87    | 0       | 0       | 0       | 0       | 0       | 0       |
| Fault exposure hours  | 0       | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Effective Reset hours   | 0       | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Required hours  | 2132.08 | 2208.00 | 2209.00 | 2160.00 | 2183.00 | 1693.25 | 2027.23 | 2160.00 |
| Indicator value   | 0.3%    | 0.3%    | 0.3%    | 0.3%    | 0.3%    | 0.3%    | 0.3%    | 0.3%    |

Licensee Comments: none

### Safety System Unavailability, Heat Removal System (AFW)

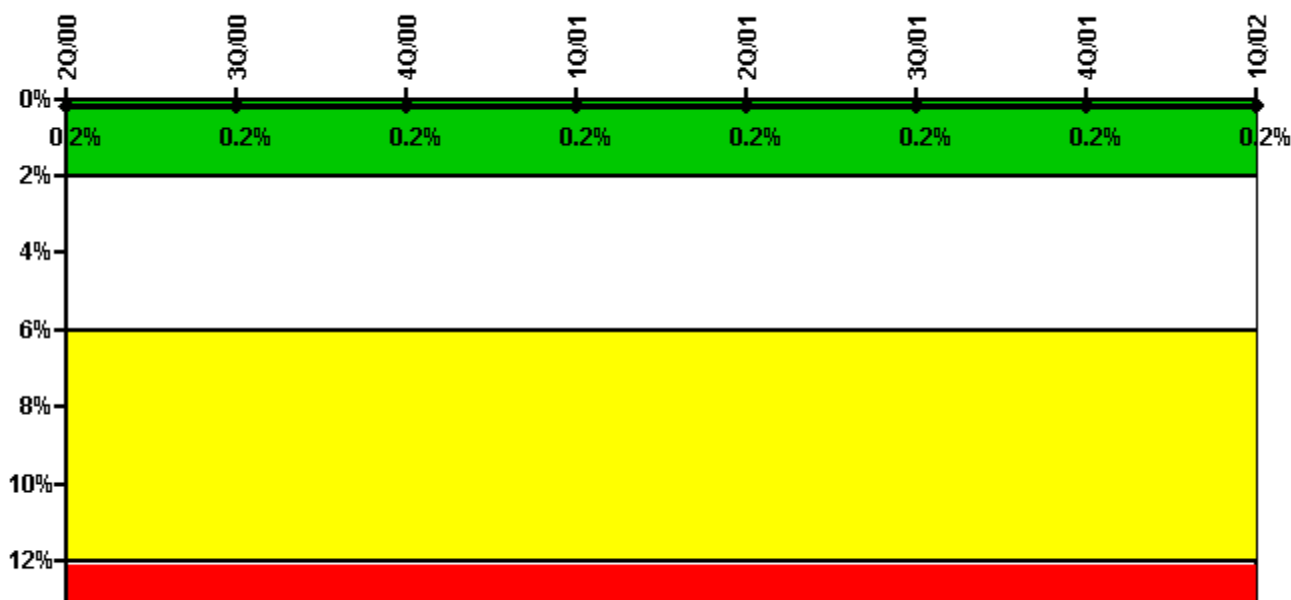


Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%

#### Notes

| Safety System Unavailability, Heat Removal System (AFW) | 2Q/00   | 3Q/00   | 4Q/00   | 1Q/01   | 2Q/01   | 3Q/01   | 4Q/01   | 1Q/02   |
|---|---------|---------|---------|---------|---------|---------|---------|---------|
| <b>Train 1</b>  |         |         |         |         |         |         |         |         |
| Planned unavailable hours                               | 1.17    | 1.10    | 1.87    | 14.02   | 2.28    | 1.12    | 1.25    | 6.95    |
| Unplanned unavailable hours                             | 0       | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Fault exposure hours                                    | 0       | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Effective Reset hours                                   | 0       | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Required hours  | 2046.23 | 2208.00 | 2209.00 | 2160.00 | 2183.00 | 1690.82 | 2023.73 | 2160.00 |
| <b>Train 2</b>  |         |         |         |         |         |         |         |         |
| Planned unavailable hours                               | 0       | 6.29    | 11.83   | 0.48    | 1.58    | 0       | 6.45    | 4.75    |
| Unplanned unavailable hours                             | 0       | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Fault exposure hours                                    | 0       | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Effective Reset hours                                   | 0       | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Required hours  | 2046.23 | 2208.00 | 2209.00 | 2160.00 | 2183.00 | 1690.82 | 2023.73 | 2160.00 |
| <b>Train 3</b>  |         |         |         |         |         |         |         |         |
| Planned unavailable hours                               | 7.98    | 13.92   | 5.00    | 3.97    | 4.18    | 2.93    | 20.41   | 4.43    |
| Unplanned unavailable hours                             | 0       | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Fault exposure hours                                    | 0       | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Effective Reset hours                                   | 0       | 0       | 0       | 0       | 0       | 0       | 0       | 0       |
| Required hours  | 2046.23 | 2208.00 | 2209.00 | 2160.00 | 2183.00 | 1690.82 | 2023.73 | 2160.00 |
| Indicator value   | 0.2%    | 0.2%    | 0.2%    | 0.2%    | 0.2%    | 0.2%    | 0.2%    | 0.2%    |

Licensee Comments: none

### Safety System Unavailability, Residual Heat Removal System

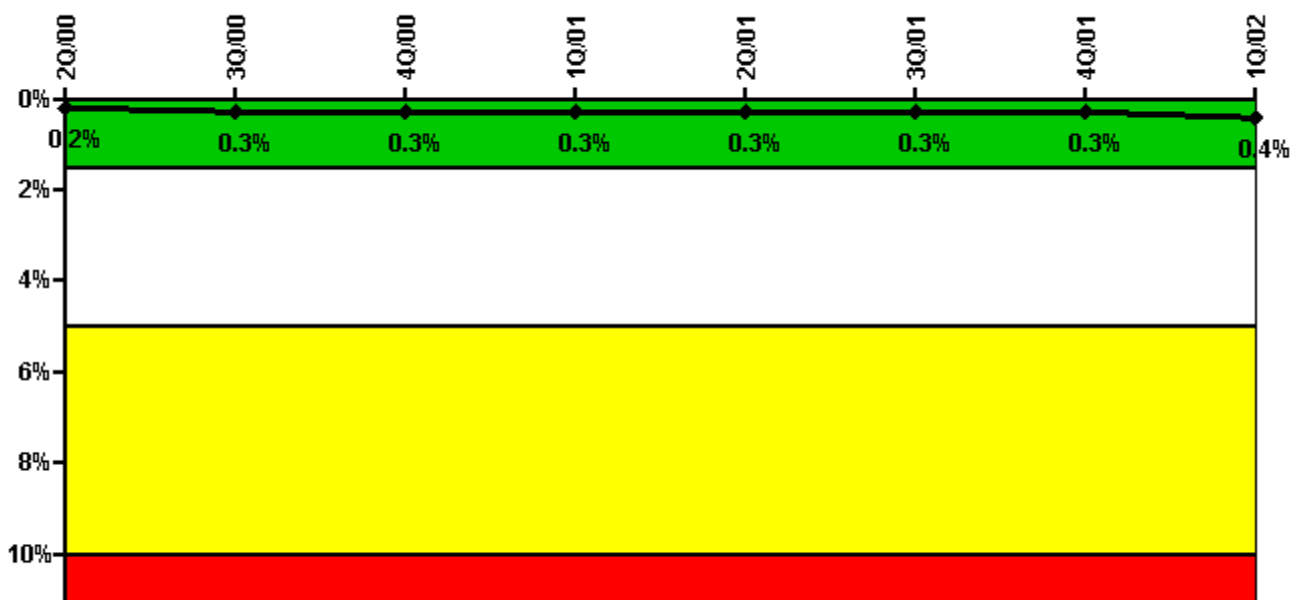


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

#### Notes

| Safety System Unavailability, Residual Heat Removal System | 2Q/00       | 3Q/00       | 4Q/00       | 1Q/01       | 2Q/01       | 3Q/01       | 4Q/01       | 1Q/02       |
|--|-------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------|
| <b>Train 1</b>   |             |             |             |             |             |             |             |             |
| Planned unavailable hours                                  | 8.03        | 37.79       | 5.68        | 4.72        | 14.69       | 15.00       | 12.50       | 21.96       |
| Unplanned unavailable hours                                | 28.95       | 2.55        | 0           | 0           | 1.40        | 0           | 0           | 0           |
| Fault exposure hours                                       | 0           | 0           | 0           | 0           | 0           | 0           | 0           | 0           |
| Effective Reset hours                                      | 0           | 0           | 0           | 0           | 0           | 0           | 0           | 0           |
| Required hours   | 2050.82     | 2208.00     | 2209.00     | 2160.00     | 2183.00     | 1695.67     | 2027.23     | 2160.00     |
| <b>Train 2</b>   |             |             |             |             |             |             |             |             |
| Planned unavailable hours                                  | 11.70       | 16.74       | 3.57        | 9.24        | 4.07        | 0.63        | 3.87        | 37.47       |
| Unplanned unavailable hours                                | 0           | 2.98        | 0           | 5.62        | 0           | 0           | 0           | 33.18       |
| Fault exposure hours                                       | 0           | 0           | 0           | 0           | 0           | 0           | 0           | 0           |
| Effective Reset hours                                      | 0           | 0           | 0           | 0           | 0           | 0           | 0           | 0           |
| Required hours   | 2050.82     | 2208.00     | 2209.00     | 2160.00     | 2183.00     | 1695.67     | 2027.23     | 2160.00     |
| <b>Train 3</b>   |             |             |             |             |             |             |             |             |
| Planned unavailable hours                                  | 0           | 0           | 0           | 0           | 8.50        | 1.67        | 0           | 0           |
| Unplanned unavailable hours                                | 12.62       | 0           | 0           | 0           | 0           | 0           | 0           | 0           |
| Fault exposure hours                                       | 0           | 0           | 0           | 0           | 0           | 0           | 0           | 0           |
| Effective Reset hours                                      | 0           | 0           | 0           | 0           | 0           | 0           | 0           | 0           |
| Required hours   | 2183.00     | 2208.00     | 2209.00     | 2160.00     | 2183.00     | 2022.20     | 2209.00     | 2160.00     |
| <b>Train 4</b>   |             |             |             |             |             |             |             |             |
| Planned unavailable hours                                  | 0           | 0           | 0           | 0           | 14.08       | 1.58        | 0           | 0           |
| Unplanned unavailable hours                                | 0           | 0           | 0           | 0           | 0           | 0           | 0           | 0           |
| Fault exposure hours                                       | 0           | 0           | 0           | 0           | 0           | 0           | 0           | 0           |
| Effective Reset hours                                      | 0           | 0           | 0           | 0           | 0           | 0           | 0           | 0           |
| Required hours   | 2183.00     | 2208.00     | 2209.00     | 2160.00     | 2183.00     | 2022.20     | 2209.00     | 2160.00     |
|  |             |             |             |             |             |             |             |             |
| <b>Indicator value</b>                                     | <b>0.2%</b> | <b>0.3%</b> | <b>0.3%</b> | <b>0.3%</b> | <b>0.3%</b> | <b>0.3%</b> | <b>0.3%</b> | <b>0.4%</b> |

Licensee Comments: none

### Safety System Functional Failures (PWR)

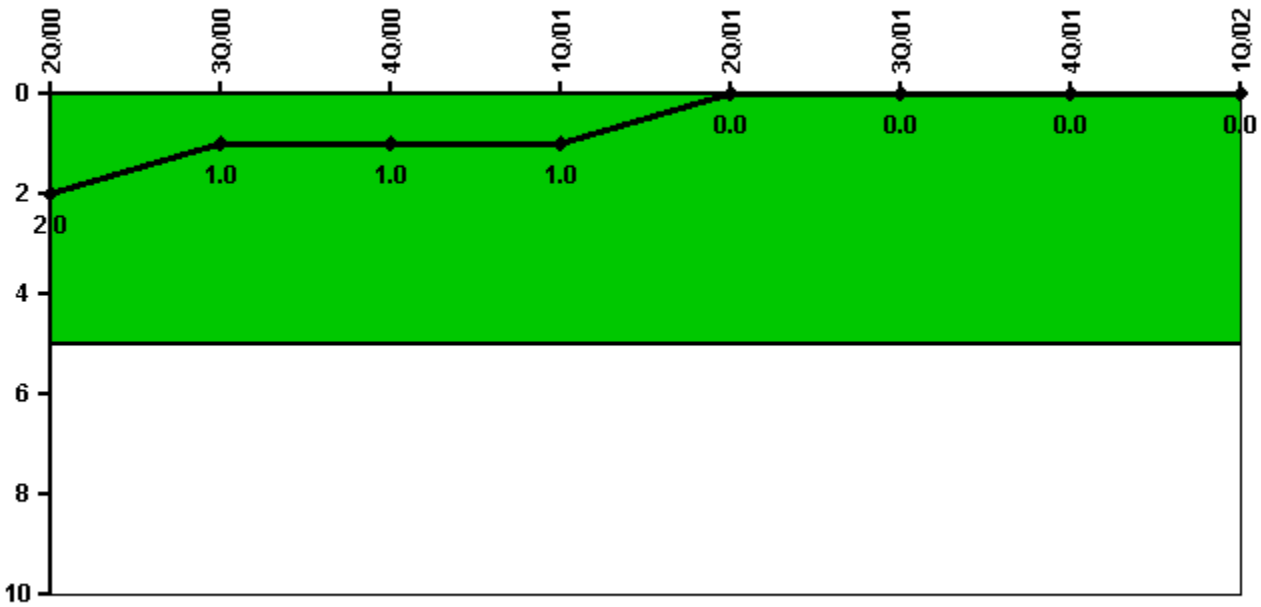

Thresholds: White > 5.0


#### Notes

| Safety System Functional Failures (PWR) | 2Q/00 | 3Q/00 | 4Q/00 | 1Q/01 | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 |
|---|-------|-------|-------|-------|-------|-------|-------|-------|
| Safety System Functional Failures       | 1     | 0     | 0     | 0     | 0     | 0     | 0     | 0     |
|   |       |       |       |       |       |       |       |       |
| Indicator value                         | 2     | 1     | 1     | 1     | 0     | 0     | 0     | 0     |

Licensee Comments: none



### Reactor Coolant System Activity

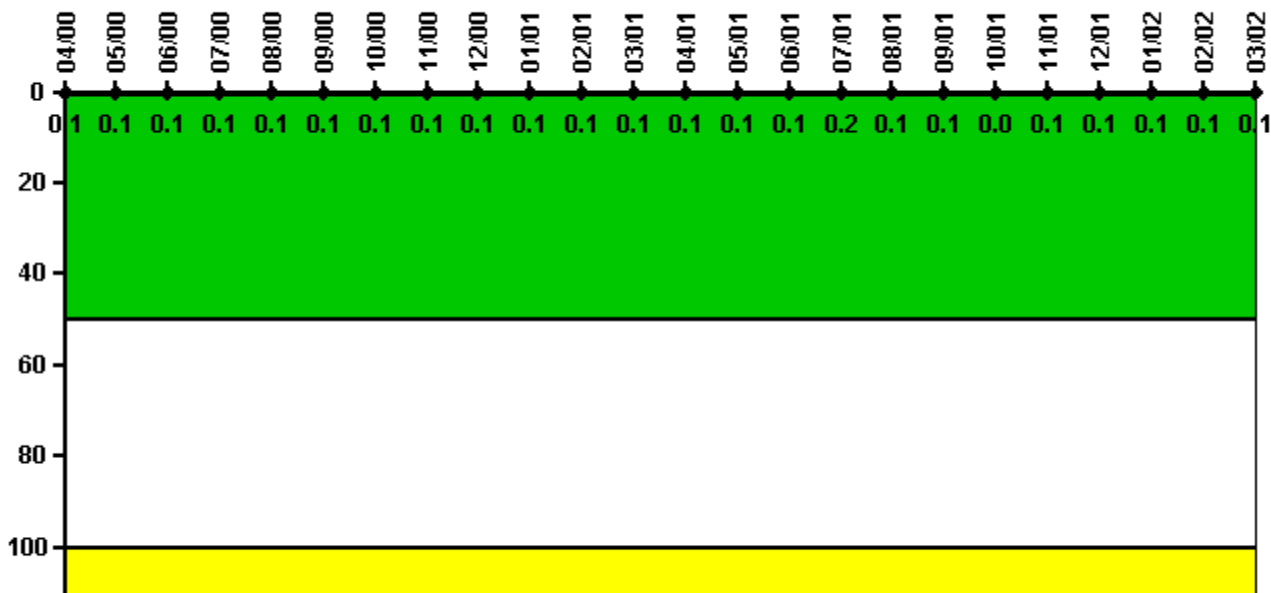

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


| Reactor Coolant System Activity | 4/00     | 5/00     | 6/00     | 7/00     | 8/00     | 9/00     | 10/00    | 11/00    | 12/00    | 1/01     | 2/01     | 3/01     |
|---------------------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| Maximum activity                | 0.000579 | 0.000632 | 0.000832 | 0.000709 | 0.000717 | 0.000830 | 0.000777 | 0.001460 | 0.000833 | 0.000854 | 0.000880 | 0.000999 |
| Technical specification limit   | 1.0      | 1.0      | 1.0      | 1.0      | 1.0      | 1.0      | 1.0      | 1.0      | 1.0      | 1.0      | 1.0      | 1.0      |
| Indicator value                 | 0.1      | 0.1      | 0.1      | 0.1      | 0.1      | 0.1      | 0.1      | 0.1      | 0.1      | 0.1      | 0.1      | 0.1      |

| Reactor Coolant System Activity | 4/01     | 5/01     | 6/01     | 7/01     | 8/01     | 9/01     | 10/01    | 11/01    | 12/01    | 1/02     | 2/02     | 3/02     |
|---------------------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| Maximum activity                | 0.001170 | 0.001150 | 0.001410 | 0.001580 | 0.001250 | 0.001380 | 0.000480 | 0.000526 | 0.000507 | 0.000582 | 0.000582 | 0.000584 |
| Technical specification limit   | 1.0      | 1.0      | 1.0      | 1.0      | 1.0      | 1.0      | 1.0      | 1.0      | 1.0      | 1.0      | 1.0      | 1.0      |
| Indicator value                 | 0.1      | 0.1      | 0.1      | 0.2      | 0.1      | 0.1      | 0        | 0.1      | 0.1      | 0.1      | 0.1      | 0.1      |

Licensee Comments: none

### Reactor Coolant System Leakage

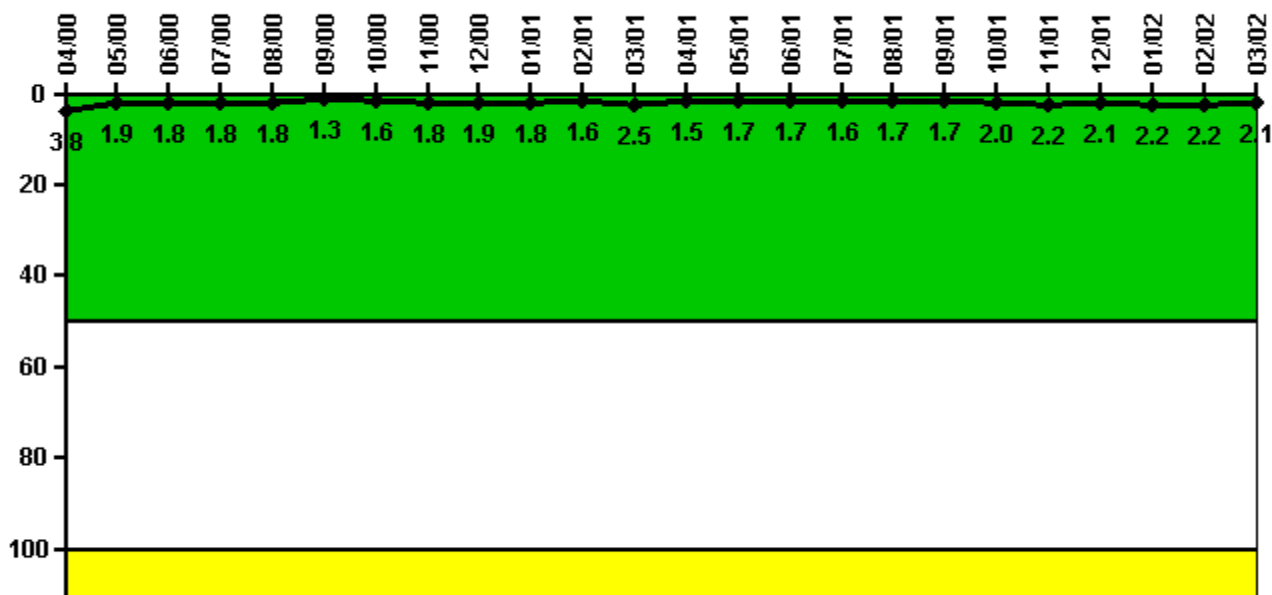

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


| Reactor Coolant System Leakage | 4/00  | 5/00  | 6/00  | 7/00  | 8/00  | 9/00  | 10/00 | 11/00 | 12/00 | 1/01  | 2/01  | 3/01  |
|--------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Maximum leakage                | 0.384 | 0.187 | 0.176 | 0.175 | 0.183 | 0.132 | 0.160 | 0.182 | 0.189 | 0.179 | 0.159 | 0.246 |
| Technical specification limit  | 10.0  | 10.0  | 10.0  | 10.0  | 10.0  | 10.0  | 10.0  | 10.0  | 10.0  | 10.0  | 10.0  | 10.0  |
| Indicator value                | 3.8   | 1.9   | 1.8   | 1.8   | 1.8   | 1.3   | 1.6   | 1.8   | 1.9   | 1.8   | 1.6   | 2.5   |

| Reactor Coolant System Leakage | 4/01  | 5/01  | 6/01  | 7/01  | 8/01  | 9/01  | 10/01 | 11/01 | 12/01 | 1/02  | 2/02  | 3/02  |
|--------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Maximum leakage                | 0.145 | 0.169 | 0.165 | 0.163 | 0.169 | 0.171 | 0.205 | 0.220 | 0.211 | 0.222 | 0.222 | 0.213 |
| Technical specification limit  | 10.0  | 10.0  | 10.0  | 10.0  | 10.0  | 10.0  | 10.0  | 10.0  | 10.0  | 10.0  | 10.0  | 10.0  |
| Indicator value                | 1.5   | 1.7   | 1.7   | 1.6   | 1.7   | 1.7   | 2.0   | 2.2   | 2.1   | 2.2   | 2.2   | 2.1   |

Licensee Comments: none

### Drill/Exercise Performance

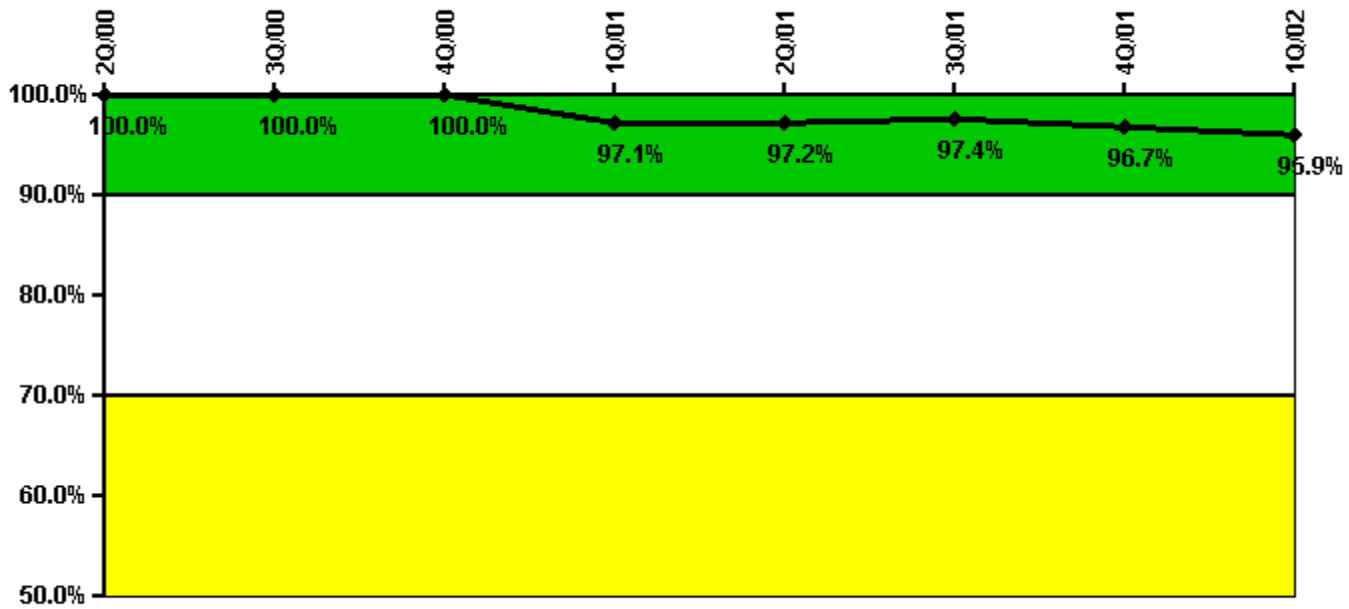


Thresholds: White < 90.0% Yellow < 70.0%

#### Notes

| Drill/Exercise Performance | 2Q/00  | 3Q/00  | 4Q/00  | 1Q/01 | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 |
|----------------------------|--------|--------|--------|-------|-------|-------|-------|-------|
| Successful opportunities   | 2.0    | 4.0    | 18.0   | 30.0  | 18.0  | 16.0  | 35.0  | 39.0  |
| Total opportunities        | 2.0    | 4.0    | 18.0   | 35.0  | 18.0  | 16.0  | 35.0  | 41.0  |
|                            |        |        |        |       |       |       |       |       |
| Indicator value            | 100.0% | 100.0% | 100.0% | 97.1% | 97.2% | 97.4% | 96.7% | 95.9% |

Licensee Comments: none

### ERO Drill Participation

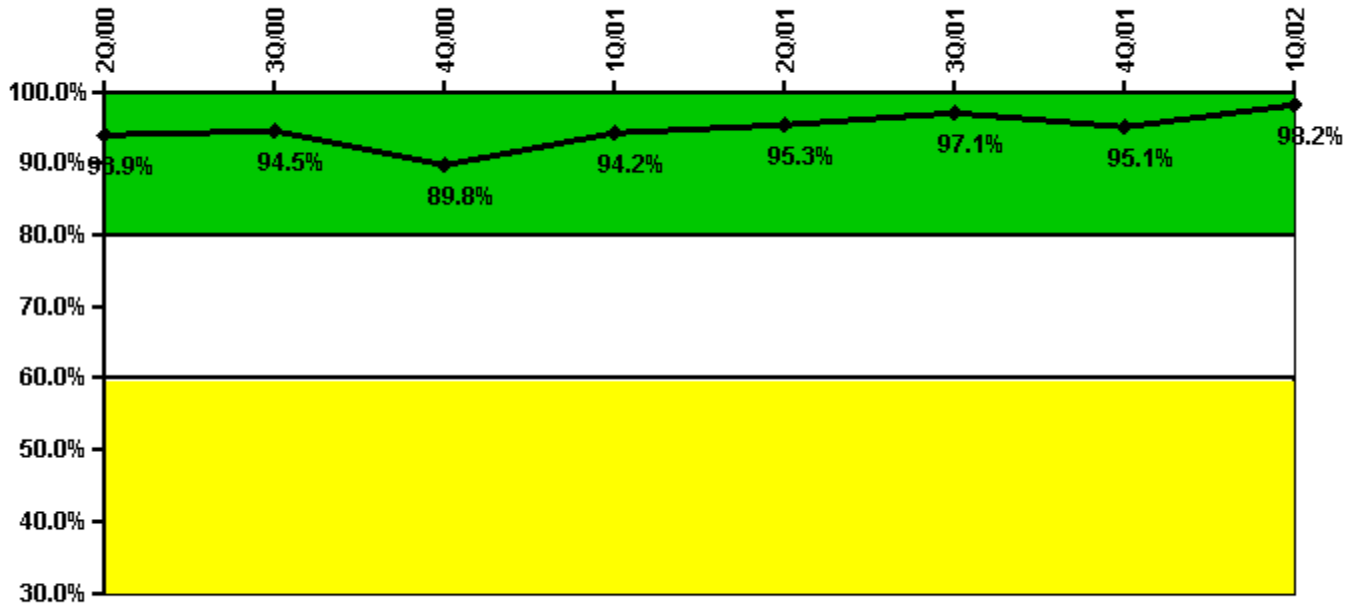


Thresholds: White < 80.0% Yellow < 60.0%

#### Notes

| ERO Drill Participation     | 2Q/00 | 3Q/00 | 4Q/00 | 1Q/01 | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 |
|-----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Participating Key personnel | 123.0 | 121.0 | 115.0 | 98.0  | 101.0 | 101.0 | 98.0  | 112.0 |
| Total Key personnel         | 131.0 | 128.0 | 128.0 | 104.0 | 106.0 | 104.0 | 103.0 | 114.0 |
|                             |       |       |       |       |       |       |       |       |
| Indicator value             | 93.9% | 94.5% | 89.8% | 94.2% | 95.3% | 97.1% | 95.1% | 98.2% |

Licensee Comments: none

### Alert & Notification System

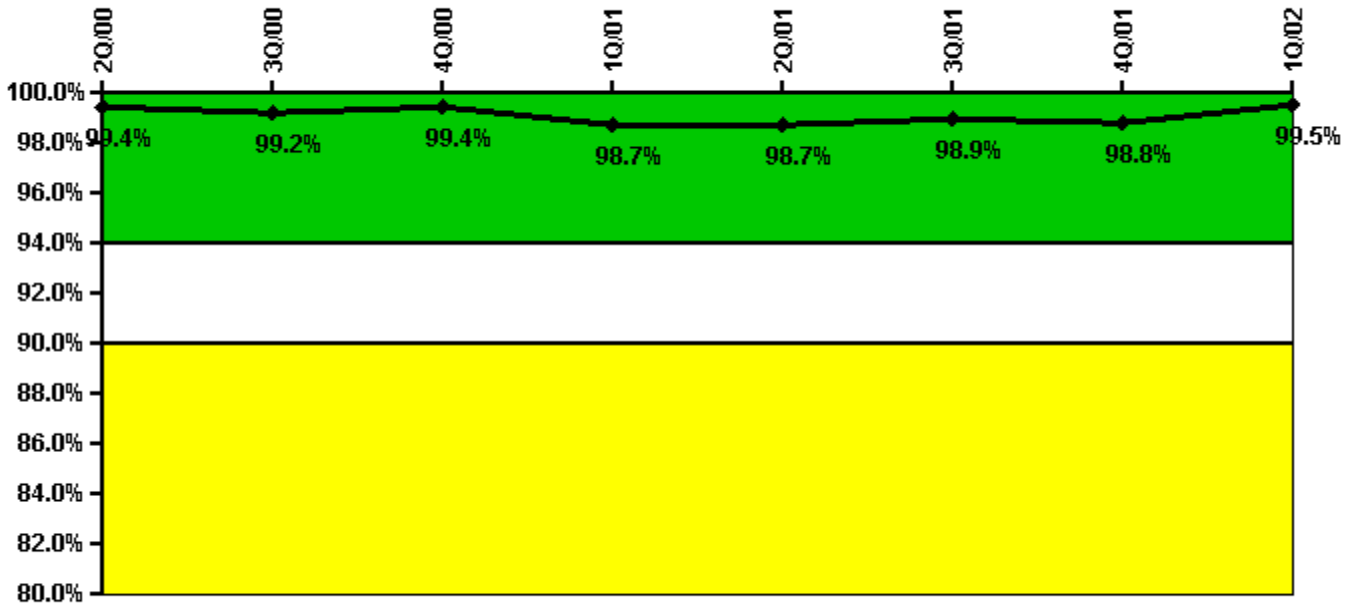


Thresholds: White < 94.0% Yellow < 90.0%

#### Notes

| Alert & Notification System | 2Q/00 | 3Q/00 | 4Q/00 | 1Q/01 | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 |
|-----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Successful siren-tests      | 384   | 380   | 384   | 414   | 427   | 431   | 431   | 434   |
| Total sirens-tests          | 385   | 385   | 385   | 427   | 429   | 434   | 434   | 434   |
|                             |       |       |       |       |       |       |       |       |
| Indicator value             | 99.4% | 99.2% | 99.4% | 98.7% | 98.7% | 98.9% | 98.8% | 99.5% |

Licensee Comments: none

### Occupational Exposure Control Effectiveness

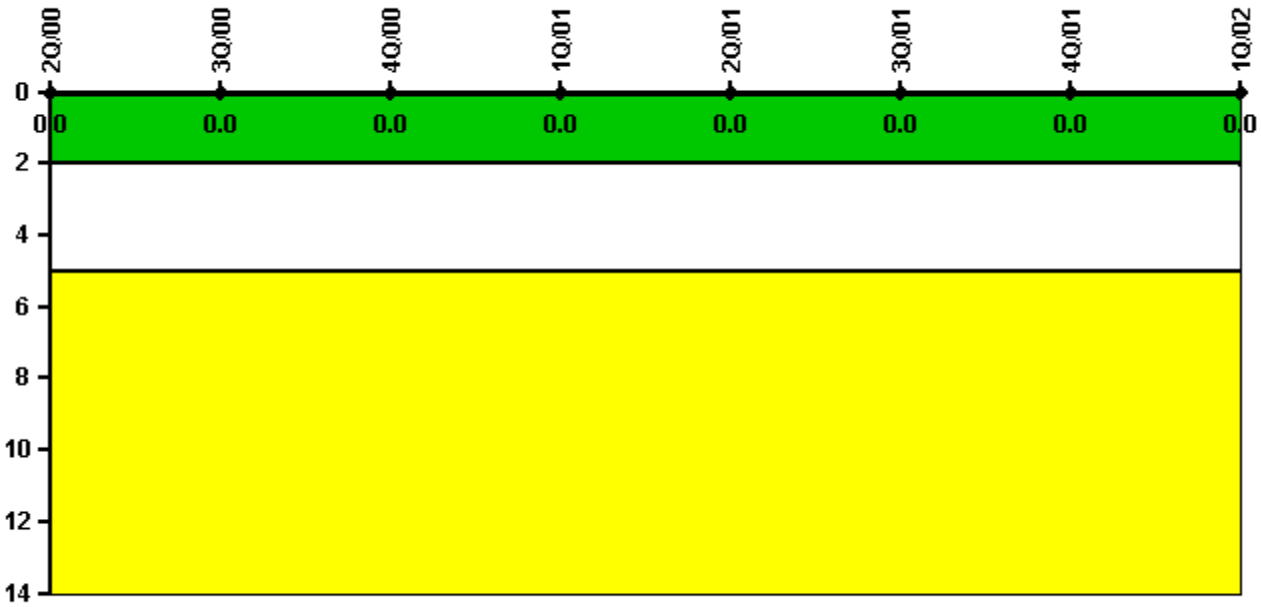

Thresholds: White > 2.0 Yellow > 5.0

#### Notes

| Occupational Exposure Control Effectiveness | 2Q/00 | 3Q/00 | 4Q/00 | 1Q/01 | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 |
|---|-------|-------|-------|-------|-------|-------|-------|-------|
| High radiation area occurrences             | 0     | 0     | 0     | 0     | 0     | 0     | 0     | 0     |
| Very high radiation area occurrences        | 0     | 0     | 0     | 0     | 0     | 0     | 0     | 0     |
| Unintended exposure occurrences             | 0     | 0     | 0     | 0     | 0     | 0     | 0     | 0     |
| Indicator value                             | 0     | 0     | 0     | 0     | 0     | 0     | 0     | 0     |

Licensee Comments: none

### RETS/ODCM Radiological Effluent




Thresholds: White > 1.0 Yellow > 3.0

#### Notes

| RETS/ODCM Radiological Effluent | 2Q/00 | 3Q/00 | 4Q/00 | 1Q/01 | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 |
|---------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| RETS/ODCM occurrences           | 0     | 0     | 0     | 0     | 0     | 0     | 0     | 0     |
|                                 |       |       |       |       |       |       |       |       |
| Indicator value                 | 0     | 0     | 0     | 0     | 0     | 0     | 0     | 0     |

Licensee Comments: none

### Protected Area Security Performance Index

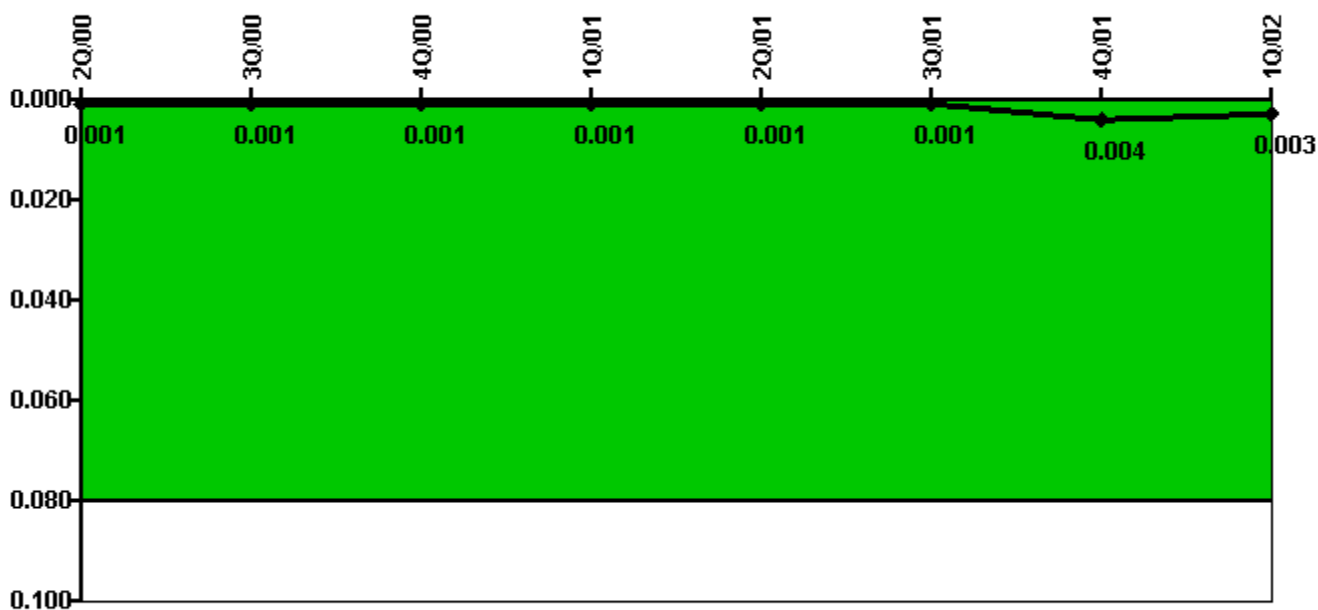

Thresholds: White > 0.080

#### Notes

| Protected Area Security Performance Index | 2Q/00        | 3Q/00        | 4Q/00        | 1Q/01        | 2Q/01        | 3Q/01        | 4Q/01        | 1Q/02        |
|---|--------------|--------------|--------------|--------------|--------------|--------------|--------------|--------------|
| IDS compensatory hours                    | 0            | 0            | 10.30        | 6.10         | 0            | 5.20         | 53.40        | 0            |
| CCTV compensatory hours                   | 0            | 0            | 0            | 0            | 0            | 0            | 0            | 0            |
| IDS normalization factor                  | 1.00         | 1.00         | 1.00         | 1.00         | 1.00         | 1.00         | 1.00         | 1.00         |
| CCTV normalization factor                 | 1.0          | 1.0          | 1.0          | 1.0          | 1.0          | 1.0          | 1.0          | 1.0          |
|   |              |              |              |              |              |              |              |              |
| <b>Index Value</b>                        | <b>0.001</b> | <b>0.001</b> | <b>0.001</b> | <b>0.001</b> | <b>0.001</b> | <b>0.001</b> | <b>0.004</b> | <b>0.003</b> |

Licensee Comments:

1Q/02: Performance reflects zero (0) hours of CCTV camera operation during this reporting period.

4Q/01: Performance reflects 17.4 hours of CCTV camera operation during this reporting period with zero (0) failures. Re-assessment noted October and December 2001, IDS Compensatory Hours should have been 40.0 (vs 40.5) and 13.4 (vs 16.2) respectively.

3Q/01: Re-assessment noted September 2001, IDS Compensatory Hours should have been 5.2 vs 6.9

1Q/01: Re-assessment noted March 2001, IDS Compensatory Hours should have been 6.1 vs. 6.2.



### Personnel Screening Program




Thresholds: White > 2.0 Yellow > 5.0

#### Notes

| Personnel Screening Program | 2Q/00 | 3Q/00 | 4Q/00 | 1Q/01 | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 |
|-----------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Program failures            | 0     | 0     | 0     | 0     | 0     | 0     | 0     | 0     |
|                             |       |       |       |       |       |       |       |       |
| Indicator value             | 0     | 0     | 0     | 0     | 0     | 0     | 0     | 0     |

Licensee Comments: none

### FFD/Personnel Reliability

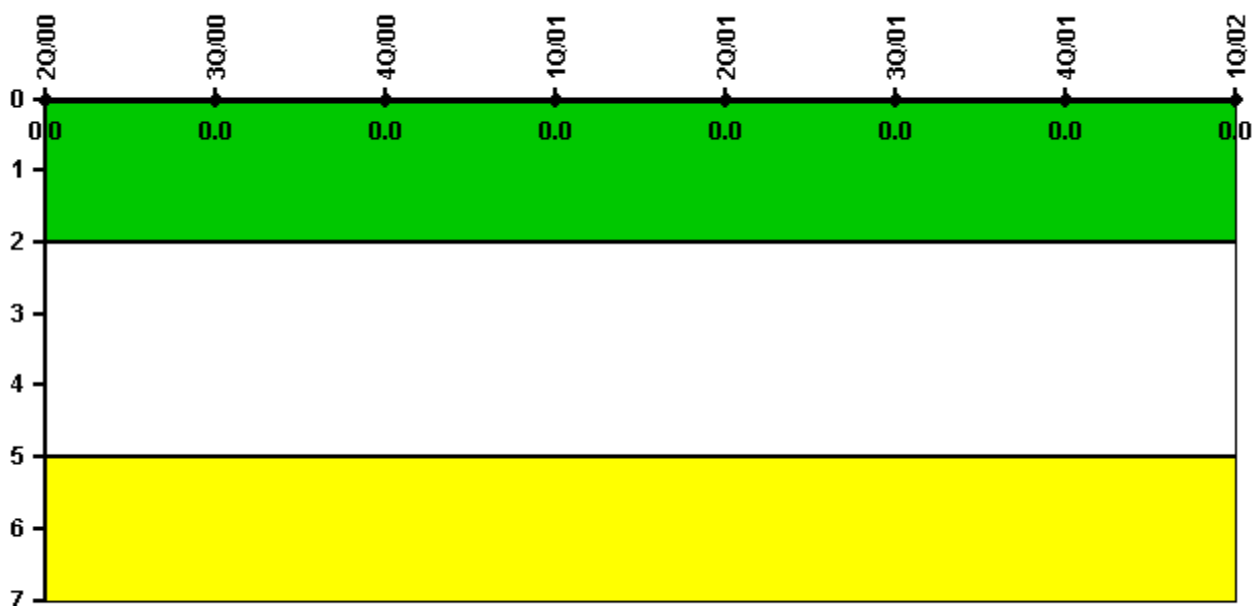

Thresholds: White > 2.0 Yellow > 5.0

#### Notes

| FFD/Personnel Reliability | 2Q/00 | 3Q/00 | 4Q/00 | 1Q/01 | 2Q/01 | 3Q/01 | 4Q/01 | 1Q/02 |
|---------------------------|-------|-------|-------|-------|-------|-------|-------|-------|
| Program Failures          | 0     | 0     | 0     | 0     | 0     | 0     | 0     | 0     |
|                           |       |       |       |       |       |       |       |       |
| Indicator value           | 0     | 0     | 0     | 0     | 0     | 0     | 0     | 0     |

Licensee Comments: none

▲ [PI Summary](#) | [Inspection Findings Summary](#) | [Reactor Oversight Process](#)

Last Modified: May 1, 2002