


# Catawba 2

## 1Q/2006 Performance Indicators

Licensee's General Comments: Technical Specification DEI Limit changed effective 04/2005 from 0.064 uCi/gr to 0.46 uCi/gr. Past indicator values were calculated against the more conservative limit. CDE pedigree information for Catawba units was not revised until 3/2006.

### Unplanned Scrams per 7000 Critical Hrs

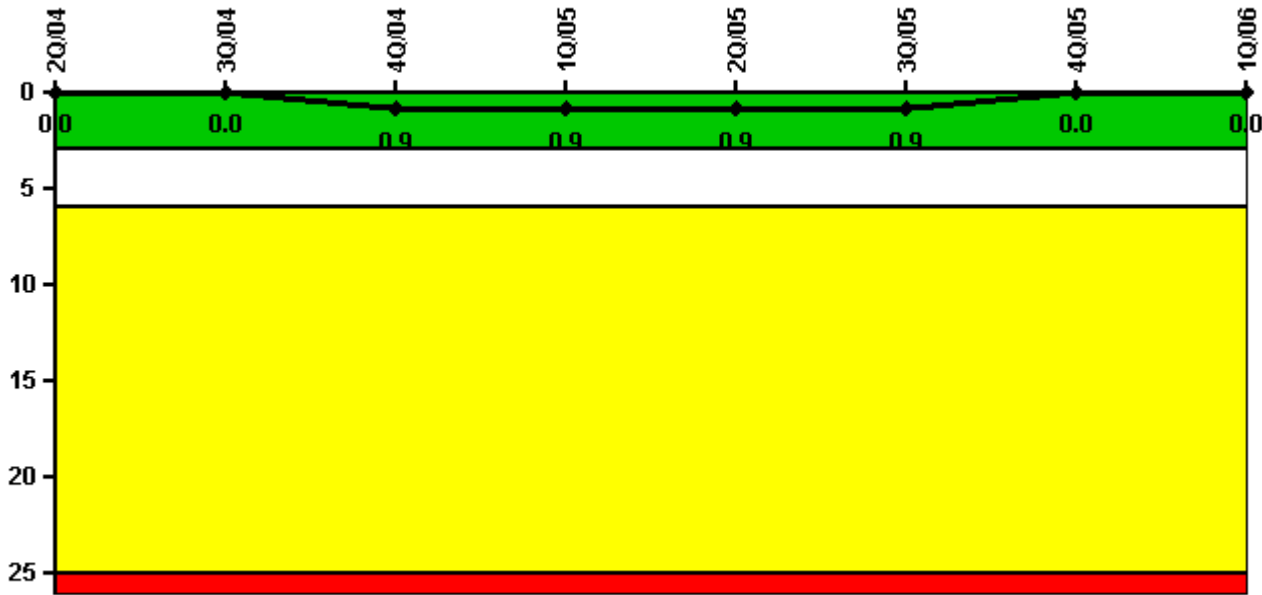


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

### Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06
Unplanned scrams	0	0	1.0	0	0	0	0	0
Critical hours	2183.0	1733.2	1611.7	2160.0	2183.0	2208.0	2209.0	1829.3
Indicator value	0	0	0.9	0.9	0.9	0.9	0	0

Licensee Comments: none

### Scrams with Loss of Normal Heat Removal

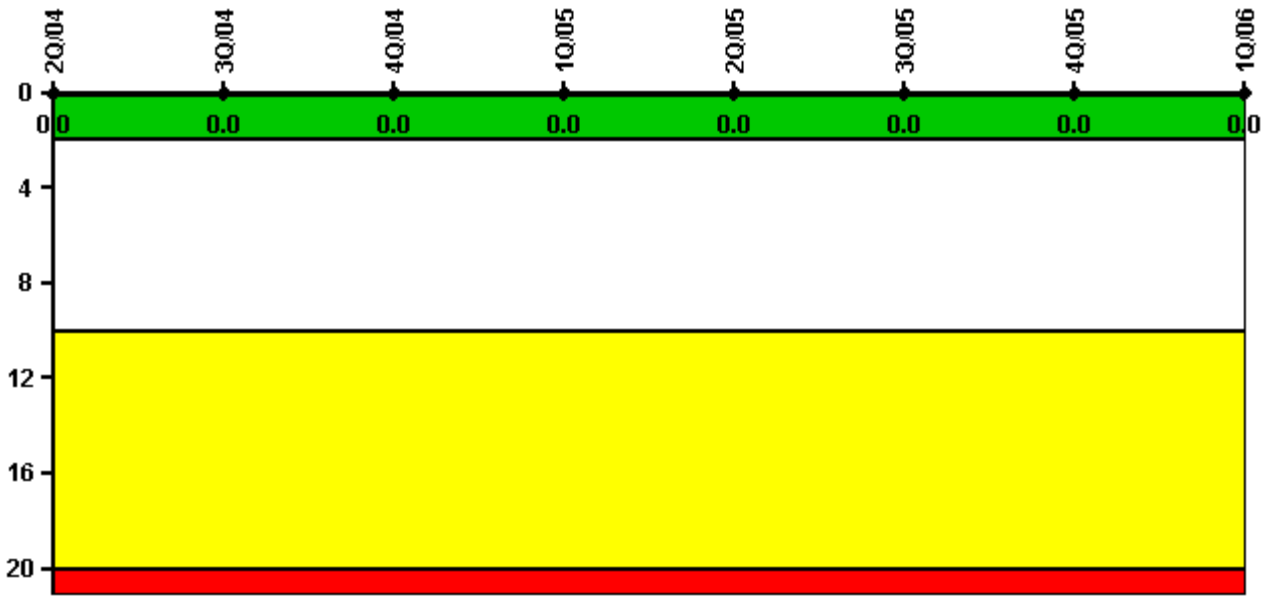


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

#### Notes

Scrams with Loss of Normal Heat Removal	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06
Scrams	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

### Unplanned Power Changes per 7000 Critical Hrs

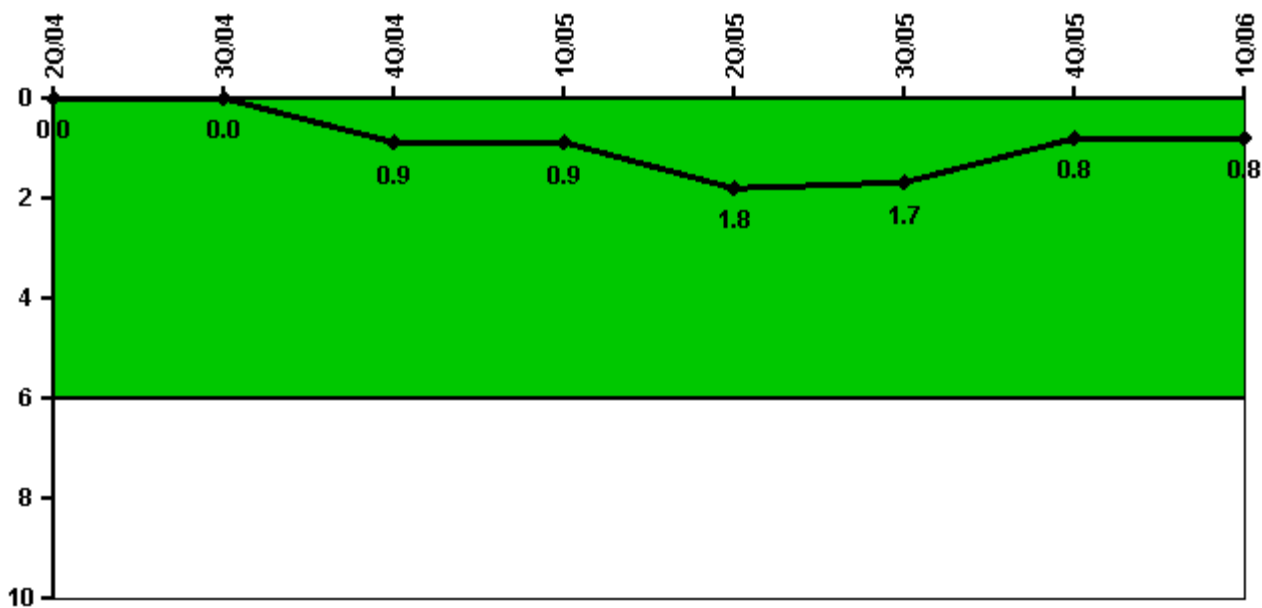


Thresholds: White > 6.0

#### Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06
Unplanned power changes	0	0	1.0	0	1.0	0	0	0
Critical hours	2183.0	1733.2	1611.7	2160.0	2183.0	2208.0	2209.0	1829.3
Indicator value	0	0	0.9	0.9	1.8	1.7	0.8	0.8

Licensee Comments: none

### Safety System Unavailability, Emergency AC Power

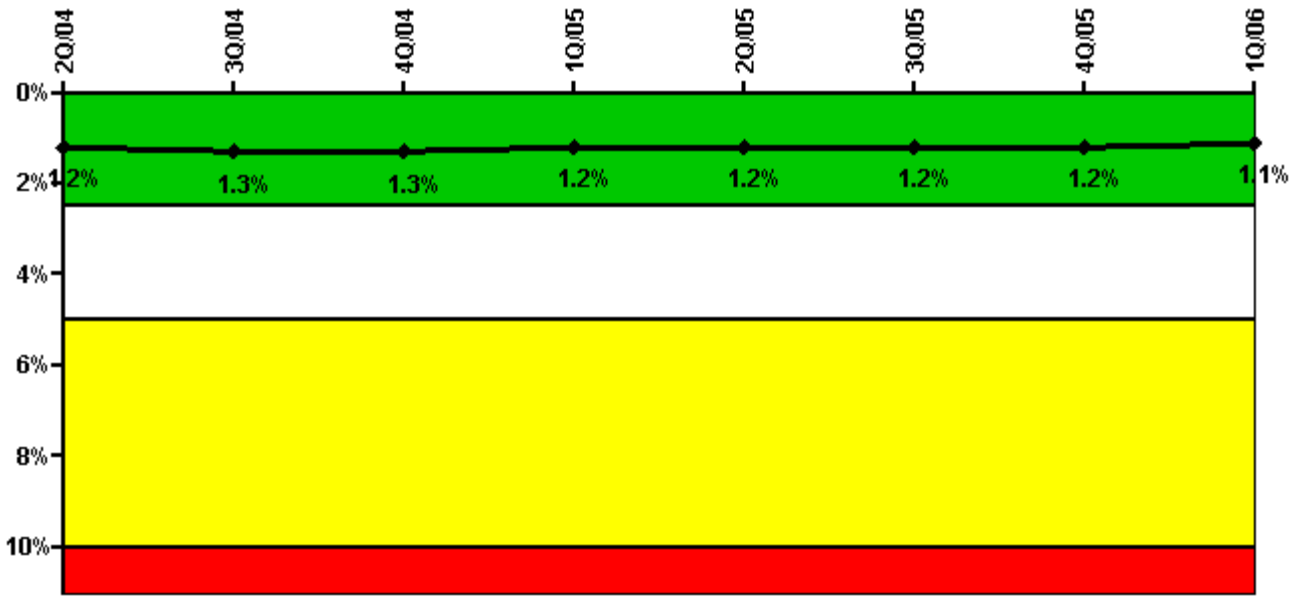


Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%

#### Notes

Safety System Unavailability, Emergency AC Power	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06
<b>Train 1</b>								
Planned unavailable hours	26.00	2.38	3.04	5.88	6.45	3.12	15.48	60.69
Unplanned unavailable hours	5.68	0.73	0	1.78	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00	2160.00
<b>Train 2</b>								
Planned unavailable hours	27.30	31.14	6.56	10.81	1.98	3.45	9.60	15.58
Unplanned unavailable hours	1.10	14.73	0	0	0	5.93	16.05	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2160.00	2183.00	2208.00	2209.00	2160.00
<b>Indicator value</b>	<b>1.2%</b>	<b>1.3%</b>	<b>1.3%</b>	<b>1.2%</b>	<b>1.2%</b>	<b>1.2%</b>	<b>1.2%</b>	<b>1.1%</b>

Licensee Comments: none

### Safety System Unavailability, High Pressure Injection System (HPSI)

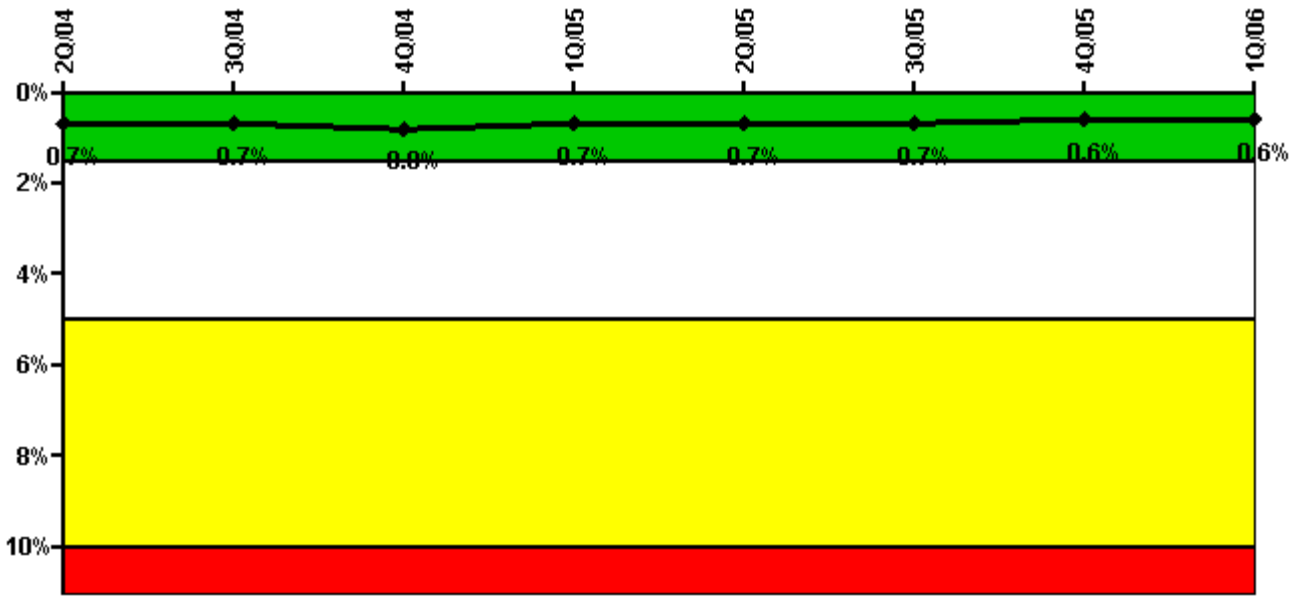


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

#### Notes

Safety System Unavailability, High Pressure Injection System (HPSI)	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06
<b>Train 1</b>								
Planned unavailable hours	17.81	16.08	12.55	3.01	3.80	12.10	3.58	1.92
Unplanned unavailable hours	0	0	0	1.78	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	1733.20	1598.18	2160.00	2183.00	2208.00	2209.00	1829.30
<b>Train 2</b>								
Planned unavailable hours	5.64	20.70	12.78	4.10	8.90	4.04	36.31	3.95
Unplanned unavailable hours	10.43	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	1733.20	1598.18	2160.00	2183.00	2208.00	2209.00	1829.30
<b>Train 3</b>								
Planned unavailable hours	4.95	4.76	1.87	12.22	3.50	3.06	3.35	1.67
Unplanned unavailable hours	0	0	0	1.78	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	1733.20	1598.18	2160.00	2183.00	2208.00	2209.00	1829.30
<b>Train 4</b>								
Planned unavailable hours	14.48	13.72	12.78	3.56	3.05	11.60	1.85	3.53
Unplanned unavailable hours	10.43	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	1733.20	1598.18	2160.00	2183.00	2208.00	2209.00	1829.30
<b>Indicator value</b>	<b>0.7%</b>	<b>0.7%</b>	<b>0.8%</b>	<b>0.7%</b>	<b>0.7%</b>	<b>0.7%</b>	<b>0.6%</b>	<b>0.6%</b>

Licensee Comments: none

### Safety System Unavailability, Heat Removal System (AFW)

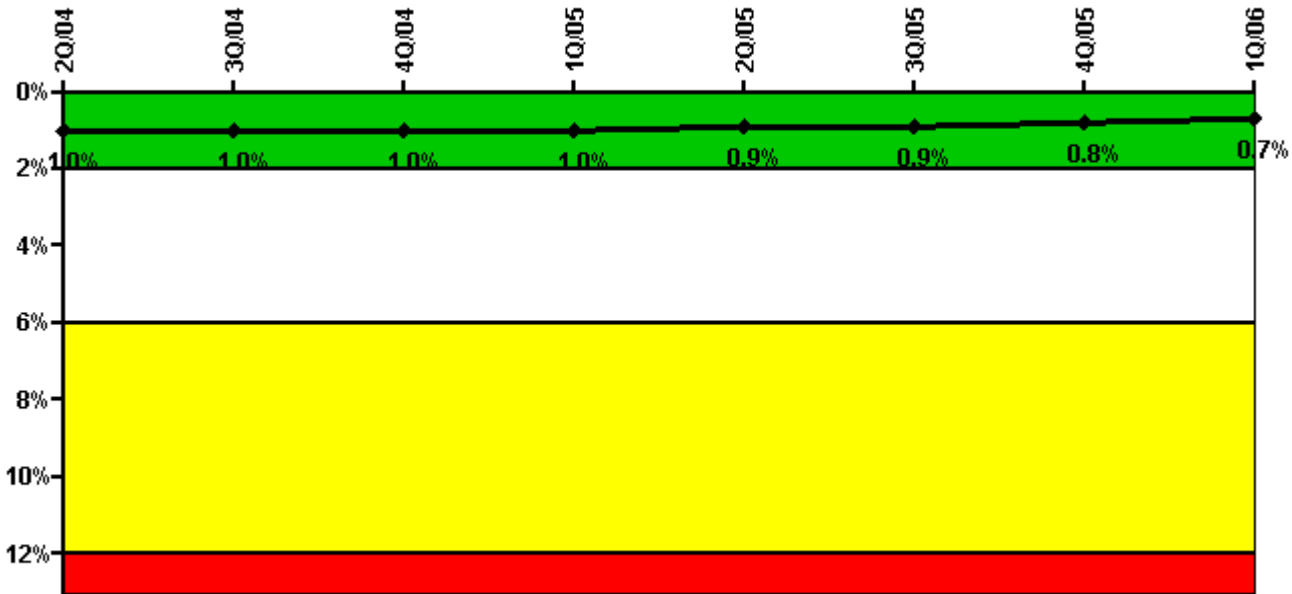


Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%

### Notes

Safety System Unavailability, Heat Removal System (AFW)	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06
<b>Train 1</b>								
Planned unavailable hours	11.28	9.40	2.12	3.05	11.70	13.29	3.35	1.67
Unplanned unavailable hours	0	0	0	1.78	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	1737.50	1711.20	2160.00	2183.00	2208.00	2209.00	1833.70
<b>Train 2</b>								
Planned unavailable hours	8.46	25.92	22.75	3.81	20.43	3.98	8.10	3.53
Unplanned unavailable hours	10.43	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	1737.50	1711.20	2160.00	2183.00	2208.00	2209.00	1833.70
<b>Train 3</b>								
Planned unavailable hours	9.43	4.68	0	16.61	4.85	12.57	6.07	0
Unplanned unavailable hours	0	7.42	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	1737.50	1711.20	2160.00	2183.00	2208.00	2209.00	1833.70
<b>Indicator value</b>	<b>1.0%</b>	<b>1.0%</b>	<b>1.0%</b>	<b>1.0%</b>	<b>0.9%</b>	<b>0.9%</b>	<b>0.8%</b>	<b>0.7%</b>

Licensee Comments: none

### Safety System Unavailability, Residual Heat Removal System

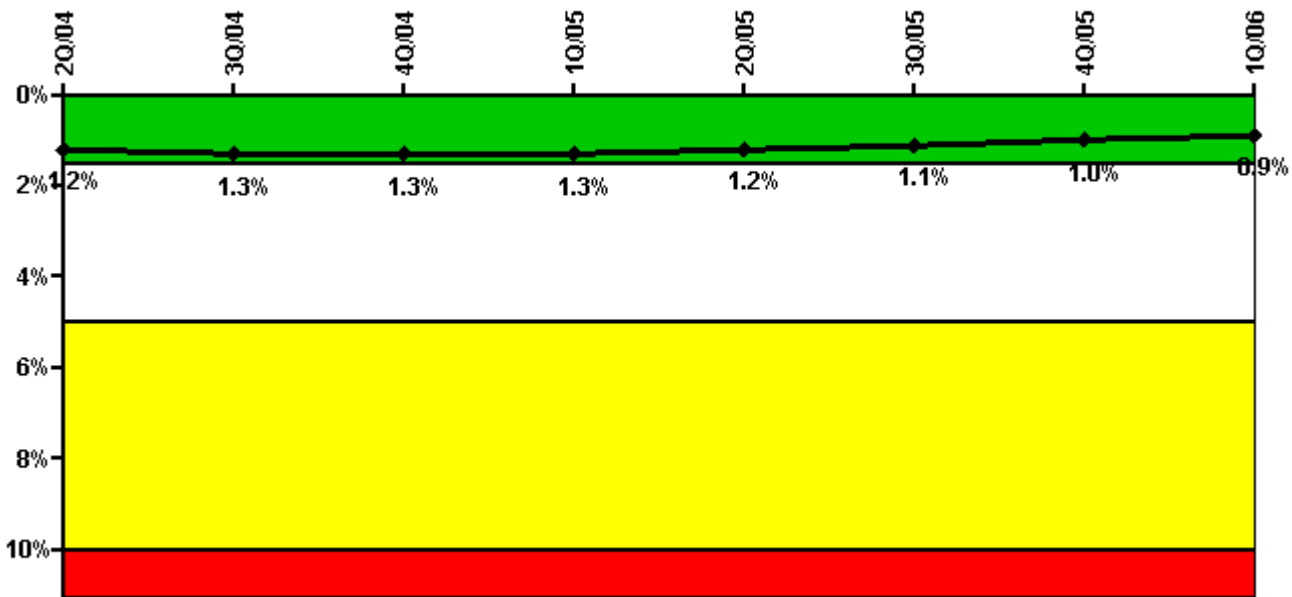


Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

#### Notes

Safety System Unavailability, Residual Heat Removal System	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06
<b>Train 1</b>								
Planned unavailable hours	5.40	11.89	2.20	3.02	3.75	21.22	3.64	1.94
Unplanned unavailable hours	0	0	0	1.78	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	1904.10	2209.00	2160.00	2183.00	2208.00	2209.00	2160.00
<b>Train 2</b>								
Planned unavailable hours	20.15	29.38	17.18	3.91	23.18	3.75	2.14	3.91
Unplanned unavailable hours	10.43	0	0	0	0	0	0	0
Fault exposure hours	0	0	0	0	0	0	0	0
Effective Reset hours	0	0	0	0	0	0	0	0
Required hours	2183.00	1904.10	2209.00	2160.00	2183.00	2208.00	2209.00	2160.00
<b>Indicator value</b>	<b>1.2%</b>	<b>1.3%</b>	<b>1.3%</b>	<b>1.3%</b>	<b>1.2%</b>	<b>1.1%</b>	<b>1.0%</b>	<b>0.9%</b>

Licensee Comments: none

### Safety System Functional Failures (PWR)

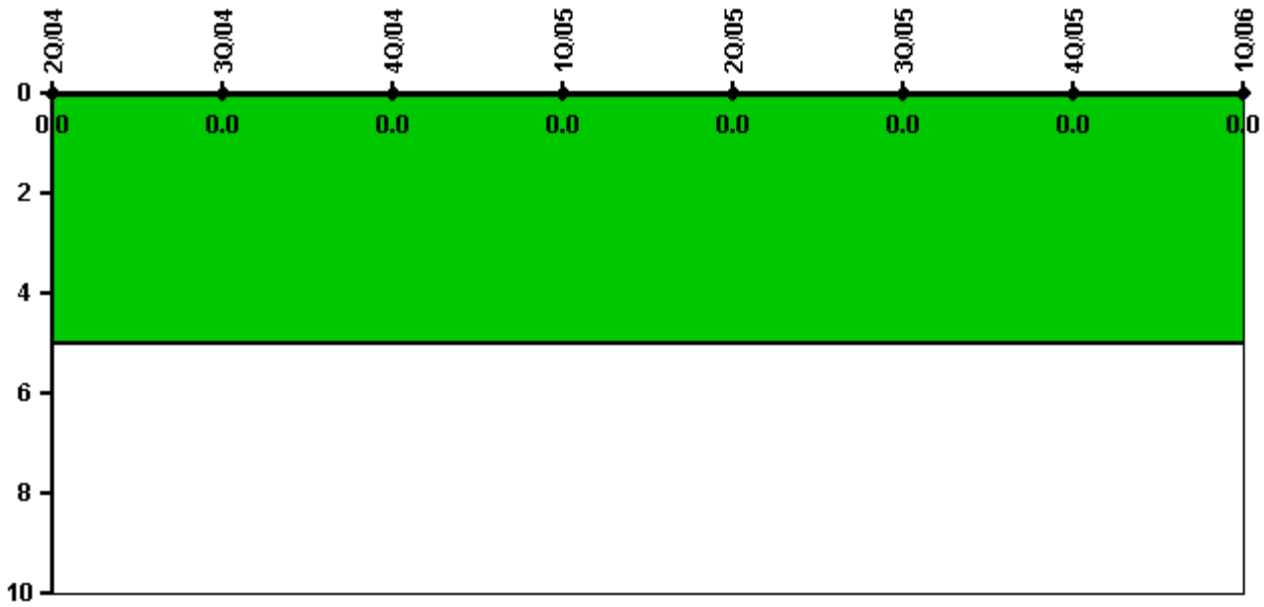

Thresholds: White > 5.0


#### Notes

Safety System Functional Failures (PWR)	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none



### Reactor Coolant System Activity

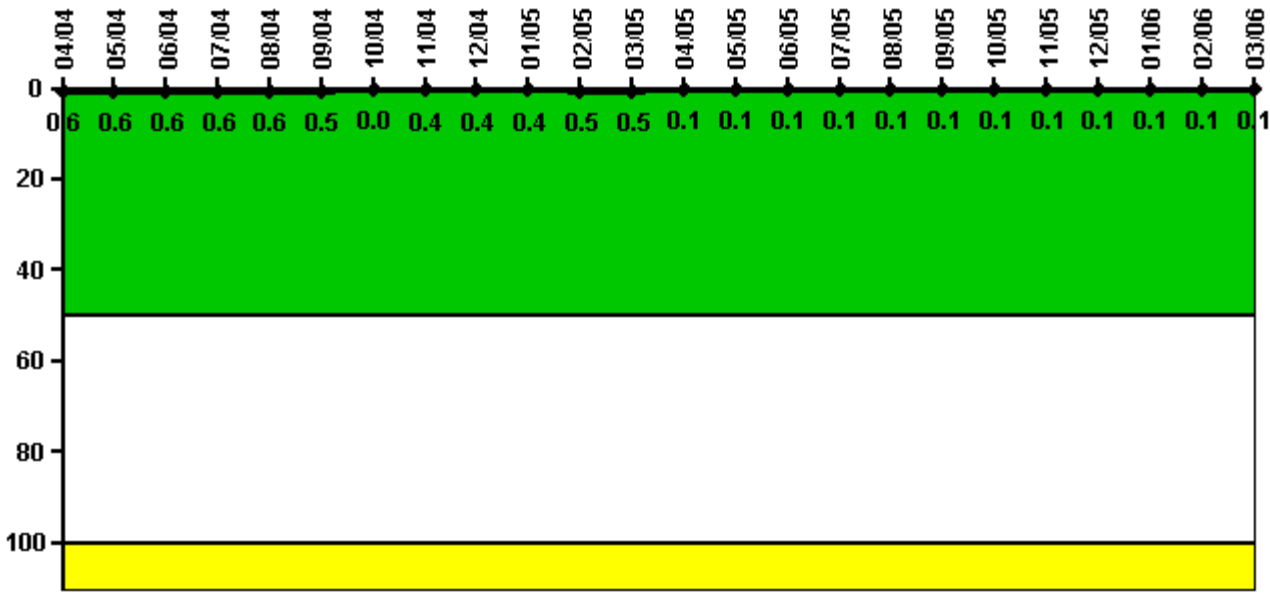

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


Reactor Coolant System Activity	4/04	5/04	6/04	7/04	8/04	9/04	10/04	11/04	12/04	1/05	2/05	3/05
Maximum activity	0.000357	0.000376	0.000392	0.000368	0.000373	0.000299	0	0.000229	0.000252	0.000283	0.000321	0.000322
Technical specification limit	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
Indicator value	0.6	0.6	0.6	0.6	0.6	0.5	0	0.4	0.4	0.4	0.5	0.5

Reactor Coolant System Activity	4/05	5/05	6/05	7/05	8/05	9/05	10/05	11/05	12/05	1/06	2/06	3/06
Maximum activity	0.000336	0.000366	0.000378	0.000369	0.000397	0.000408	0.000411	0.000407	0.000433	0.000419	0.000399	0.000389
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1

Licensee Comments: none

### Reactor Coolant System Leakage

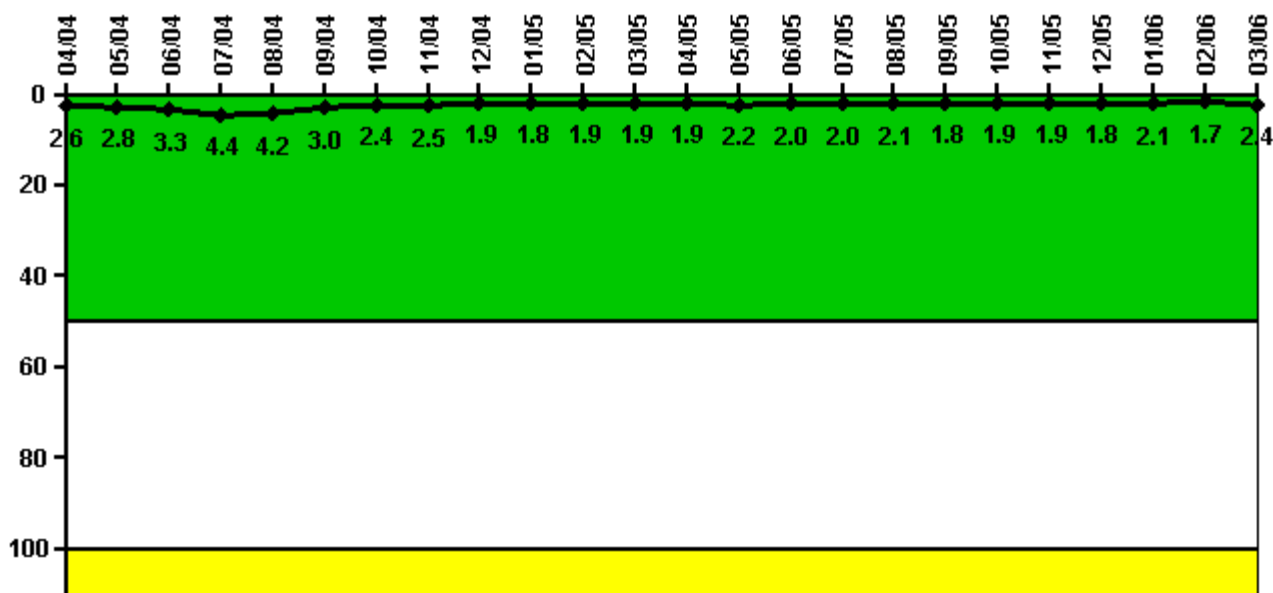


Thresholds: White > 50.0 Yellow > 100.0

#### Notes

Reactor Coolant System Leakage	4/04	5/04	6/04	7/04	8/04	9/04	10/04	11/04	12/04	1/05	2/05	3/05
Maximum leakage	0.264	0.278	0.328	0.444	0.423	0.298	0.235	0.251	0.192	0.176	0.188	0.185
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	2.6	2.8	3.3	4.4	4.2	3.0	2.4	2.5	1.9	1.8	1.9	1.9
Reactor Coolant System Leakage	4/05	5/05	6/05	7/05	8/05	9/05	10/05	11/05	12/05	1/06	2/06	3/06
Maximum leakage	0.194	0.221	0.201	0.197	0.209	0.184	0.186	0.187	0.181	0.209	0.167	0.239
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	1.9	2.2	2.0	2.0	2.1	1.8	1.9	1.9	1.8	2.1	1.7	2.4

Licensee Comments: none

### Drill/Exercise Performance

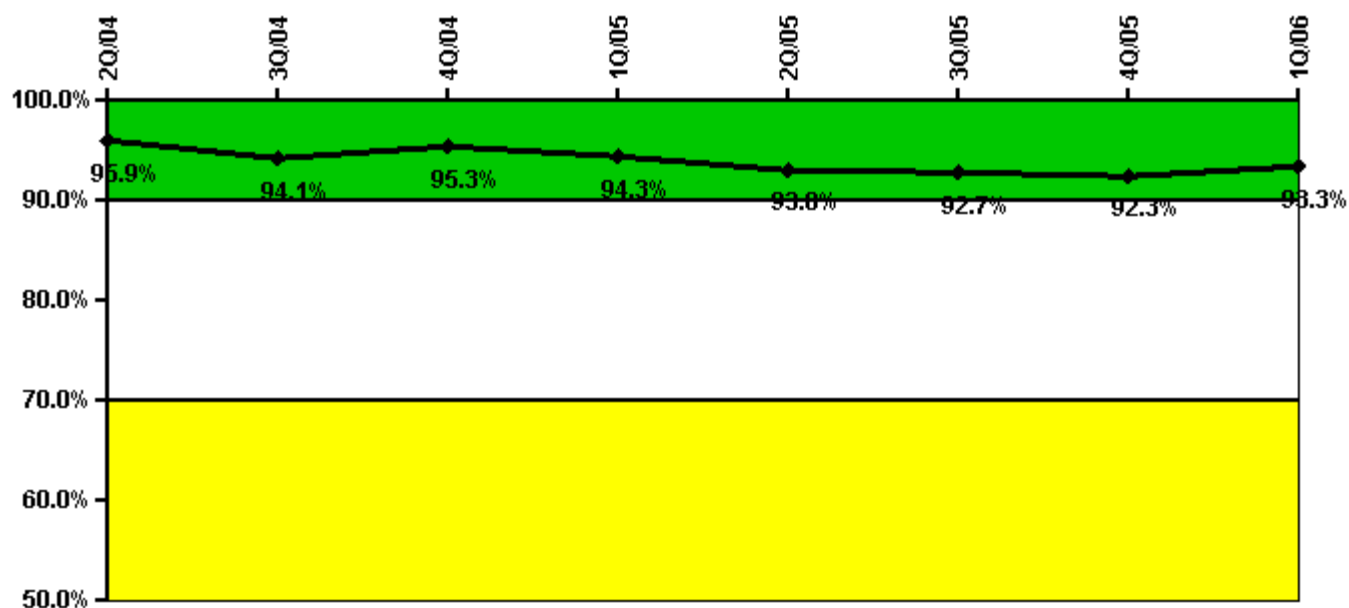


Thresholds: White < 90.0% Yellow < 70.0%

#### Notes

Drill/Exercise Performance	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06
Successful opportunities	19.0	66.0	15.0	56.0	8.0	119.0	15.0	51.0
Total opportunities	20.0	76.0	15.0	62.0	8.0	125.0	16.0	52.0
Indicator value	95.9%	94.1%	95.3%	94.3%	93.0%	92.7%	92.3%	93.3%

Licensee Comments: none

### ERO Drill Participation

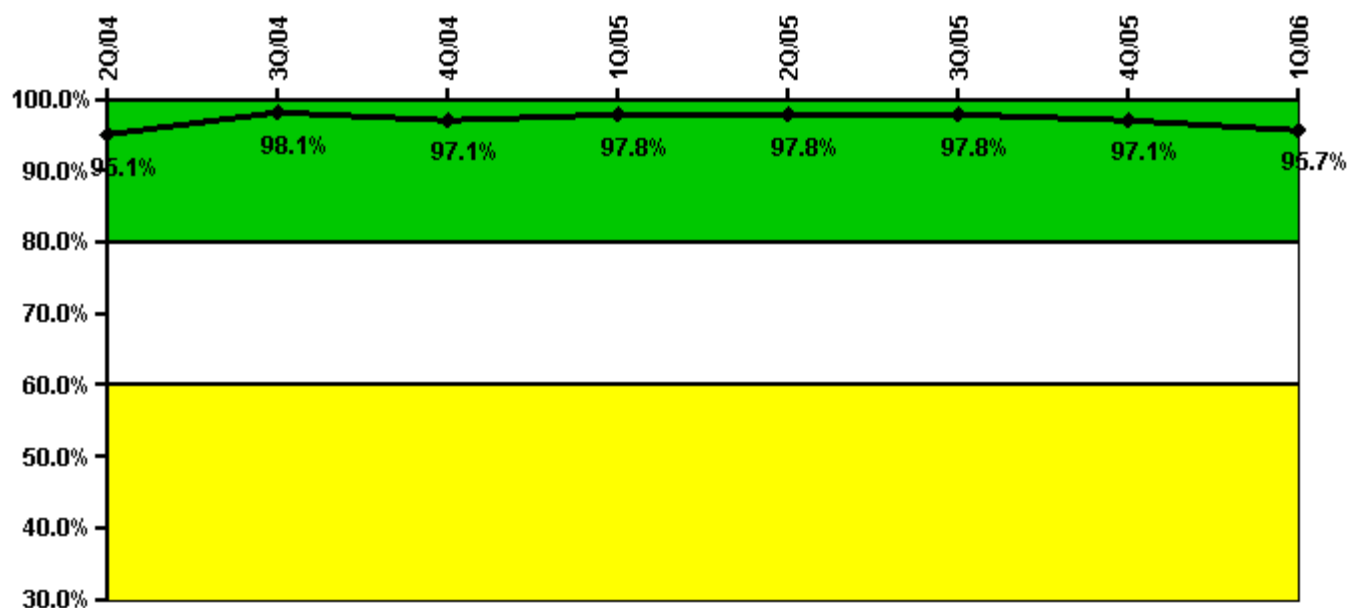


Thresholds: White < 80.0% Yellow < 60.0%

#### Notes

ERO Drill Participation	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06
Participating Key personnel	154.0	156.0	133.0	134.0	133.0	131.0	132.0	132.0
Total Key personnel	162.0	159.0	137.0	137.0	136.0	134.0	136.0	138.0
Indicator value	95.1%	98.1%	97.1%	97.8%	97.8%	97.8%	97.1%	95.7%

Licensee Comments: none

### Alert & Notification System

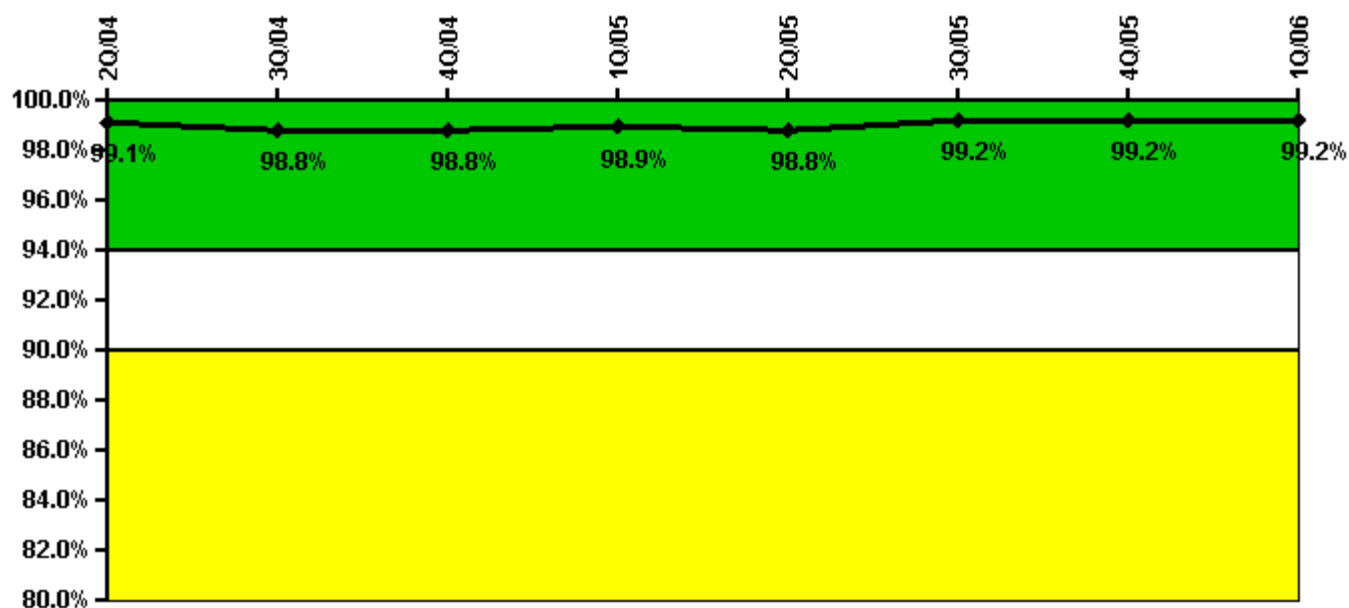


Thresholds: White < 94.0% Yellow < 90.0%

#### Notes

Alert & Notification System	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06
Successful siren-tests	2384	2494	2394	2391	2376	2377	2319	2396
Total sirens-tests	2403	2560	2403	2403	2403	2403	2335	2403
Indicator value	99.1%	98.8%	98.8%	98.9%	98.8%	99.2%	99.2%	99.2%

Licensee Comments: none

### Occupational Exposure Control Effectiveness

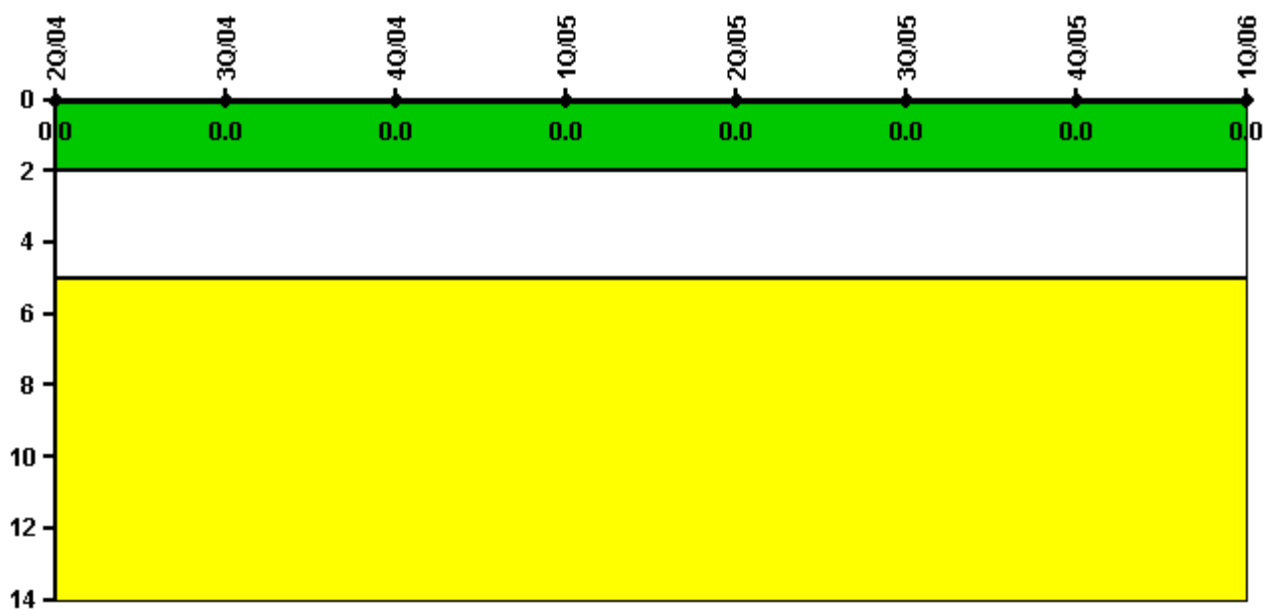


Thresholds: White > 2.0 Yellow > 5.0

#### Notes

Occupational Exposure Control Effectiveness	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### RETS/ODCM Radiological Effluent

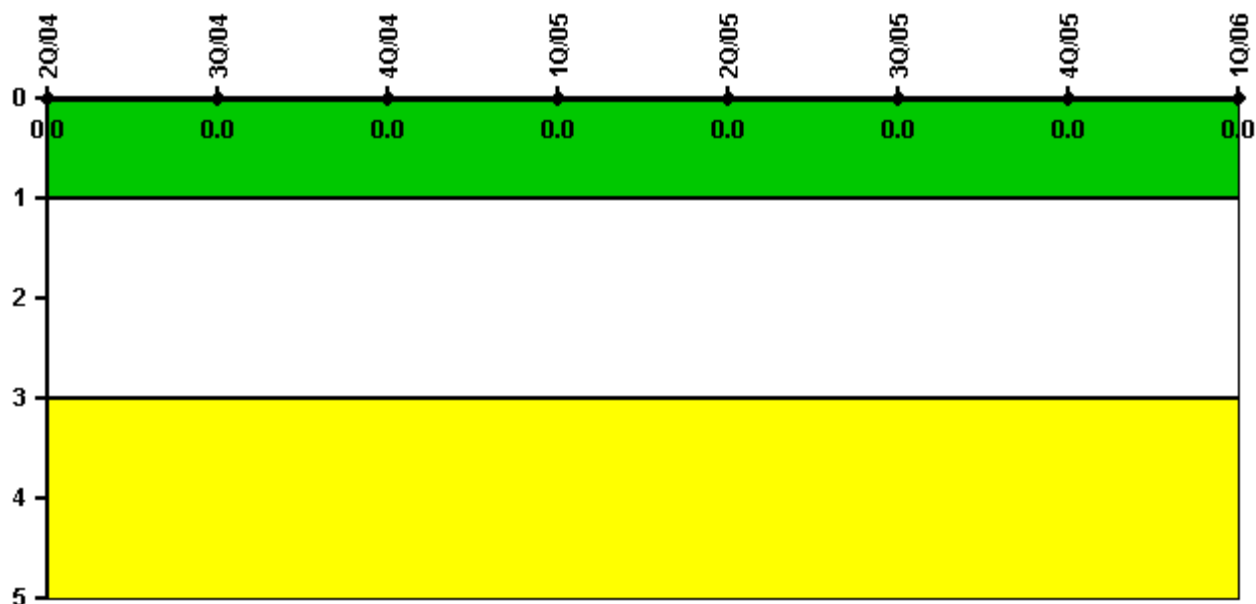

Thresholds: White > 1.0 Yellow > 3.0

#### Notes

RETS/ODCM Radiological Effluent	2Q/04	3Q/04	4Q/04	1Q/05	2Q/05	3Q/05	4Q/05	1Q/06
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: May 5, 2006