


Hope Creek 1

1Q/2007 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

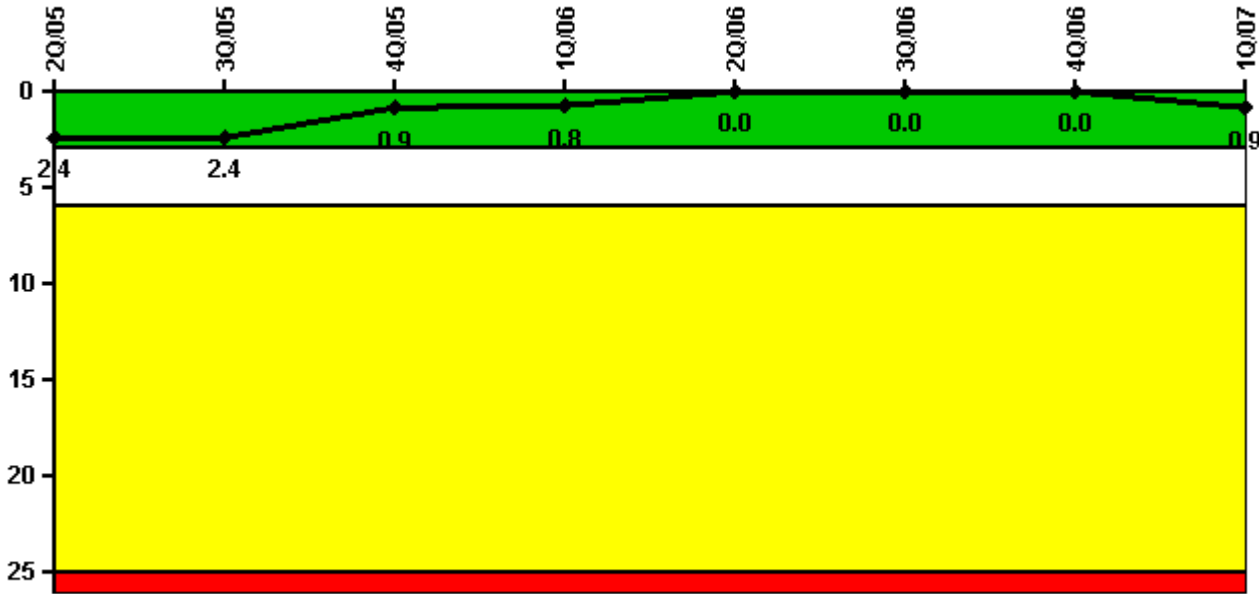


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Unplanned scrams	1.0	0	0	0	0	0	0	1.0
Critical hours	1821.5	2075.8	2209.0	2160.0	1563.3	2208.0	2209.0	2078.3
Indicator value	2.4	2.4	0.9	0.8	0	0	0	0.9

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

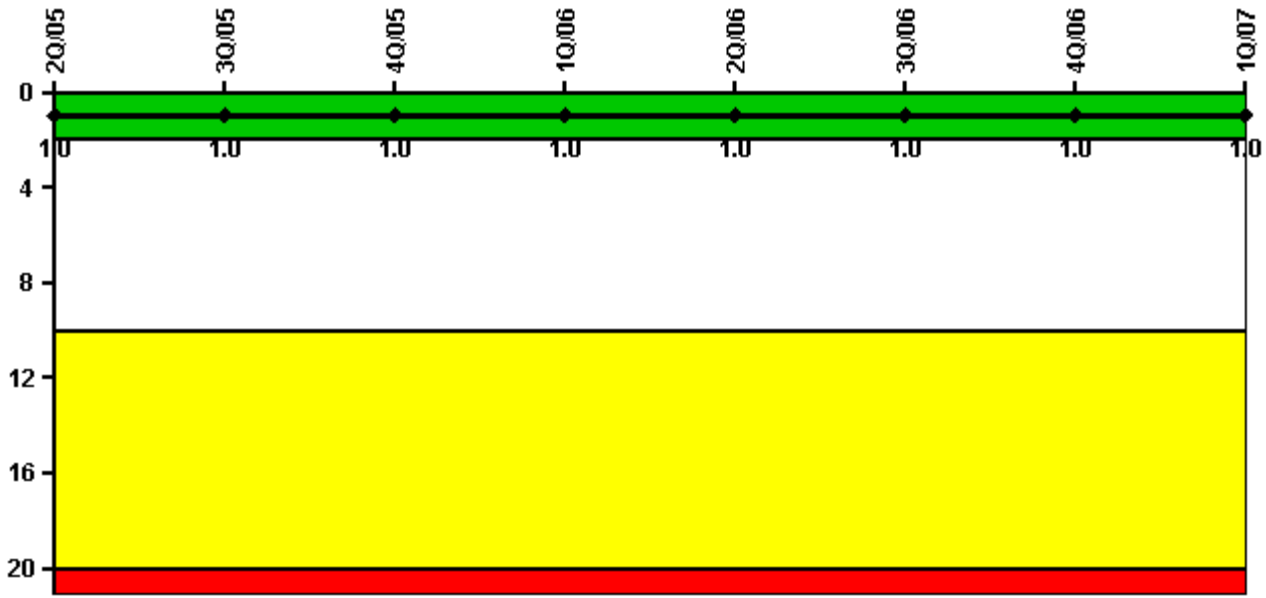


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Scrams	0	0	0	0	0	0	0	0
Indicator value	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

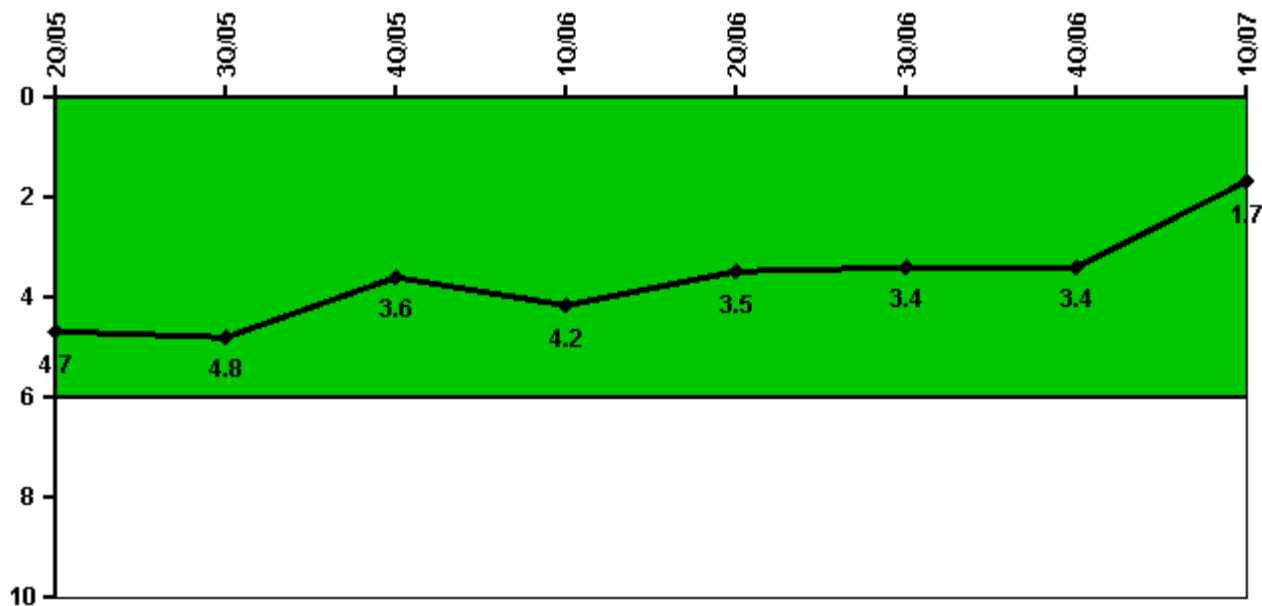


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Unplanned power changes	1.0	2.0	0	2.0	0	2.0	0	0
Critical hours	1821.5	2075.8	2209.0	2160.0	1563.3	2208.0	2209.0	2078.3
Indicator value	4.7	4.8	3.6	4.2	3.5	3.4	3.4	1.7

Licensee Comments: none

Safety System Functional Failures (BWR)

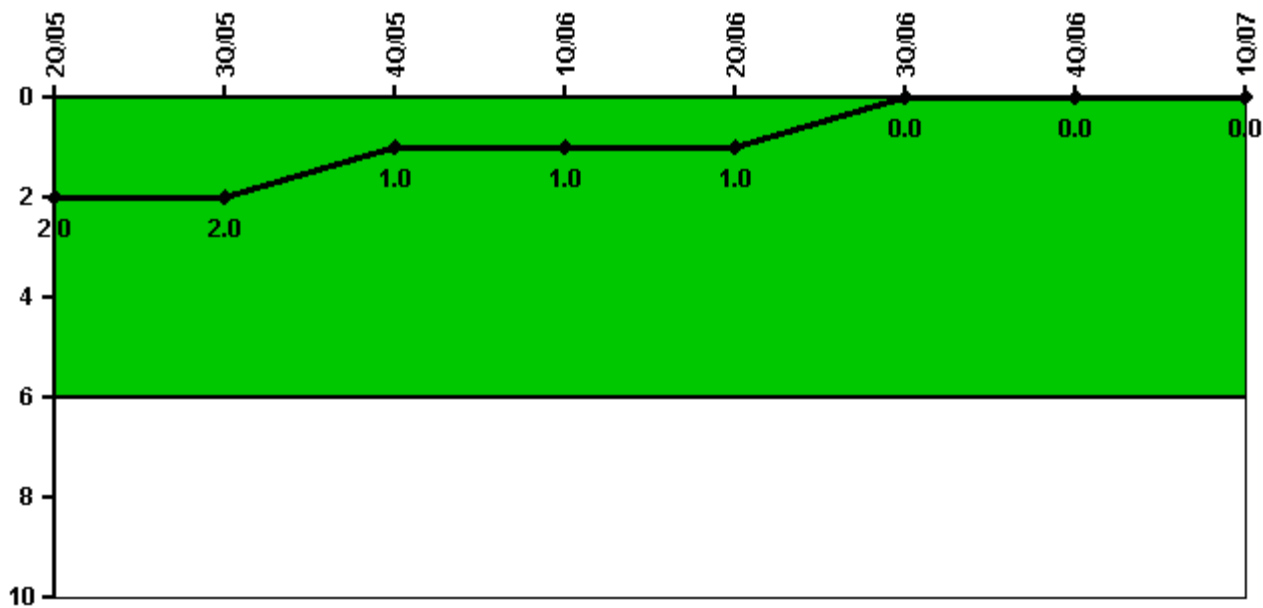


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Safety System Functional Failures	0	1	0	0	0	0	0	0
Indicator value	2	2	1	1	1	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

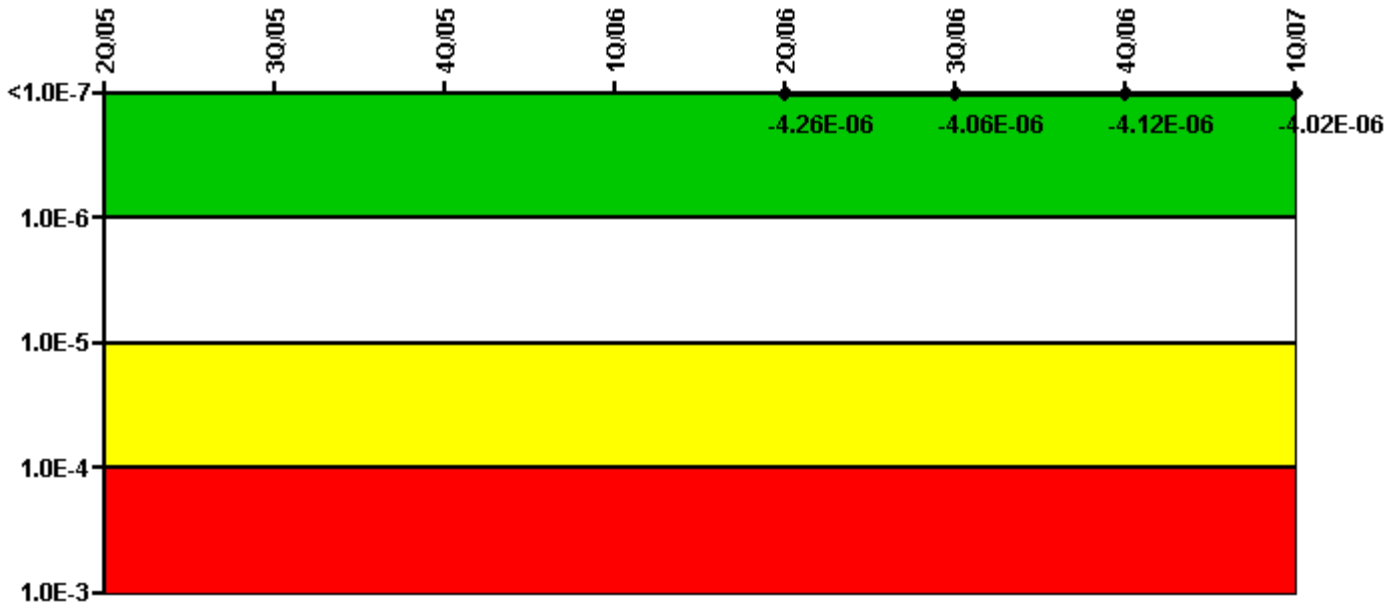


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (Δ CDF)					-2.60E-07	-2.60E-07	-2.20E-07	-2.40E-08
URI (Δ CDF)					-4.00E-06	-3.80E-06	-3.90E-06	-4.00E-06
PLE					NO	NO	NO	NO
Indicator value					-4.26E-06	-4.06E-06	-4.12E-06	-4.02E-06

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

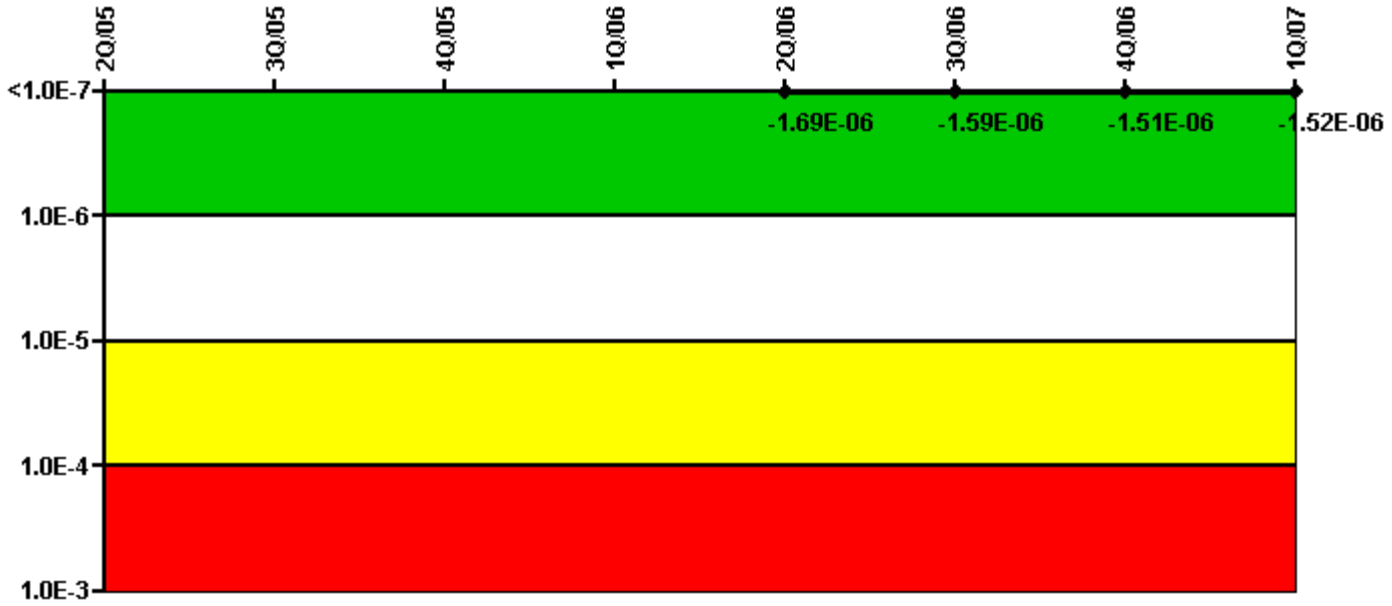


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (Δ CDF)					-5.90E-07	-5.90E-07	-5.10E-07	-5.20E-07
URI (Δ CDF)					-1.10E-06	-1.00E-06	-1.00E-06	-1.00E-06
PLE					NO	NO	NO	NO
Indicator value					-1.69E-06	-1.59E-06	-1.51E-06	-1.52E-06

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

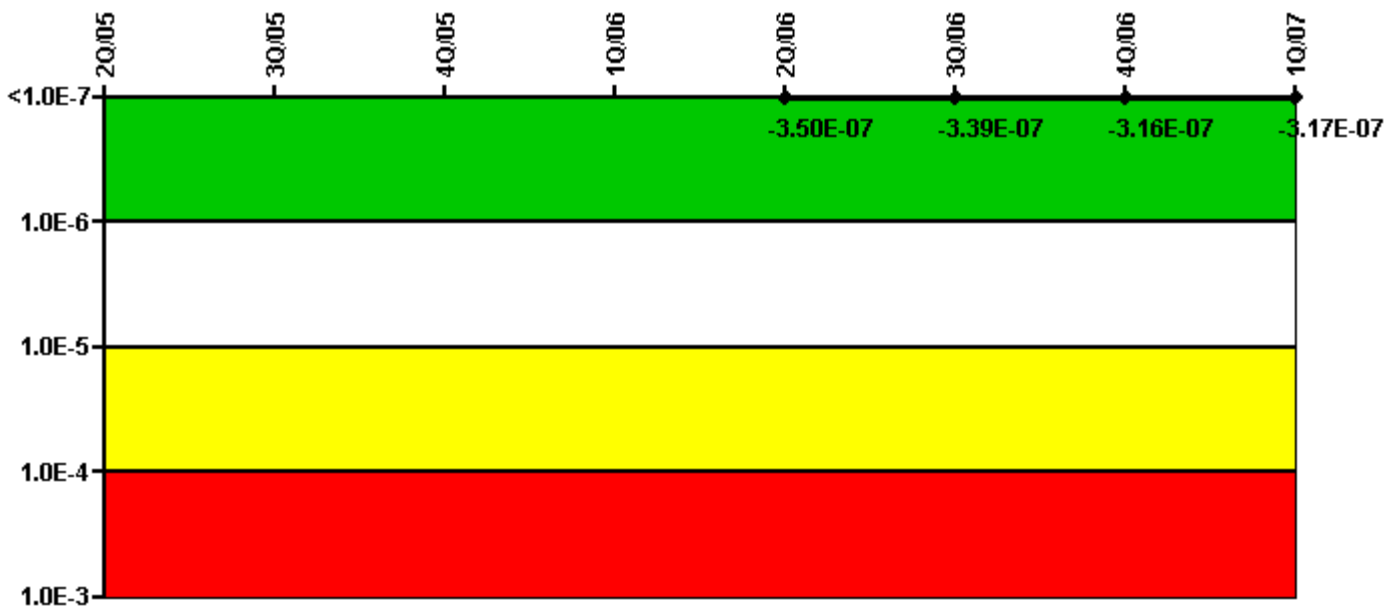


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (Δ CDF)					-1.10E-07	-9.90E-08	-7.60E-08	-7.70E-08
URI (Δ CDF)					-2.40E-07	-2.40E-07	-2.40E-07	-2.40E-07
PLE					NO	NO	NO	NO
Indicator value					-3.50E-07	-3.39E-07	-3.16E-07	-3.17E-07

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

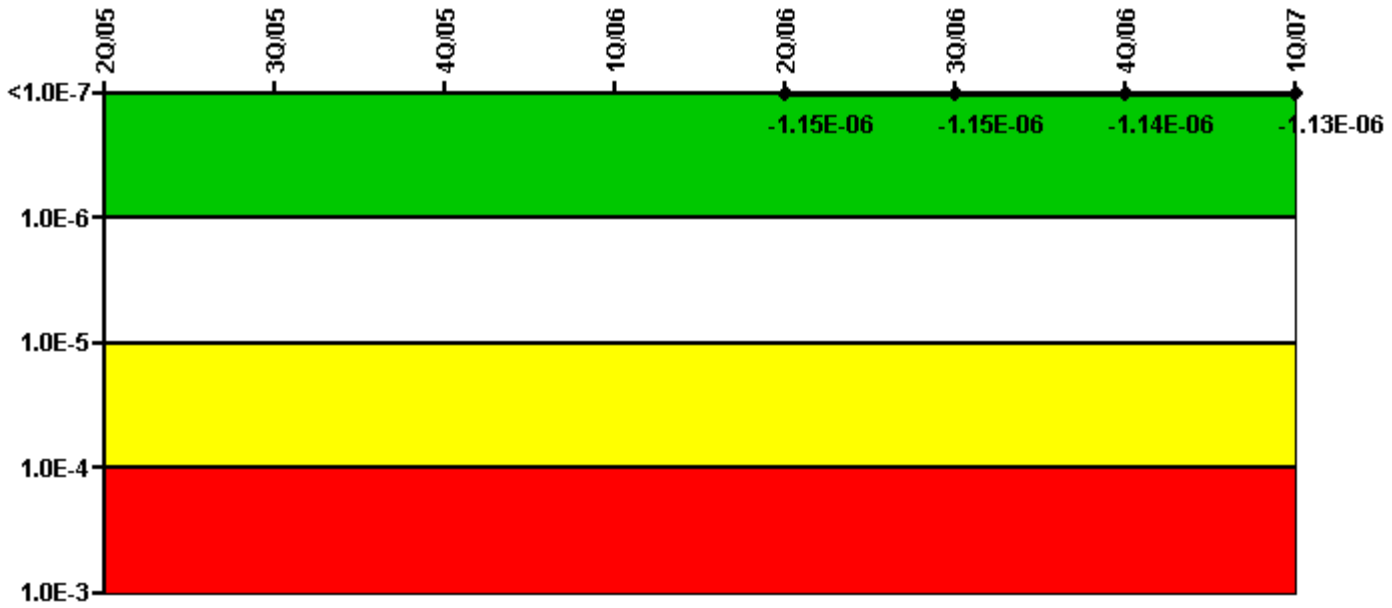


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (Δ CDF)					-2.00E-07	-2.00E-07	-2.10E-07	-2.10E-07
URI (Δ CDF)					-9.50E-07	-9.50E-07	-9.30E-07	-9.20E-07
PLE					NO	NO	NO	NO
Indicator value					-1.15E-06	-1.15E-06	-1.14E-06	-1.13E-06

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

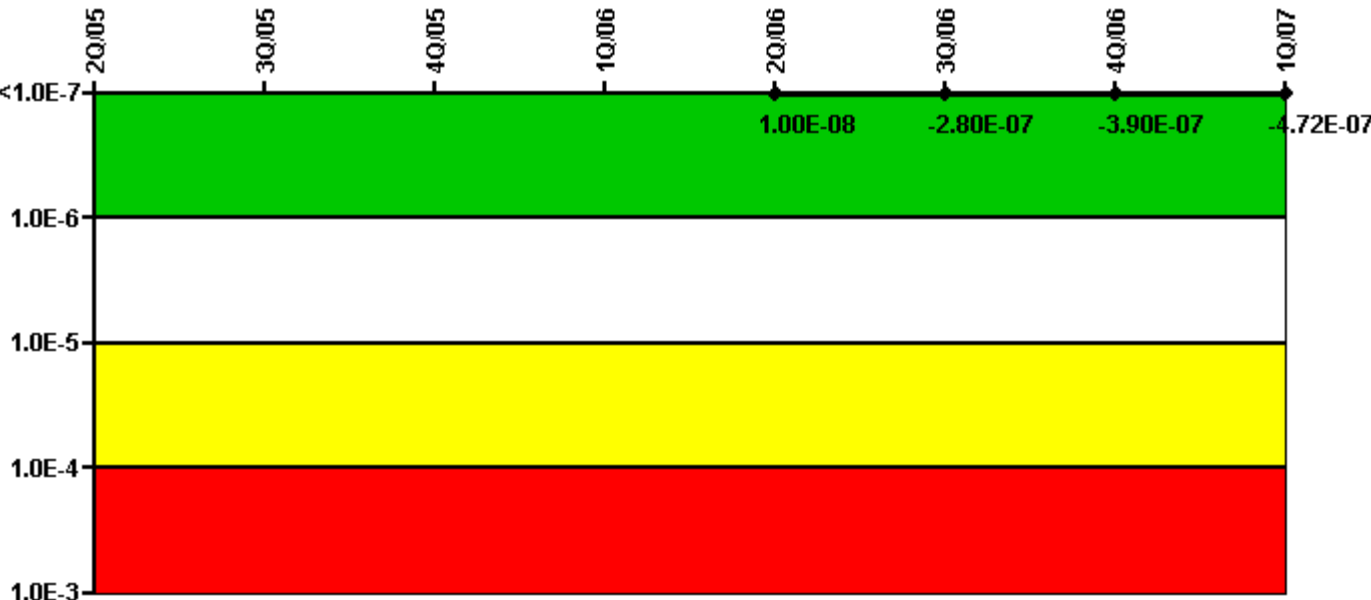


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
UAI (ΔCDF)					4.30E-07	1.50E-07	4.00E-08	-3.20E-08
URI (ΔCDF)					-4.20E-07	-4.30E-07	-4.30E-07	-4.40E-07
PLE					NO	NO	NO	NO
Indicator value					1.00E-08	-2.80E-07	-3.90E-07	-4.72E-07

Licensee Comments: none

Reactor Coolant System Activity

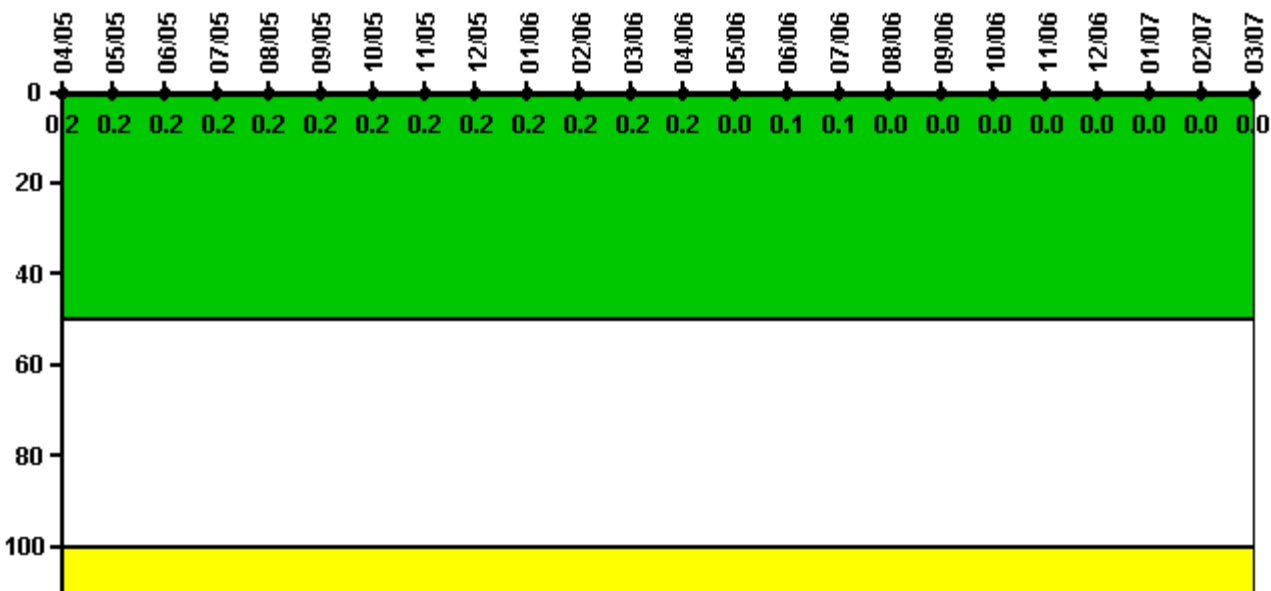

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	4/05	5/05	6/05	7/05	8/05	9/05	10/05	11/05	12/05	1/06	2/06	3/06
Maximum activity	0.000357	0.000410	0.000400	0.000437	0.000402	0.000384	0.000392	0.000389	0.000371	0.000479	0.000382	0.000405
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2

Reactor Coolant System Activity	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07
Maximum activity	0.000393	0.000099	0.000232	0.000106	0.000051	0.000050	0.000048	0.000048	0.000046	0.000044	0.000050	0.000049
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.2	0	0.1	0.1	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

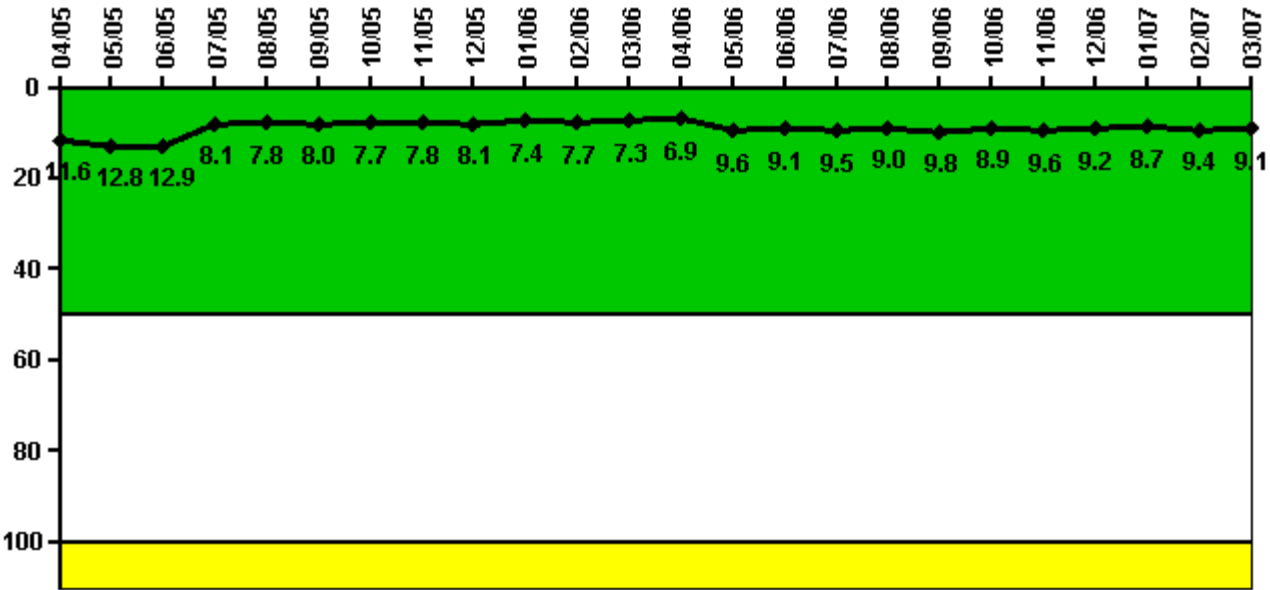


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	4/05	5/05	6/05	7/05	8/05	9/05	10/05	11/05	12/05	1/06	2/06	3/06
Maximum leakage	2.910	3.200	3.230	2.020	1.942	1.990	1.920	1.950	2.030	1.840	1.920	1.820
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	11.6	12.8	12.9	8.1	7.8	8.0	7.7	7.8	8.1	7.4	7.7	7.3
Reactor Coolant System Leakage	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07
Maximum leakage	1.720	2.400	2.277	2.370	2.260	2.440	2.220	2.410	2.300	2.177	2.350	2.270
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	6.9	9.6	9.1	9.5	9.0	9.8	8.9	9.6	9.2	8.7	9.4	9.1

Licensee Comments: none

Drill/Exercise Performance

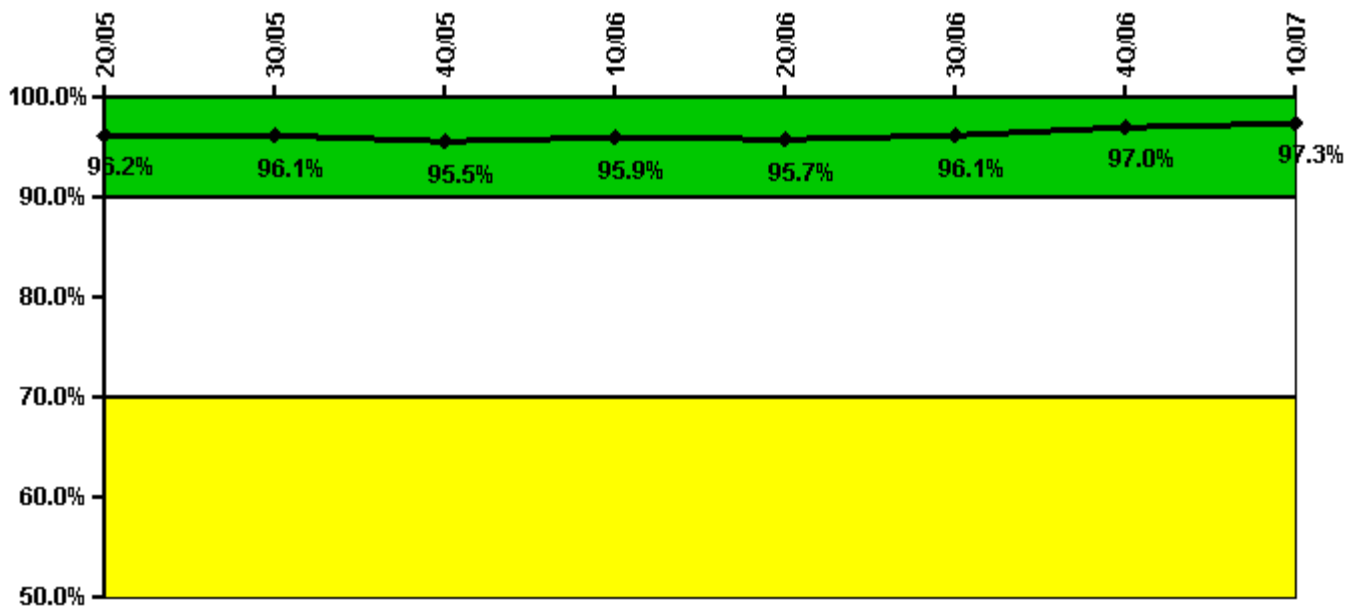


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Successful opportunities	7.0	14.0	65.0	75.0	36.0	54.0	88.0	24.0
Total opportunities	8.0	14.0	68.0	76.0	38.0	54.0	91.0	24.0
Indicator value	96.2%	96.1%	95.5%	95.9%	95.7%	96.1%	97.0%	97.3%

Licensee Comments: none

ERO Drill Participation

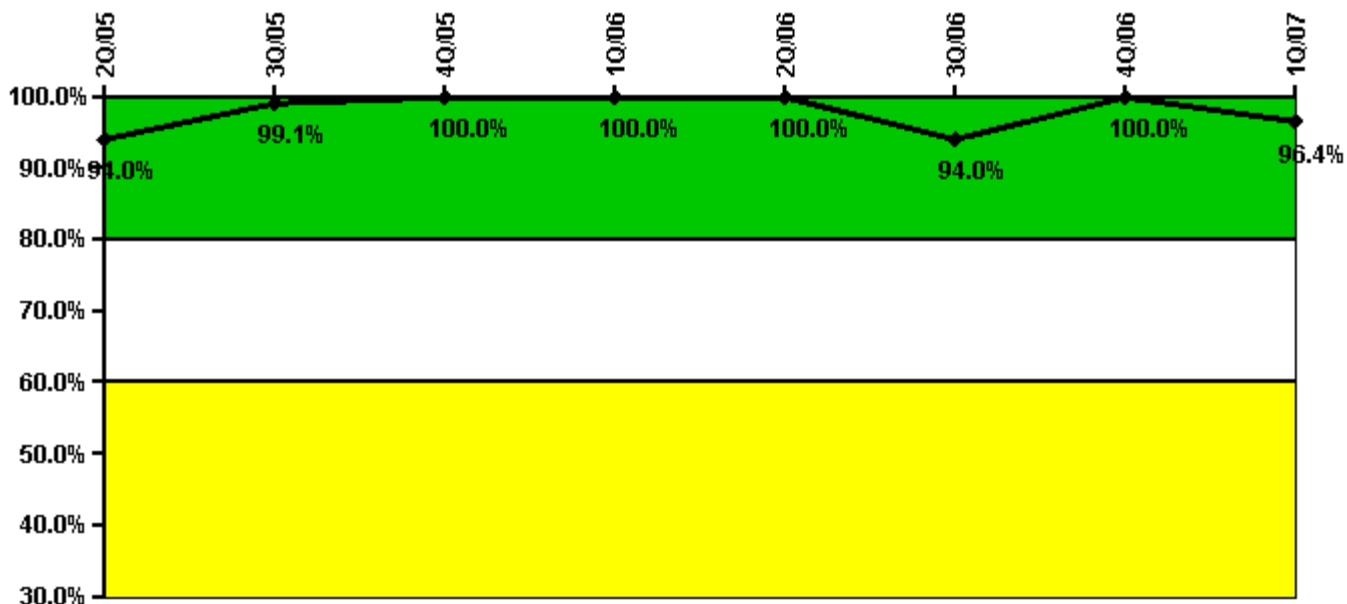


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Participating Key personnel	110.0	116.0	108.0	111.0	107.0	110.0	112.0	106.0
Total Key personnel	117.0	117.0	108.0	111.0	107.0	117.0	112.0	110.0
Indicator value	94.0%	99.1%	100.0%	100.0%	100.0%	94.0%	100.0%	96.4%

Licensee Comments: none

Alert & Notification System

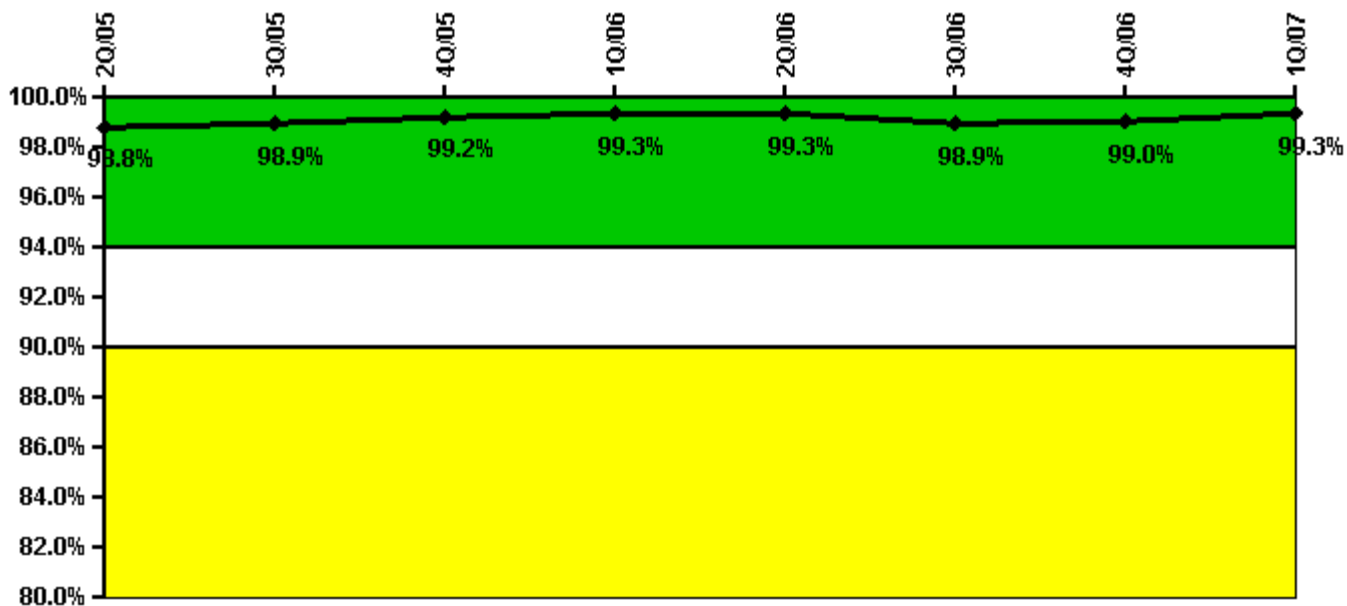


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
Successful siren-tests	496	493	493	492	496	485	496	497
Total sirens-tests	497	497	497	497	497	497	497	497
Indicator value	98.8%	98.9%	99.2%	99.3%	99.3%	98.9%	99.0%	99.3%

Licensee Comments: none

Occupational Exposure Control Effectiveness

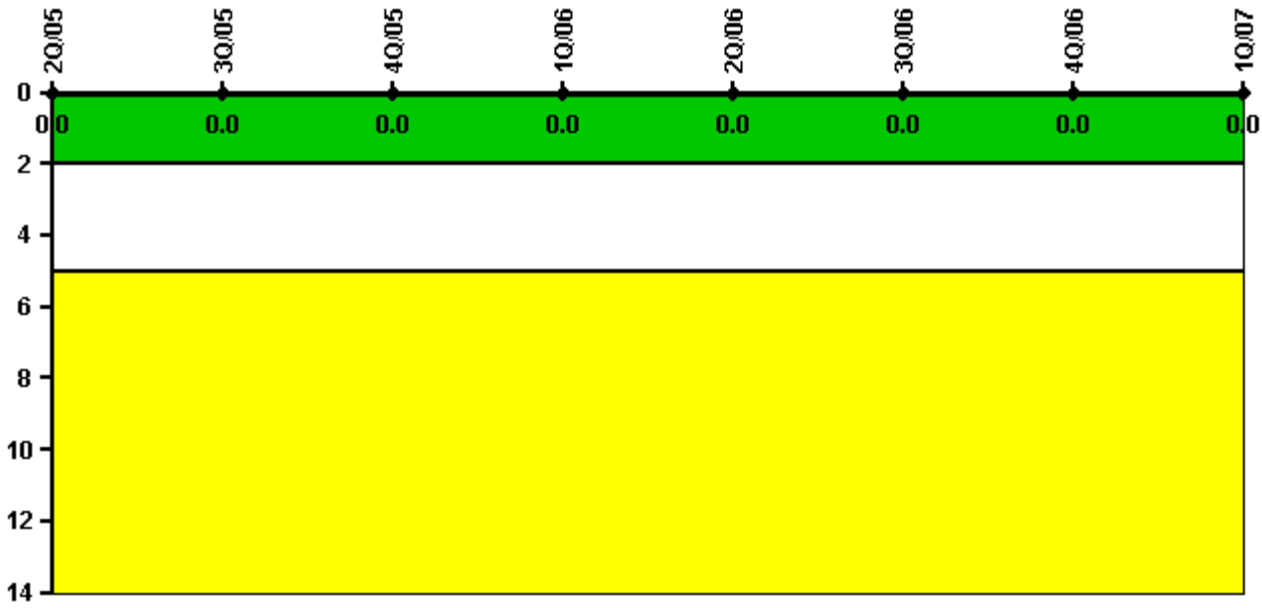


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

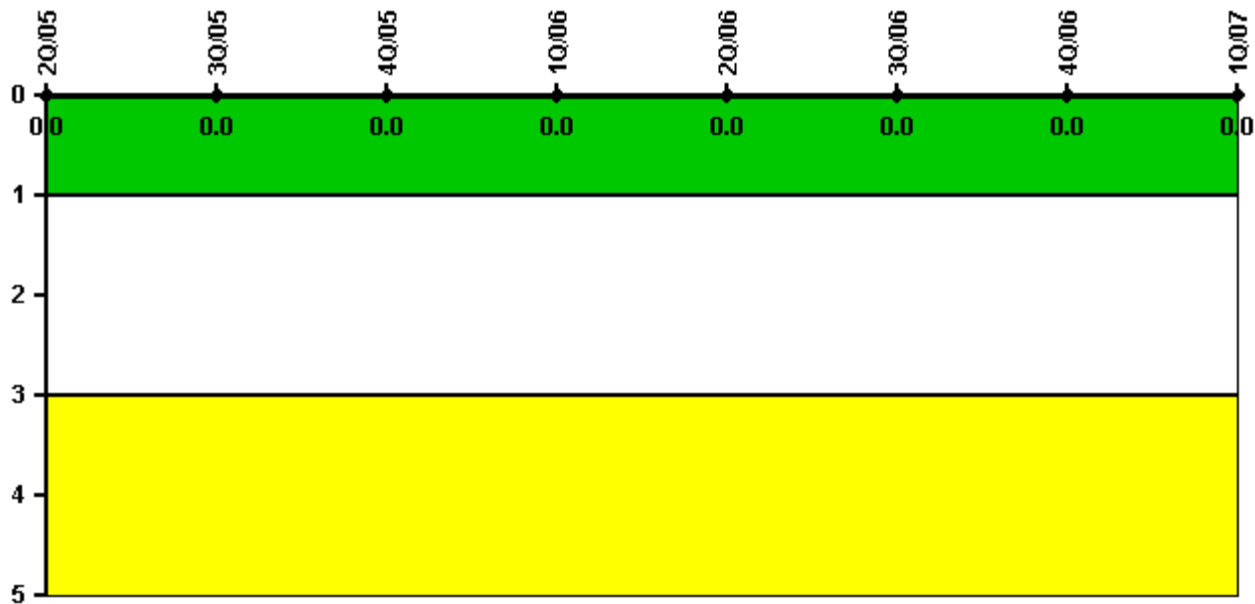

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/05	3Q/05	4Q/05	1Q/06	2Q/06	3Q/06	4Q/06	1Q/07
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: June 1, 2007