


Columbia Generating Station

1Q/2008 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

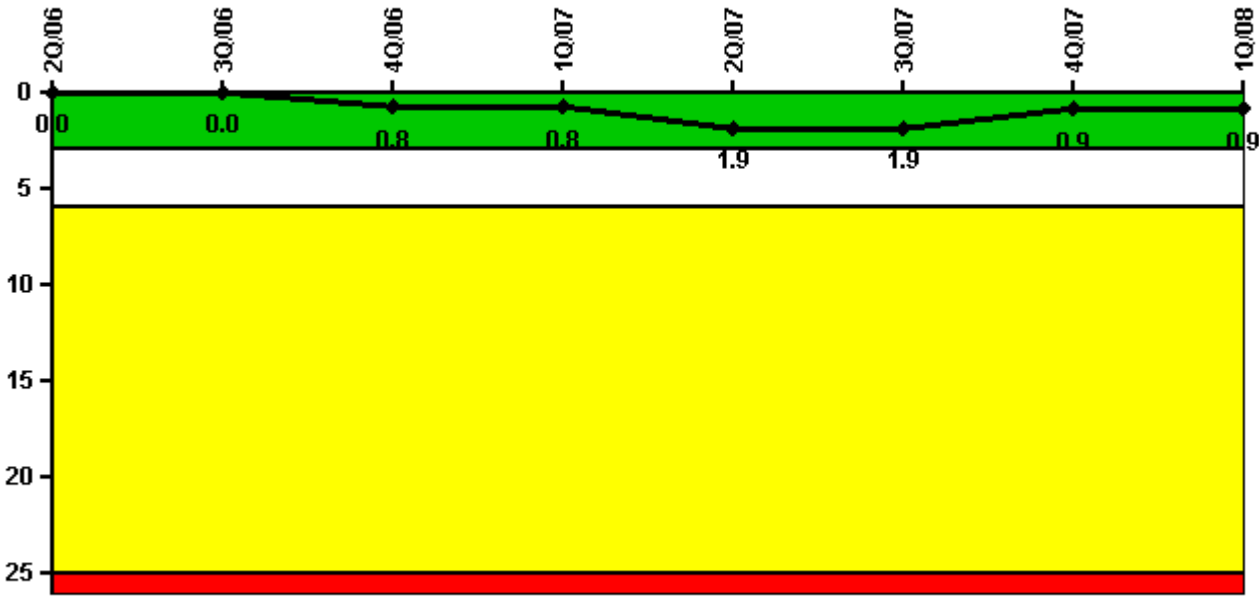


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
Unplanned scrams	0	0	1.0	0	1.0	0	0	0
Critical hours	2183.0	2208.0	2048.1	2159.0	1060.4	2208.0	2209.0	2183.0
Indicator value	0	0	0.8	0.8	1.9	1.9	0.9	0.9

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

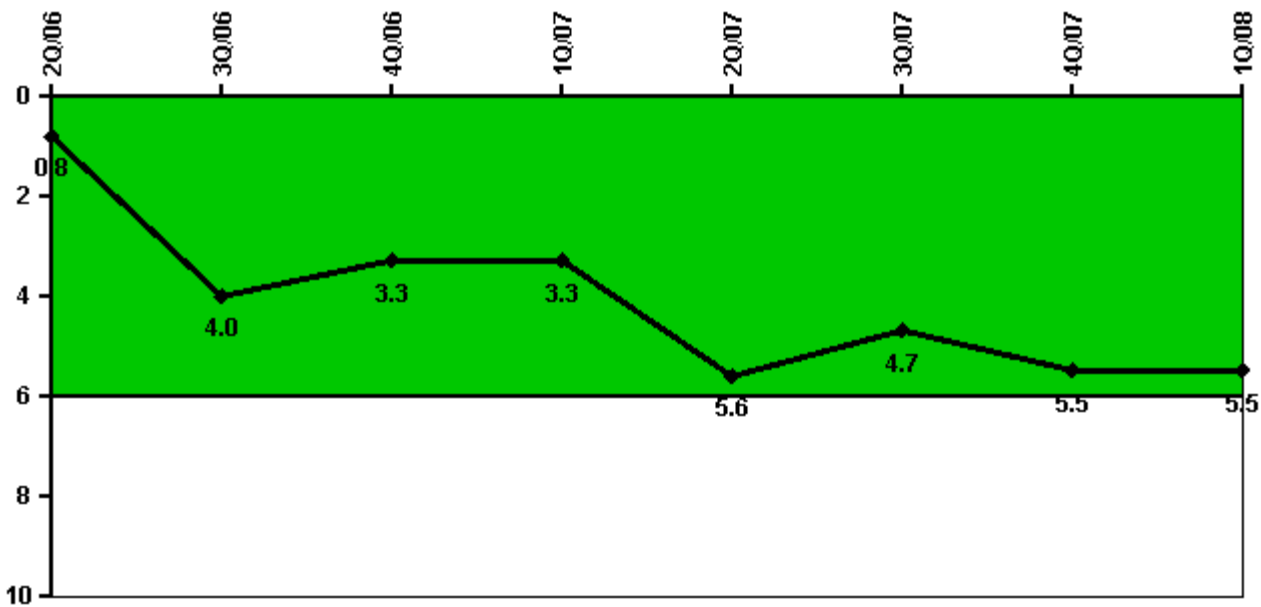

Thresholds: White > 6.0


Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
Unplanned power changes	0	4.0	0	0	2.0	3.0	1.0	0
Critical hours	2183.0	2208.0	2048.1	2159.0	1060.4	2208.0	2209.0	2183.0
Indicator value	0.8	4.0	3.3	3.3	5.6	4.7	5.5	5.5

Licensee Comments:

1Q/08: FAQ number 80.1 has been submitted regarding an event that occurred March 22 (power was reduced to ~81% due to the RFP B experiencing significant speed excursion. Reactor power returned to 100% on March 23). Columbia Generating Station is not reporting this event under this performance indicator per NEI 99-02; page E-1, lines 43-47 (If the licensee has reasonable confidence that its position will be accepted, it is under no obligation to report the information).

Unplanned Scrams with Complications

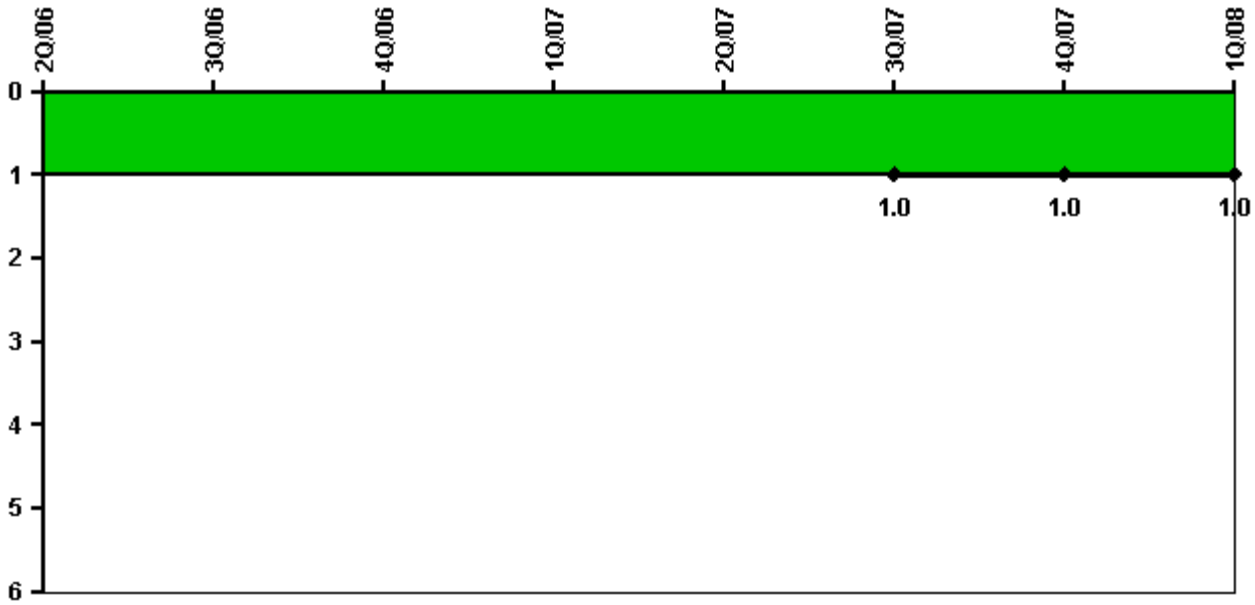


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
Scrams with complications			0	0	1.0	0	0	0
Indicator value						1.0	1.0	1.0

Licensee Comments: none

Safety System Functional Failures (BWR)

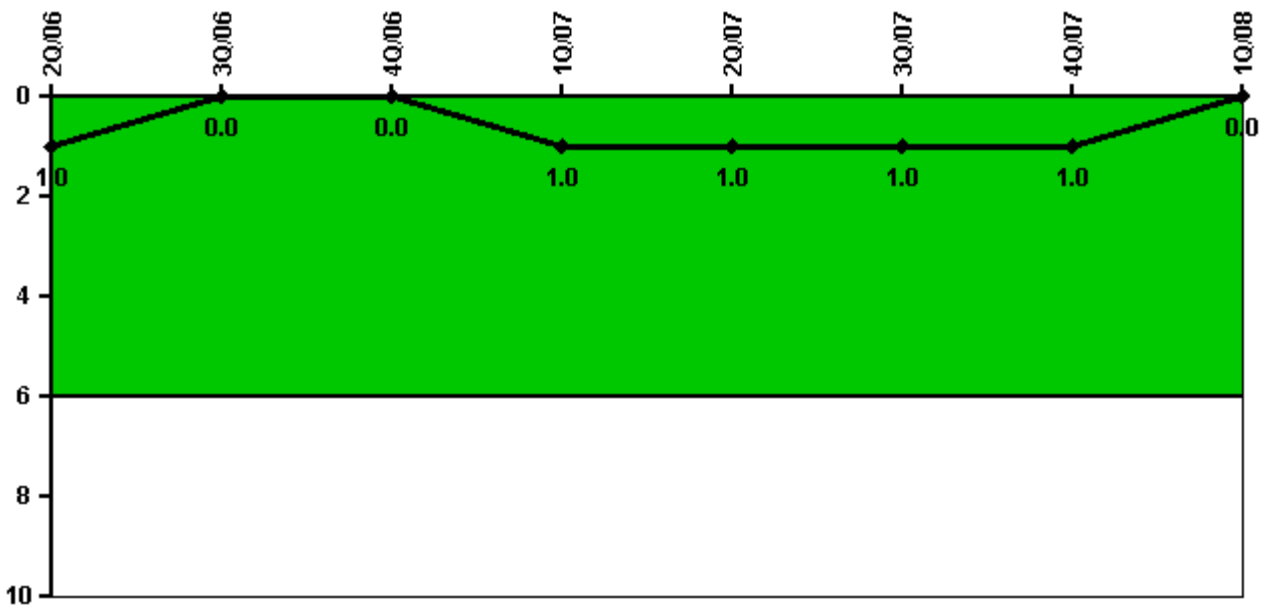


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
Safety System Functional Failures	0	0	0	1	0	0	0	0
Indicator value	1	0	0	1	1	1	1	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

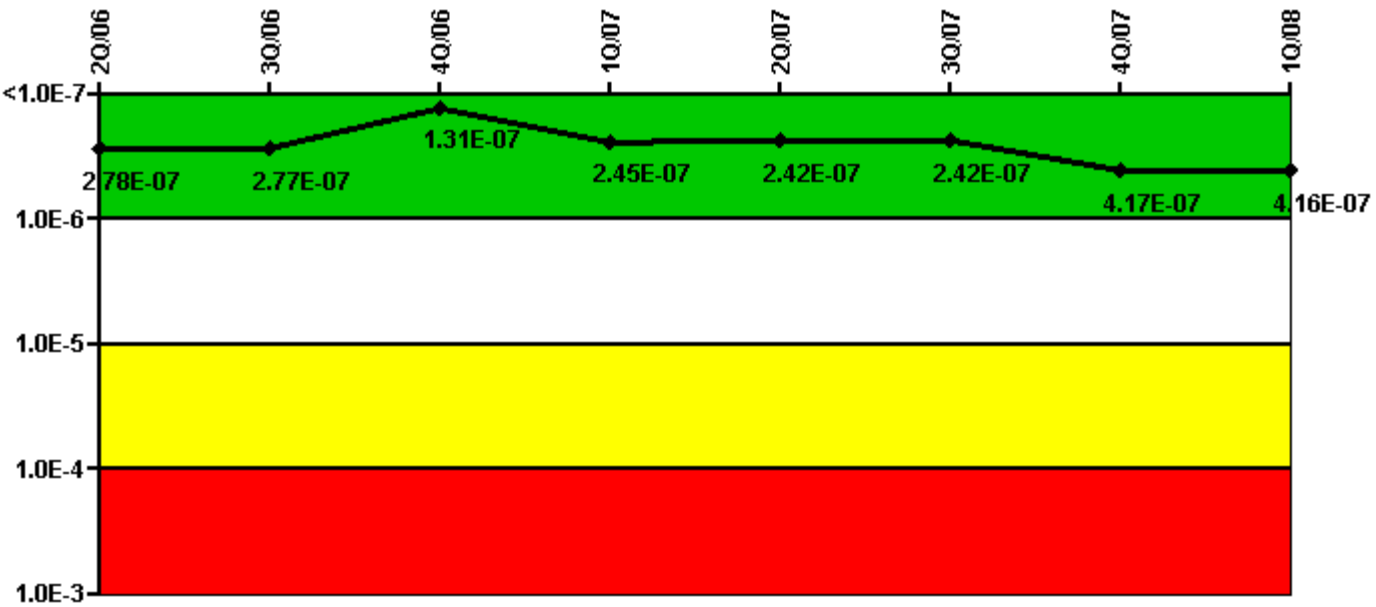


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
UAI (Δ CDF)	1.80E-08	1.70E-08	1.10E-08	1.50E-08	1.20E-08	1.20E-08	3.70E-08	3.60E-08
URI (Δ CDF)	2.60E-07	2.60E-07	1.20E-07	2.30E-07	2.30E-07	2.30E-07	3.80E-07	3.80E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.78E-07	2.77E-07	1.31E-07	2.45E-07	2.42E-07	2.42E-07	4.17E-07	4.16E-07

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

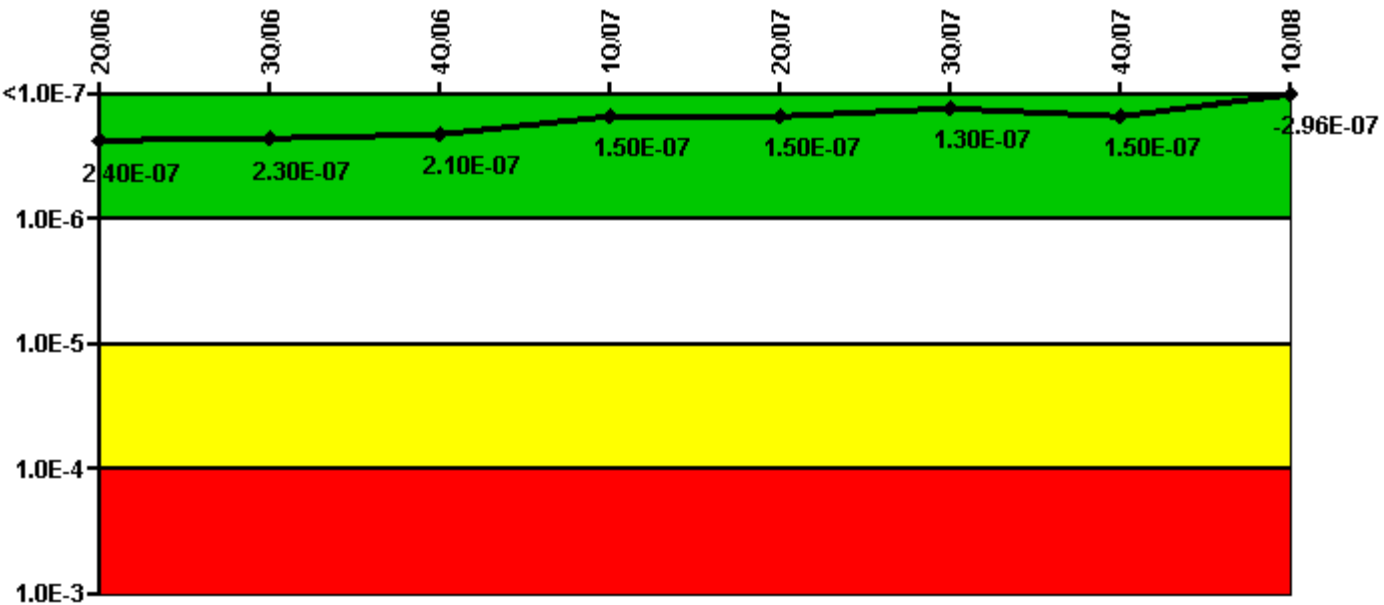


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
UAI (Δ CDF)	5.40E-07	5.30E-07	5.10E-07	4.50E-07	4.60E-07	4.40E-07	4.60E-07	1.40E-08
URI (Δ CDF)	-3.00E-07	-3.00E-07	-3.00E-07	-3.00E-07	-3.10E-07	-3.10E-07	-3.10E-07	-3.10E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	2.40E-07	2.30E-07	2.10E-07	1.50E-07	1.50E-07	1.30E-07	1.50E-07	-2.96E-07

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

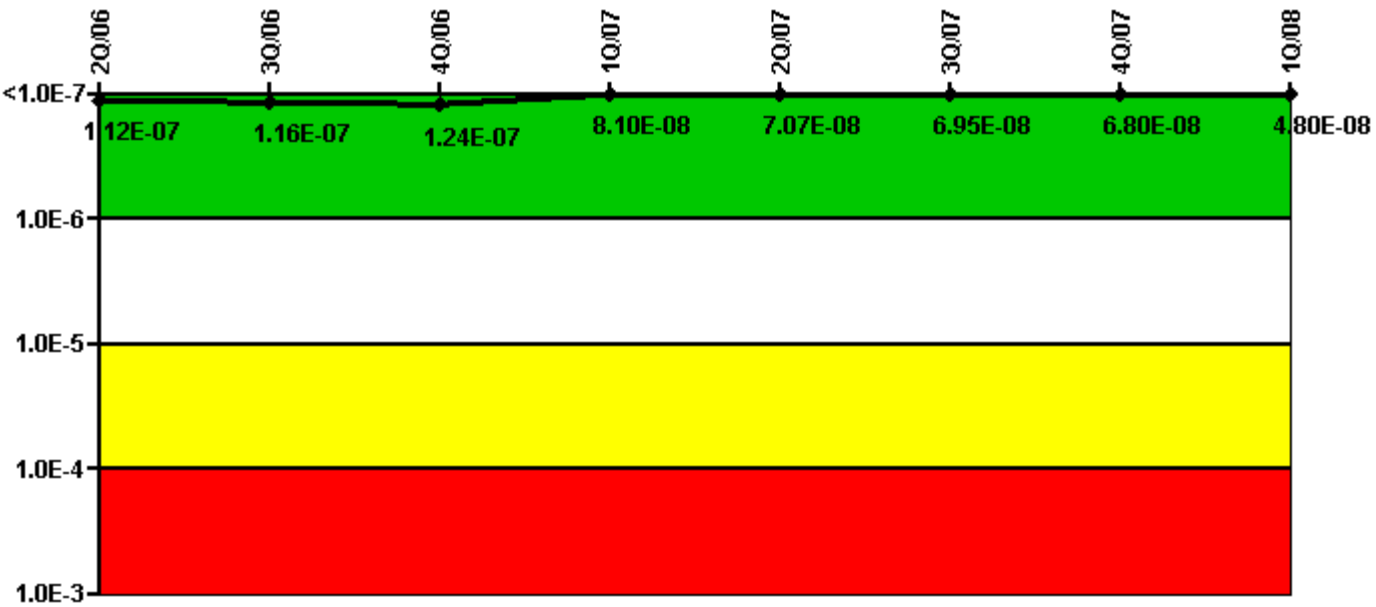


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
UAI (Δ CDF)	-2.80E-08	-2.40E-08	-1.60E-08	-1.40E-08	-8.30E-09	-9.50E-09	-1.10E-08	-2.60E-08
URI (Δ CDF)	1.40E-07	1.40E-07	1.40E-07	9.50E-08	7.90E-08	7.90E-08	7.90E-08	7.40E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.12E-07	1.16E-07	1.24E-07	8.10E-08	7.07E-08	6.95E-08	6.80E-08	4.80E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

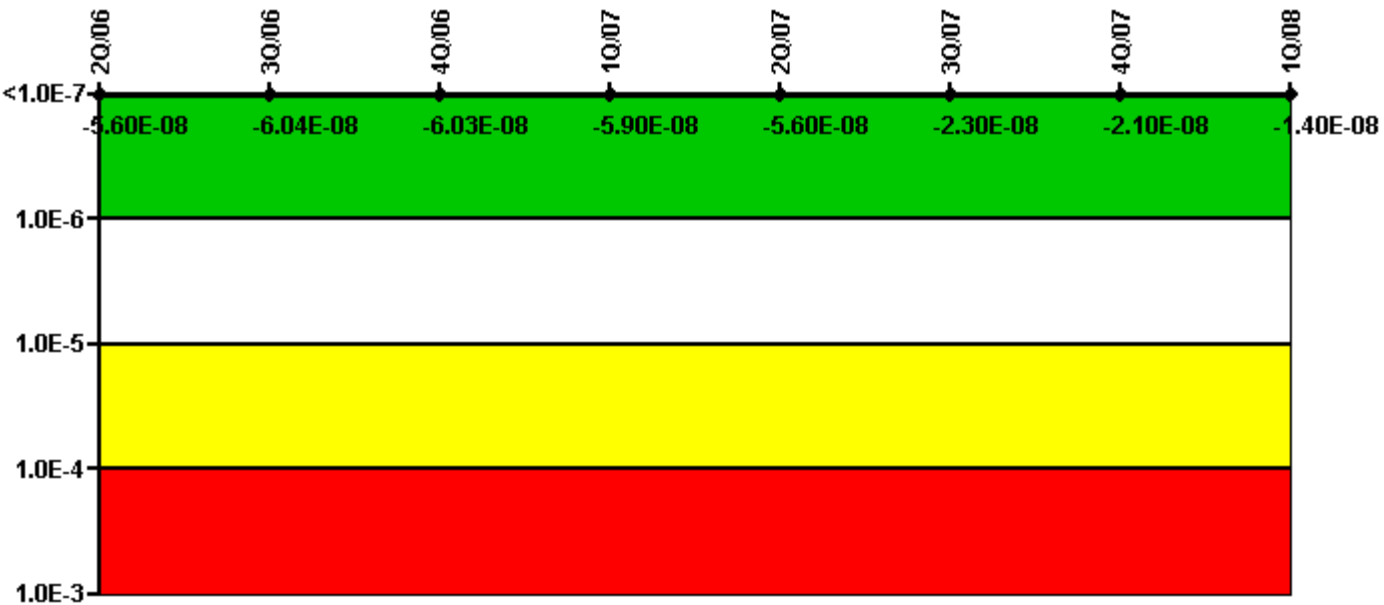


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
UAI (Δ CDF)	1.40E-08	9.60E-09	9.70E-09	1.10E-08	1.40E-08	1.30E-08	1.50E-08	2.20E-08
URI (Δ CDF)	-7.00E-08	-7.00E-08	-7.00E-08	-7.00E-08	-7.00E-08	-3.60E-08	-3.60E-08	-3.60E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-5.60E-08	-6.04E-08	-6.03E-08	-5.90E-08	-5.60E-08	-2.30E-08	-2.10E-08	-1.40E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

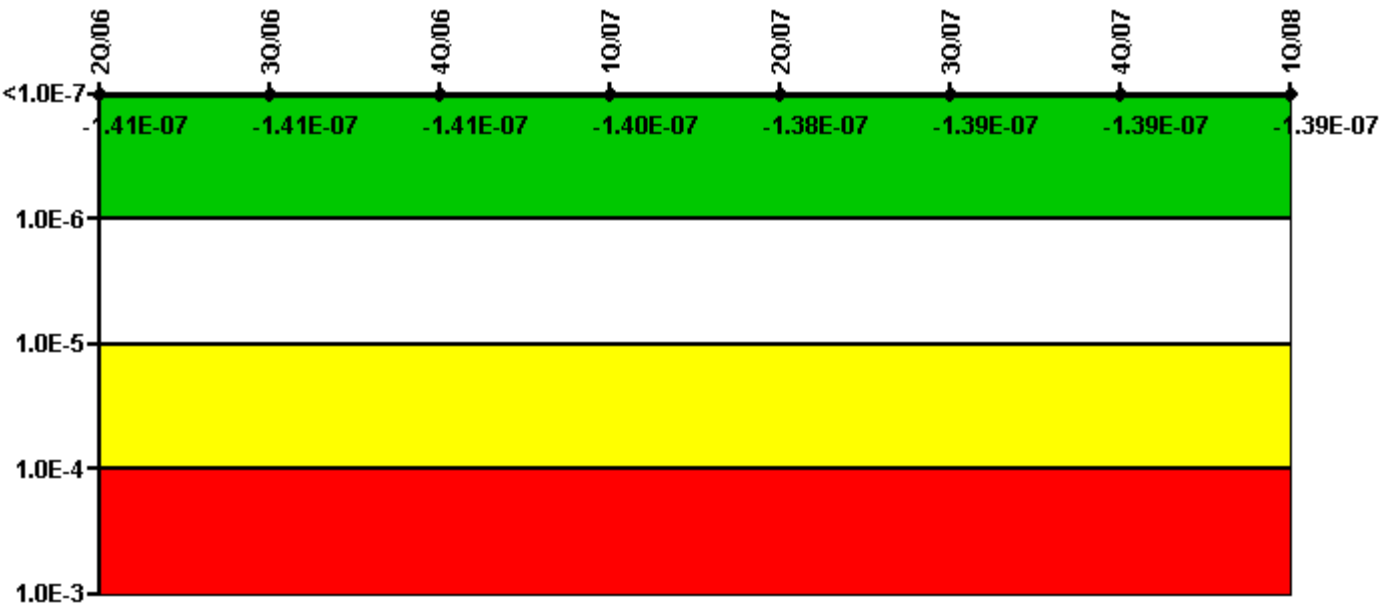


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
UAI (Δ CDF)	1.90E-08	1.90E-08	1.90E-08	2.00E-08	2.20E-08	2.10E-08	2.10E-08	2.10E-08
URI (Δ CDF)	-1.60E-07	-1.60E-07	-1.60E-07	-1.60E-07	-1.60E-07	-1.60E-07	-1.60E-07	-1.60E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-1.41E-07	-1.41E-07	-1.41E-07	-1.40E-07	-1.38E-07	-1.39E-07	-1.39E-07	-1.39E-07

Licensee Comments: none

Reactor Coolant System Activity

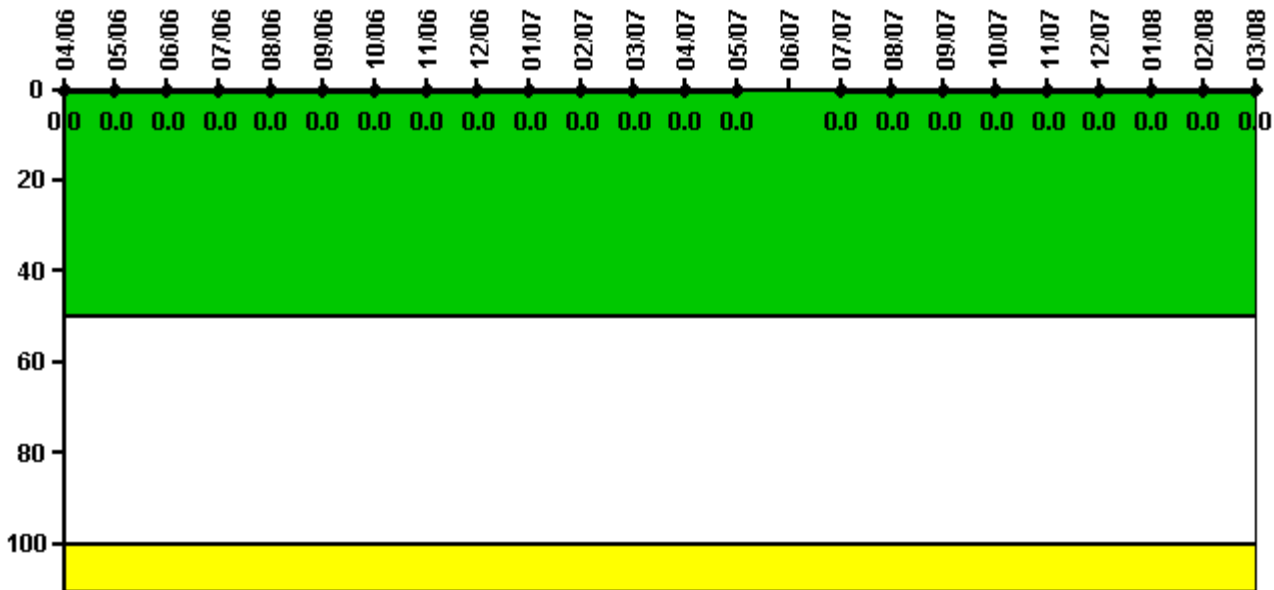


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07
Maximum activity	0.000003	0.000003	0.000003	0.000003	0.000003	0.000003	0.000005	0.000004	0.000003	0.000004	0.000005	0.000004
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08
Maximum activity	0.000005	0.000005	N/A	0.000007	0.000008	0.000007	0.000007	0.000006	0.000006	0.000005	0.000005	0.000004
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	N/A	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

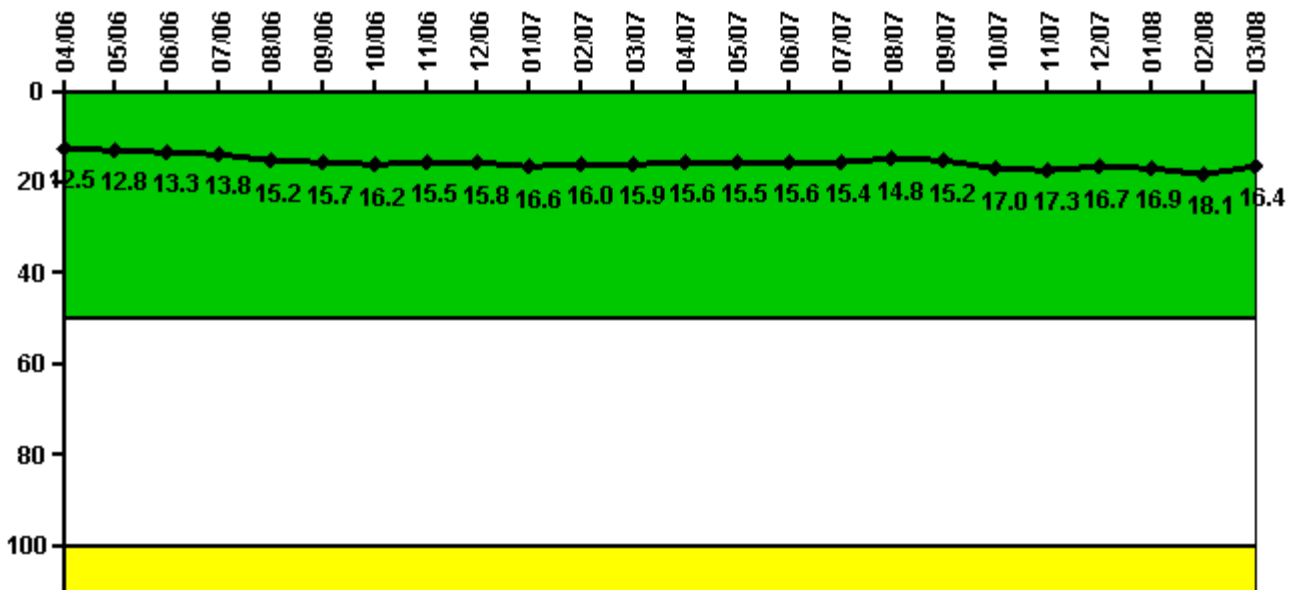

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Leakage	4/06	5/06	6/06	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07
Maximum leakage	3.120	3.210	3.330	3.450	3.810	3.930	4.060	3.870	3.960	4.140	4.010	3.970
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	12.5	12.8	13.3	13.8	15.2	15.7	16.2	15.5	15.8	16.6	16.0	15.9

Reactor Coolant System Leakage	4/07	5/07	6/07	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08
Maximum leakage	3.910	3.880	3.890	3.860	3.700	3.810	4.240	4.330	4.170	4.220	4.530	4.100
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	15.6	15.5	15.6	15.4	14.8	15.2	17.0	17.3	16.7	16.9	18.1	16.4

Licensee Comments: none

Drill/Exercise Performance

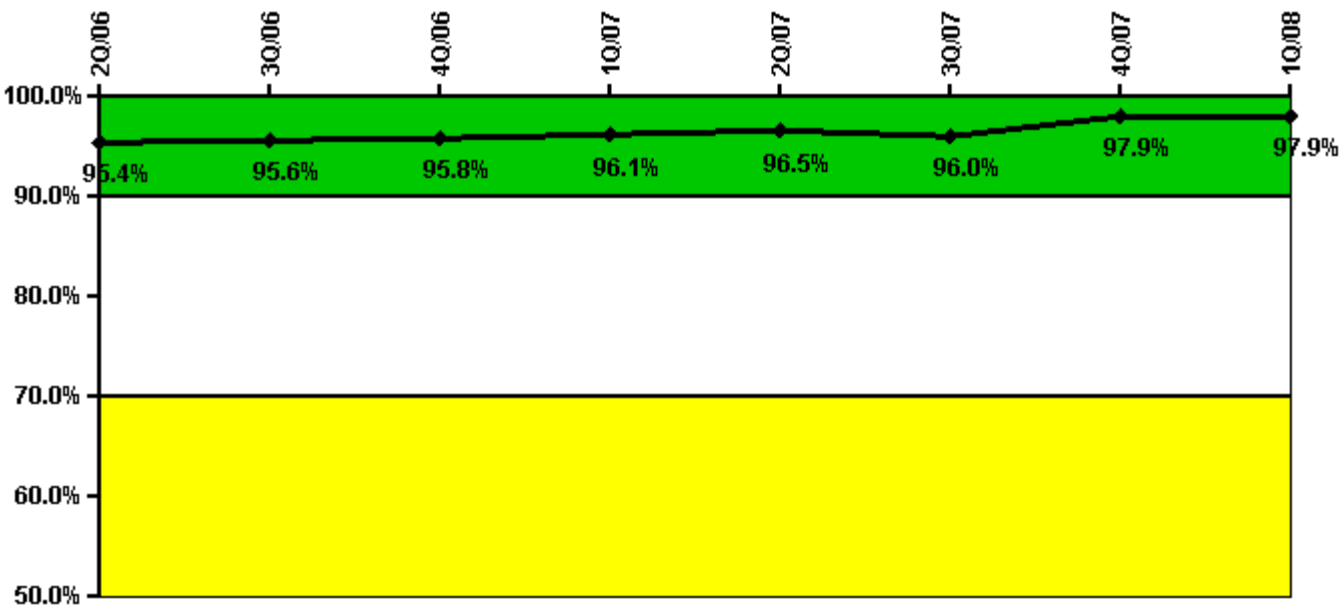


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
Successful opportunities	41.0	39.0	51.0	37.0	8.0	11.0	53.0	42.0
Total opportunities	43.0	41.0	51.0	37.0	8.0	12.0	54.0	42.0
Indicator value	95.4%	95.6%	95.8%	96.1%	96.5%	96.0%	97.9%	97.9%

Licensee Comments: none

ERO Drill Participation

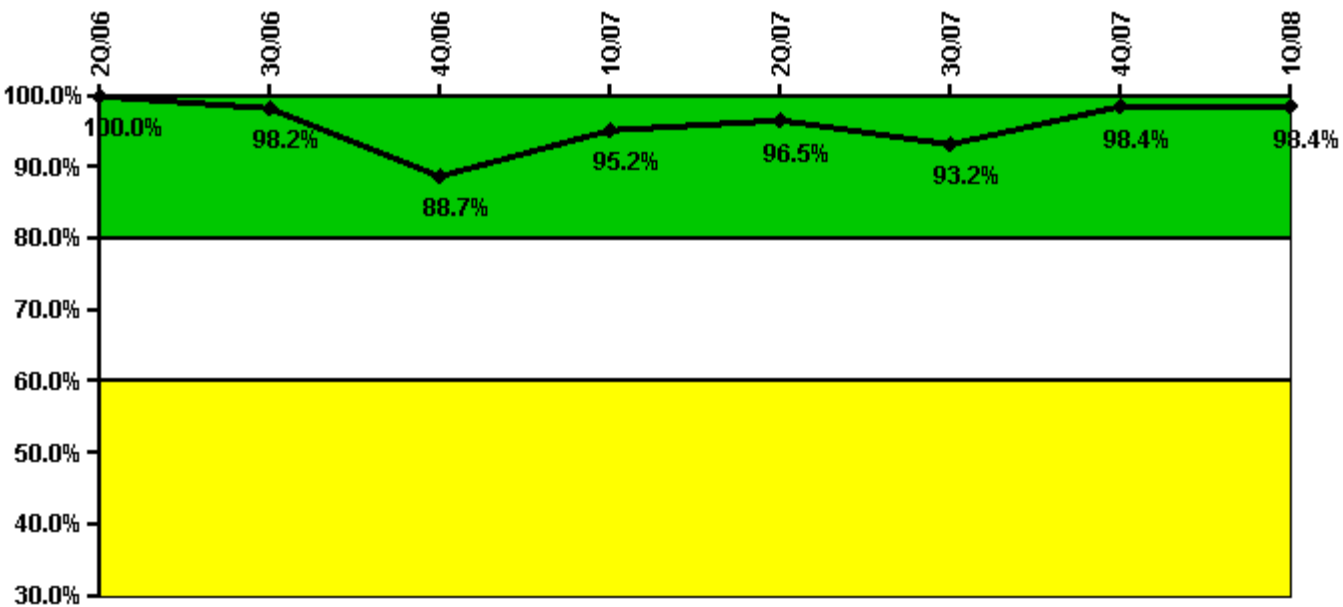


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
Participating Key personnel	59.0	56.0	55.0	60.0	55.0	55.0	60.0	62.0
Total Key personnel	59.0	57.0	62.0	63.0	57.0	59.0	61.0	63.0
Indicator value	100.0%	98.2%	88.7%	95.2%	96.5%	93.2%	98.4%	98.4%

Licensee Comments: none

Alert & Notification System

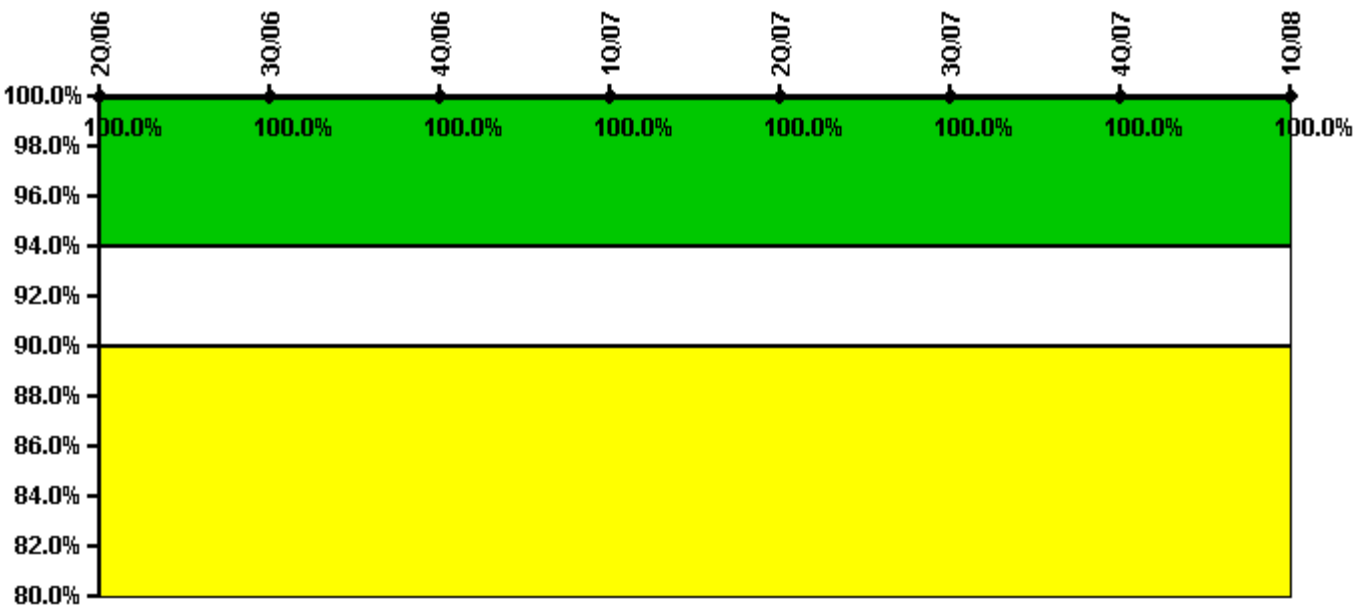


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
Successful siren-tests	143	143	165	143	143	143	154	143
Total sirens-tests	143	143	165	143	143	143	154	143
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Occupational Exposure Control Effectiveness

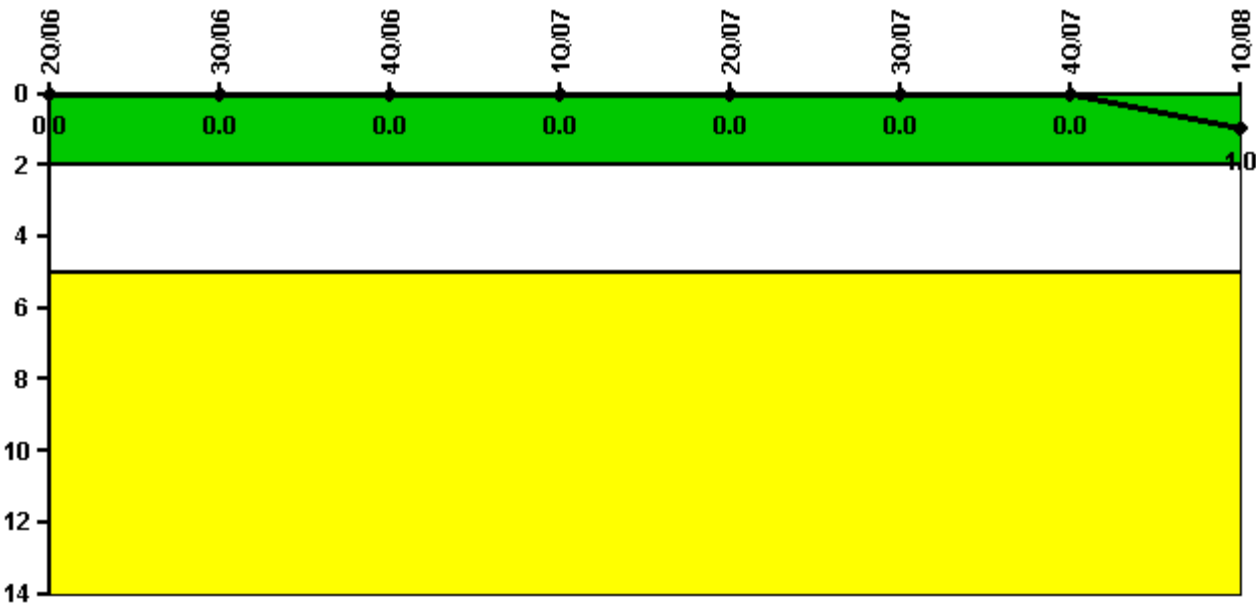

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
High radiation area occurrences	0	0	0	0	0	0	0	1
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	1

Licensee Comments: none

RETS/ODCM Radiological Effluent



Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/06	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: April 30, 2008