


Nine Mile Point 1

2Q/2008 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

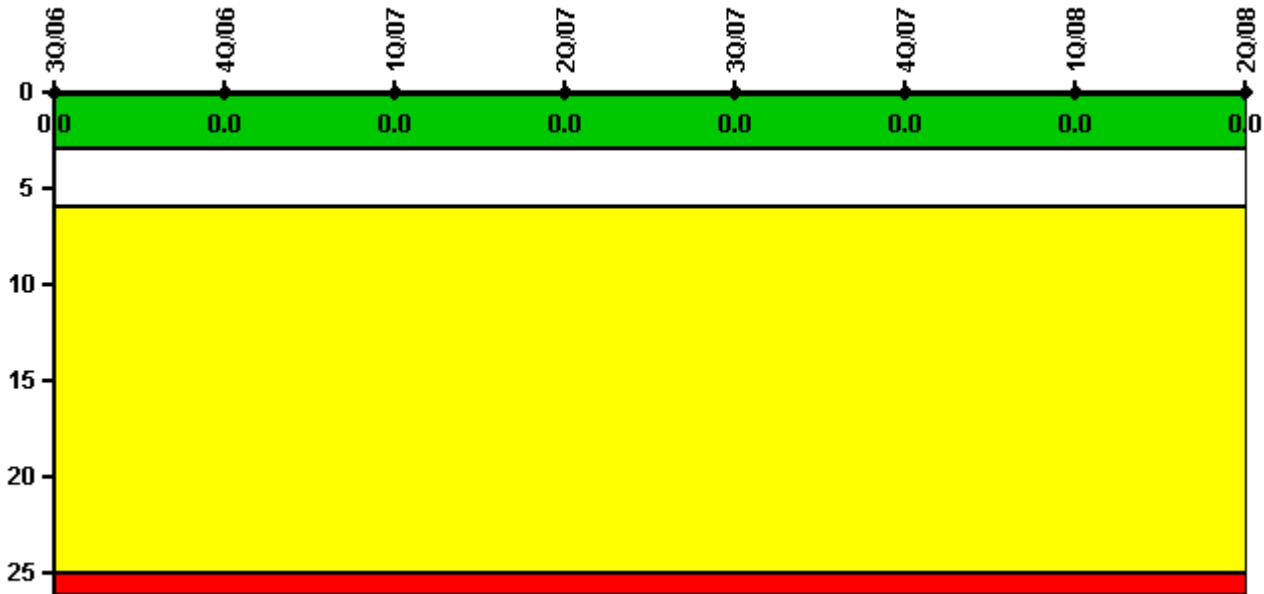


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2208.0	2209.0	1801.6	1740.3	2208.0	2209.0	2183.0	2184.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

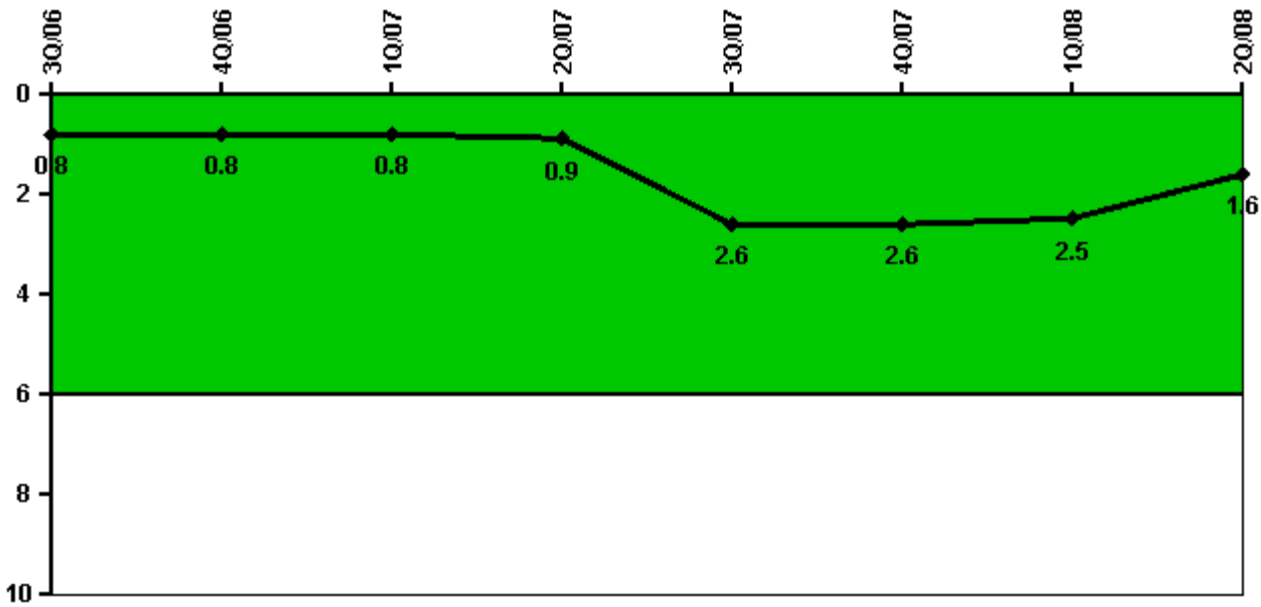


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
Unplanned power changes	0	0	0	1.0	2.0	0	0	0
Critical hours	2208.0	2209.0	1801.6	1740.3	2208.0	2209.0	2183.0	2184.0
Indicator value	0.8	0.8	0.8	0.9	2.6	2.6	2.5	1.6

Licensee Comments: none

Unplanned Scrams with Complications

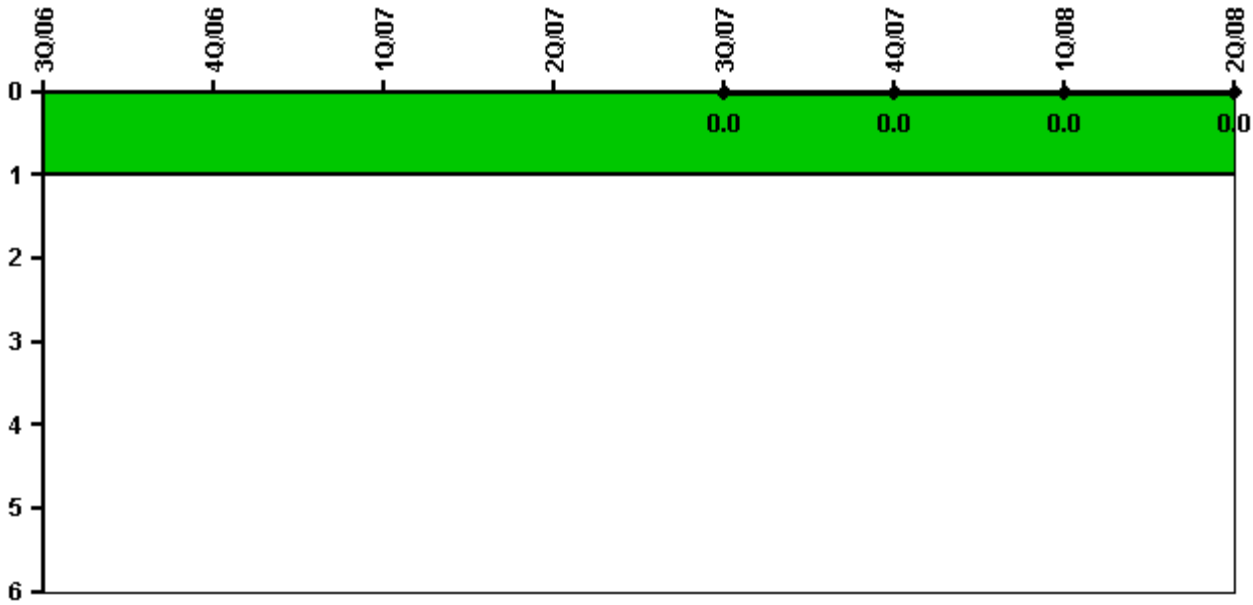


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
Scrams with complications		0	0	0	0	0	0	0
Indicator value					0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

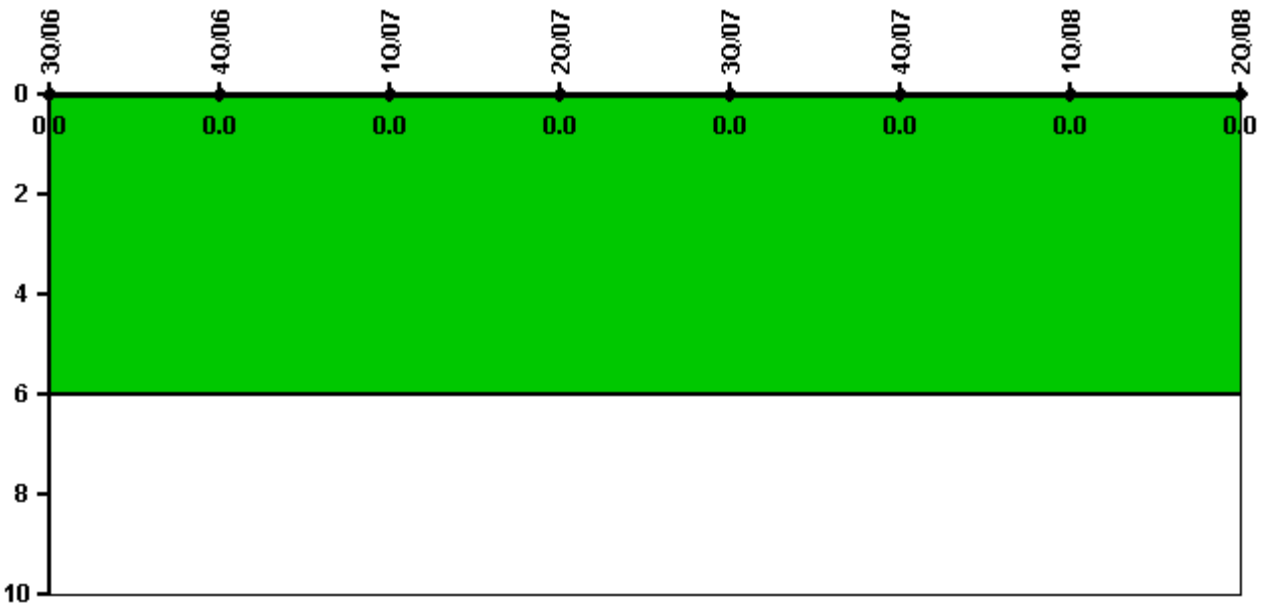


Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
Safety System Functional Failures	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Mitigating Systems Performance Index, Emergency AC Power System

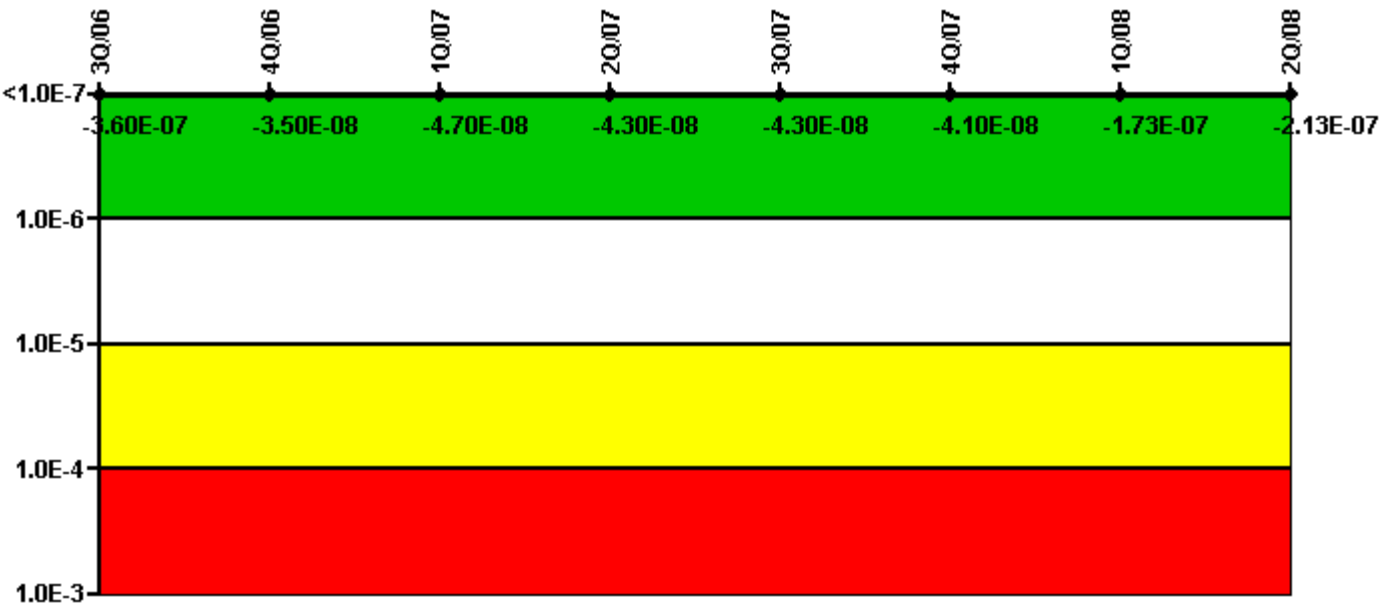


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
UAI (Δ CDF)	2.20E-07	4.40E-08	4.40E-08	4.50E-08	4.50E-08	4.50E-08	3.70E-08	-3.00E-09
URI (Δ CDF)	-5.80E-07	-7.90E-08	-9.10E-08	-8.80E-08	-8.80E-08	-8.60E-08	-2.10E-07	-2.10E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-3.60E-07	-3.50E-08	-4.70E-08	-4.30E-08	-4.30E-08	-4.10E-08	-1.73E-07	-2.13E-07

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

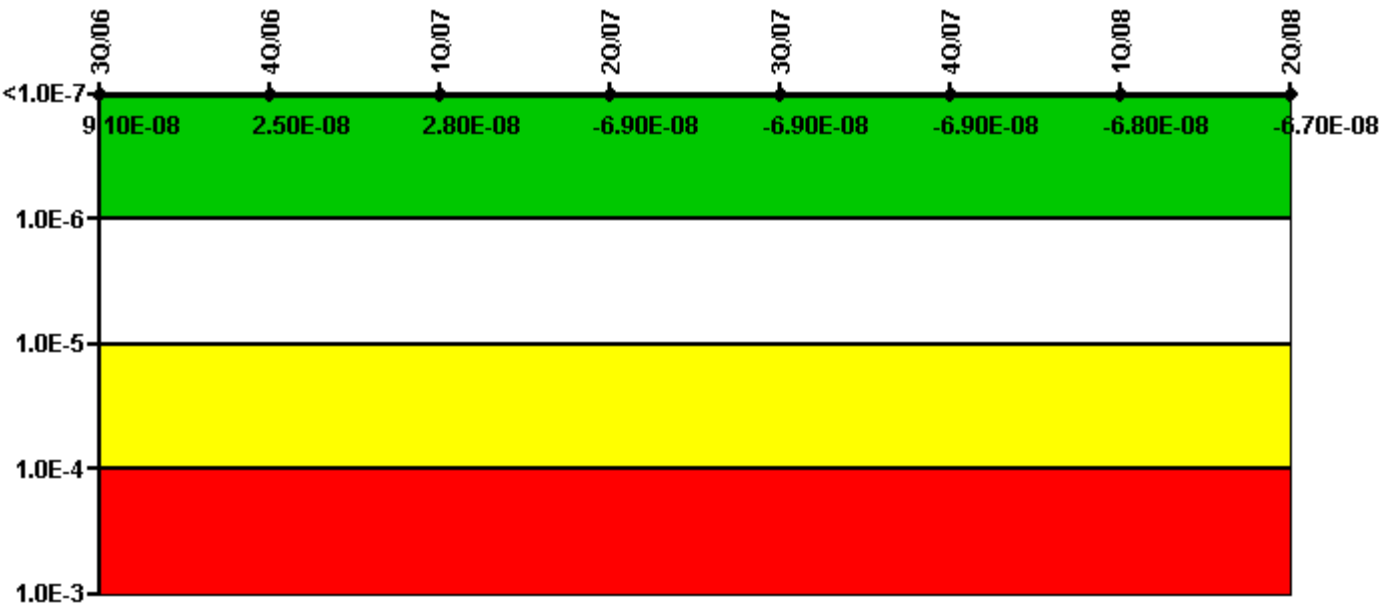


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
UAI (Δ CDF)	-3.90E-08	-4.10E-08	-4.10E-08	-5.20E-08	-5.20E-08	-5.20E-08	-5.20E-08	-5.30E-08
URI (Δ CDF)	1.30E-07	6.60E-08	6.90E-08	-1.70E-08	-1.70E-08	-1.70E-08	-1.60E-08	-1.40E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	9.10E-08	2.50E-08	2.80E-08	-6.90E-08	-6.90E-08	-6.90E-08	-6.80E-08	-6.70E-08

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

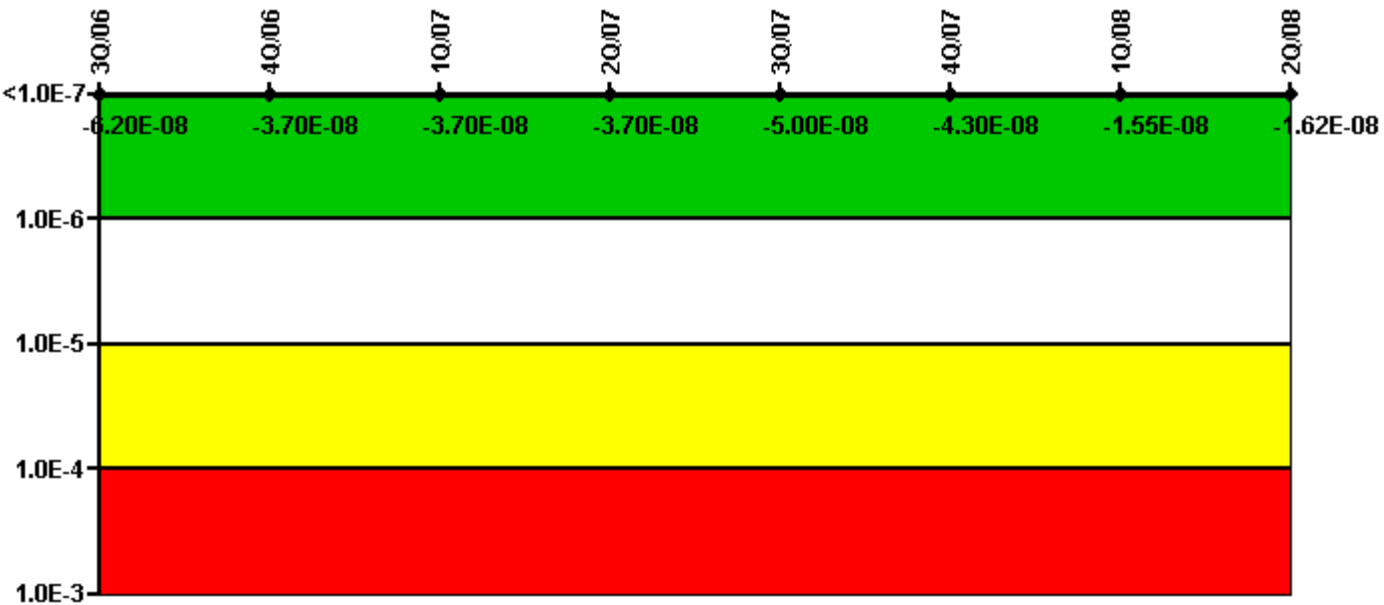


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
UAI (Δ CDF)	-4.10E-08	-2.50E-08	-2.40E-08	-2.40E-08	-3.70E-08	-3.00E-08	-2.50E-09	-4.20E-09
URI (Δ CDF)	-2.10E-08	-1.20E-08	-1.30E-08	-1.30E-08	-1.30E-08	-1.30E-08	-1.30E-08	-1.20E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-6.20E-08	-3.70E-08	-3.70E-08	-3.70E-08	-5.00E-08	-4.30E-08	-1.55E-08	-1.62E-08

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

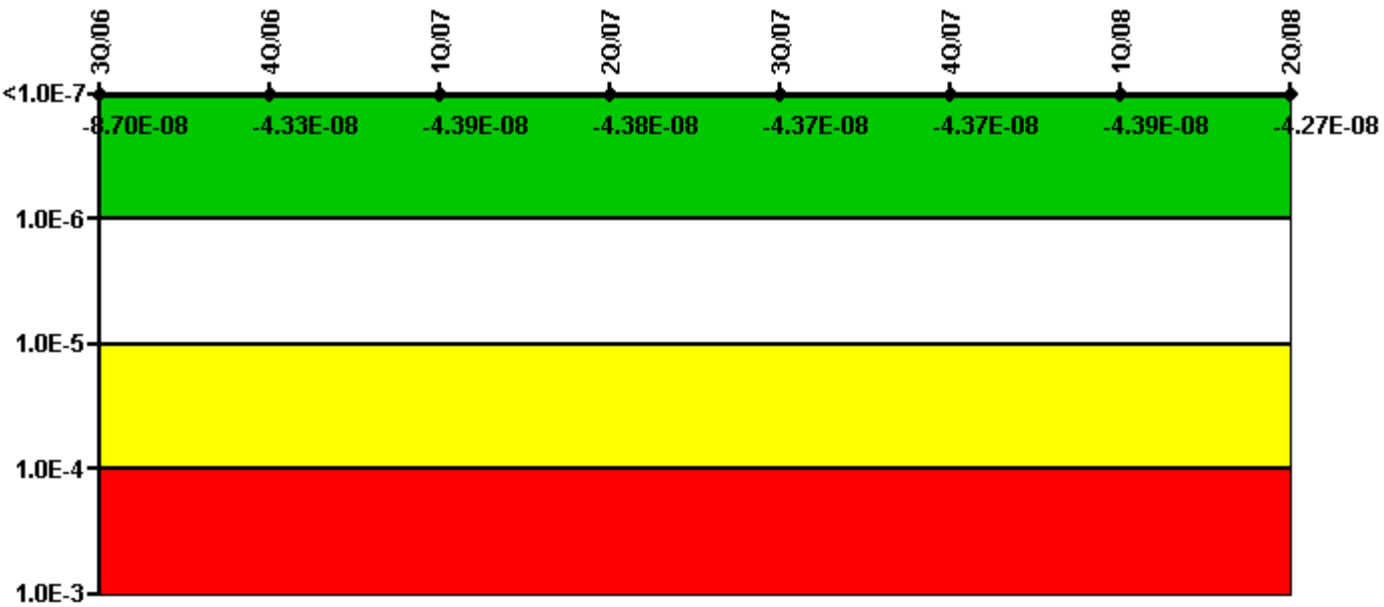


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
UAI (Δ CDF)	-7.40E-08	-3.50E-08	-3.50E-08	-3.50E-08	-3.50E-08	-3.50E-08	-3.50E-08	-3.50E-08
URI (Δ CDF)	-1.30E-08	-8.30E-09	-8.90E-09	-8.80E-09	-8.70E-09	-8.70E-09	-8.90E-09	-7.70E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-8.70E-08	-4.33E-08	-4.39E-08	-4.38E-08	-4.37E-08	-4.37E-08	-4.39E-08	-4.27E-08

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

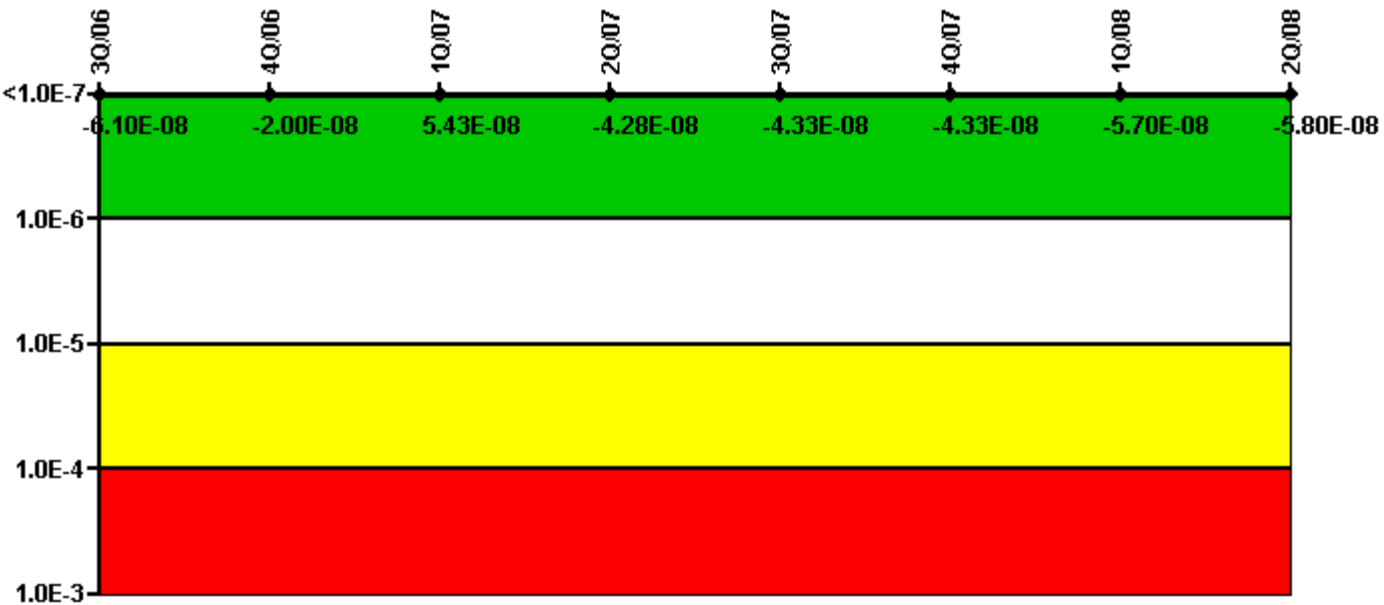


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
UAI (Δ CDF)	-1.30E-07	-7.20E-08	6.30E-09	-5.80E-09	-6.30E-09	-6.30E-09	-2.00E-08	-2.30E-08
URI (Δ CDF)	6.90E-08	5.20E-08	4.80E-08	-3.70E-08	-3.70E-08	-3.70E-08	-3.70E-08	-3.50E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-6.10E-08	-2.00E-08	5.43E-08	-4.28E-08	-4.33E-08	-4.33E-08	-5.70E-08	-5.80E-08

Licensee Comments: none

Reactor Coolant System Activity

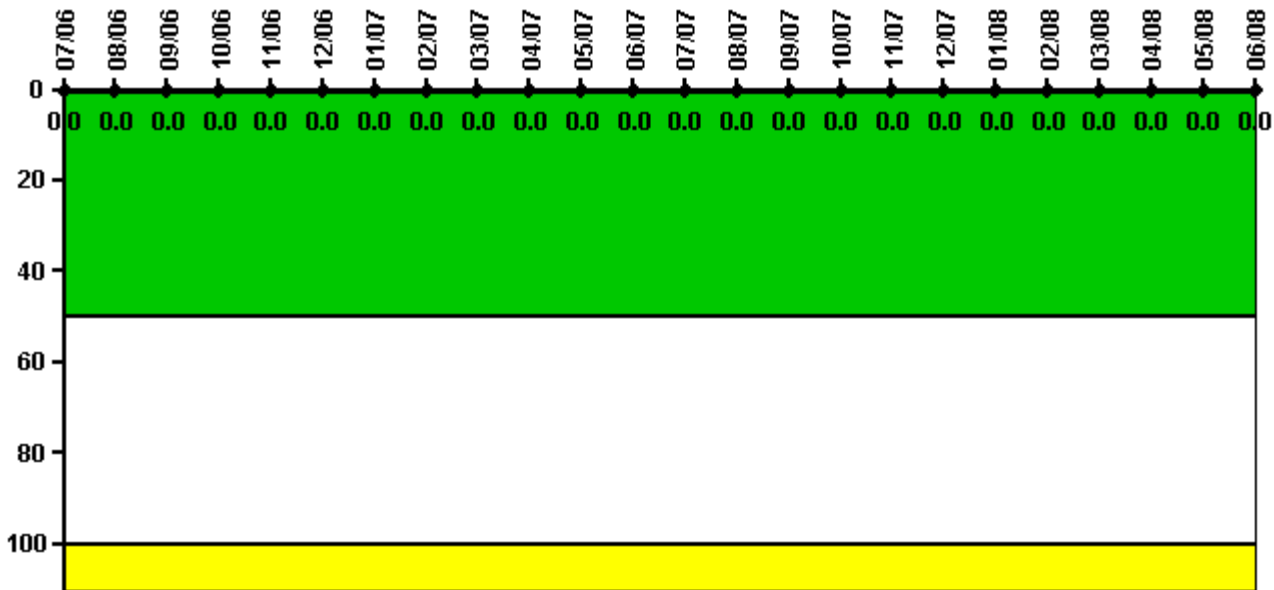

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07	4/07	5/07	6/07
Maximum activity	0.000067	0.000068	0.000071	0.000049	0.000065	0.000224	0.000117	0.000152	0.000080	0.000138	0.000069	0.000067
Technical specification limit	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0
Reactor Coolant System Activity	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08
Maximum activity	0.000053	0.000080	0.000147	0.000179	0.000156	0.000161	0.000172	0.000124	0.000177	0.000199	0.000012	0.000008
Technical specification limit	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5	9.5
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments:

6/08: In accordance with Technical Specification Amendment 194, beginning in May 2008 Nine Mile Point Unit 1 is reporting this indicator as Dose Equivalent Iodine.

Reactor Coolant System Leakage

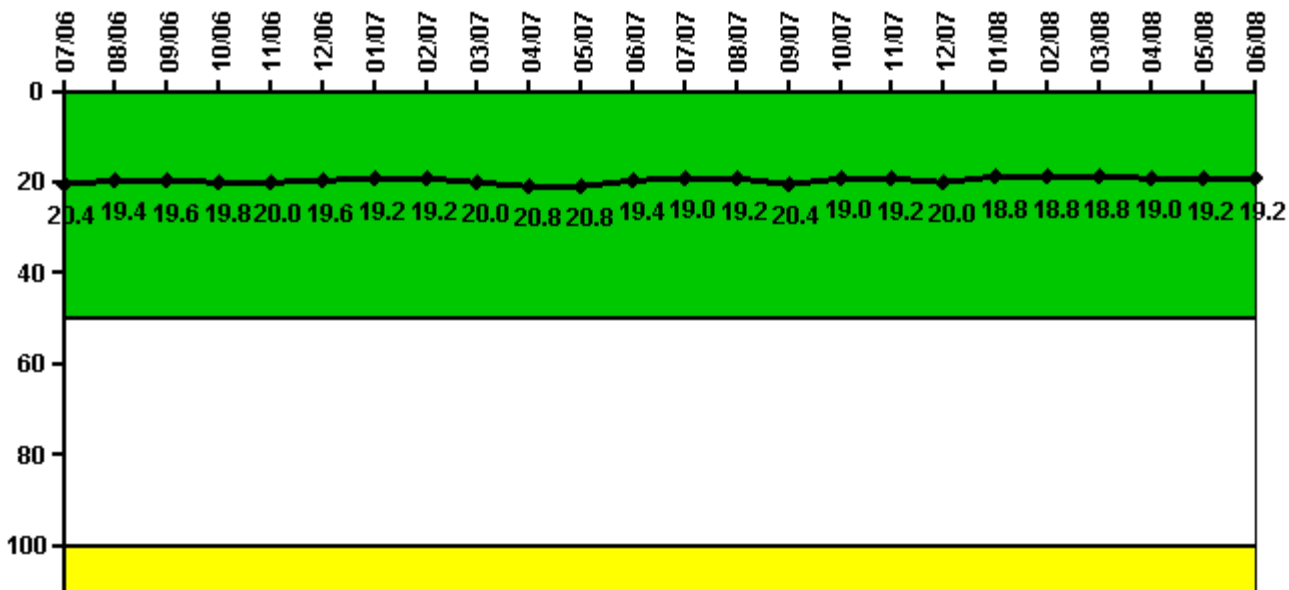


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/06	8/06	9/06	10/06	11/06	12/06	1/07	2/07	3/07	4/07	5/07	6/07
Maximum leakage	5.100	4.850	4.900	4.950	5.000	4.900	4.800	4.800	5.000	5.200	5.200	4.850
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	20.4	19.4	19.6	19.8	20.0	19.6	19.2	19.2	20.0	20.8	20.8	19.4
Reactor Coolant System Leakage	7/07	8/07	9/07	10/07	11/07	12/07	1/08	2/08	3/08	4/08	5/08	6/08
Maximum leakage	4.750	4.800	5.100	4.750	4.800	5.000	4.700	4.700	4.700	4.750	4.800	4.800
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	19.0	19.2	20.4	19.0	19.2	20.0	18.8	18.8	18.8	19.0	19.2	19.2

Licensee Comments: none

Drill/Exercise Performance

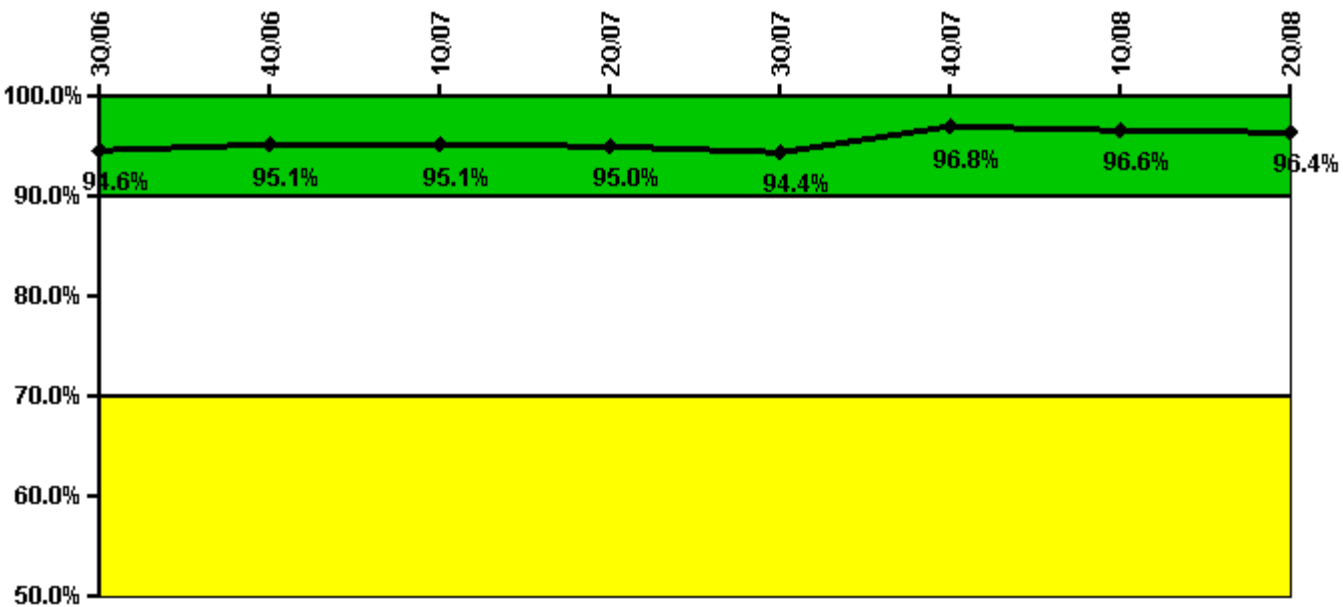


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
Successful opportunities	129.0	109.0	41.0	27.0	35.0	318.0	31.0	38.0
Total opportunities	138.0	113.0	43.0	30.0	39.0	318.0	34.0	40.0
Indicator value	94.6%	95.1%	95.1%	95.0%	94.4%	96.8%	96.6%	96.4%

Licensee Comments: none

ERO Drill Participation

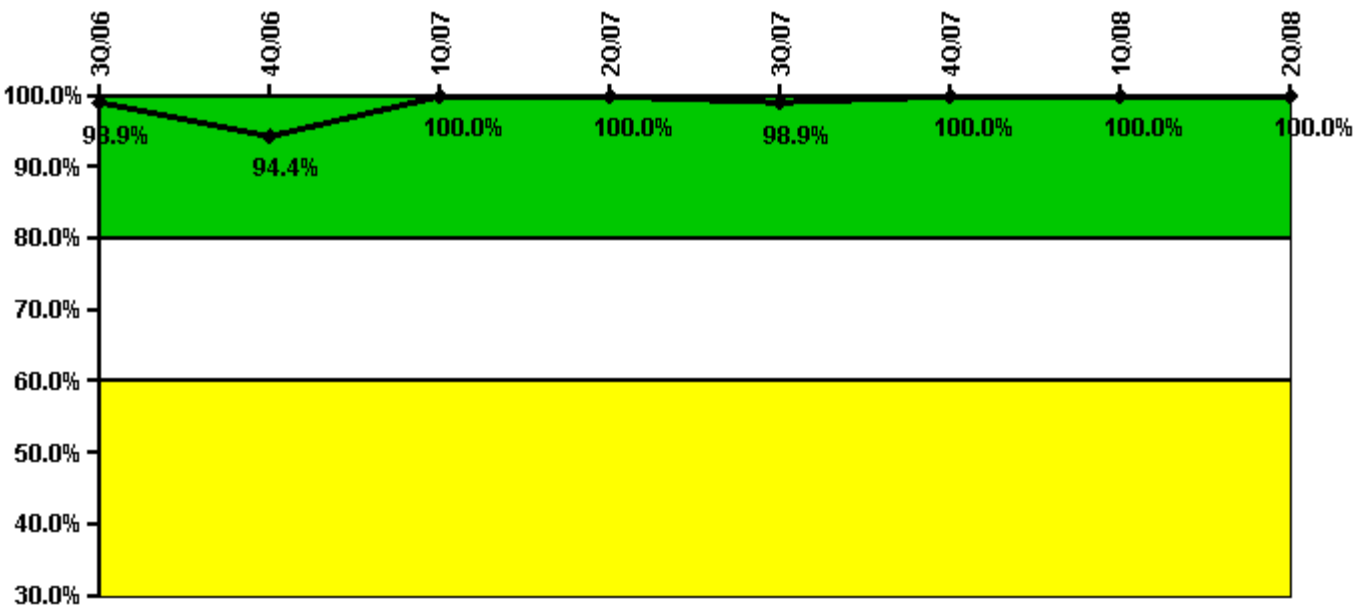


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
Participating Key personnel	93.0	84.0	97.0	97.0	94.0	93.0	90.0	91.0
Total Key personnel	94.0	89.0	97.0	97.0	95.0	93.0	90.0	91.0
Indicator value	98.9%	94.4%	100.0%	100.0%	98.9%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

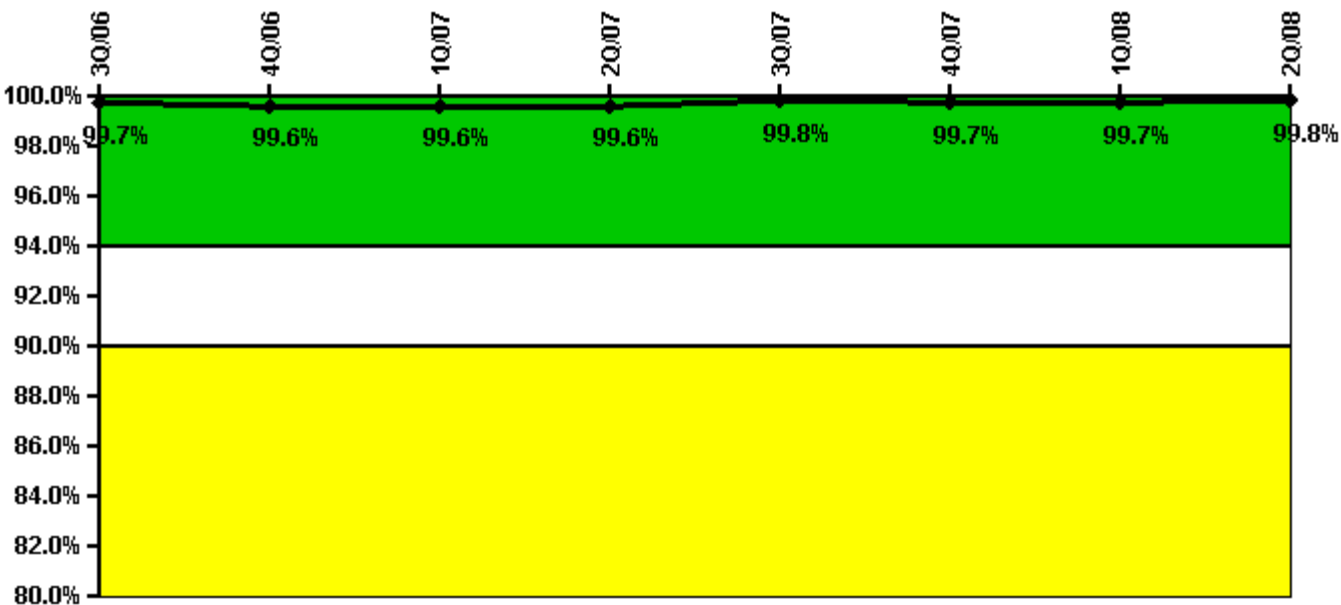


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
Successful siren-tests	294	295	296	221	296	257	296	222
Total sirens-tests	296	296	296	222	296	259	296	222
Indicator value	99.7%	99.6%	99.6%	99.6%	99.8%	99.7%	99.7%	99.8%

Licensee Comments: none

Occupational Exposure Control Effectiveness

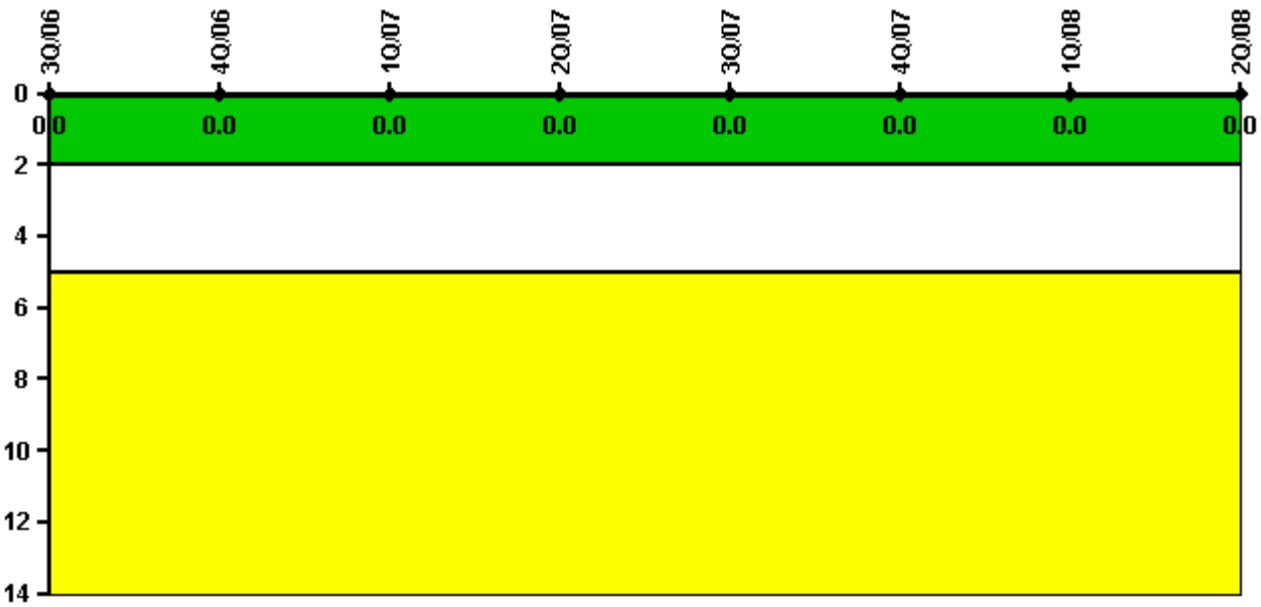


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

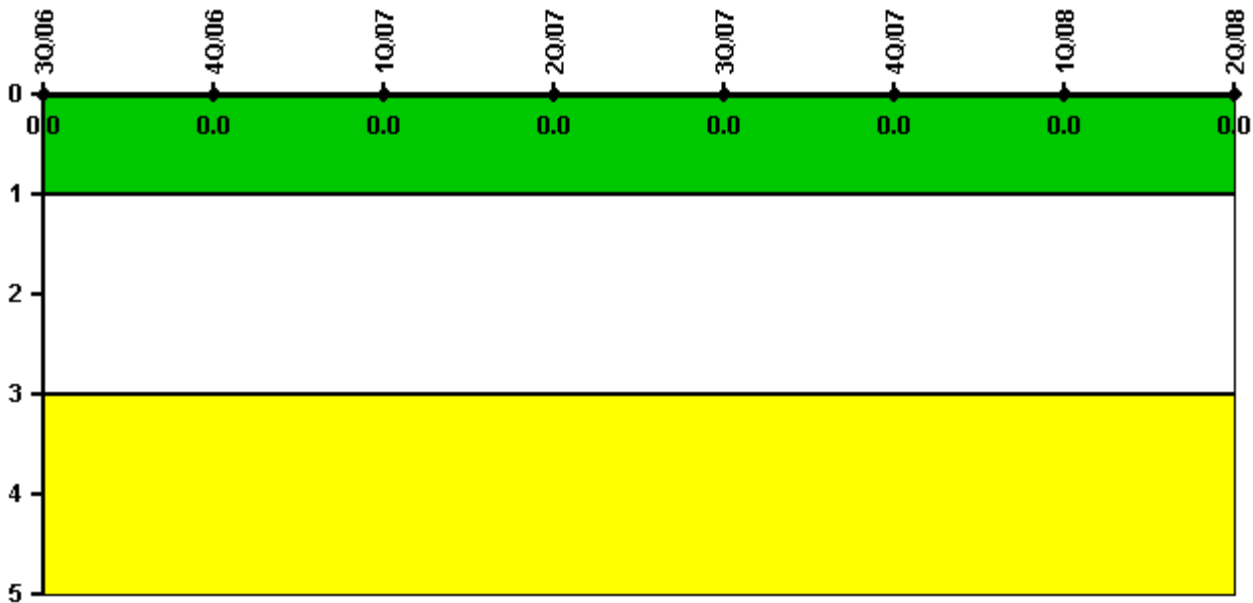

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/06	4Q/06	1Q/07	2Q/07	3Q/07	4Q/07	1Q/08	2Q/08
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

[Physical Protection](#) information not publicly available.

▲ [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: August 4, 2008