


# California

## ASHRAE 90.1-1999 Climate Zones - DRAFT

Sep 6 14:57 2002

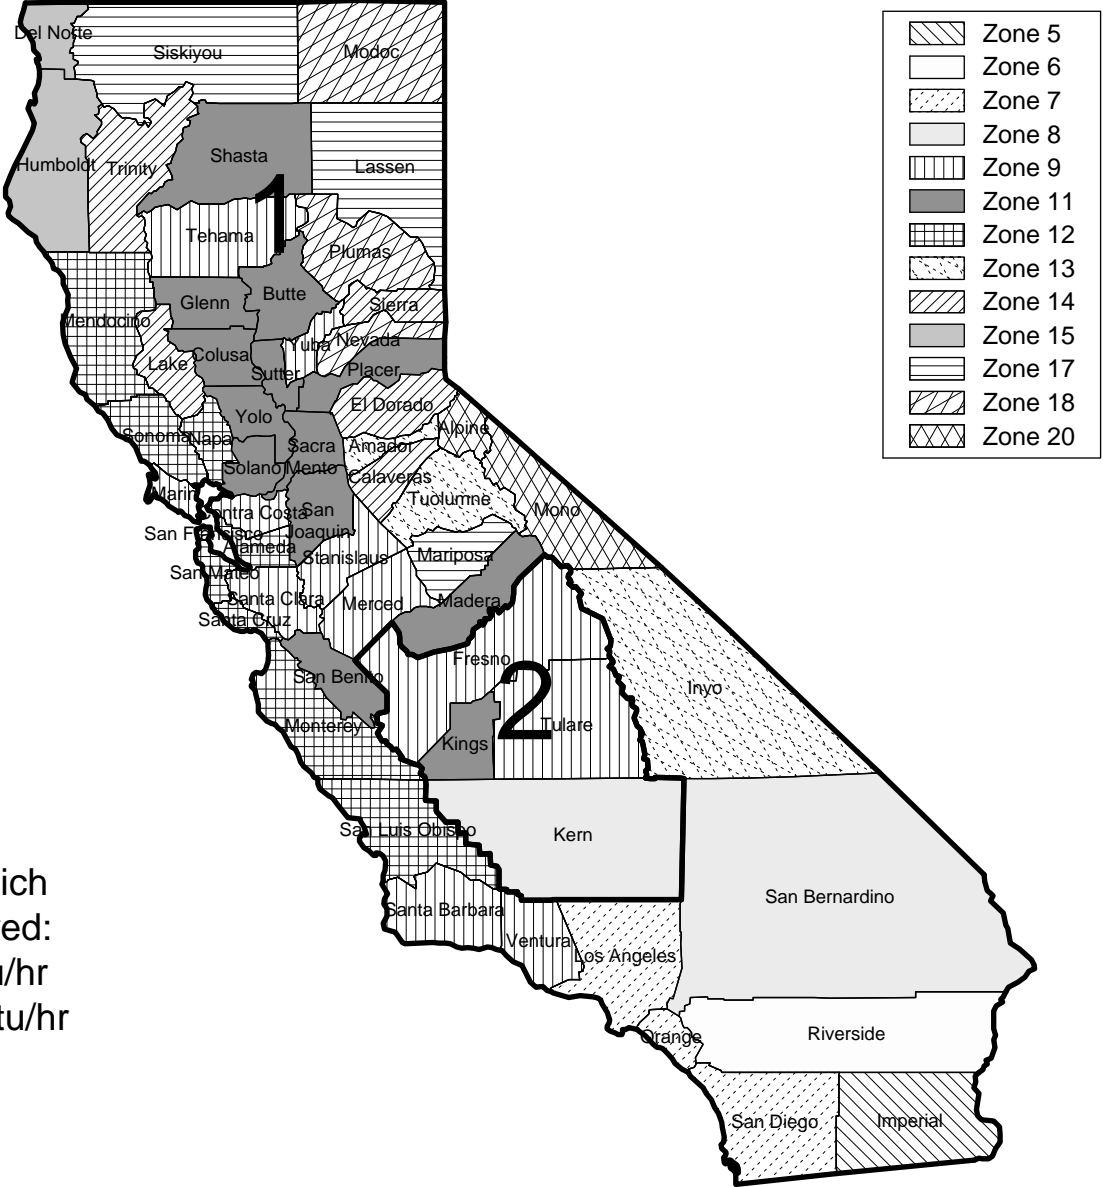

Min. system size for which  
 an economizer is required:  
 Region 1: 65,000 Btu/hr  
 Region 2: 135,000 Btu/hr