Michigan

ASHRAE 90.1-1999 Climate Zones - DRAFT

Sep 6 14:57 2002

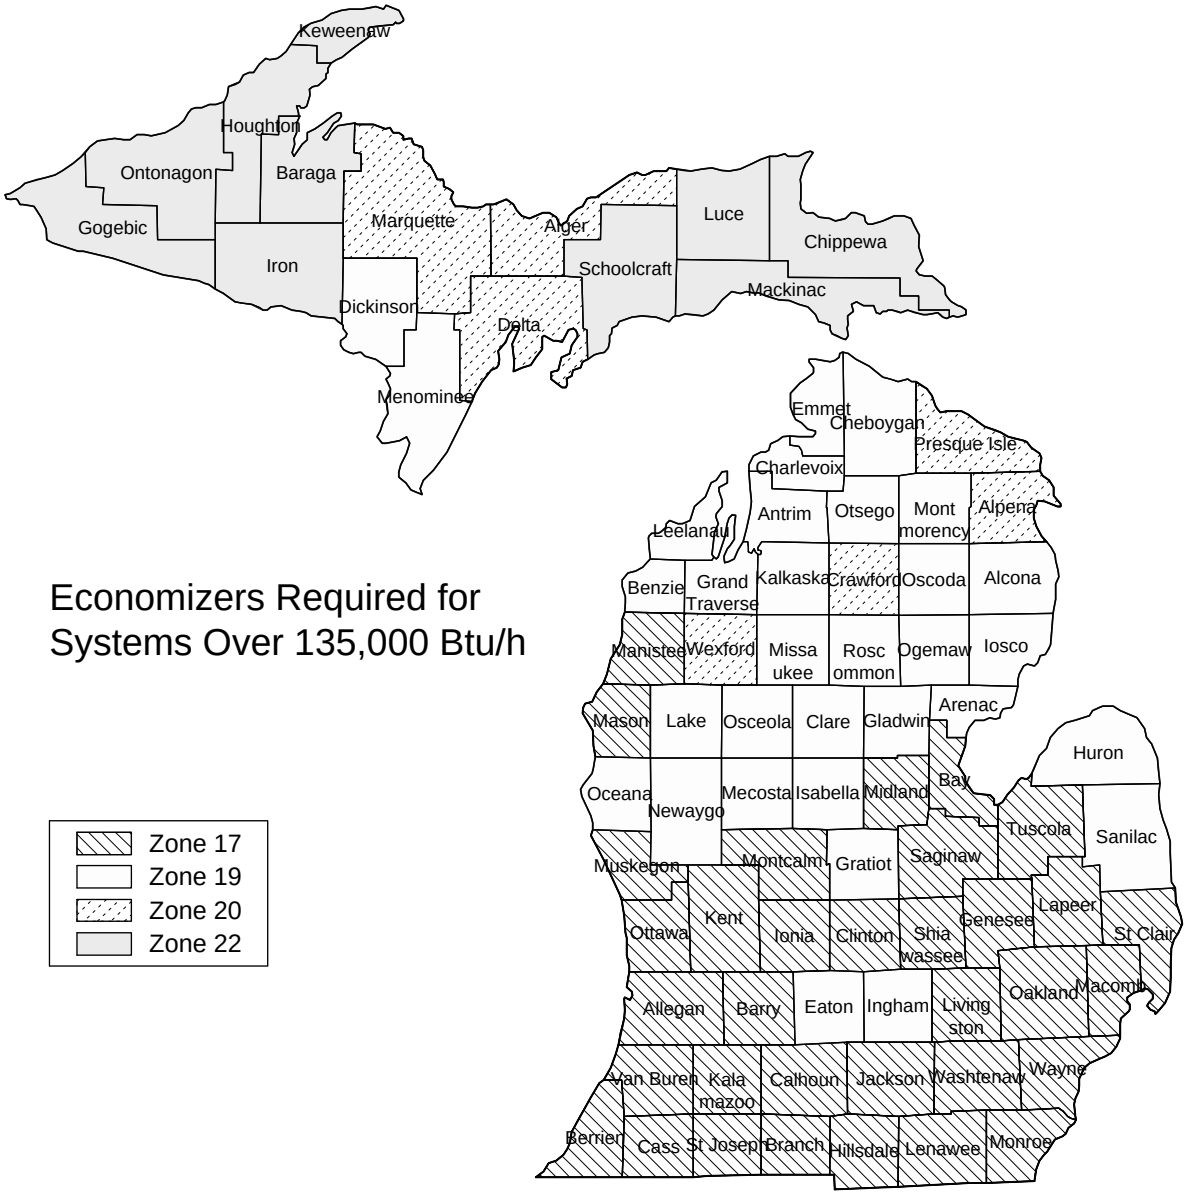

Economizers Required for Systems Over 135,000 Btu/h

- Zone 17
- Zone 19
- Zone 20
- Zone 22