


# Nebraska

## ASHRAE 90.1-1999 Climate Zones - DRAFT

Sep 6 14:58 2002

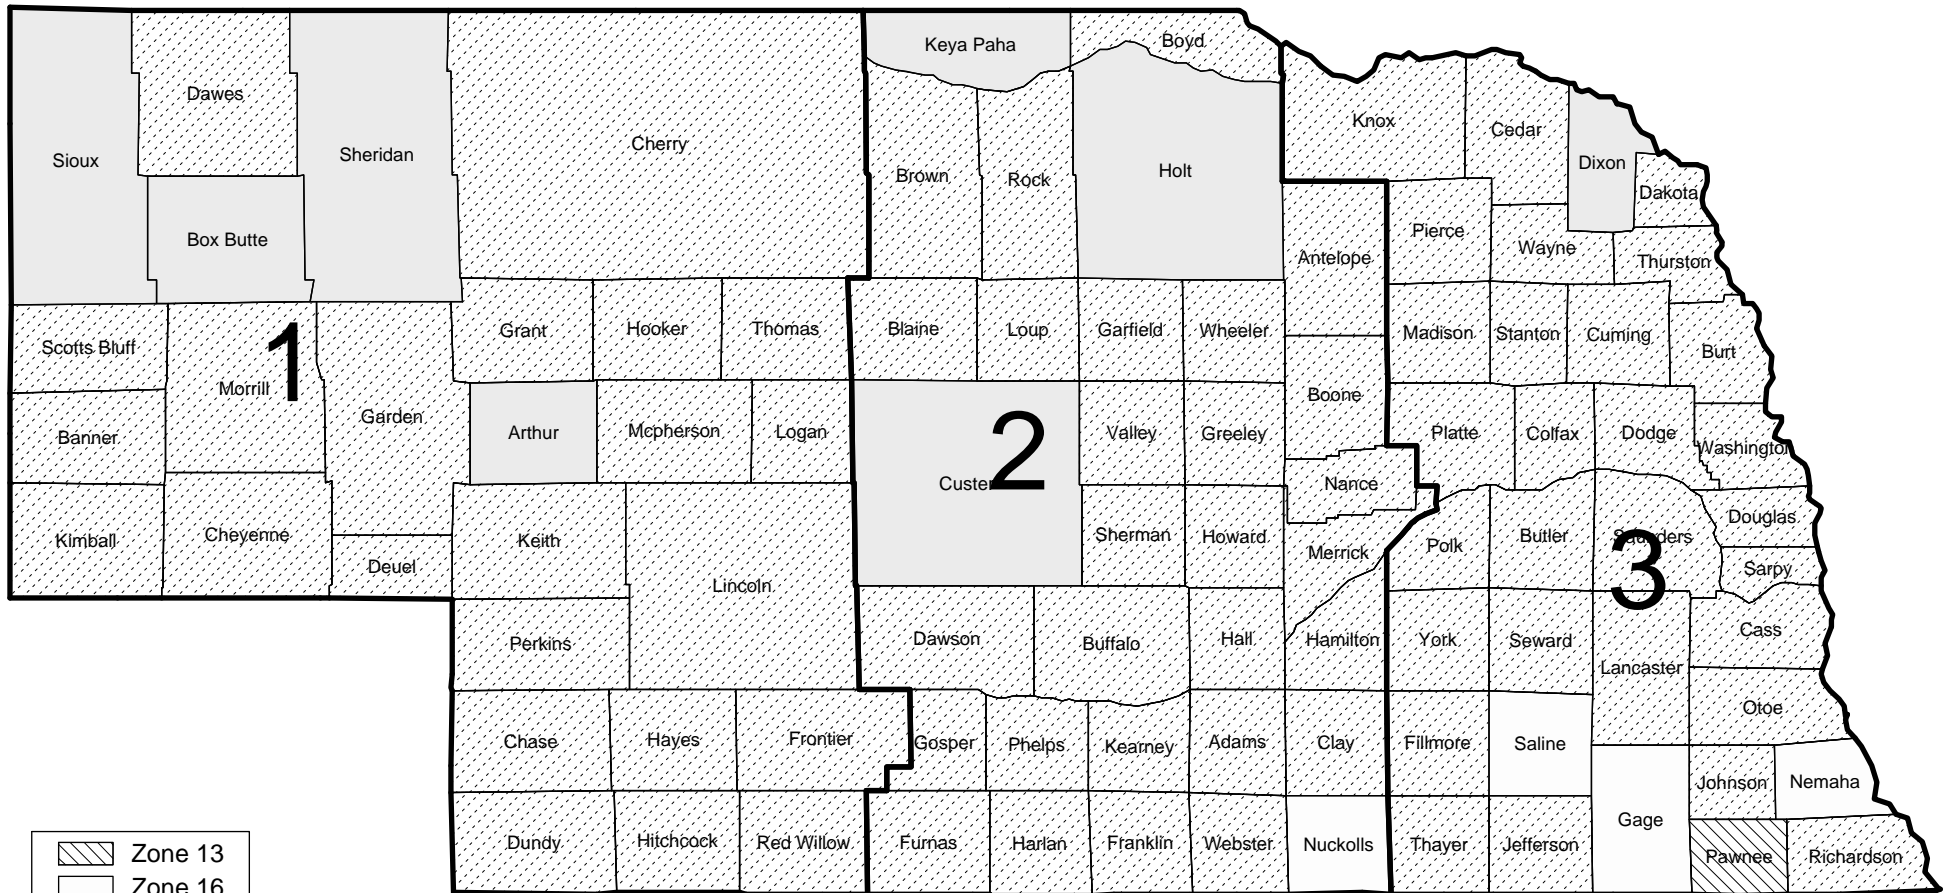

Min. system size for which  
an economizer is required:  
Region 1: 65,000 Btu/hr  
Region 2: 135,000 Btu/hr  
Region 3: No requirement