


New Hampshire

ASHRAE 90.1-1999 Climate Zones - DRAFT

Sep 6 14:58 2002

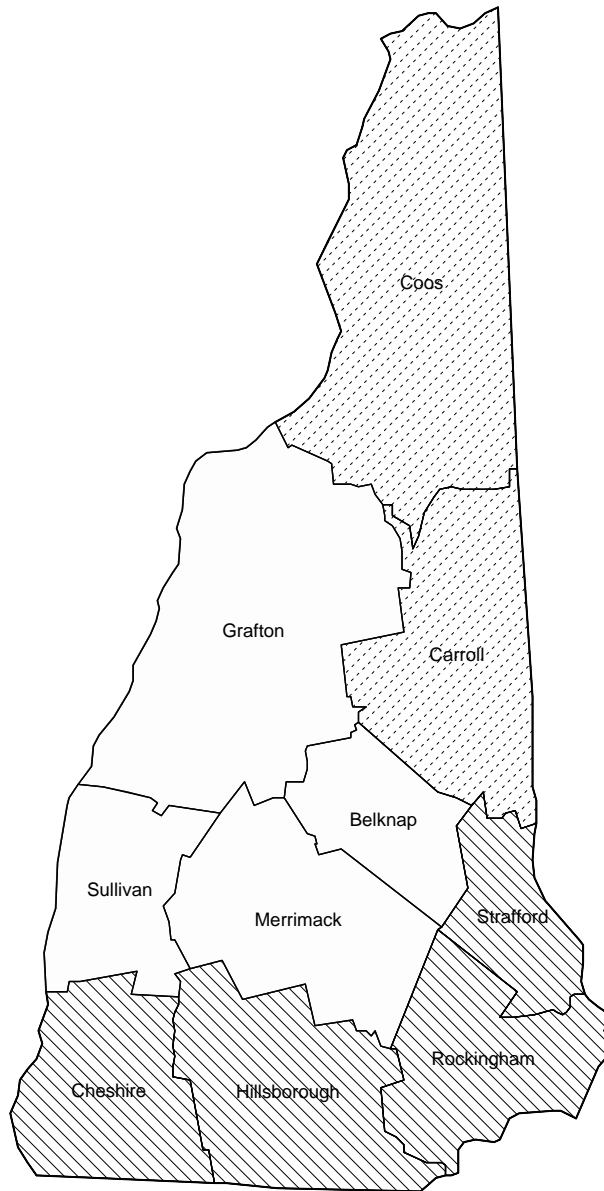

Economizers Required for
Systems Over 135,000 Btu/h

