



Pennsylvania

ASHRAE 90.1-1999 Climate Zones - DRAFT



Sep 6 14:58 2002

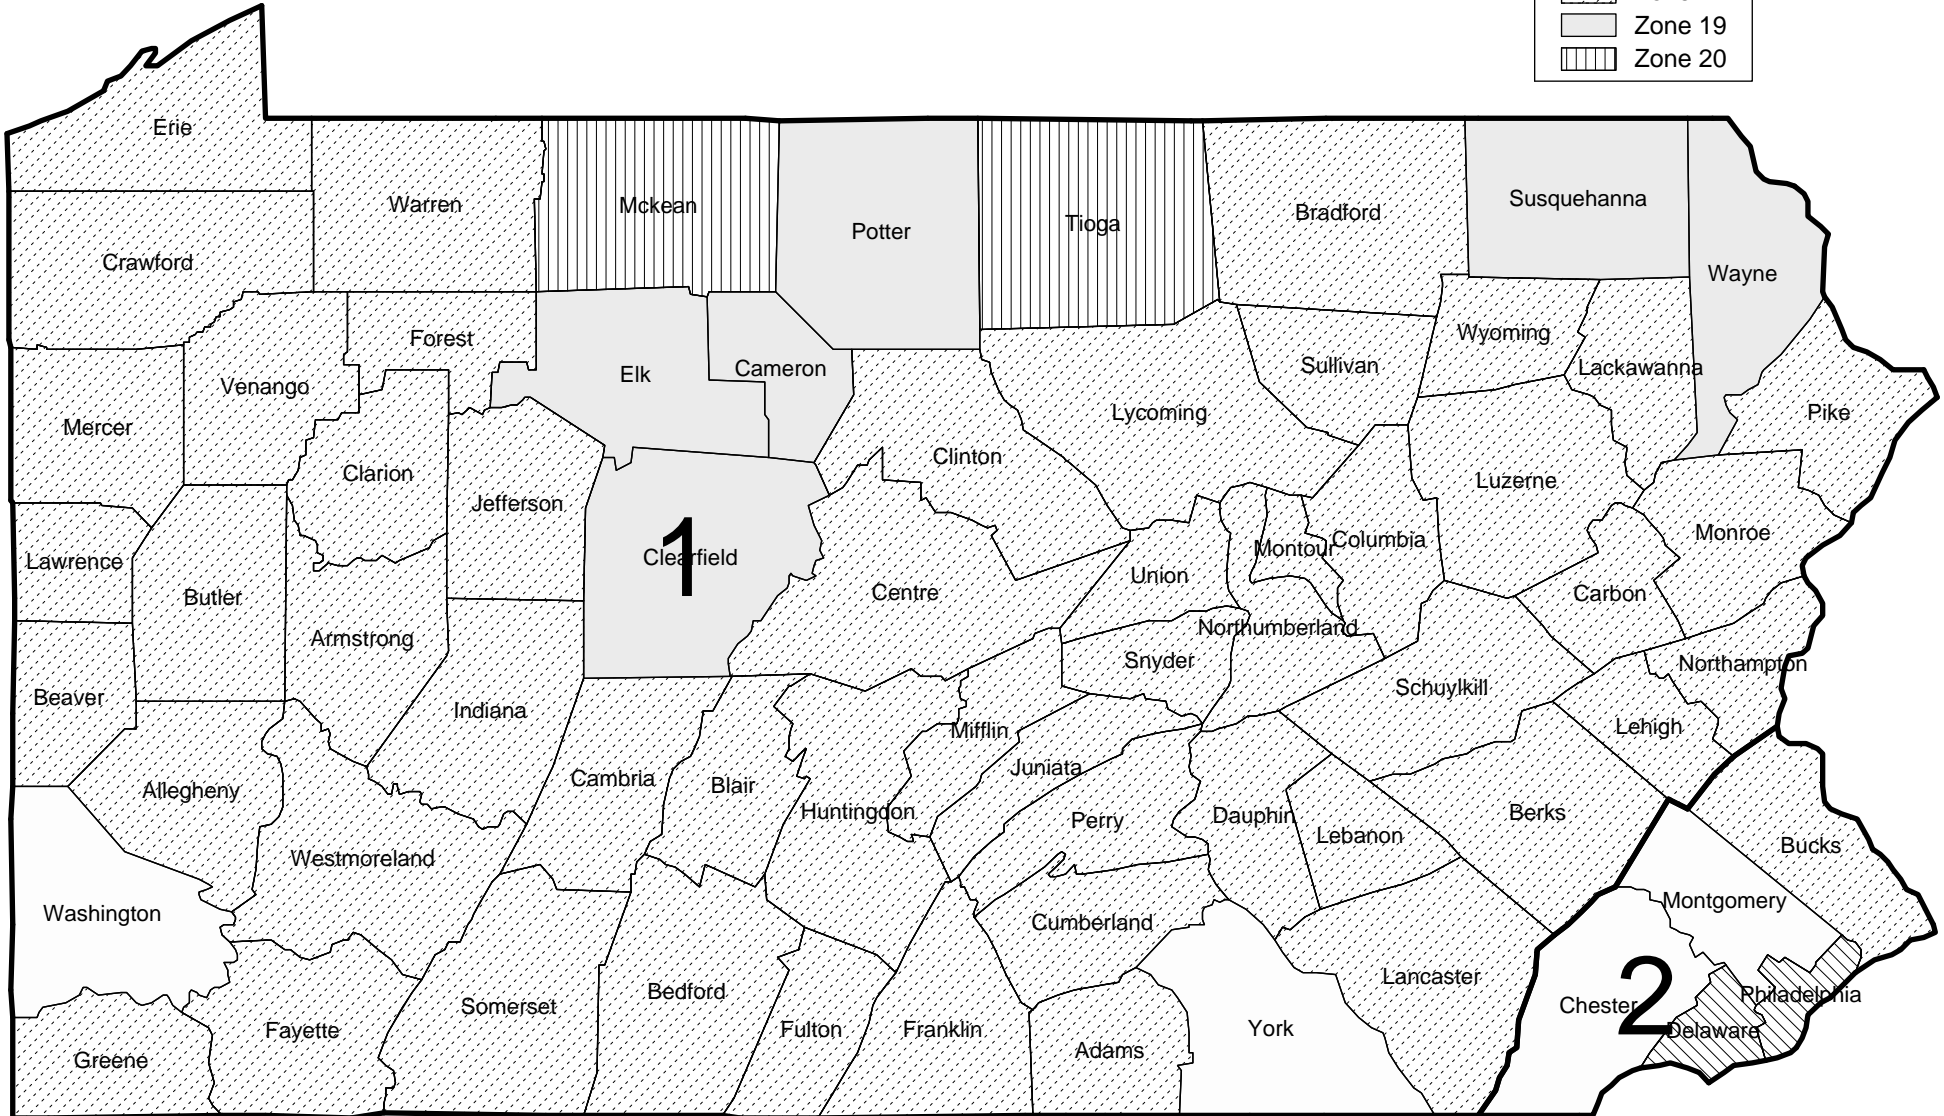

Min. system size for which
an economizer is required:
Region 1: 135,000 Btu/hr
Region 2: No requirement