
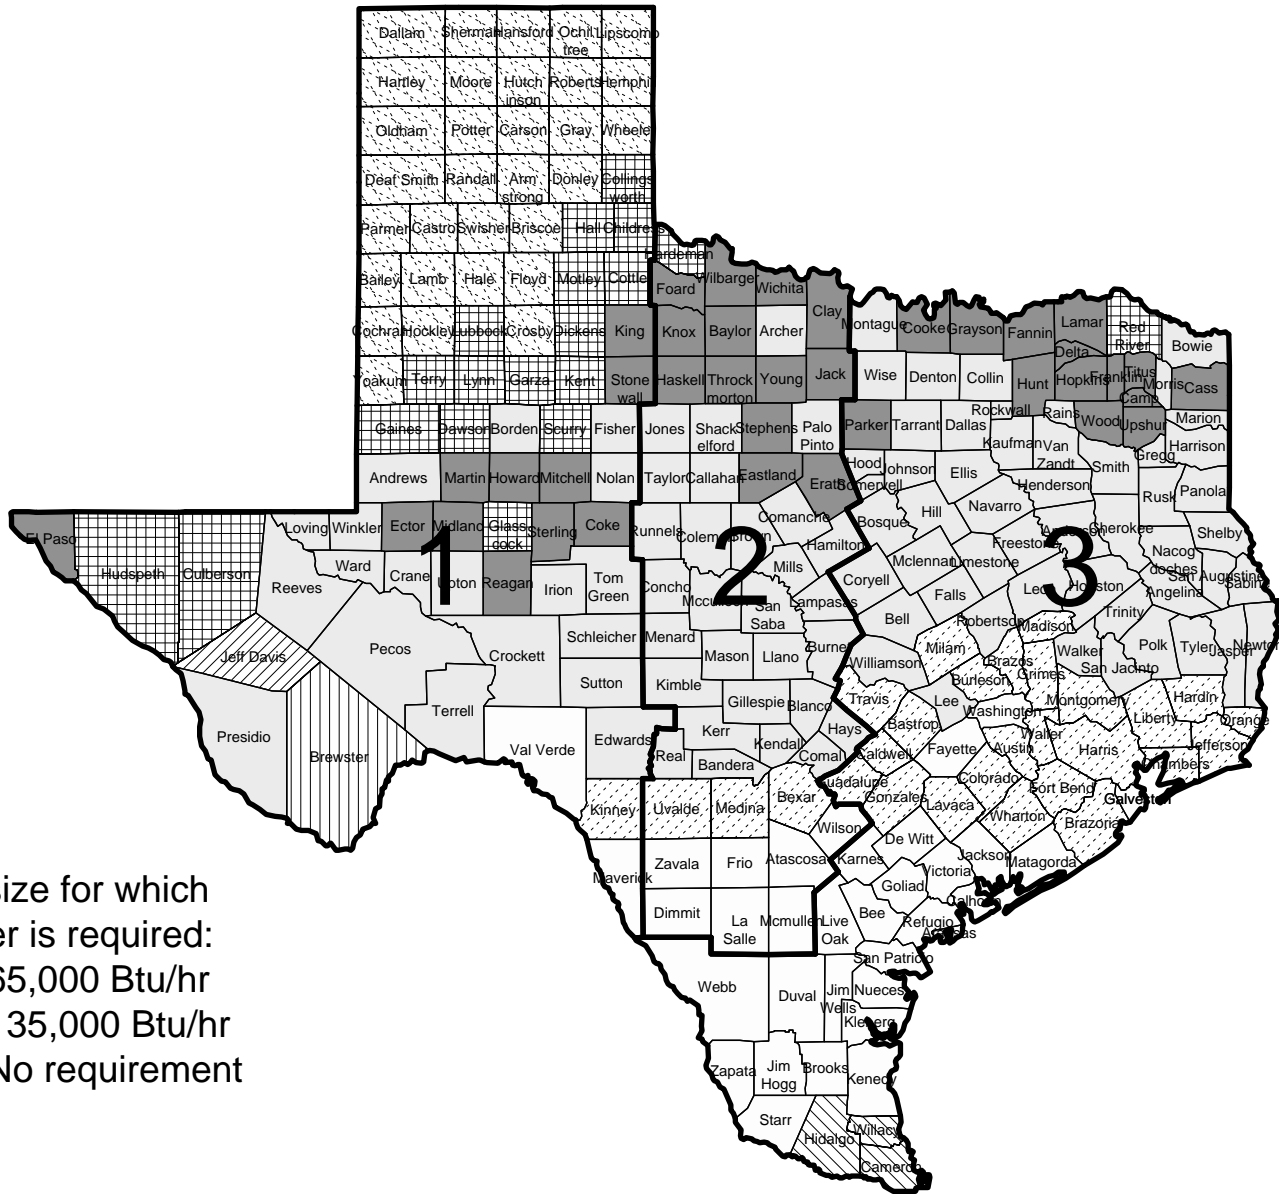


Texas

ASHRAE 90.1-1999 Climate Zones - DRAFT

Sep 6 14:58 2002

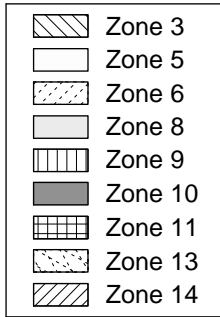

Min. system size for which
an economizer is required:

- Region 1: 65,000 Btu/hr
- Region 2: 135,000 Btu/hr
- Region 3: No requirement