

120°W


100°W

80°W

Establishment Potential

Sirex woodwasp - *Sirex noctilio*

4-26-2006

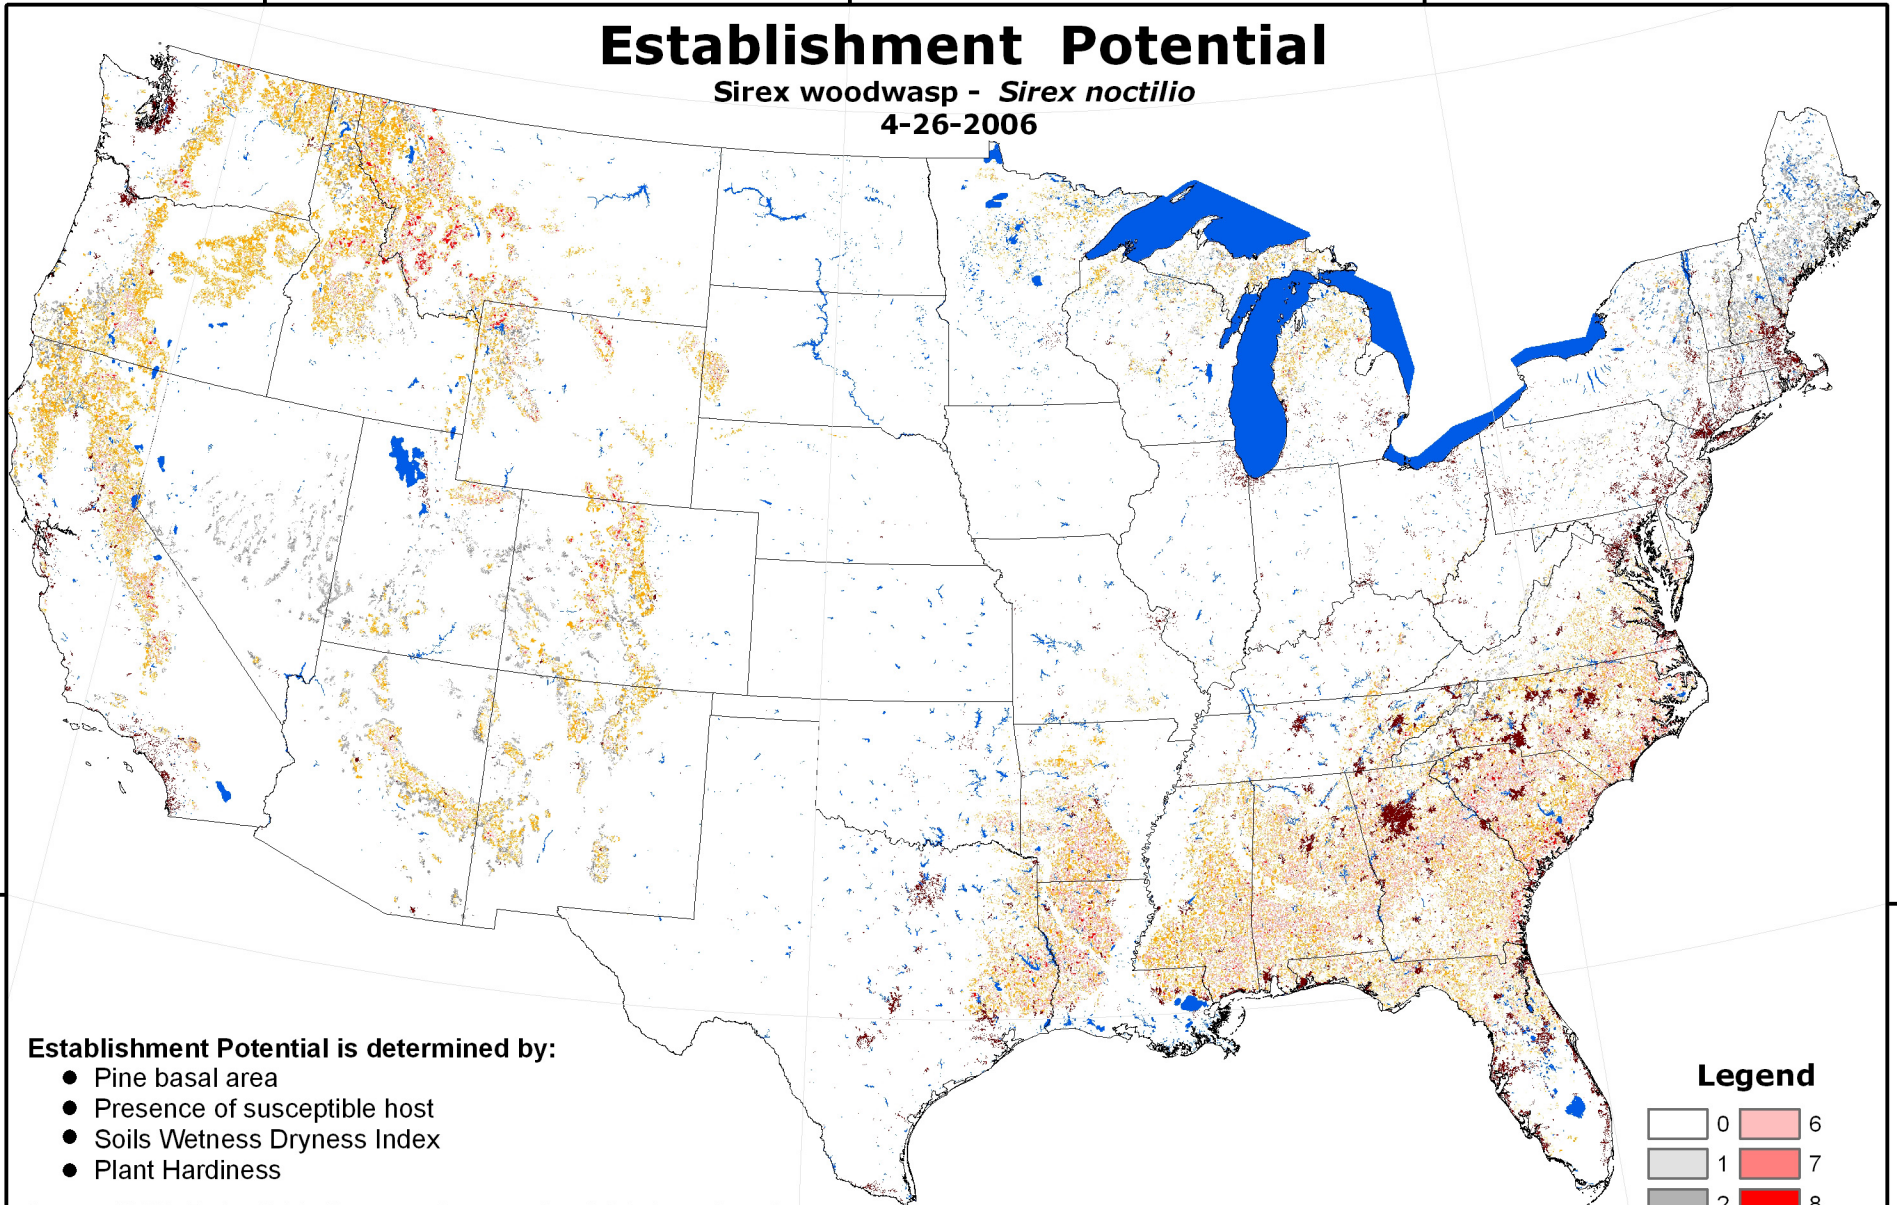

30°N

30°N

Establishment Potential is determined by:

- Pine basal area
- Presence of susceptible host
- Soils Wetness Dryness Index
- Plant Hardiness

Susceptibility Potential is the sum of an equal weighted overlay of:

The Introduction Potential and Establishment Potential

http://www.fs.fed.us/foresthealth/technology/invasives_sirexnoctilio_riskmaps.shtml

Legend



A value of 0 is the lowest potential and a value of 10 is highest potential of establishment.



Albers Equal Area Conic Projection
Resolution = one-kilometer

file: establishment7.mdx
GRID: estab4_msk
Tool = Sirex_NewYork model = Sirex_fin

Map Produced by FHTET
Fort Collins, CO on 5-9-2006. MFT

100°W

80°W