

DOE/PC/92521--7267

TECHNICAL REPORT

December 1, 1994 through February 28, 1995

RECEIVED
MAR 19 1996
OSTI

Project Title: **SULFUR REMOVAL IN ADVANCED TWO STAGE
PRESSURIZED FLUIDIZED BED COMBUSTION**

DOE Cooperative Agreement Number: DE-FC22-92PC92521 (Year 3)
ICCI Project Number.: 94-1/5.1A-1M
Principal Investigator: Javad Abbasian, Institute of Gas Technology
Other Investigators: Andy Hill, and James, R. Wangerow,
Institute of Gas Technology
Project Manager: Franklin I. Honea, Illinois Clean Coal Institute

ABSTRACT

The objective of this study is to obtain data on the rates and the extent of sulfation reactions involving partially sulfided calcium-based sorbents, and oxygen as well as sulfur dioxide, at operating conditions closely simulating those prevailing in the second stage (combustor) of Advanced Two-Stage Pressurized Fluidized-Bed Combustors (PFBC). In these systems the CO₂ partial pressure generally exceeds the equilibrium value for calcium carbonate decomposition. Therefore, calcium sulfate is produced through the reactions between SO₂ and calcium carbonate as well as the reaction between calcium sulfide and oxygen.

To achieve this objective, the rates of reaction involving SO₂ and oxygen (gaseous reactant); and calcium sulfide and calcium carbonate (solid reactants), will be determined by conducting tests in a pressurized thermogravimetric analyzer (HPTGA) unit. The effects of sorbent type, sorbent particle size, reactor temperature and pressure; and O₂ as well as SO₂ partial pressures on the sulfation reactions rate will be determined.

During this quarter, samples of the selected limestone and dolomite, sulfided in the fluidized-bed reactor during last quarter, were analyzed. The extent of sulfidation in these samples was in the range of 20 to 50%, which represent carbonizer discharge material at different operating conditions. The high pressure thermogravimetric analyzer (HPTGA) unit has been modified and a new pressure control system was installed to eliminate pressure fluctuation during the sulfation tests.

RECEIVED
USDOE/PETC
95 APR 17 AM 9:39
ACQUISITION & ASSISTANCE DIV.

U.S. DOE Patent Clearance is **NOT** required prior to the publication of this document.

DISTRIBUTION OF THIS DOCUMENT IS UNLIMITED

MASTER

EXECUTIVE SUMMARY

Second generation staged combustion processes for power generation systems such as Advanced Two Stage Fluidized-Bed Combustion (PFBC) combined cycle plants can achieve higher thermal efficiencies and a lower cost of electricity than a conventional pulverized coal-fired (PC fired) plant equipped with flue gas desulfurization. Because two-stage PFBC plants incorporate coal gasification and combustion and can use high sulfur coals in an environmentally acceptable manner, they have the potential to expand the marketability of high sulfur Illinois coals. Projected costs for two-stage PFBC plants are substantially lower than comparable pulverized-coal (PC) combustion plants, especially if air emission regulations were to require much lower SO₂ emissions.

In the two-stage PFBC processes supported by the United States Department of Energy, calcium-based sorbents such as limestone and dolomite are added to the first stage reactor to capture hydrogen sulfide as calcium sulfide (CaS) in the reducing atmosphere of the carbonizer. The partially sulfided calcium-based sorbent is transferred to the second stage (combustor) where the unreacted calcium carbonate is reacted with SO₂ and oxygen in the oxidizing atmosphere of the combustor to produce calcium sulfate. The calcium sulfide is also expected to react with oxygen and convert to calcium sulfate.

The partial pressure of CO₂ in the carbonizer usually exceeds the equilibrium value for calcination of calcium carbonate. Under such conditions, the removal of sulfur compounds takes place through the reaction of hydrogen sulfide and calcium carbonate (direct sulfidation reaction). The rates of direct sulfidation reaction at carbonizer conditions were determined in an earlier ICCI-funded project (Ref. No. R93-1/2.1A-1M). This project is a follow-up of the earlier project to determine the rates and the extent of sulfation reactions involving partially sulfided Ca-based sorbents (containing CaS and CaCO₃), at the operating conditions prevailing in the second stage (combustor) of the advanced PFBC processes.

A systematic study of the sulfation reactions occurring in the combustor stage of the two-stage PFBC is necessary to improve the economic and environmental advantages of two-stage PFBC processes by maximizing the utilization of calcium-based sorbents and minimizing the production of solid waste materials by such processes.

The objective of this investigation is to obtain data on the rates and the extent of sulfation reactions involving partially sulfided calcium-based sorbents, sulfur dioxide, and oxygen under operating conditions expected in the combustor stage of the two-stage PFBC processes.

This study will focus on the determination of the effects of sorbent type (i.e. limestone or dolomite), sorbent particle size; SO₂ and O₂ partial pressures, as well as reactor temperature and pressure, on the sulfation reactions. The rate of reaction with fully calcined sulfided sorbents at near equilibrium CO₂ partial pressure will also be measured

to determine the relative rates of sulfation reactions involving calcined and uncalcined sorbents.

The results of this study will allow a more accurate estimation to be made of the amount of sorbent needed in two-stage PFBC processes, thereby maximizing the sulfur capture efficiency while minimizing disposal of solid wastes and reducing the cost of electricity produced by these types of plants.

Samples of partially sulfided limestone and dolomite (prepared during last quarter) were analyzed. These samples had been sulfided in the high pressure fluidized bed unit at carbonizer operating conditions, representing both calcining and non-calcining regimes of operation. The results of these tests indicate that the extent of sulfidation achieved was in the range of 20 to 50%. These samples were screened into three particle size ranges with average particle diameters of 0.01, 0.03, and 0.09 cm. These samples will be used as "solid reactant" in the sulfation tests.

The high pressure thermogravimetric analyzer (HPTGA) unit has been modified and a new pressure control system was installed to eliminate the effect of pressure fluctuation on the sample weight during sulfation tests. The new pressure control system is currently being evaluated.

DISCLAIMER

This report was prepared as an account of work sponsored by an agency of the United States Government. Neither the United States Government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof.

OBJECTIVES

The overall objective of this project is to obtain data on the rates of reactions involving calcium sulfide, calcium carbonate, sulfur dioxide, and oxygen, under the operating conditions expected in the combustion stage of the two-stage PFBC processes, where, in general, because of high CO₂ partial pressures, the calcium carbonate in the partially sulfided limestone (or dolomite) does not decompose. Under such circumstances, the sulfur compounds in char are converted to sulfur dioxide which should be removed by the uncalcined calcium carbonate in the combustor.

The specific objectives of this project are to --

1. Obtain experimental data on the rates and extent of sulfation reactions involving calcium sulfide and uncalcined calcium carbonate (in partially sulfided limestone and dolomite); and oxygen and sulfur dioxide, at operating conditions expected in the combustor reactor in PFBC.
2. Determine the effects of operating variables such as reactor temperature and pressure, sorbent type and particle size; and O₂, CO₂ and SO₂ partial pressures, on the sulfation reaction rates.
3. Provide a direct comparison between the rates of sulfation reactions involving calcium-based sorbent at CO₂ partial pressure in the vicinity of the equilibrium value for calcination of calcium carbonate.
4. Estimate the extent of desulfurization in the second stage (combustor) of the advanced two stage pressurized fluidized-bed combustors.
5. Establish a guideline for selection of the operating variables in the two-stage PFBC process for optimum conversion of sulfur dioxide and calcium sulfide to calcium sulfate.

INTRODUCTION AND BACKGROUND

Illinois has large reserves of high-sulfur, caking coals. These coals cannot be used directly for power generation due to emissions regulations of SO₂, unless scrubbers are used which decrease thermal efficiency and increase the cost of electricity (COE). Two technologies, Advanced Two Stage Fluidized Bed Combustion (PFBC)⁽¹⁻⁶⁾, and Integrated Gasification Combined Cycle (IGCC), are being developed that can use high sulfur coals in an economical and environmentally sound manner.⁽⁵⁻⁶⁾ Two-stage PFBC involves the use of a pressurized fluid bed combustor integrated with a fluid bed "partial" gasifier in a combined cycle plant to generate power. Depending on the design selected, two-stage PFBC can achieve 45% efficiency and a COE at least 20% lower than that of a pulverized coal-fired (PC-fired) plant equipped with flue gas desulfurization.^(1,2) IGCC is another attractive option for power generation. In this concept, pressurized fluidized bed

gasification of coal is integrated into a power and steam generating combined cycle.⁽⁷⁻¹¹⁾ With either option, sulfur removal efficiencies of at least 90% are expected by using calcium-based sorbents as in-situ capture agents.


One proposed plant concept for a two-stage PFBC combined-cycle plant, shown in Figure 1 as a simplified process block diagram, is being developed by Foster Wheeler under a DOE contract.⁽¹⁾ In this design, coal is fed to a pressurized fluidized-bed carbonizer where the coal partially gasifies producing a low-Btu fuel gas and char. The fuel gas is cleaned in a cyclone and filter to remove particulates, and burned in a topping combustor. The topping combustor produces the energy required to drive the gas turbine which drives a generator and a compressor that feeds air to the carbonizer, a Circulating Fluidized Bed Combustor (CPFBC), and a Fluidized-Bed Heat Exchanger (FBHE). The carbonizer char is burned in the CPFBC with a high excess air, and flue gas from the CPFBC is used to support combustion of the fuel gas in the topping combustor. Steam generated in a Heat Recovery Steam Generator (HRSG) downstream of the gas turbine and in the Fluidized Bed Heat Exchanger (FBHE) associated with the CPFBC, drives the steam turbine generator that produces the remainder of electric power delivered by the plant.

A low-Btu gas is produced in the carbonizer by the pyrolysis/mild devolatilization of coal in a fluidized-bed reactor. Char residue is also produced due to the lower operating temperature of the carbonizer as compared to the higher temperature used in "total" gasifiers. Calcium-based sorbents are injected into the carbonizer to promote tar cracking and to capture sulfur as calcium sulfide. Because the sulfur capture is done in-situ, the raw fuel gas can be used without cooling thereby avoiding expensive heat exchangers and chemical or sulfur-capturing bed clean-up systems.

Depending on the partial pressure of CO₂ in the carbonizer, the CaCO₃ in the sorbent will either exist as CaCO₃ or calcine to CaO. Calcination of CaCO₃ proceeds by the following reaction:




H₂S is removed in the carbonizer/gasifier by reaction with uncalcined limestone, as in Reaction (2):



or with calcined limestone, as in Reaction (3):



The extent to which Reaction (1) proceeds is determined by the bed temperature and the partial pressure of CO₂ in the carbonizer. The following correlation was used to estimate the equilibrium CO₂ partial pressure for the decomposition of CaCO₃⁽¹¹⁾

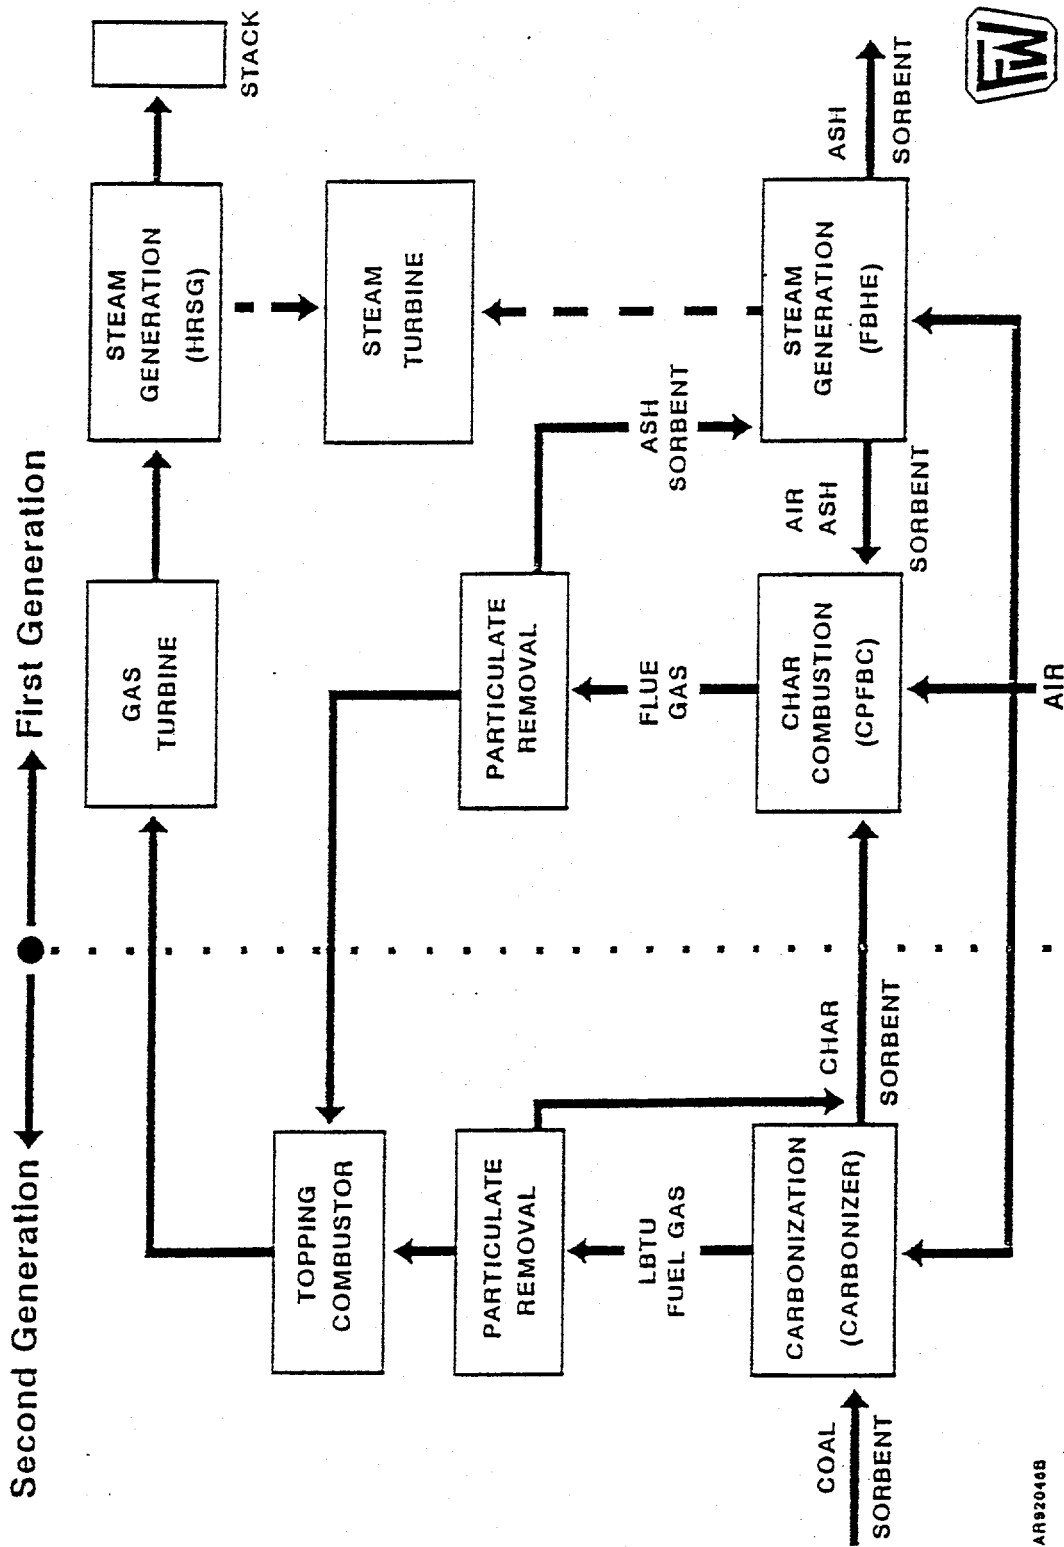

AR92046B

Figure 1. SCHEMATIC DIAGRAM OF AN ADVANCED TWO-STAGE PFBC PLANT (1)

$$P_{\text{CO}_2} = 10^{\frac{[-8799.7+7.521]}{T}} \quad (\text{A})$$

In Equation (A), P_{CO_2} is the equilibrium partial pressure of CO_2 in atmospheres, and T is temperature in degrees Kelvin. If the partial pressure of CO_2 in the gasifier is less than the equilibrium CO_2 pressure determined by Reaction (1), H_2S removal will take place by Reaction (3). If the CO_2 partial pressure exceeds that equilibrium pressure, H_2S will be removed by Reaction (2). It should be noted that the MgCO_3 present in the feed limestone or dolomite always calcines to MgO under typical fluidized-bed gasifier operating conditions. Furthermore MgO does not remove H_2S from the system to any significant extent.

Computer models have been developed, based on published data, to simulate air-blown pyrolysis of coal in a carbonizer. Carbonizer fuel gas compositions predicted by models developed by IGT⁽⁵⁾ and M. W. Kellogg⁽²⁾ are shown in Table 1. The predicted carbonizer product gases are for a Pittsburgh coal feed at 14 atmospheres and 1600°F (IGT) and an Illinois No. 6 coal feed at 15 atmospheres and 1450°F (M. W. Kellogg). The CO_2 partial pressure is seen to be approximately 1.7 atmospheres in both cases. According to equation (A), at this temperature and partial pressure of CO_2 , the calcium in the limestone/dolomite injected into the carbonizer for sulfur capture will be in the form of CaCO_3 , and therefore the H_2S will be removed mainly by Reaction (2). The predicted Ca/S ratio, based on the sulfur in the coal feed, varies from 1.75 in the IGT model to 1.99 in the Kellogg model.

Actual gasifier product gas compositions from a pilot scale fluidized-bed gasifier based on IGT's U-GAS technology, are shown in Table 2. This represents gasification technology being developed as part of an IGCC process. The data shown in Table 2 are from a series of in-situ desulfurization tests with coal and limestone cofeeding in the steam-air gasification mode⁽¹²⁾, indicating that the partial pressure of CO_2 in the gasifier may, under certain operating conditions, be high enough to place the calcium carbonate in the noncalcining regime.

The reaction between calcium-based sorbents and hydrogen sulfide [Reactions (2) and (3)] have been studied by many investigators, including the Principal Investigator of this project, over the past two decades. Among these investigators, Abbasian *et al.*⁽¹⁴⁻²⁰⁾, Borgwardt and Roache⁽²¹⁾, Ruth *et al.*⁽²²⁾, Squires⁽²³⁾, Kamath and Petrie⁽²⁴⁾, Simon and Raulins⁽²⁵⁾, Yen *et al.*⁽²⁶⁾, Freund⁽²⁷⁾, Borgwardt *et al.*⁽²⁸⁾ However, none of the above studies include experimental data on direct sulfidation reaction (2) with limestone and dolomite at conditions prevalent in the proposed designs of these carbonizers, that is, temperature of 800°-950°C, pressures of 12-20 atmospheres, CO_2 partial pressures near 2 atmospheres and sorbent particle sizes in the range of 100 to 900 μm .

Table 1. MODEL PREDICTED CARBONIZER FUEL GAS COMPOSITION

<u>Operating Conditions</u>	<u>IGT</u>	<u>Kellogg</u>
Coal Type	Pittsburgh No. 8	Illinois No. 6
Temperature, °F	1600	1450
Pressure, psig	192	148
Ca/S Feed Molar Ratio	1.75	1.5
Sorbent Particle Size, μm	100	
<u>Selected Gases</u>	----- vol % -----	
Carbon Monoxide	11.04	15.51
Hydrogen	5.90	19.35
Carbon Dioxide	12.32	10.34
Methane	6.23	1.30
Hydrogen Sulfide	0.035	0.01
Water Vapor	8.20	10.03

Table 2. SUMMARY OF U-GAS PDU IN-SITU DESULFURIZATION TEST DATA
 Feed Material: Pittsburgh Seam Bituminous Coal - Ireland Mine
 Sorbent: New Enterprise Limestone

	<u>Test No.</u>				
	1	2	3	4	5
Bed Temperature, °F	1845	1870	1860	1767	1762
Reactor Pressure, psig	150	303	303	406	290
Ca/S Feed Molar Ratio	2.60	1.72	2.25	4.21	3.80
Sulfur Capture, %	95.9	84.9	74.4	93.4	103.7
Reactor Gas Composition, Vol %					
Carbon Monoxide	10.54	4.31	6.62	1.90	3.53
Hydrogen	12.13	8.34	10.78	4.92	7.35
Carbon Dioxide	13.05	12.53	13.42	11.35	11.95
Methane	2.47	1.55	2.19	1.33	1.99
Nitrogen	38.43	36.45	33.87	37.26	36.34
Hydrogen Sulfide	0.11	0.18	0.22	0.16	0.08
Water Vapor	23.27	36.64	32.90	43.08	38.71

The mathematical models used for estimation of sulfur capture in the carbonizer^(2,5) are based on either the extrapolation of the available data on this reaction at lower temperature and atmospheric pressure, or based on the thermodynamic consideration.

The reactivity of calcium-based sorbents (limestone and dolomite) toward H₂S in the direct sulfidation reaction [Reaction (2)] at the carbonizer operating conditions in an earlier ICCI-funded project (Ref. No. 93-01/2.1A-1M) were determined. This information^(29,30) is one of the key factors in determination of the optimum calcium to sulfur ratio in the two-stage PFBC processes. The other key factor for determination of the optimum utilization of calcium-based sorbent in two-stage PFBC is sulfation of the partially sulfided sorbent in the second stage of the process (pressurized combustor) --



A systematic study of the complex desulfurization reactions occurring in the both stages of the two-stage PFBC is necessary in order to improve the economic and environmental advantages of two-stage PFBC processes by maximizing the utilization of calcium-based sorbents and minimizing the production of solid waste materials by such processes.

Sulfation of calcium sulfide in partially sulfided (and calcined) calcium-based sorbents has been studied by the principal investigator of this project over the past several years under the sponsorship of the ICCI⁽³¹⁻³⁵⁾. The results of these investigations indicate that limestone can only be partially sulfated while dolomite can be nearly completely sulfated at about 800°C. The extent of sulfation depends not only on the sorbent type, but also on the extent of sulfidation in the gasifier (or carbonizer).

The limited conversion of calcium sulfide in limestone to calcium sulfate is believed to be due to plugging of the pores of the sorbent that can prevent diffusion of oxygen inside the particle. Sulfation of limestone involving calcium oxide has also been reported to be limited to a fraction of complete conversion due to pore plugging.⁽³⁶⁻³⁸⁾

The literature on the direct sulfation reaction (Reaction 4) is limited and mostly concentrates on small sorbent particles that are typically used in limestone injection system. Snow *et al.*⁽³⁹⁾ showed that the uncalcined limestone particles (3-20 μm diameter) were sulfated at a rate that was higher than that for the corresponding calcine. The higher rate of direct sulfation reaction is believed to be due to more porous nature of the sulfated surface. It was hypothesized that the porosity was created by the outflow of CO₂ through the product sulfate larger and thereby improved the accessibility of SO₂ and oxygen to the reacting surface. A similar result has been reported by Lisa *et al.*⁽⁴⁰⁾

The results of these studies suggest that the sulfation of both calcium sulfide and calcium carbonate in the partially sulfided calcium-based sorbent, because of the uncalcined nature

of the sorbent, may proceed at higher rate and achieve higher conversion compared to the corresponding calcined and sulfided sorbent. The experimental data on sulfation of partially sulfided (and uncalcined) sorbents at the combustion stage in the PFBC process is necessary to verify the suitability of limestone for use in the Advanced Two-Stage PFBC Processes.

This project will focus on the determination of the rate and the extent of reactions involving partially sulfided uncalcined calcium-based sorbents with oxygen and sulfur dioxide at the operating conditions that are expected to prevail in the combustor. This systematic study will include determination of the effects of sorbent type (i.e. limestone or dolomite), sorbent particle size; CO_2 , O_2 , and SO_2 partial pressures, as well as reaction temperature and pressure, on the direct sulfidation reactions [Reaction (4) and (5)].

EXPERIMENTAL PROCEDURE

This project is divided into the following tasks:

Task 1. Sorbent Preparation and Characterization

Task 2. Sulfidation Reactions Tests


Task 3. Analyses of Sulfation Reactions Data

Because the equilibrium partial pressure of CO_2 at combustor temperatures exceeds one atmosphere, the tests must be conducted in a pressurized reactor. The tests in this project are conducted in a specially designed high-pressure Thermogravimetric Analyzer (HPTGA) unit that is available at IGT.

The schematic diagram and the schematic diagram of the HPTGA unit is shown in Figure 2. This unit has a balanced pressure reactor design, capable of operation at 1000°C at 100 atm. The special design of the inner reactor is suitable for operation in a corrosive environment.

Task 1. Sorbents Preparation and Characterization

The two sorbents selected for testing in this project, including one limestone and one dolomite, have already been tested in earlier ICCI-funded programs. The desired particle sizes of each sorbent were obtained by crushing and screening the selected sorbent. The average particle sizes selected for this study were 100, 300, and 900 μm . The bulk chemical composition of the sorbent as determined in the previous ICCI-funded program is presented in Table 3.

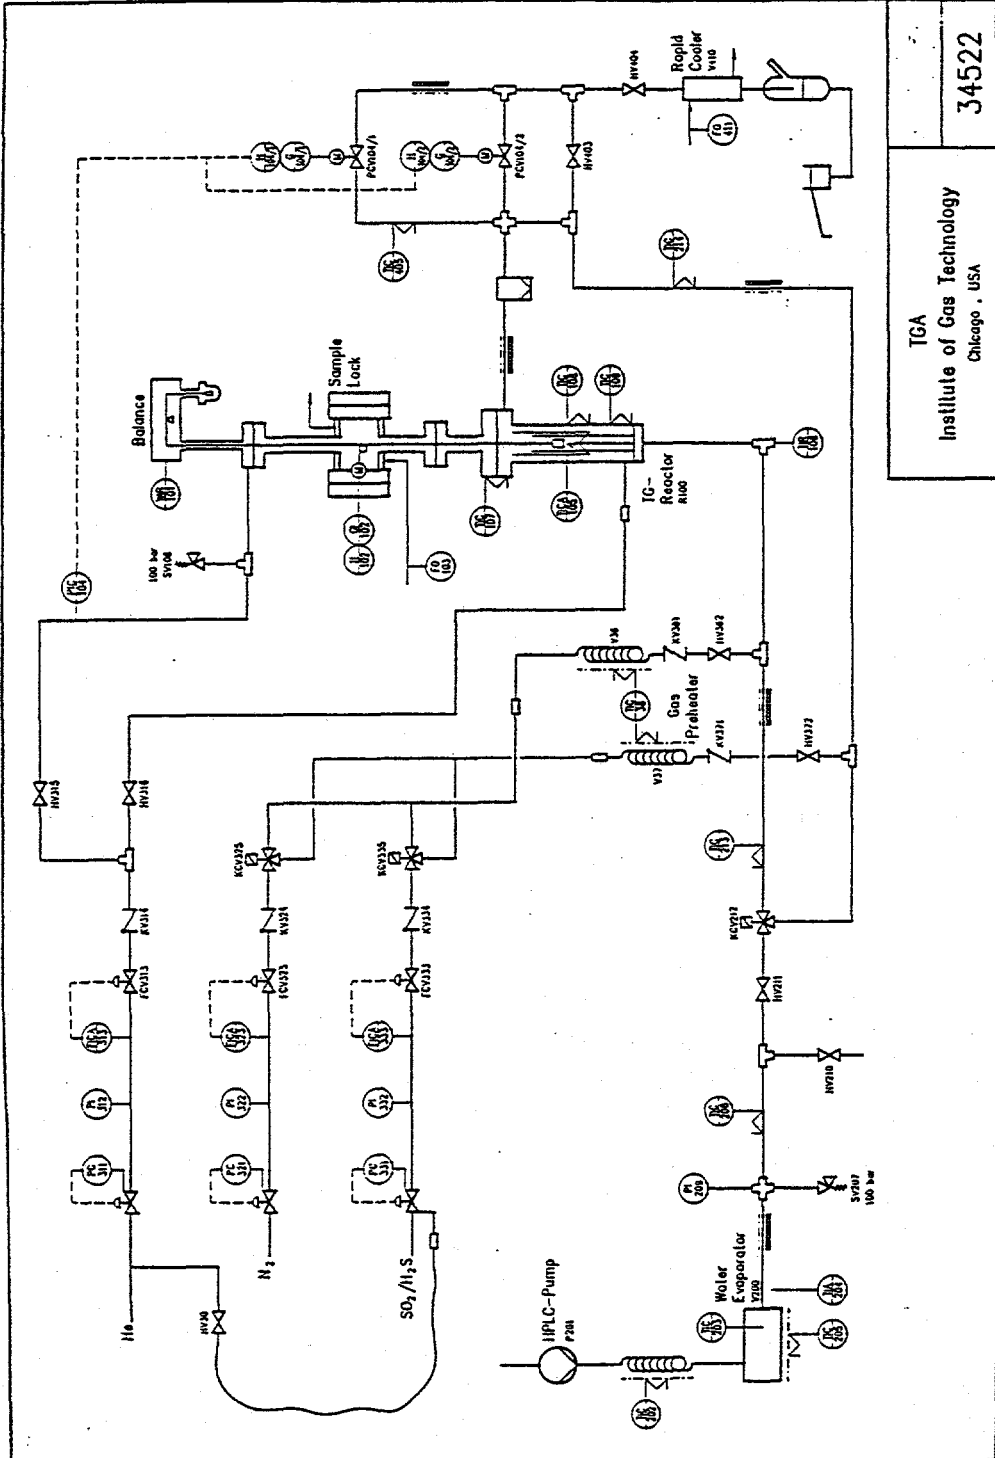

TGA
Institute of Gas Technology
Chicago, USA

34522

Figure 2. SCHEMATIC DIAGRAM OF THE PRESSURIZED TGA UNIT

Table 3. CHEMICAL ANALYSES OF SORBENTS

<u>Analyses, wt %</u>	Limestone	Dolomite
Calcium	38.7	22.2
Magnesium	0.59	13.2
Potassium	0.5	0.5
Iron	0.084	0.11
Aluminum	0.05	0.069
Silicon	0.11	0.3
Strontium	0.015	0.005
Carbon Dioxide	44.7	48.0
Oxygen (by Diff.)	<u>15.251</u>	<u>15.616</u>
	100	100

Samples of the selected limestone and dolomite, sulfided in fluidized-bed reactor (during last quarter) were analyzed. These samples represent discharge material from carbonizer with in-bed sulfur capture operating in calcining as well as non-calcining regime. The extent of sulfidation in these samples are given in the section under "RESULTS AND DISCUSSION".

Task 2. Sulfation Reaction Tests

The objective of this task is to determine the rates of reactions involving partially sulfided limestone and dolomite (produced by direct sulfidation reaction in the carbonizer), and oxygen as well as sulfur dioxide, at operating conditions expected in the second stage (combustor) of two-stage PFBC processes.

The effects of sorbent type, oxygen and SO₂ partial pressures, and reactor pressure and temperature on the reaction rate will be determined. Sulfation tests will also be conducted with CO₂ partial pressures slightly below the equilibrium values, to determine the rate of reaction with calcined sorbents in the vicinity of equilibrium. These tests will be conducted with both sorbents, in the temperature range of 800 to 950°F, pressure range of 12 to 20 atmospheres, and both sorbents with an average particle diameter of about 300 μm.

The schematic diagram of the HPTGA unit is shown in Figure 2. In a typical HPTGA test, the wire mesh basket containing the sample is initially in the upper section of the reactor in which a downward flow of an inert gas at ambient temperature is maintained. During this time the desired conditions are established in the lower, heated section of the reactor in the presence of flowing inert gases. The reactor gas is then changed to a gas mixture with the desired composition when the reactor temperature has reached the desired value. The test is initiated by lowering the sample into the heated zone while its weight is continually monitored and recorded as the sorbent reacts with the gas. The test is terminated when the sample weight reaches a constant value (no weight loss or gain).

Because the gas flow rates in the reactor are sufficiently high to essentially eliminate changes in the gas composition, the reactions occur under a constant and known environment. Under these conditions the weight loss-versus-time characteristics can be used to determine the reaction rates under constant conditions.

A number of shakedown tests were conducted with the HPTGA unit. However because of problems with the pressure control system, the reactor pressure could not be stabilized within 0.01 atm., required for accurate measurement of the sample weight change during sulfation tests. A new pressure control system has been installed and is currently being evaluated to eliminate this problem.

Task 3. Analysis of Sulfation Reaction Data

The objective of this task is to provide guidelines for estimation of the extent of sulfur removal and the composition of the final solid waste material in the second stage (combustor) of the advanced two-stage PFBC at different operating conditions.

The reaction rate data to be obtained in Task 2 at the prevailing PFBC operating conditions, combined with the data obtained in the previous ICCI-funded project, will provide the necessary information to make a more accurate prediction to the extent of desulfurization and the composition of the solid waste products in the large-scale advanced two-stage PFBC processes.

RESULTS AND DISCUSSION

The results of chemical analyses of the partially sulfided sorbents are given in Table 4.

Table 4. CHEMICAL COMPOSITION OF SULFIDED SORBENTS

<u>Sorbent</u>	<u>State of Calcination</u>	<u>Extent of Sulfidation, %</u>
Dolomite	Calcined	50.1
Dolomite	Half-Calcined	41.0
Limestone	Calcined	22.9
Limestone	Uncalcined	21.2

These samples, which are to be used as feed material for the sulfation tests, were screened into three particle sizes with average diameters of 0.01, 0.03, and 0.09 cm.

even smaller weight changes. At these conditions, external factors such as buoyancy and drag forces are as large or even larger than the expected sample weight change. Therefore, any change in the reactor pressure will significantly affect the sample weight measurements. In order to minimize or potentially eliminate the pressure fluctuations during the experiments, a new pressure control system has been installed. The new pressure control system is currently being evaluated.

CONCLUSIONS AND RECOMMENDATIONS

Analyses of the partially sulfided sorbents indicate that the extent of sulfidation in the samples are in the range of 20 to 50%, which are suitable as feed material for the sulfation tests. The high pressure thermogravimetric analyzer (HPTGA) unit was modified during this quarter to install a new pressure control system. Therefore, no conclusions about the sulfation test results can be made at this time.

REFERENCES CITED

1. Robertson, A., et al., 1988, "Effects of Tightened Emission Standards on Second-Generation Pressurized Fluidized-Bed Combustion Plants," Fifth Annual International Pittsburgh Coal Conference Proceedings, Pittsburgh, PA, Sept. 12-16.
2. Campbell, W. M., et al., 1990, Pressurized Fluid-Bed Combustion Alternate Advanced Concepts, Final Report to U.S. DOE, DOE/MC/2500-2934, September.
3. Minchener, A. J., Clark, R. K., and Dawes, S. G., 1991, "The British Coal Topping Cycle Development Programme," Proceedings of the 1991 International Conference on Fluidized Combustion, Vol 1, pg. 115, Montreal, Canada.
4. Robertson, A., et al., 1992, "The Advanced PFB Process: Pilot Plant Results and Design Studies," Paper presented at the 11th International Conference on Fluidized-Bed Combustion, Montreal, Canada.
5. Rehmat, A. and Goyal, A., 1987, Pressurized Fluidized-Bed Combustion (PFBC): Second-Generation Systems Research and Development, Subtask: Carbonizer In the HPTGA experiments, to eliminate interparticle diffusion and changes in the reactant gas composition, the amount of sample used are very small (i.e., 2-10 mg), resulting in Model, Final Report to Foster Wheeler Development Corp., under U.S. DOE Contract No.: DE-AC21-86MC231023, November.
6. Newby, A. R., et al., 1993, "Cross Flow Filter Performance With Second Generation PFBC Carbonizer Fuel Gas," Paper presented at the 12th International Conference on Fluidized-Bed Combustion, San Diego, California.

7. Mojtahedi, W., Horvath, A., and Salo, K., 1991, "An Environmentally Sound Scheme for Energy Production: Tampella's IGCC Process." Paper presented at 1991 International Symposium on Energy and Environment, Helsinki, Finland.
8. Lau, F. S. and Salo, K., 1991, "Demonstration Plant for IGCC Using the U-GAS Process." Paper presented at the 18th World Gas Conference, Berlin, Germany, June 24-28.
9. Squires, A. M., Graff, R. A. and Pell, M., 1971, "Desulfurization of Fuels With Calcined Dolomite. I. Introduction and First Kinetic Results," Chemical Engineering Progress Symposium Series, 115(67).
10. Goyal, A., et al., 1990, "In-Situ Desulfurization in a Fluidized-Bed Gasifier," Energy Sources, 12, 161-179.
11. Keairns, D., Newby, R. A., O'Neill, E. P. and Archer, D. H., 1976, "High Temperature Sulfur Removal System Development for Westinghouse Fluidized Bed Coal Gasification Process," Am. Chem. Soc. Div. Fuel Chem. Prepr., 21:91.
12. Jones, F. L. and Patel, J. G., 1985, "Performance of Utah Bituminous Coal in the U-GAS Gasifier." Paper presented at the Fifth EPRI Contractor's Conference on Coal Gasification. EPRI, Palo Alto, CA.
13. Weldon, J., Haldipur, G. B., Lewandowski, D. A., Smith, K. J., 1986, "Advanced Coal Gasification and Desulfurization with Calcium Based Sorbents," Am. Chem. Soc. Div. Fuel Chem., Prepr., 33:3.
14. Rehmat, A., Abbasian, M. J., 1987, "Reactions of Calcium-Based Sorbents With Sulfur in Coal Gasification." Paper presented at 1987 International Conference on Coal Science, Eurohal, Maastricht, The Netherlands.
15. Abbasian, J., Rehmat, A., Leppin, D., 1990, "Desulfurization of Fuels With Calcium-Based Sorbents," Fuel Processing Technology, 25, 1-15.
16. Rehmat, A., Abbasian, J., and Lau, F., 1990, "U-GAS Coal Gasification Process with In-Situ Desulfurization." Paper presented at the Seventh U.S.-Korea Joint Workshop on Coal Utilization Technology, Pittsburgh, PA.
17. Abbasian, J., Rehmat, A., Leppin, D. and Banerjee, D. D., 1990, "H₂S Removal from Fuel Gas During Coal Gasification." Paper presented at the Division of Fuel Chemistry, American Chemical Society, Boston, MA.
18. Abbasian, J., and Hill, A. H., 1993, "Sulfation of Spent Sorbents From Coal Gasifier," Paper presented at the AIChE Summer National Meeting, Seattle.

19. Abbasian, J., Wangerow, J. R., and Hill, A. H., 1993, "Effects of HCl on Sulfidation of Calcium Sulfide," Chemical Engineering Science, Vol. 48, No. 15, 1993.
20. Abbasian, J. and Rehmat, A., 1991, Reaction of Calcium-Based Sorbents With Sulfur Compounds During Gasification, Final Technical Report 1986-1991 by Institute of Gas Technology for Gas Research Institute.
21. Borgwardt, R. H., Roache, N. F., 1984, "Reaction of H₂S and Sulfur with Limestone Particles," Ind. Eng. Chem. Process Des. Dev., 23, 742-748.
22. Ruth, L. A., Squires, A. M., and Graff, R. A., 1972, "Desulfurization of Fuels with Half-Calcined Dolomite: First Kinetic Data," Environmental Science and Technology, 6(12), 1009, November.
23. Squires, A. M., 1967, "Cyclic Use of Calcined Dolomite to Desulfurize Fuels Undergoing Gasification," Adv. Chem. Ser., 69, 205-229.
24. Kamath, V. S. and Petrie, T. W., 1981, "Rate of Reaction of Hydrogen Sulfide-Carbonyl Sulfide Mixtures with Fully Calcined Dolomite," Environ. Sci. Technol., 15, 966-968.
25. Simons, G. A and Rawlins, W., 1980, "Reaction of Sulfur Dioxide and Hydrogen Sulfide with Porous Calcined Limestone," Ind. Eng. Chem. Process Des. Dev., 19, 565-572.
26. Yen, J. H., Li, K. and Rogan, F. H., 1981, "Reaction Mechanism of Half-Calcined Dolomite During Sulfidation," Chem. Eng. Commun., 10, 35-60.
27. Freund, H., 1984, "Intrinsic Global Rate Constant for the High-Temperature Reaction of CaO with H₂S," Ind. Eng. Chem. Fundam., 23, 338-341.
28. Borgwardt, R. H., Roache, N. F., and Bruce, K. R., 1984, "Surface Area of Calcium Oxide and Kinetics of Calcium Sulfide Formation," Environ. Progr., 3(2), 129, May.
29. Abbasian, J., Hill, A. H., Chowdiah, P., Rue, D. M., and Honea, F. I., 1994, "Sulfur Removal in Advanced Two-Stage PFBC Process," Paper presented at the 1994 AIChE Annual Meeting, San Francisco.
30. Abbasian, J., Hill, A. H., and Rue, D. M., 1994, Sulfur Removal in Advanced Two-Stage Pressurized Fluidized-Bed Combustion, Final Report prepared for Illinois Clean Coal Institute.

31. Abbasian, M. J., Rehmat, A., Leppin, D., Banerjee, D. D., 1991, "Oxidation of Partially Sulfided Calcium-Based Sorbents." Paper presented at the 1991 International Symposium on Energy and Environment, Helsinki, Finland.
32. Abbasian, M. J., Rehmat, A., Banerjee, D. D., 1991, "Sulfation of Partially Sulfided Calcium-Based Sorbents." Ind. Eng. Chem. Res., 30, 8, 1990-1994.
33. Abbasian, J., Hill, A. H., Wangerow, J. R., Rehmat, A., 1991, "Stabilization of Solid Wastes From Coal Gasification," Paper presented at the 1991 AIChE Annual Meeting, Los Angeles, CA.
34. Abbasian, J., Rehmat, A., Hill, A., 1991, Stabilization of Solid Wastes From Coal Gasification, Final Technical Report, by the Institute of Gas Technology to Center for Research on Sulfur in Coal.
35. Abbasian, J., 1990, Stabilization of Solid Wastes From Coal Gasification, Final Technical Report, by the Institute of Gas Technology for Center for Research on Sulfur in Coal.
36. Chang, E. Y. and Thodos, G., 1984, "Complex Nature of Sulfation Reactions of Limestone and Dolomite," AIChE J., Vol. 30, No. 3.
37. Borgwardt, R. H. and Bruce, K. R., 1986, "Effect of Specific Surface Area on Reactivity of CaO with SO₂," AIChE J. Vol. 32, No. 2.
38. Simon, G. A. and Garmen, A. R., 1985, "Interparticle Mass Transfer During Sulfidation by Calcined Limestone," Paper presented at 23rd AIChE/ASME National Heat Transfer Conference, Denver, Colorado.
39. Snow, M. J. H., Longwell, J. P., and Surofim, A. G., 1988, Environmental Science Technology, 6, 350.
40. Iisa, K., Tullin, C., and Hupa, M., 1991, "Simultaneous Sulfation and Recarbonation of Limestone Under PFBC Condition," Paper presented at the 11th International Conference on Fluidized Bed Combustion, Montreal, Canada.

This report was prepared by Javad Abbasian, Institute of Gas Technology, with support, impart by grants made possible by the U. S. Department of Energy Cooperative Agreement Number DE-FC22-92PC92521 and the Illinois Department of Energy through the Illinois Coal Development Board and the Illinois Clean Coal Institute. Neither Javad Abbasian, Institute of Gas Technology, nor any of its subcontractors nor the U.S. Department of Energy, Illinois Department of Energy & Natural Resources, Illinois Coal Development Board, Illinois Clean Coal Institute, nor any person acting on behalf of either:

- (A) Makes any warranty of representation, express or implied, with respect to the accuracy, completeness, or usefulness of the information contained in this report, or that the use of any information, apparatus, method, or process disclosed in this report may not infringe privately-owned rights; or
- (B) Assumes any liabilities with respect to the use of, or for damages resulting from the use of, any information, apparatus, method or process disclosed in this report.

Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendations, or favoring by the U.S. Department of Energy. The views and opinions of authors expressed herein do not necessarily state or reflect those of the U.S. Department of Energy.

Notice to Journalists and Publishers: If you borrow information from any part of this report, you must include a statement about the DOE and Illinois cost-sharing support of the project.

PROJECT MANAGEMENT REPORT
December 1, 1994 through February 28, 1995

Project Title: **SULFUR REMOVAL IN ADVANCED TWO STAGE
PRESSURIZED FLUIDIZED-BED COMBUSTION**

DOE Cooperative Agreement Number: DE-FC22-92PC92521 (Year 3)
ICCI Project Number.: 94-1/5.1A-1M
Principal Investigator: Javad Abbasian, Institute of Gas Technology
Other Investigators: Andy Hill and James, R. Wangerow,
Institute of Gas Technology
Project Manager: Franklin I. Honea, Illinois Clean Coal Institute

COMMENTS

Because of the problem with pressure control system in the high pressure thermogravimetric analyzer (HPTGA), no successful sulfation test were made during this quarter. A new pressure control system has been installed to eliminate this problem. Despite the delay, the project is expected to be completed within schedule.

EXPENDITURES - EXHIBIT B

CUMULATIVE PROJECTED AND ESTIMATED EXPENDITURES BY QUARTER


Quarter*	Types of Cost	Direct Labor	Fringe Benefits	Materials & Supplies	Travel	Major Equipment	Other Direct Costs	Indirect Costs	Total
Sept. 1, 1994 to Nov. 30, 1994	Projected	9263	-----	700	1000	-----	-----	16,652	27,615
	Estimated	3615	-----	500	1000	-----	-----	6,682	11,797
Sept. 1, 1994 to Feb. 28, 1995	Projected	20405	-----	2300	1000	-----	-----	36,583	60,288
	Estimated	8431	-----	1061	670	-----	-----	15196	25,358
Sept. 1, 1994 to May 31, 1995	Projected	29965	-----	4300	1000	-----	-----	53,820	89,085
	Estimated	40708	-----	4300	1392	-----	-----	72,784	119,184

*Cumulative by Quarter

CUMULATIVE COSTS BY QUARTER - EXHIBIT C

SULFUR REMOVAL IN ADVANCED TWO STAGE
PRESSURIZED FLUIDIZED BED COMBUSTION

(In Thousands)

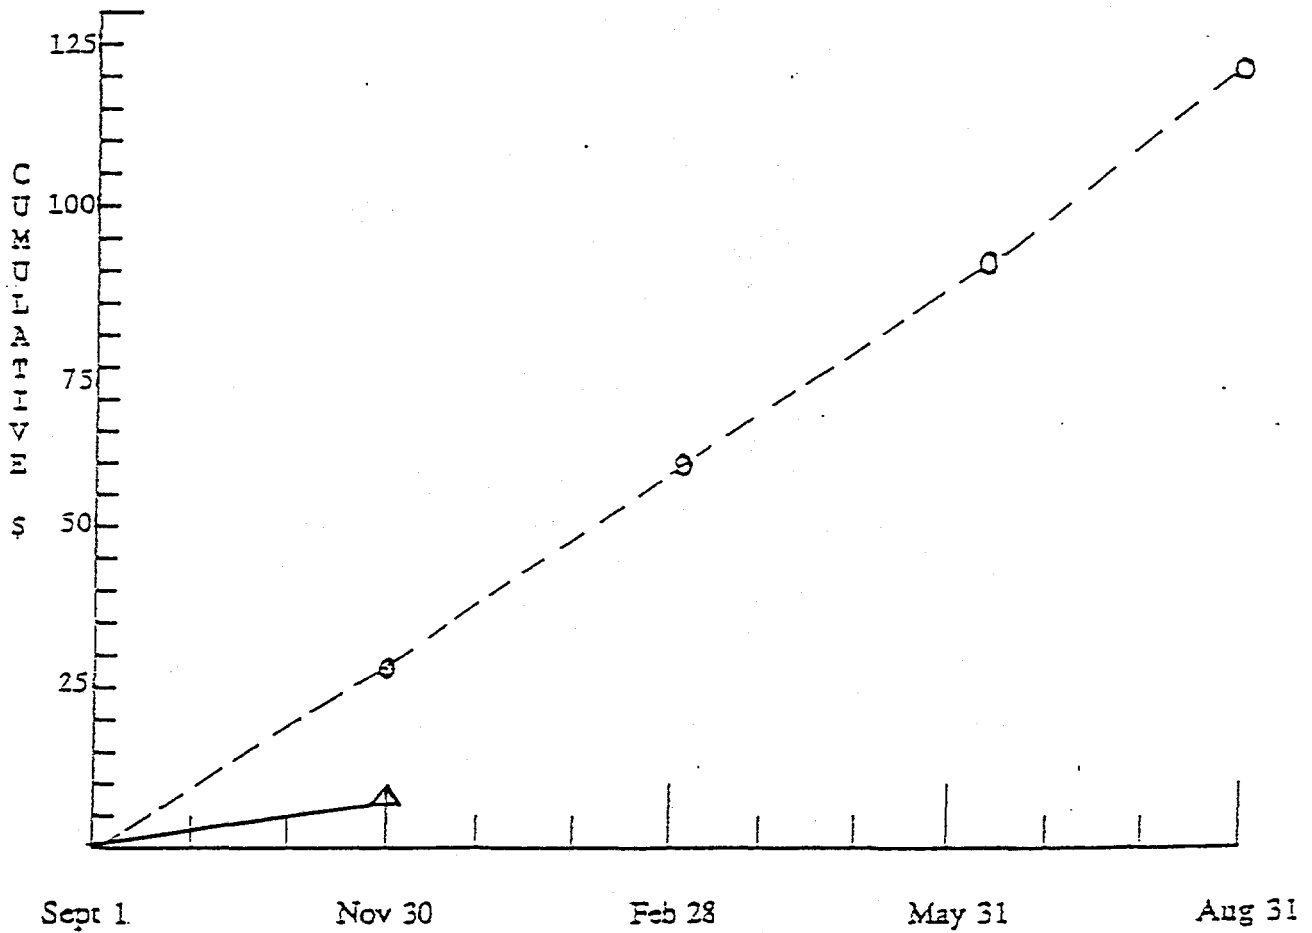


Months and Quarters

O = Projected Expenditures \$60,288

Δ = Actual Expenditures \$25,358

Total ICCI Award \$ 119,184

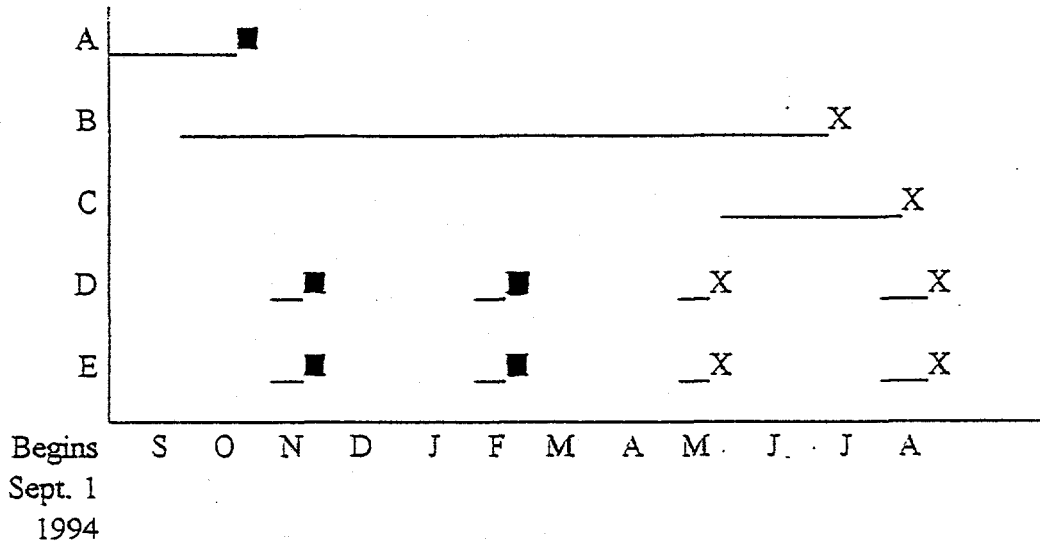

- A. Sorbent Preparation and Characterization
- B. Sulfation Reaction Tests
- C. Analysis of Reaction Rate Data
- D. Preparation of Technical Reports
- E. Preparation of Project Management Report

SCHEDULE OF PROJECT MILESTONES