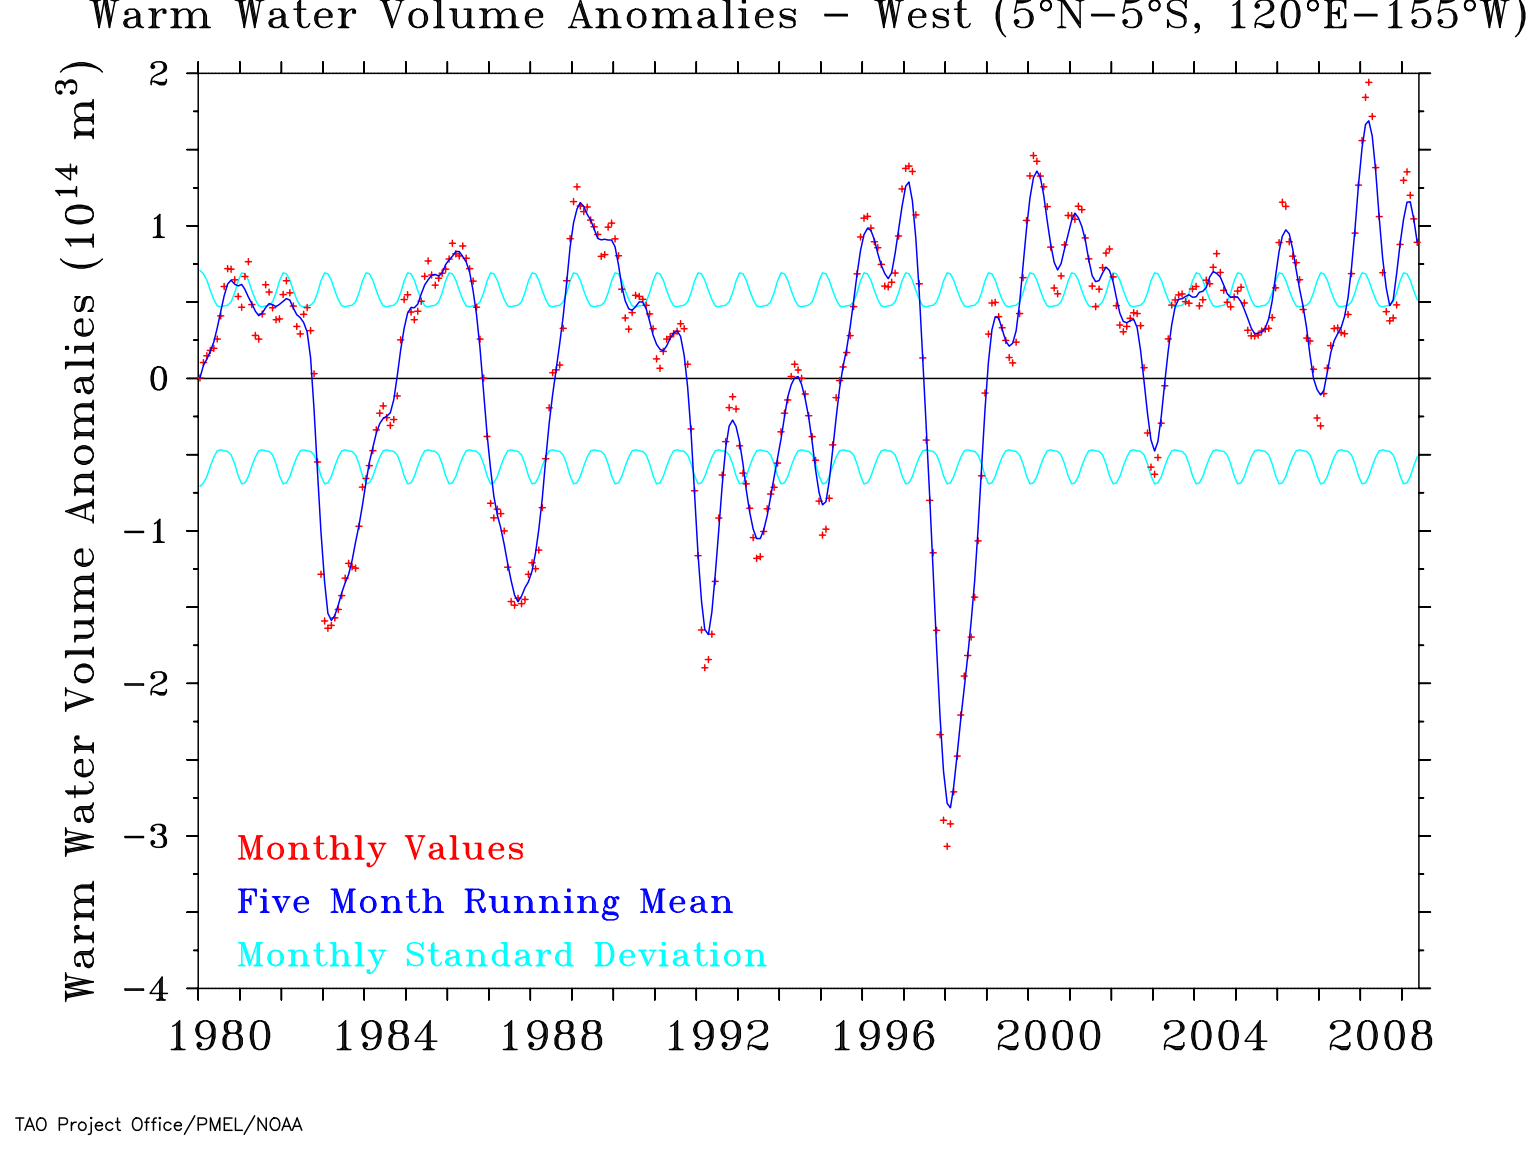
Warm Water Volume Anomalies – West (5°N–5°S, 120°E–155°W)
Warm Water Volume Anomalies (10^{14} m^3)
2
1
0
−1
−2
−3
−4
1980
1984
1988
1992
1996
2000
2004
2008
Monthly Values
Five Month Running Mean
Monthly Standard Deviation
TAO Project Office/PMEL/NOAA