

Expected Change In Coverage: Post-Transition Appendix B Facility

Appendix B (solid): 1000 kW ERP at 248 m HAAT, Network: Fox vs. Analog (dashed): 100 kW ERP at 323 m HAAT, Network: Fox

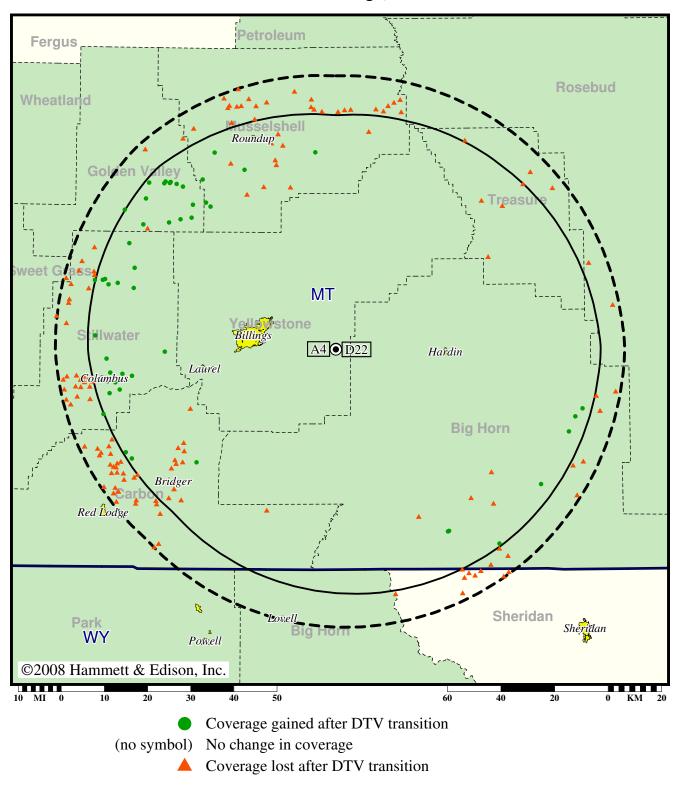


Expected Change In Coverage: Post-Transition Appendix B Facility

Appendix B (solid): 1000 kW ERP at 228 m HAAT, Network: ABC vs. Analog (dashed): 100 kW ERP at 249 m HAAT, Network: ABC

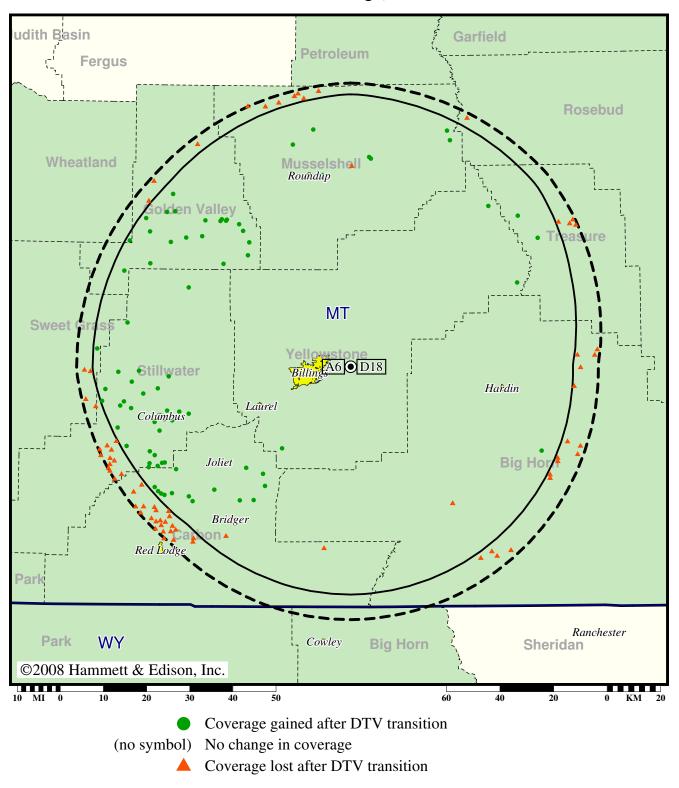


Expected Change In Coverage: Post-Transition Appendix B Facility

Appendix B (solid): 26.1 kW ERP at 180 m HAAT, Network: CBS vs. Analog (dashed): 100 kW ERP at 165 m HAAT, Network: CBS

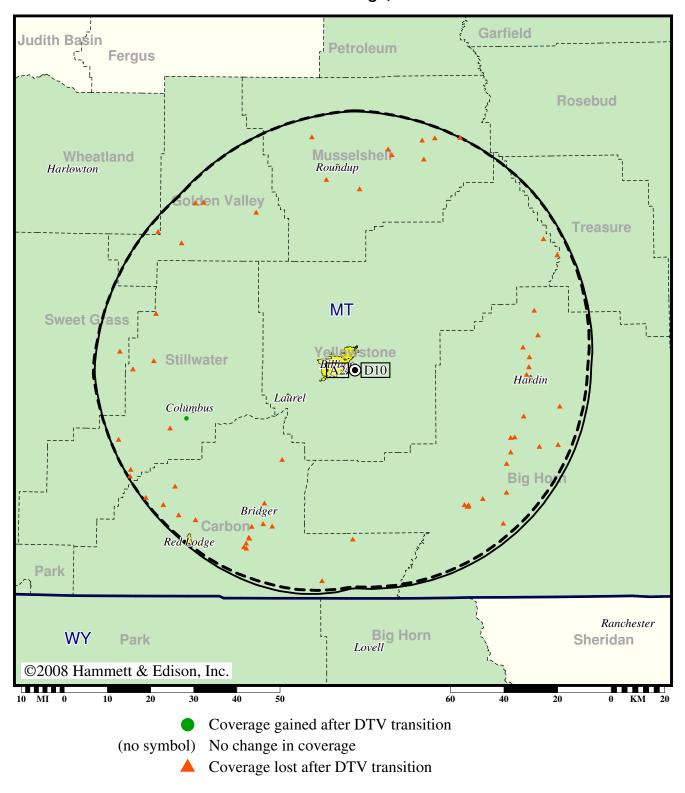

Expected Change In Coverage: Licensed Operation

Licensed (solid): 16.0 kW ERP at 191 m HAAT, Network: NBC vs. Analog (dashed): 316 kW ERP at 229 m HAAT, Network: NBC

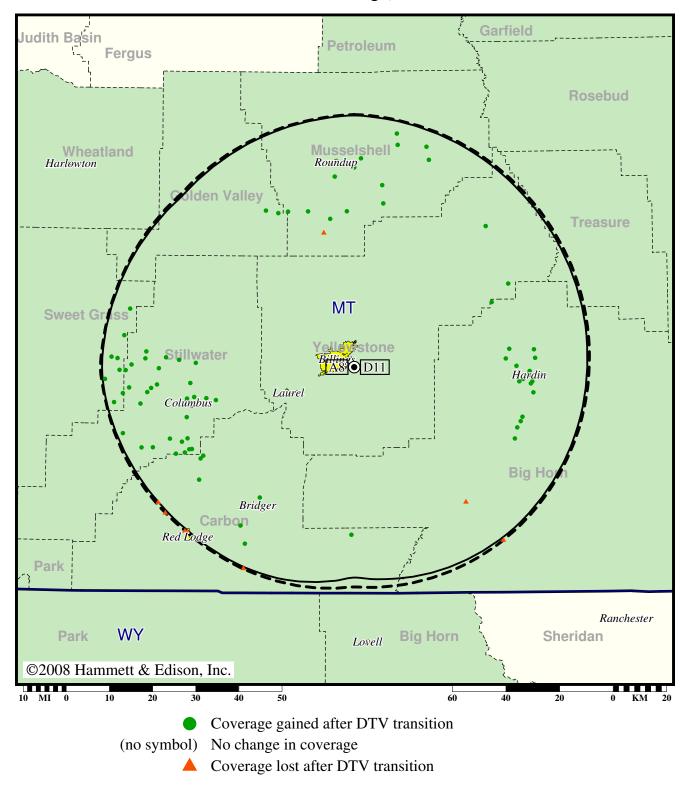

Expected Change In Coverage: Granted Construction Permit

CP (solid): 1.03 kW ERP at 30 m HAAT, Network: NBC vs. Analog (dashed): 10.5 kW ERP at 31 m HAAT, Network: NBC

