

### **Expected Change In Coverage: Granted Construction Permit**

CP (solid): 50.0 kW ERP at 291 m HAAT vs. Analog (dashed): 5000 kW ERP at 349 m HAAT

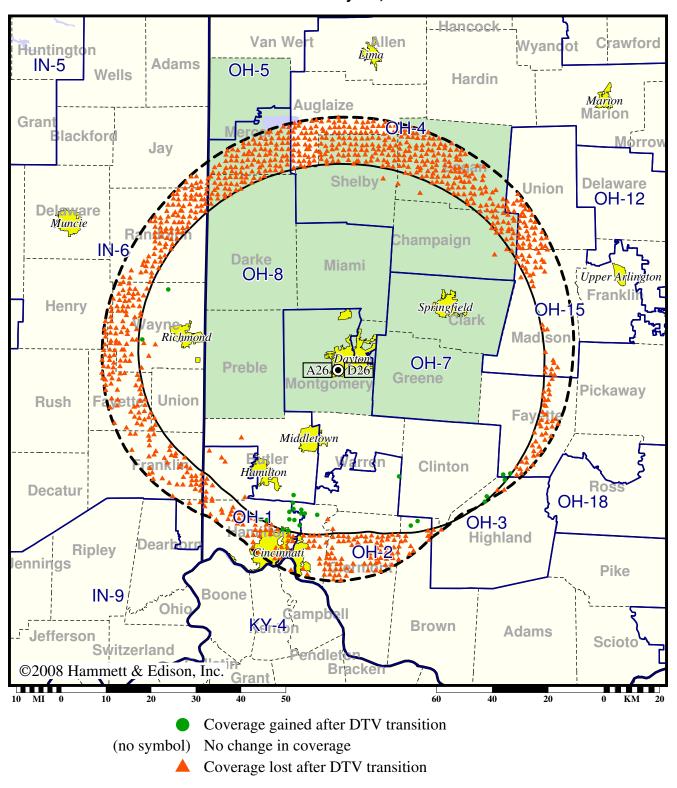


#### **Expected Change In Coverage: Licensed Operation**

# Licensed (solid): 1000 kW ERP at 323 m HAAT, Network: NBC vs. Analog (dashed): 100 kW ERP at 304 m HAAT, Network: NBC

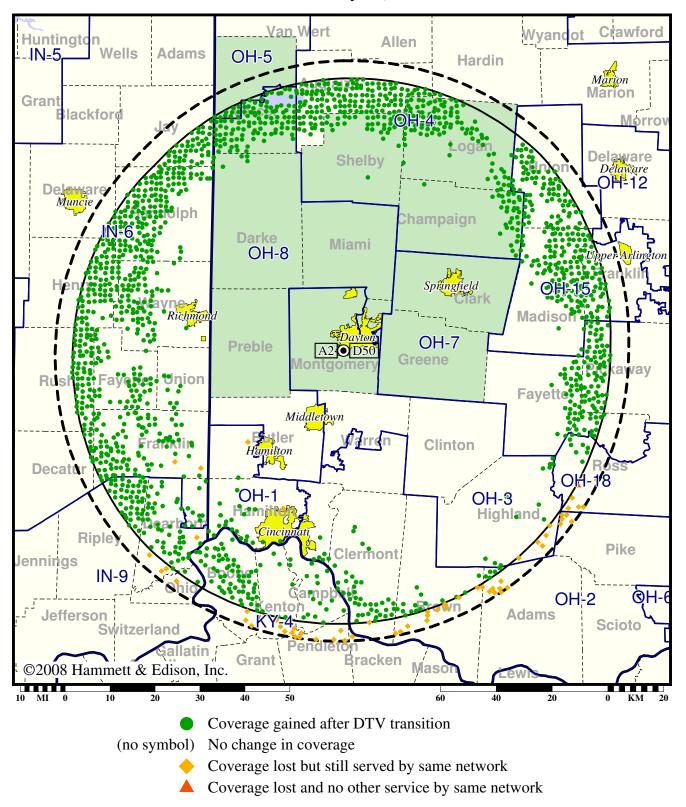


#### **Expected Change In Coverage: Licensed Operation**

# Licensed (solid): 1000 kW ERP at 290 m HAAT, Network: CBS vs. Analog (dashed): 200 kW ERP at 348 m HAAT, Network: CBS

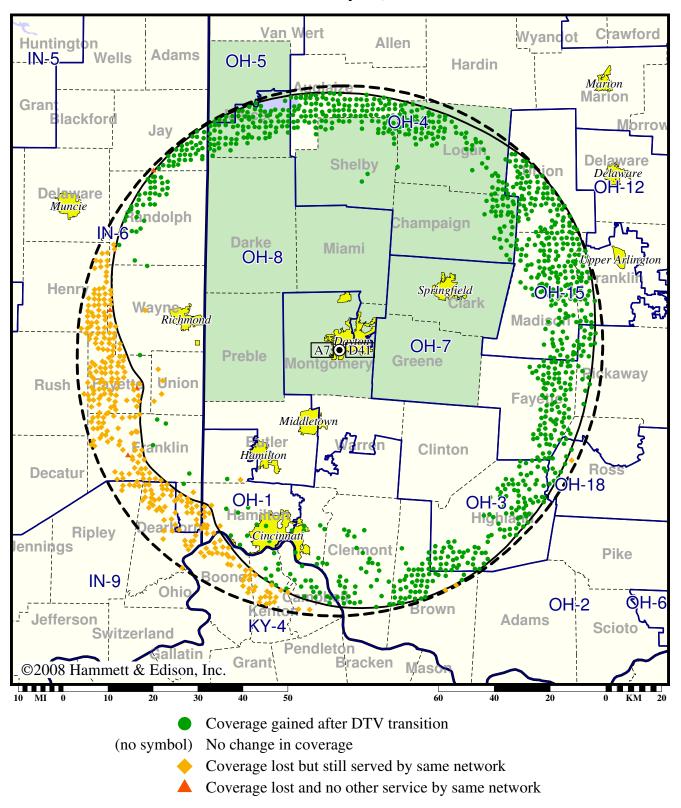


#### **Expected Change In Coverage: Licensed Operation**

# Licensed (solid): 138 kW ERP at 351 m HAAT, Network: ABC vs. Analog (dashed): 2340 kW ERP at 351 m HAAT, Network: ABC

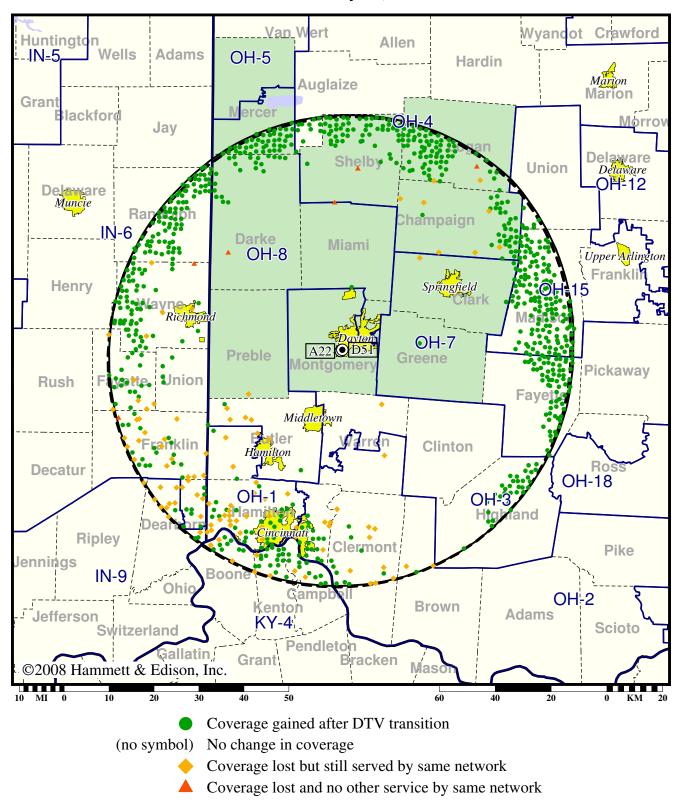


### **Expected Change In Coverage: Granted Construction Permit**

CP (solid): 370 kW ERP at 296 m HAAT vs. Analog (dashed): 2290 kW ERP at 302 m HAAT

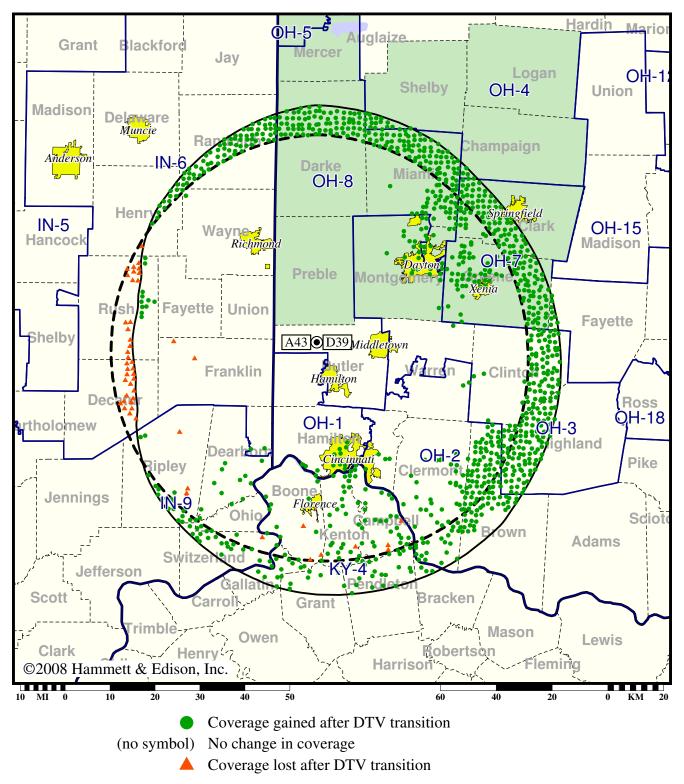

#### **Expected Change In Coverage: Granted Construction Permit**

### CP (solid): 155 kW ERP at 350 m HAAT, Network: PBS vs. Analog (dashed): 1510 kW ERP at 350 m HAAT, Network: PBS

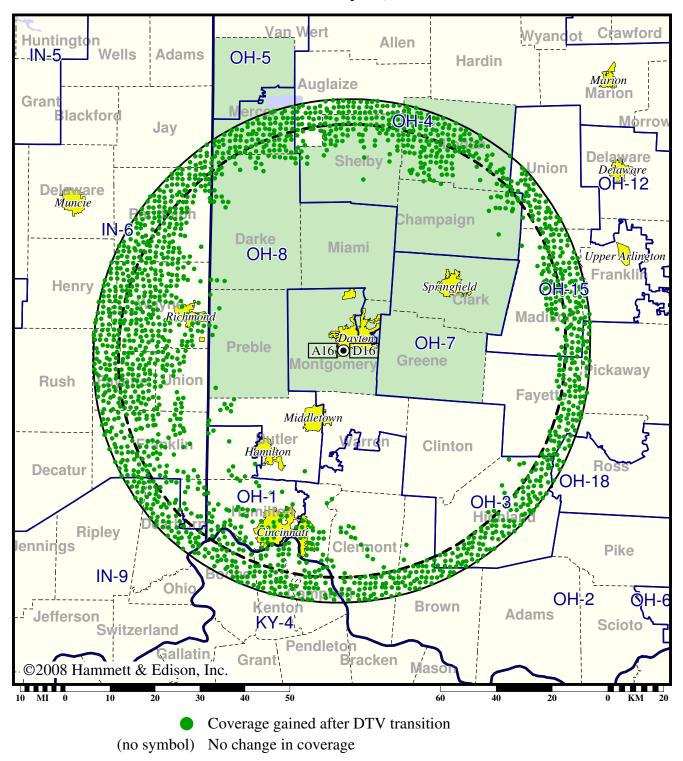

### Expected Change In Coverage: Post-Transition Appendix B Facility

# Appendix B (solid): 425 kW ERP at 351 m HAAT, Network: Fox vs. Analog (dashed): 5000 kW ERP at 357 m HAAT, Network: Fox

