

Expected Change In Coverage: Post-Transition Appendix B Facility

Appendix B (solid): 850 kW ERP at 276 m HAAT, Network: Fox vs. Analog (dashed): 891 kW ERP at 271 m HAAT, Network: Fox

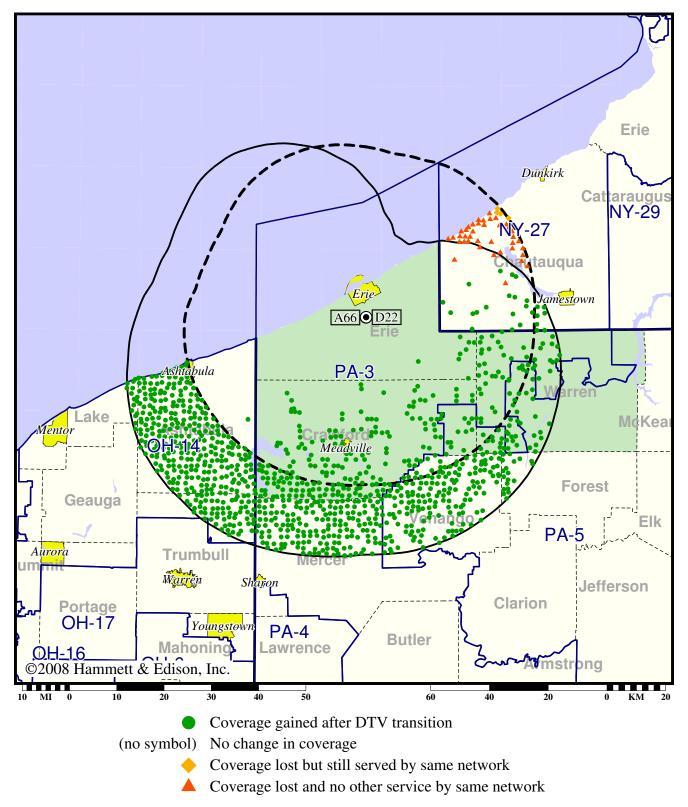


Expected Change In Coverage: Granted Construction Permit

CP (solid): 5.40 kW ERP at 307 m HAAT, Network: NBC vs. Analog (dashed): 316 kW ERP at 305 m HAAT, Network: NBC

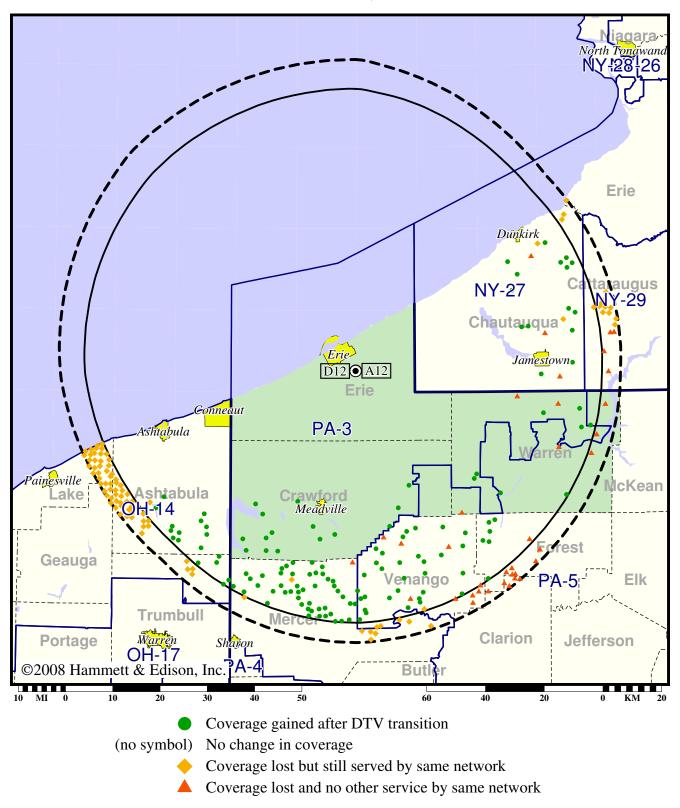


Expected Change In Coverage: Granted Construction Permit

CP (solid): 523 kW ERP at 304 m HAAT, Network: ABC vs. Analog (dashed): 1120 kW ERP at 290 m HAAT, Network: ABC

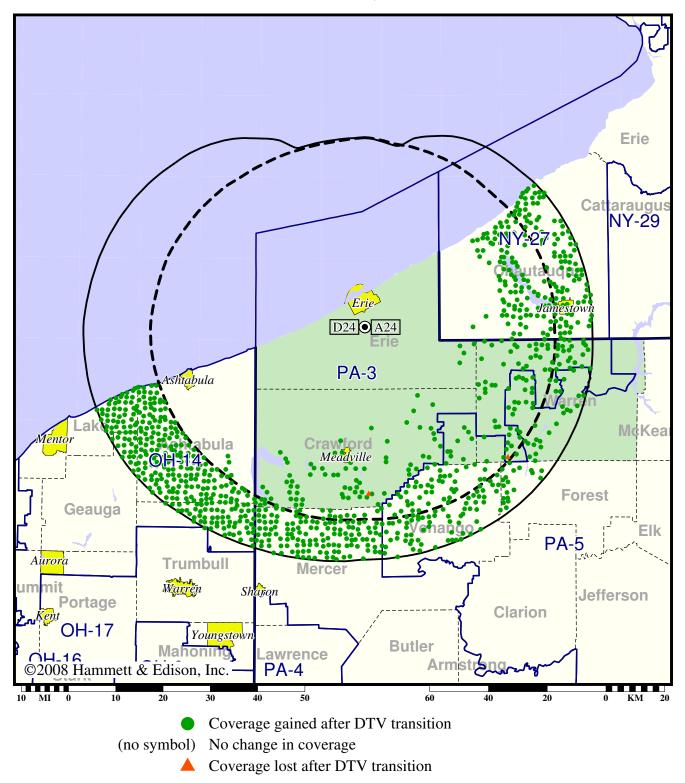

Expected Change In Coverage: Licensed Operation

Licensed (solid): 39.1 kW ERP at 271 m HAAT, Network: PBS vs. Analog (dashed): 1000 kW ERP at 271 m HAAT, Network: PBS

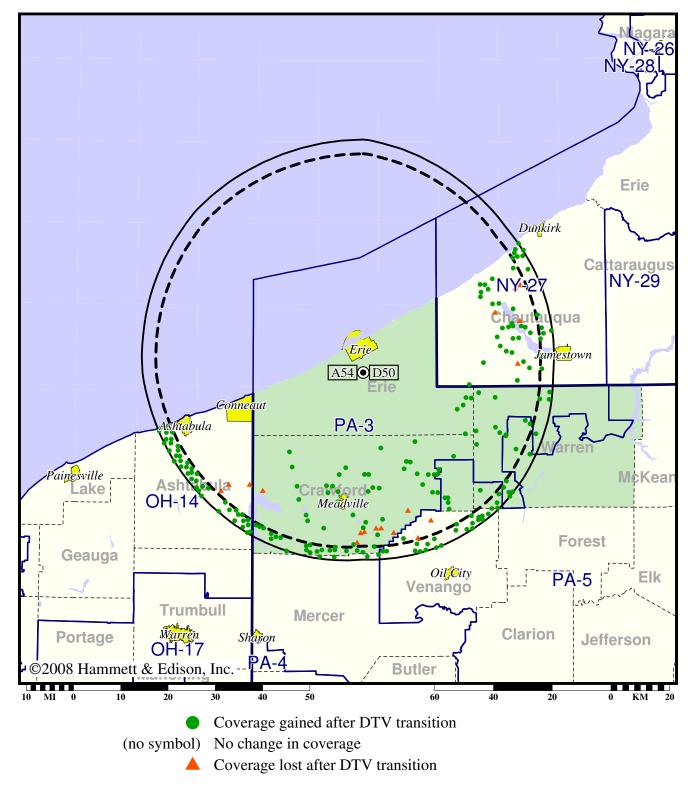

Expected Change In Coverage: Post-Transition Appendix B Facility

Appendix B (solid): 200 kW ERP at 279 m HAAT, Network: CBS vs. Analog (dashed): 1170 kW ERP at 291 m HAAT, Network: CBS

