

Expected Change In Coverage: Post-Transition Appendix B Facility

Appendix B (solid): 71.5 kW ERP at 407 m HAAT, Network: Fox vs. Analog (dashed): 10.7 kW ERP at 422 m HAAT, Network: Fox

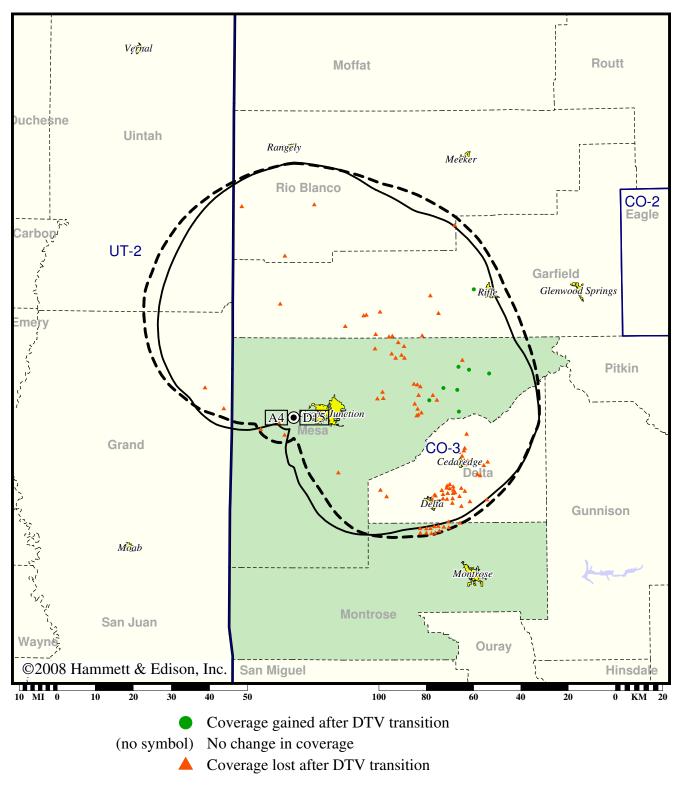


Expected Change In Coverage: Licensed Operation

Licensed (solid): 9.70 kW ERP at 892 m HAAT, Network: ABC vs. Analog (dashed): 120 kW ERP at 829 m HAAT, Network: ABC

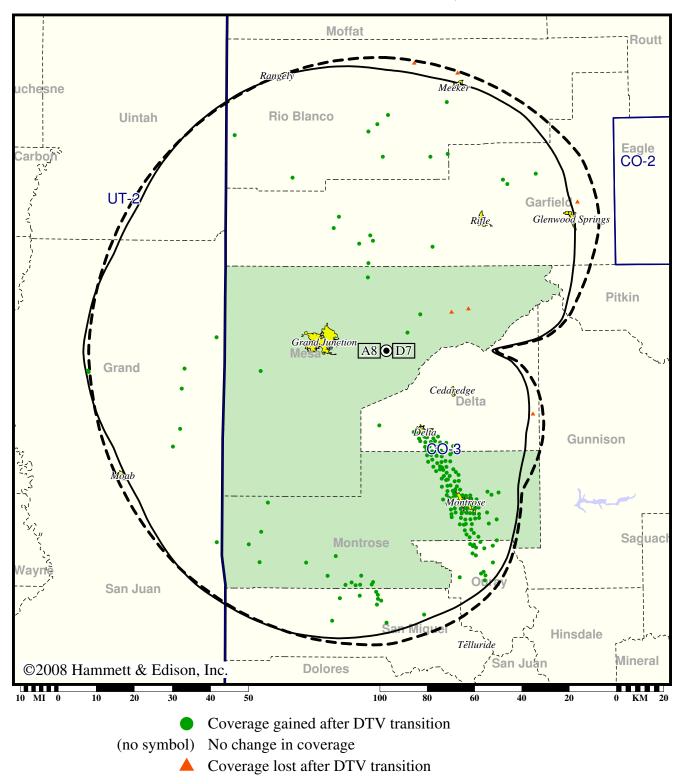


Expected Change In Coverage: Licensed Operation

Licensed (solid): 5.30 kW ERP at 452 m HAAT, Network: NBC vs. Analog (dashed): 155 kW ERP at 446 m HAAT, Network: NBC

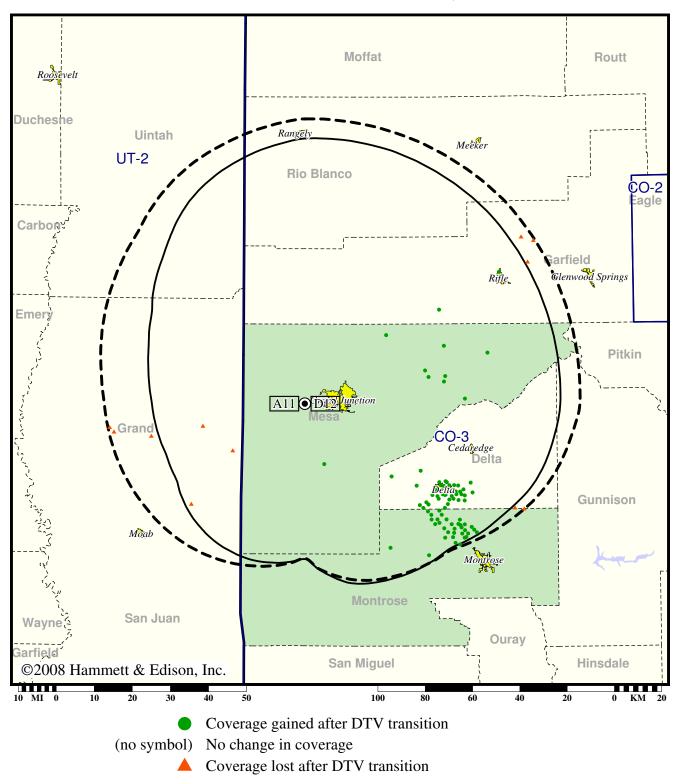


Expected Change In Coverage: Post-Transition Appendix B Facility

Appendix B (solid): 0.800 kW ERP at 28 m HAAT, Network: CBS vs. Analog (dashed): 100 kW ERP at 428 m HAAT, Network: CBS

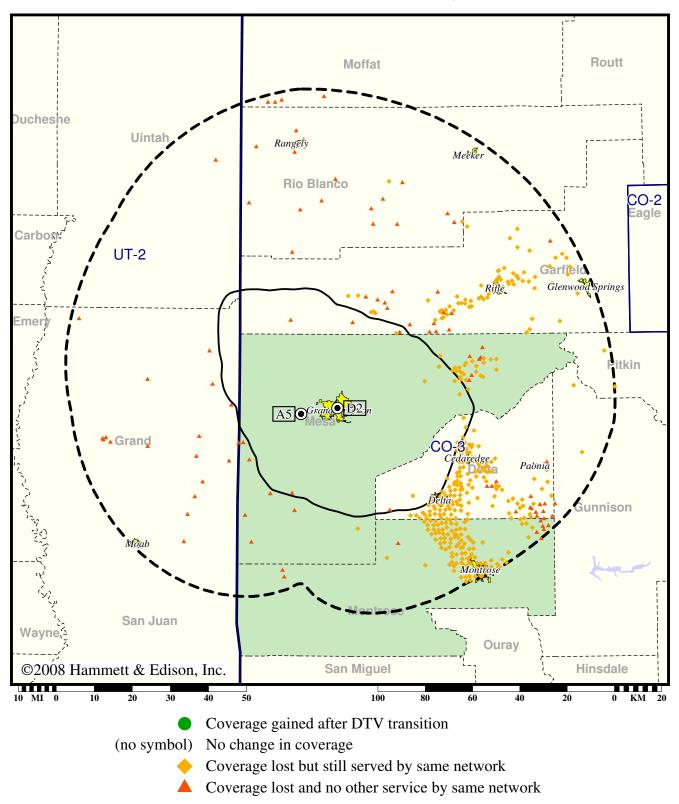

Expected Change In Coverage: Post-Transition Appendix B Facility

Appendix B (solid): 2.60 kW ERP at 35 m HAAT, Network: CBS vs. Analog (dashed): 6.17 kW ERP at 24 m HAAT, Network: CBS

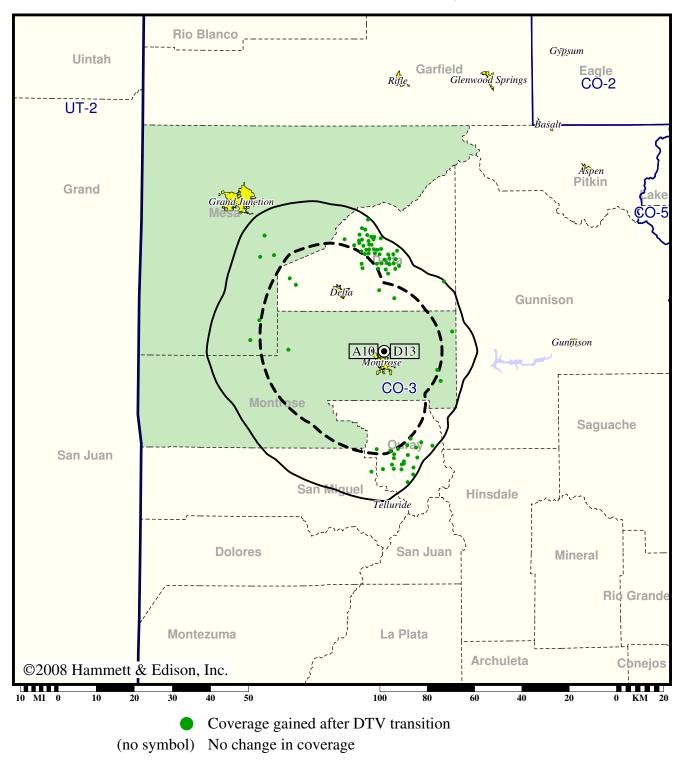

Expected Change In Coverage: Granted Construction Permit

CP (solid): 50.0 kW ERP at 409 m HAAT, Network: PBS vs. Analog (dashed): 105 kW ERP at 409 m HAAT, Network: PBS

