


### Licensed (solid): 1000 kW ERP at 311 m HAAT, Network: ABC vs. Analog (dashed): 708 kW ERP at 324 m HAAT, Network: ABC

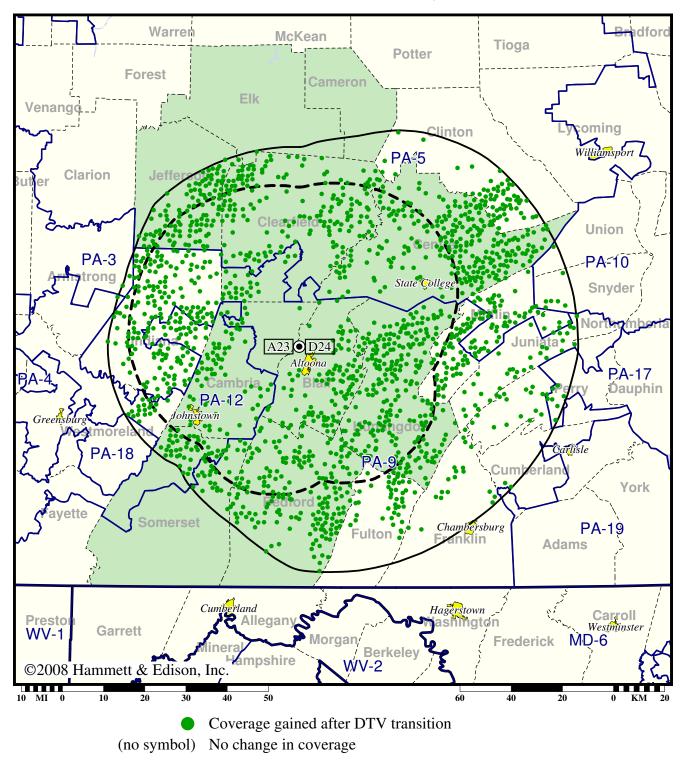

# Licensed (solid): 1000 kW ERP at 386 m HAAT, Network: NBC vs. Analog (dashed): 70.8 kW ERP at 341 m HAAT, Network: NBC

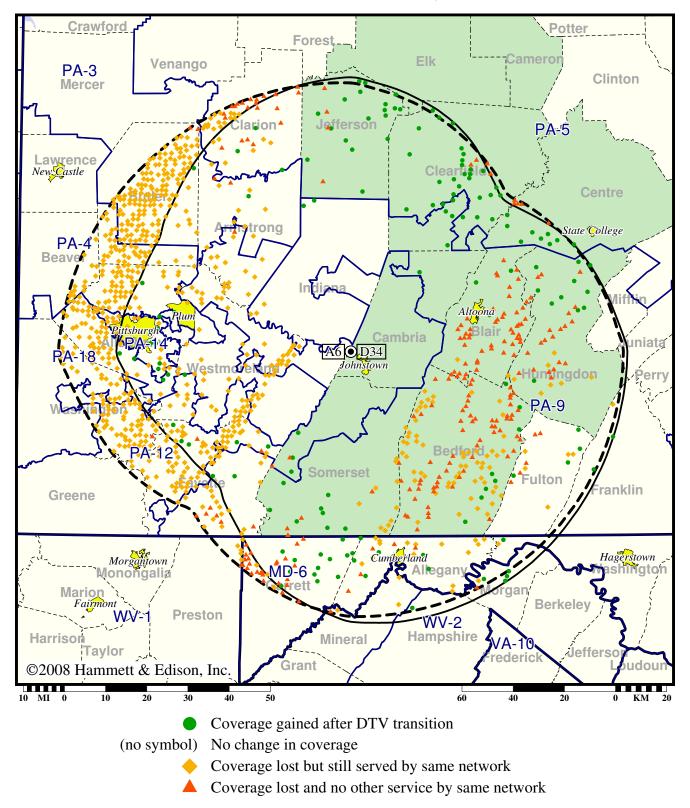


### Licensed (solid): 50.0 kW ERP at 309 m HAAT vs. Analog (dashed): 1510 kW ERP at 308 m HAAT

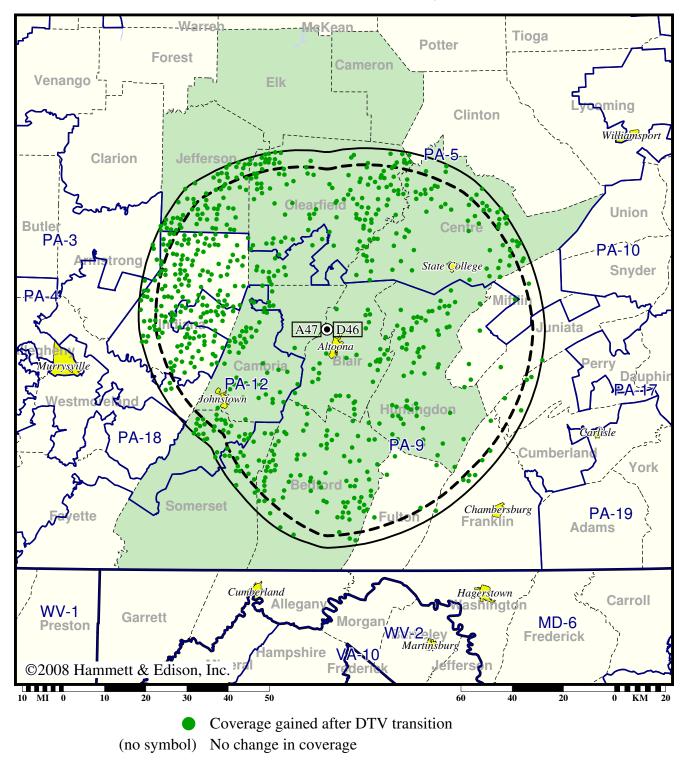


#### Expected Change In Coverage: Post-Transition Appendix B Facility

### Appendix B (solid): 810 kW ERP at 413 m HAAT, Network: PBS vs. Analog (dashed): 42.4 kW ERP at 395 m HAAT, Network: PBS

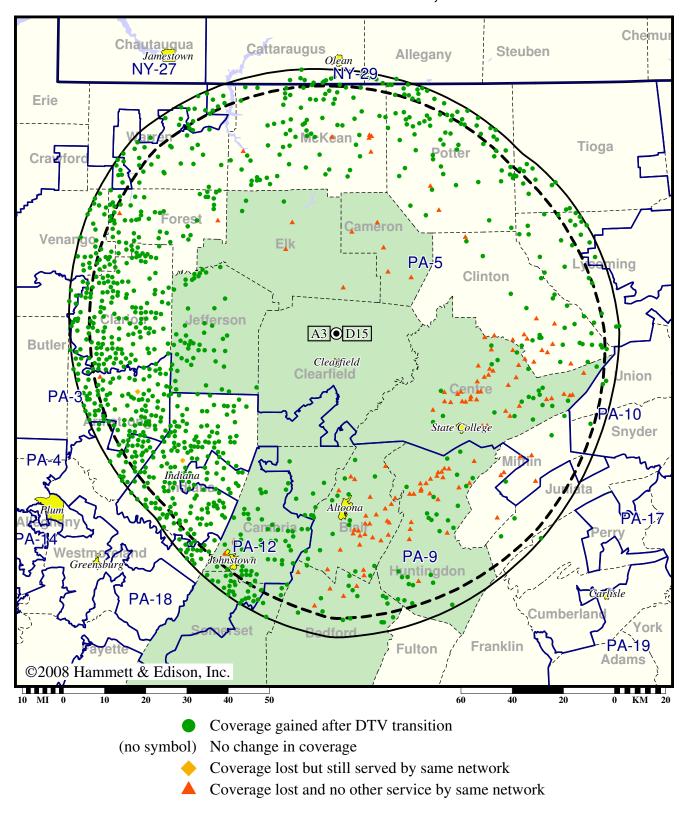

## Licensed (solid): 883 kW ERP at 305 m HAAT, Network: CBS vs. Analog (dashed): 231 kW ERP at 335 m HAAT, Network: CBS

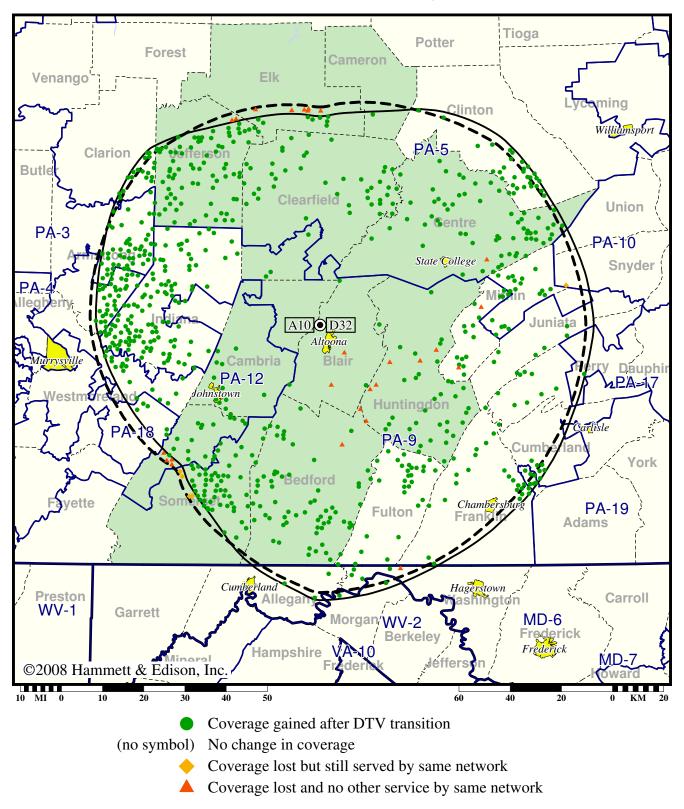

### **Expected Change In Coverage: Granted Construction Permit**

## CP (solid): 8.40 kW ERP at 368 m HAAT, Network: Fox vs. Analog (dashed): 166 kW ERP at 368 m HAAT, Network: Fox

