


CP (solid): 1000 kW ERP at 187 m HAAT vs. Analog (dashed): 631 kW ERP at 189 m HAAT

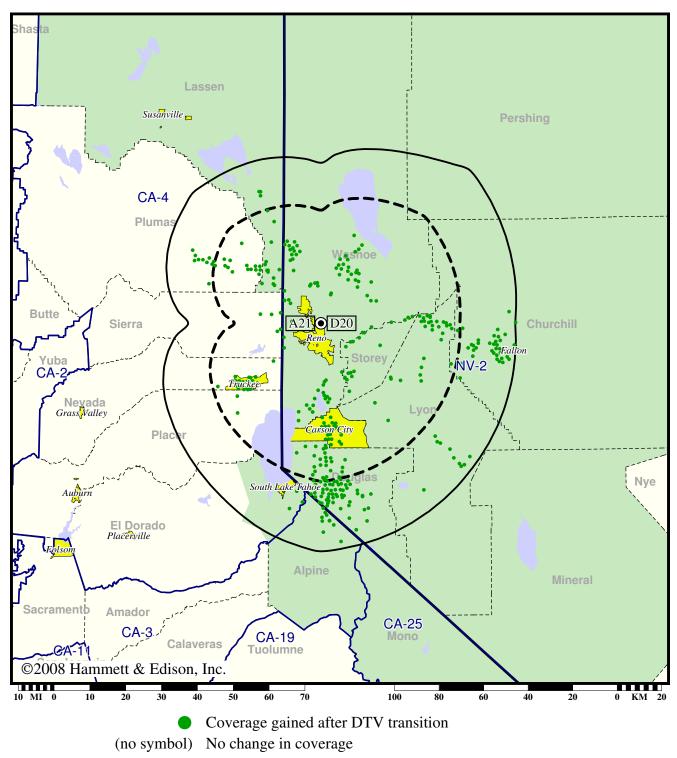


CP (solid): 1.90 kW ERP at 924 m HAAT vs. Analog (dashed): 4.20 kW ERP at 924 m HAAT

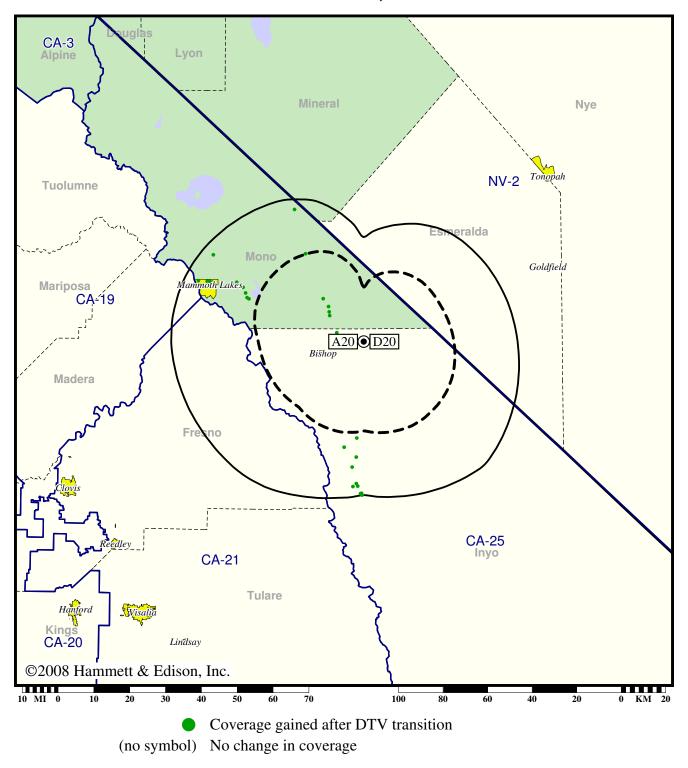


Licensed (solid): 32.3 kW ERP at 149 m HAAT, Network: PBS vs. Analog (dashed): 4.61 kW ERP at 145 m HAAT, Network: PBS

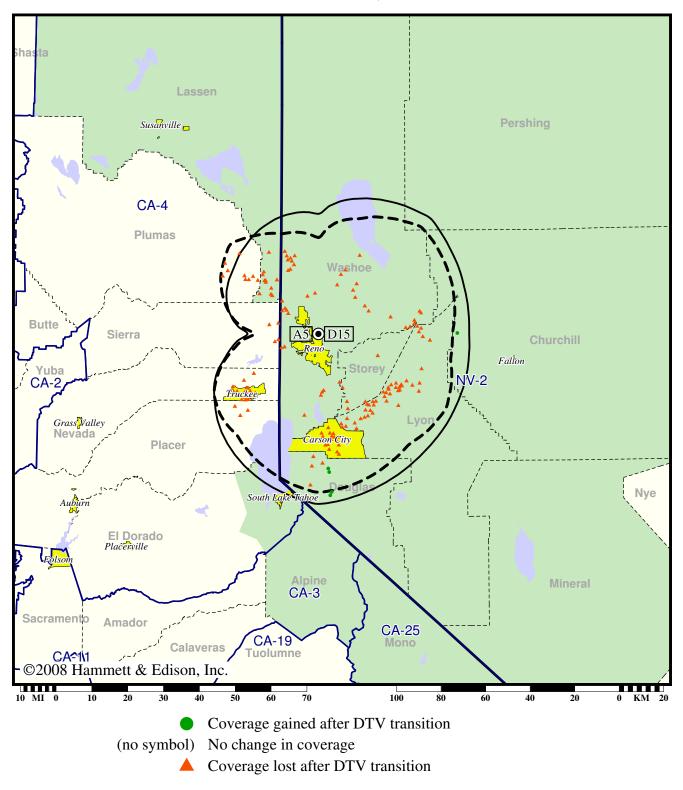


CP (solid): 15.6 kW ERP at 893 m HAAT, Network: ABC vs. Analog (dashed): 166 kW ERP at 893 m HAAT, Network: ABC

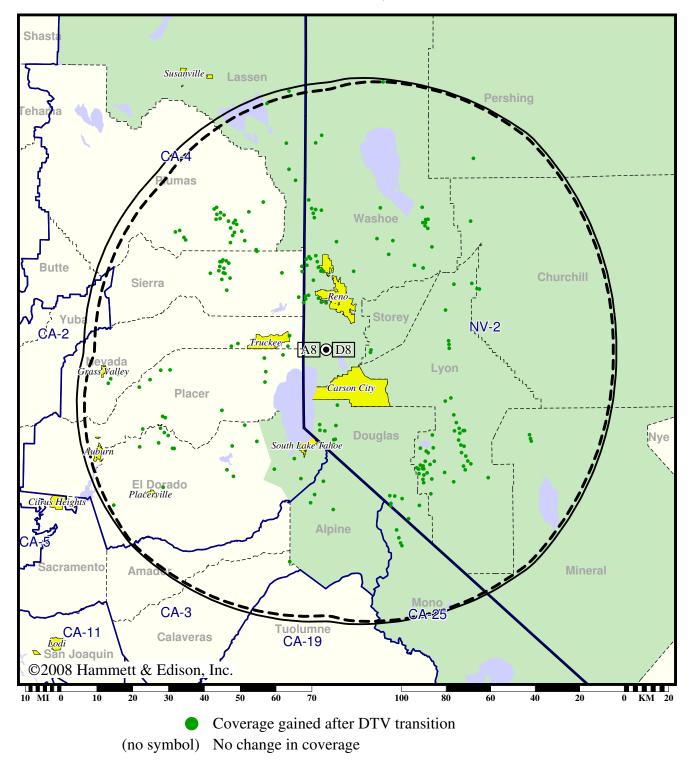


CP (solid): 1000 kW ERP at 896 m HAAT vs. Analog (dashed): 1820 kW ERP at 891 m HAAT

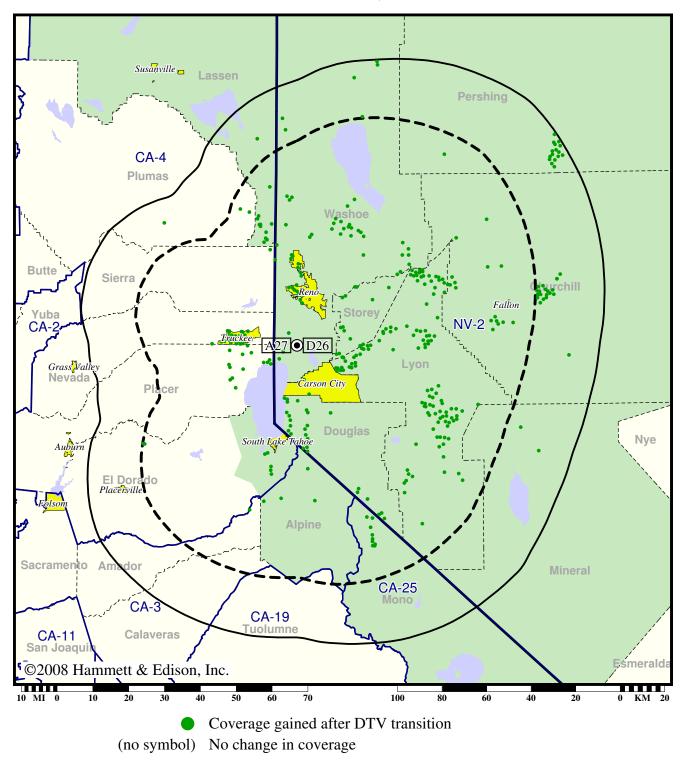


Licensed (solid): 16.1 kW ERP at 879 m HAAT, Network: NBC vs. Analog (dashed): 17.4 kW ERP at 128 m HAAT, Network: NBC

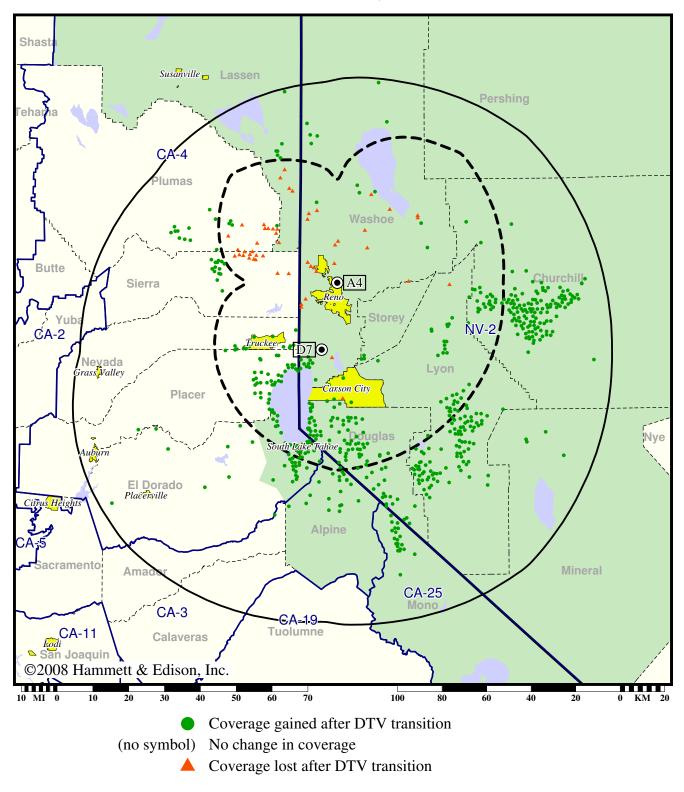

Licensed (solid): 1000 kW ERP at 836 m HAAT, Network: Fox vs. Analog (dashed): 178 kW ERP at 854 m HAAT, Network: Fox

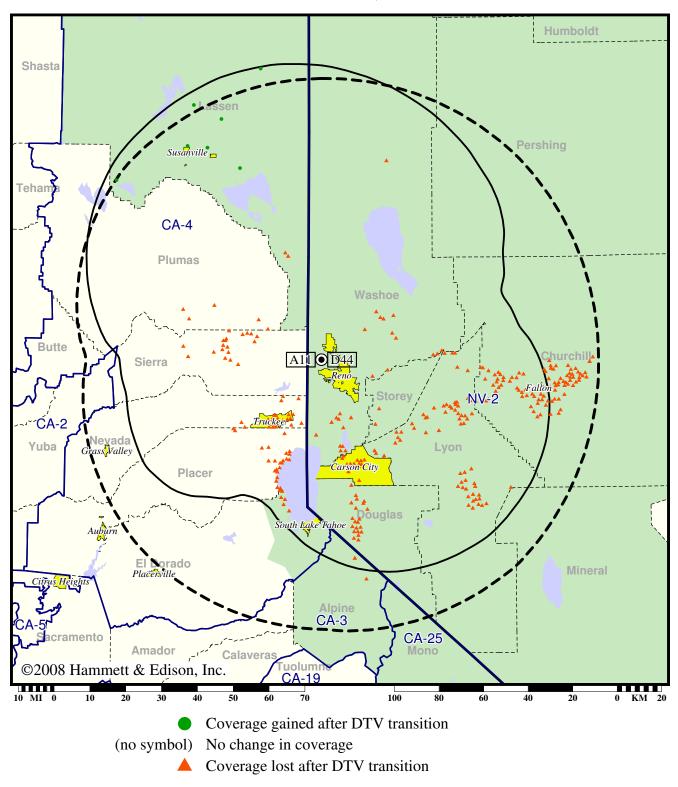


Licensed (solid): 16.1 kW ERP at 876 m HAAT, Network: CBS vs. Analog (dashed): 89.1 kW ERP at 656 m HAAT, Network: CBS

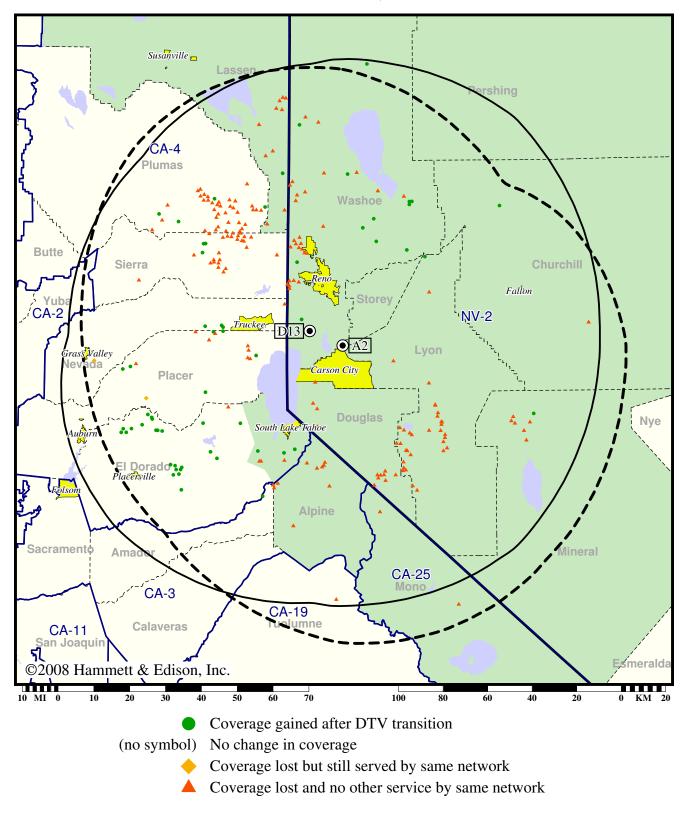

Expected Change In Coverage: Post-Transition Appendix B Facility

Appendix B (solid): 3.20 kW ERP at 650 m HAAT vs. Analog (dashed): 0.890 kW ERP at 650 m HAAT

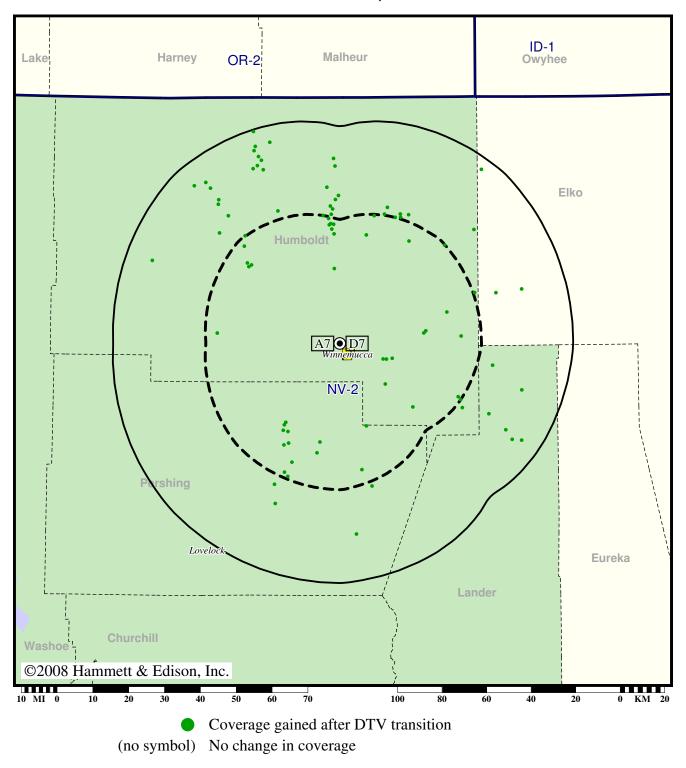

CP (solid): 3.20 kW ERP at 659 m HAAT vs. Analog (dashed): 0.890 kW ERP at 650 m HAAT

