

#### Expected Change In Coverage: Post-Transition Appendix B Facility

## Appendix B (solid): 850 kW ERP at 248 m HAAT, Network: Fox vs. Analog (dashed): 2140 kW ERP at 299 m HAAT, Network: Fox

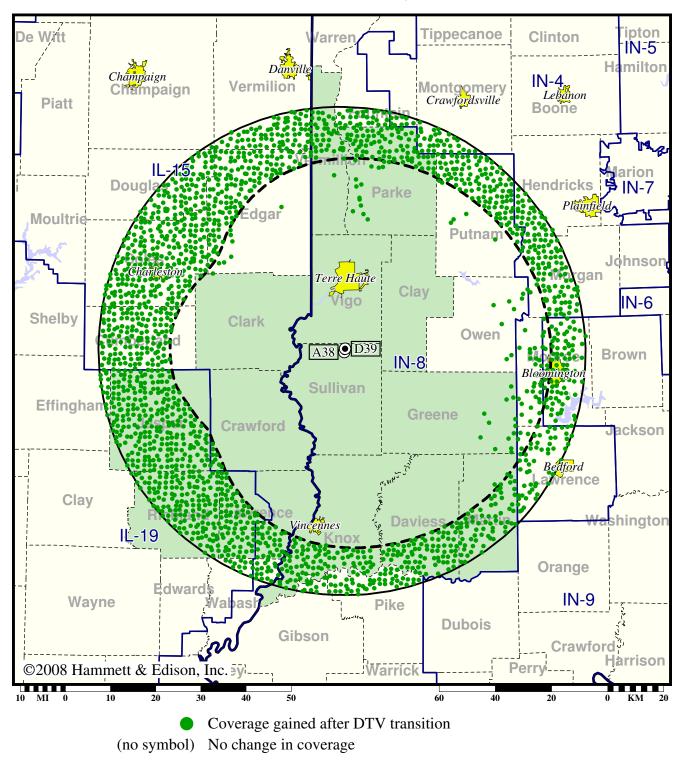


**Expected Change In Coverage: Granted Construction Permit** 

# CP (solid): 14.2 kW ERP at 293 m HAAT, Network: CBS vs. Analog (dashed): 316 kW ERP at 293 m HAAT, Network: CBS

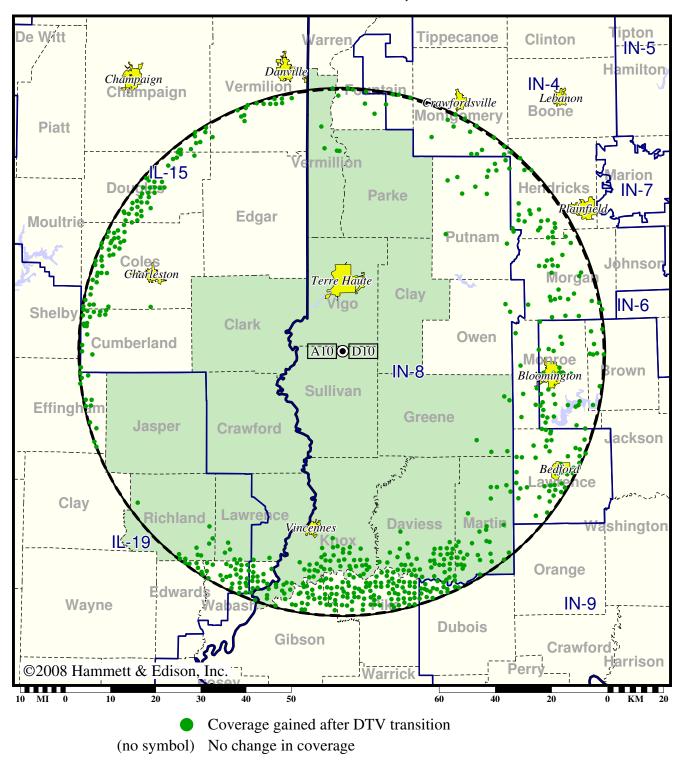


#### Expected Change In Coverage: Post-Transition Appendix B Facility

## Appendix B (solid): 1000 kW ERP at 248 m HAAT, Network: NBC vs. Analog (dashed): 100 kW ERP at 290 m HAAT, Network: NBC

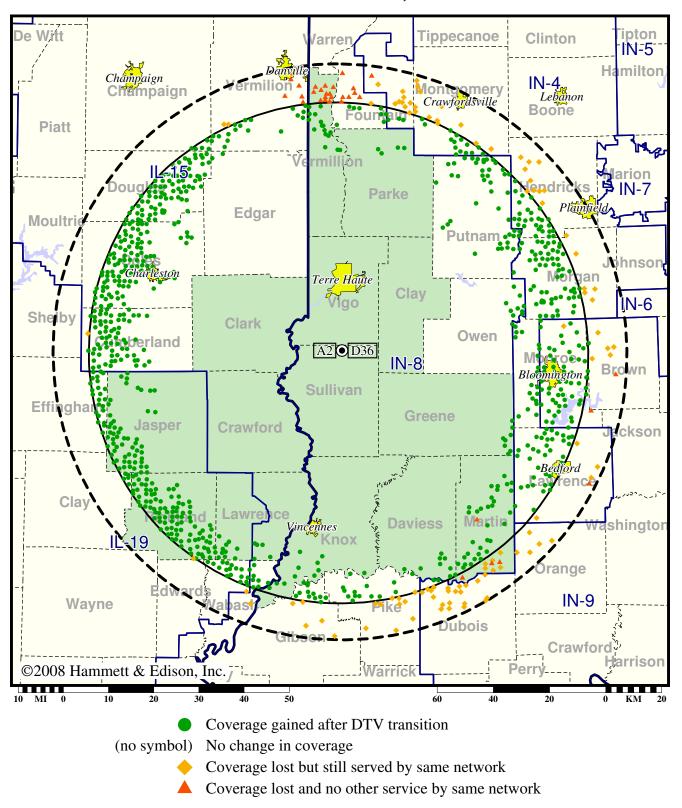

#### Expected Change In Coverage: Licensed Operation

### Licensed (solid): 46.0 kW ERP at 284 m HAAT, Network: PBS vs. Analog (dashed): 1150 kW ERP at 283 m HAAT, Network: PBS

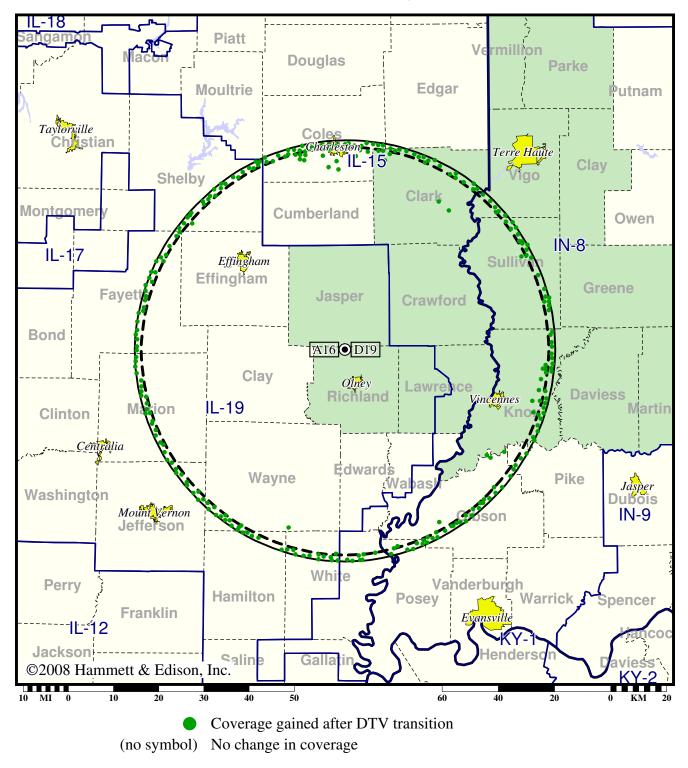

**Expected Change In Coverage: Granted Construction Permit** 

## CP (solid): 57.0 kW ERP at 164 m HAAT, Network: PBS vs. Analog (dashed): 1550 kW ERP at 174 m HAAT, Network: PBS

