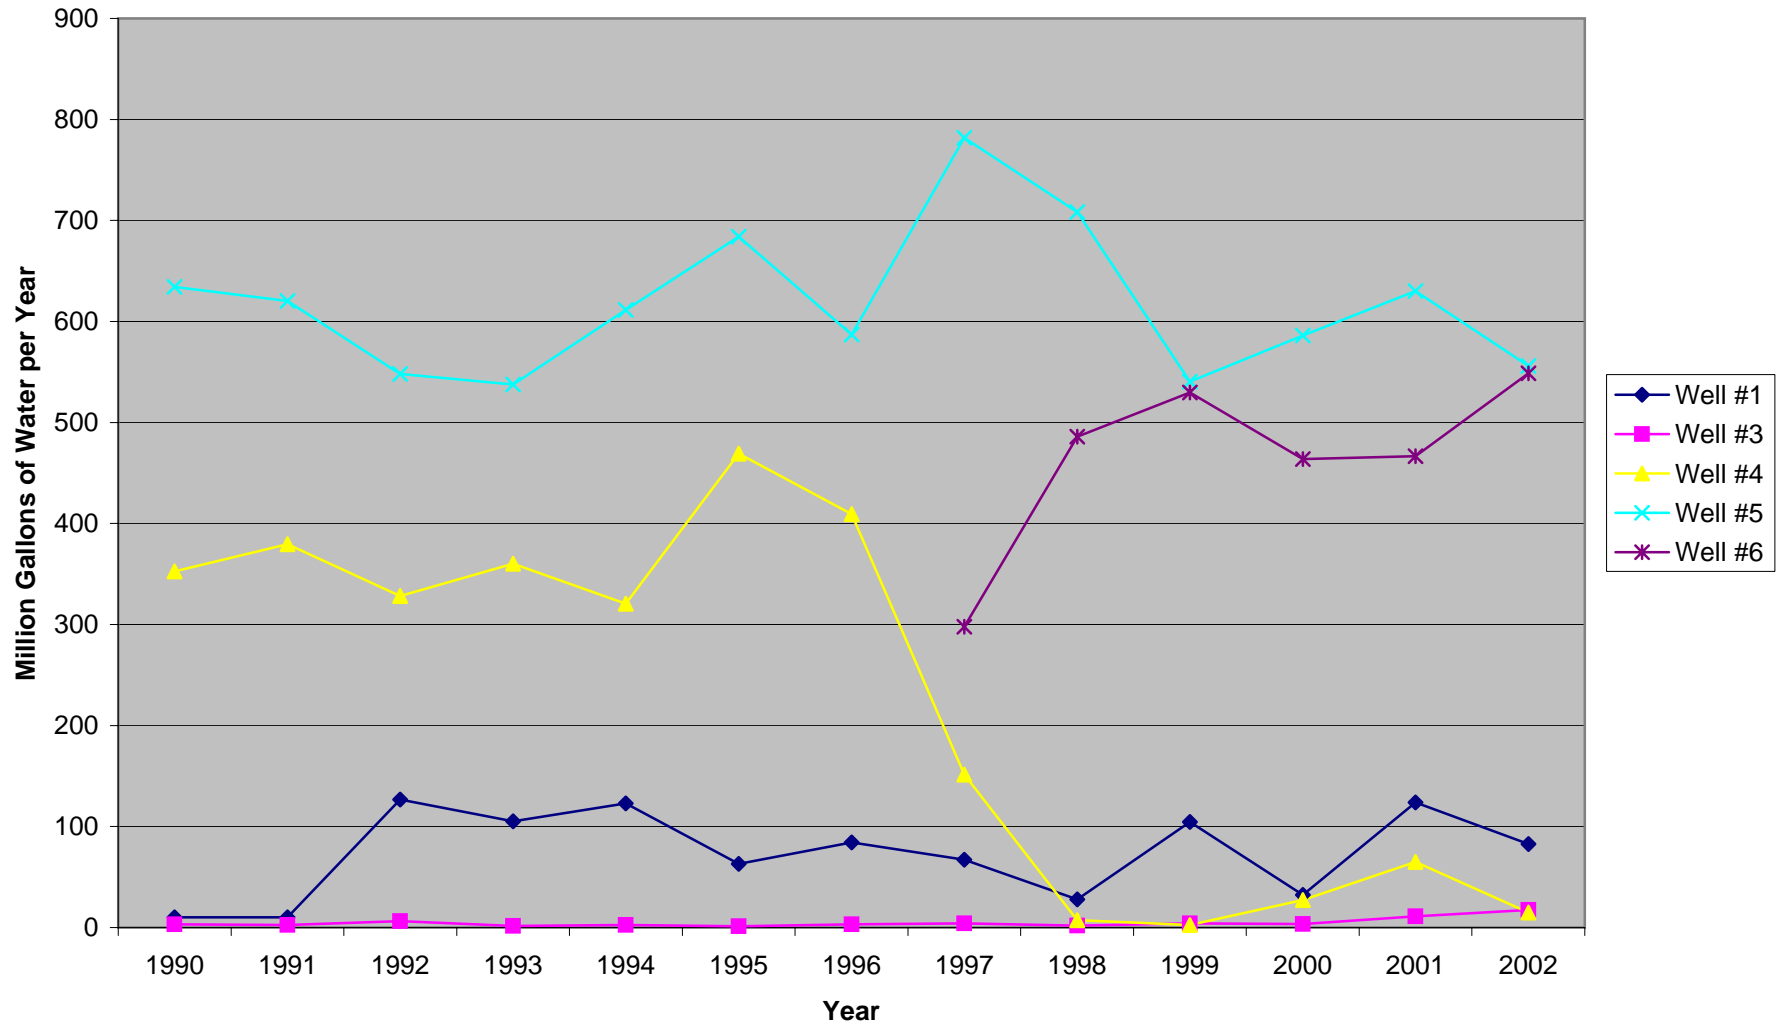
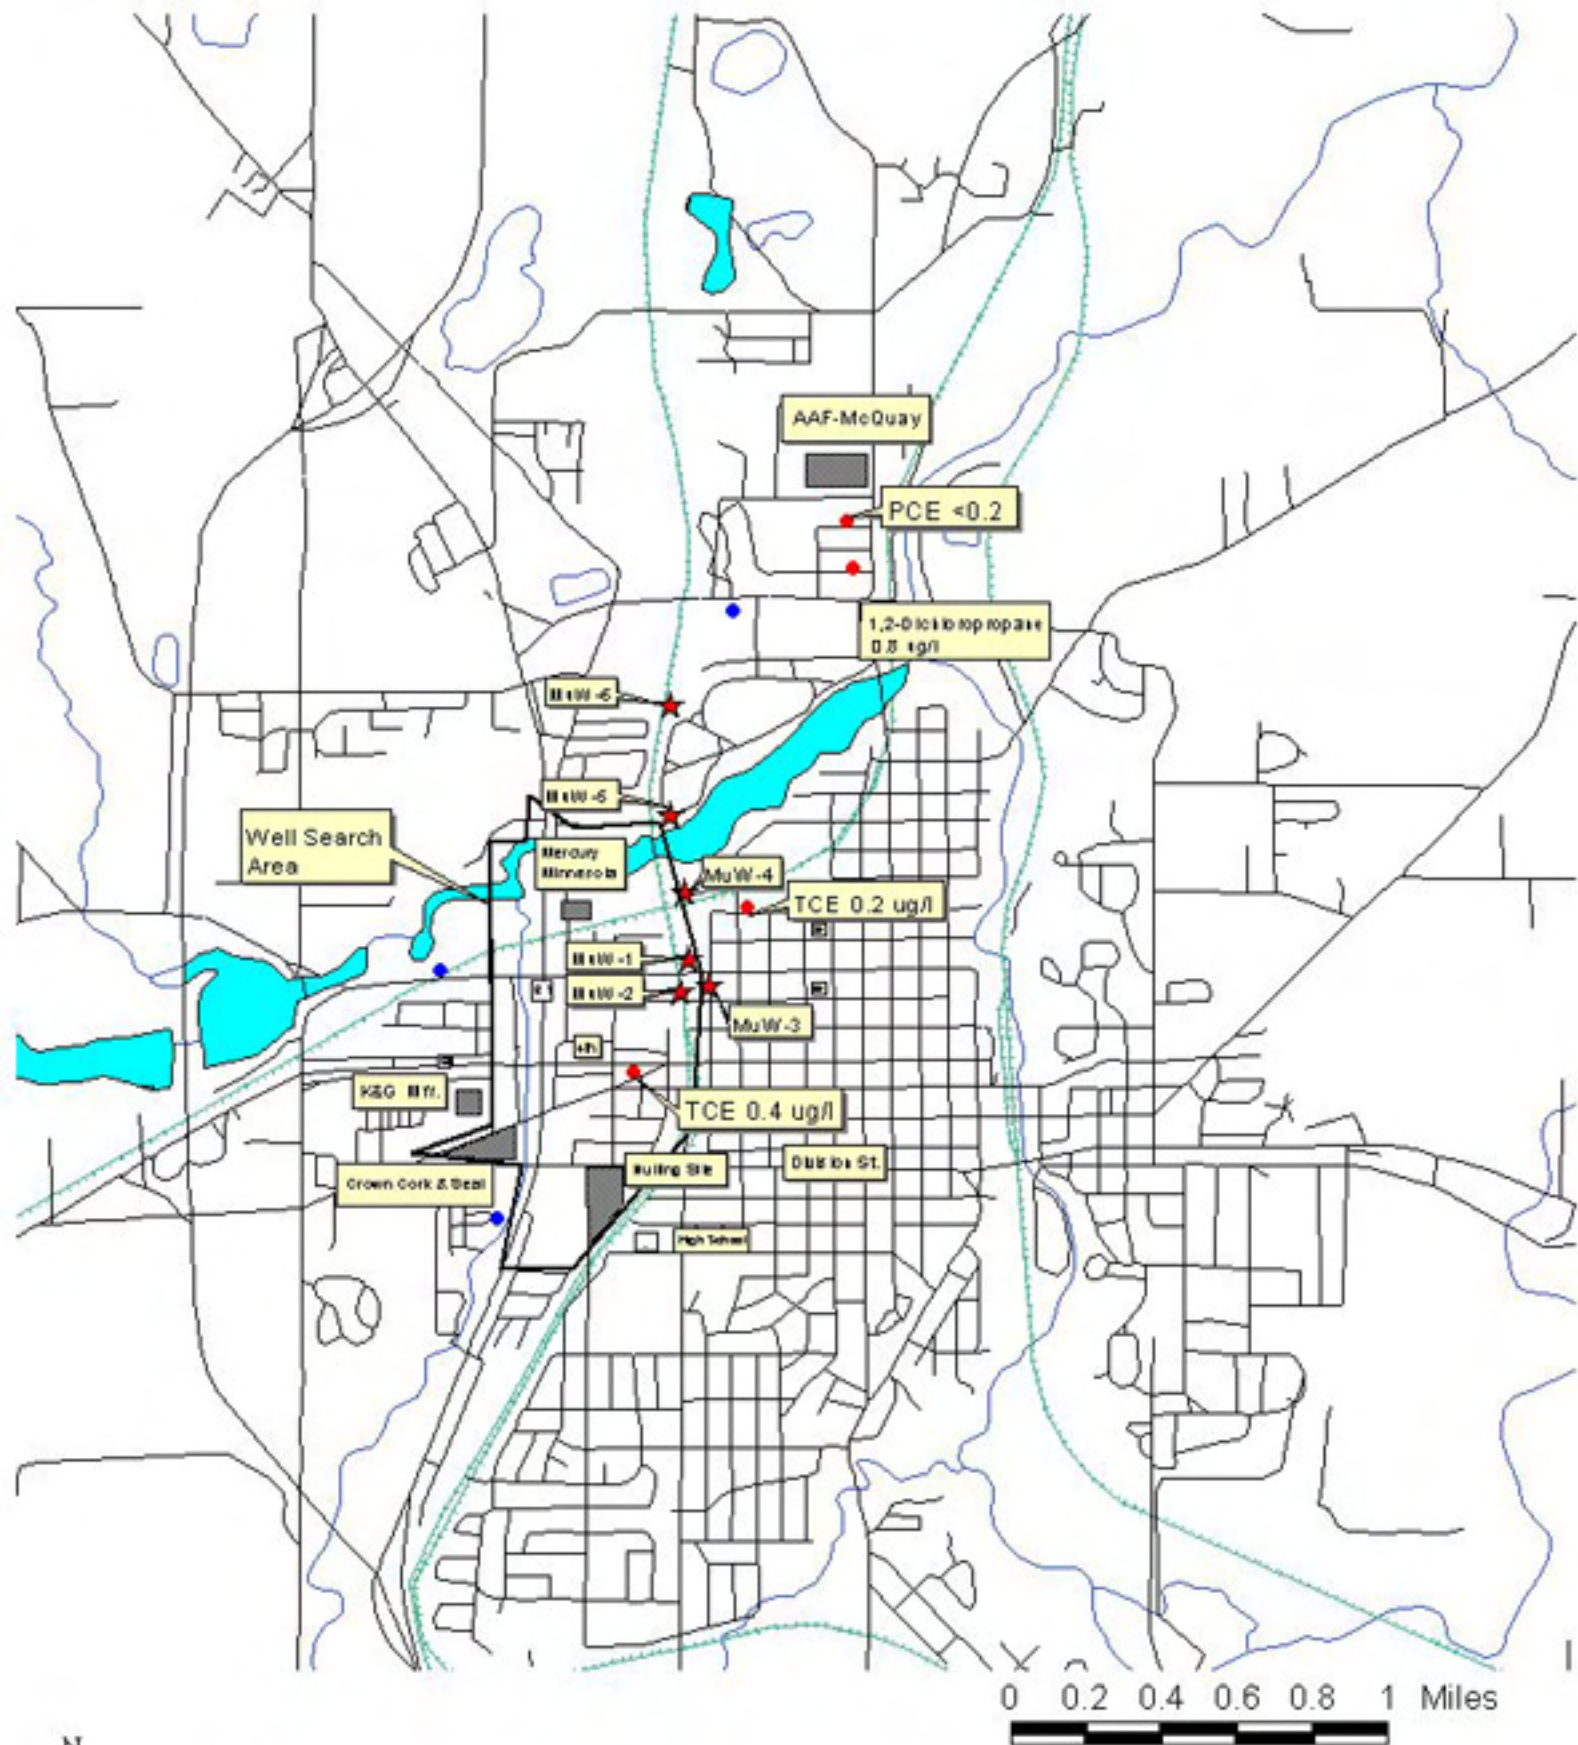


Figure 7: Faribault Well Pumping Rates 1990-2002





**Figure 8: Private Well Monitoring**

● = Private well w/ VOC detection

● = Private well w/ no VOCs

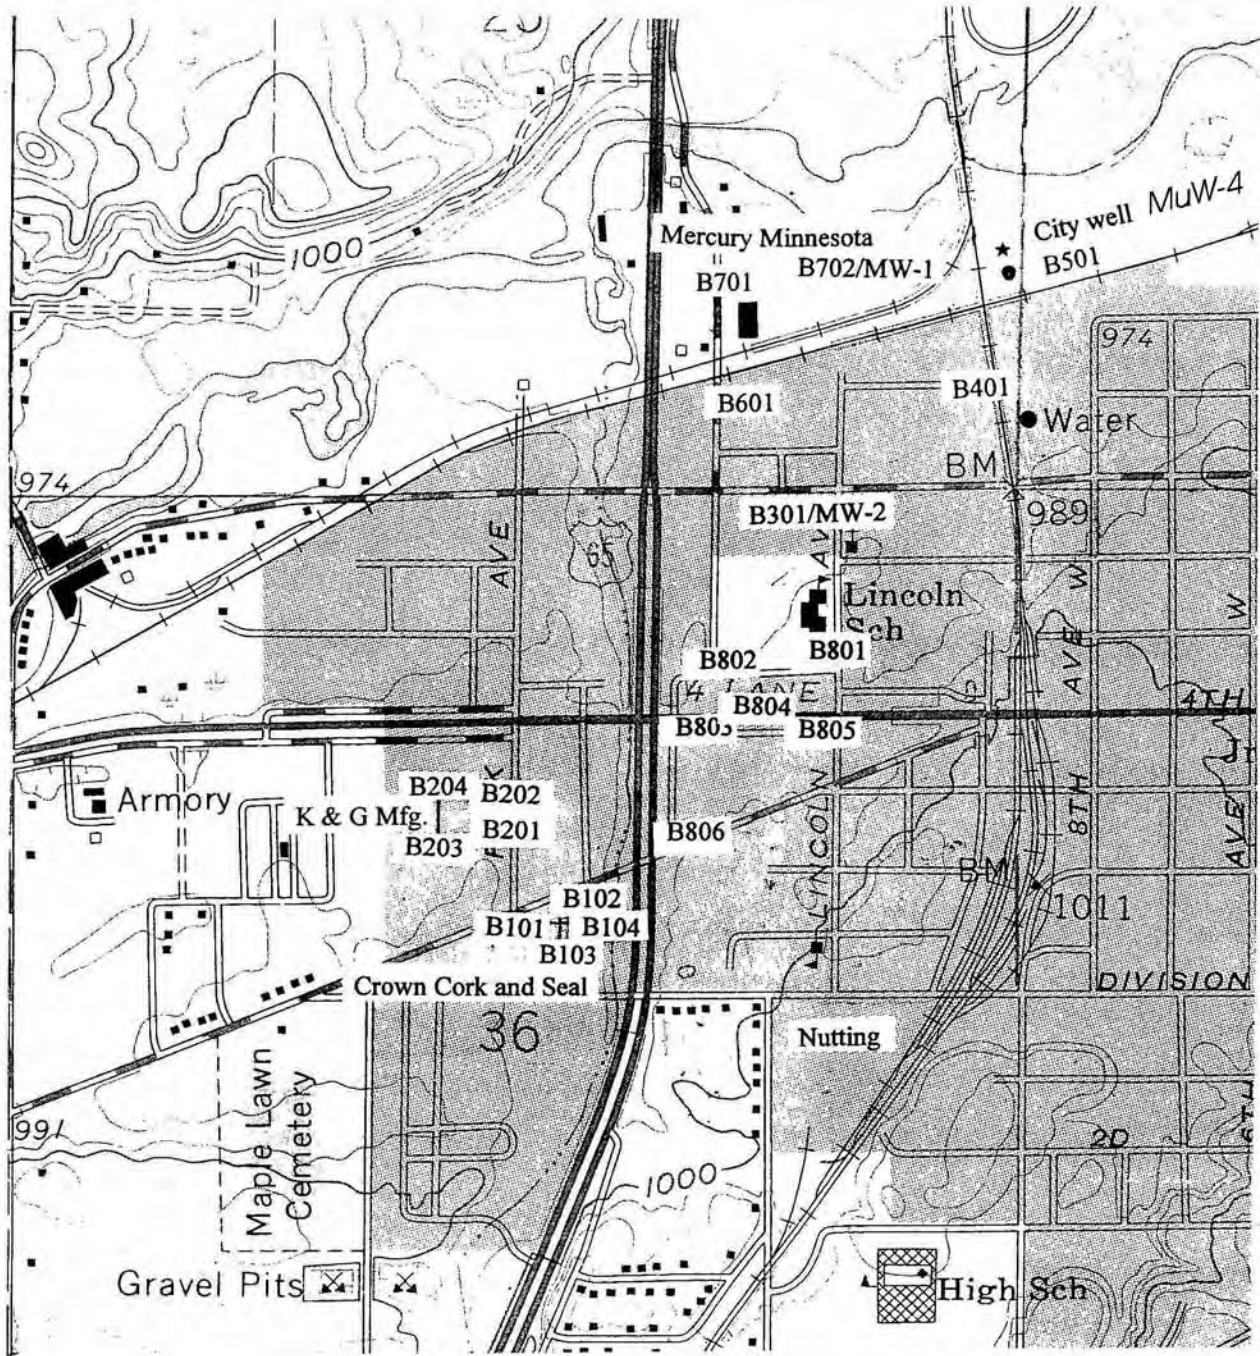


Figure 9: 1999 MPCA Investigation Boring Locations



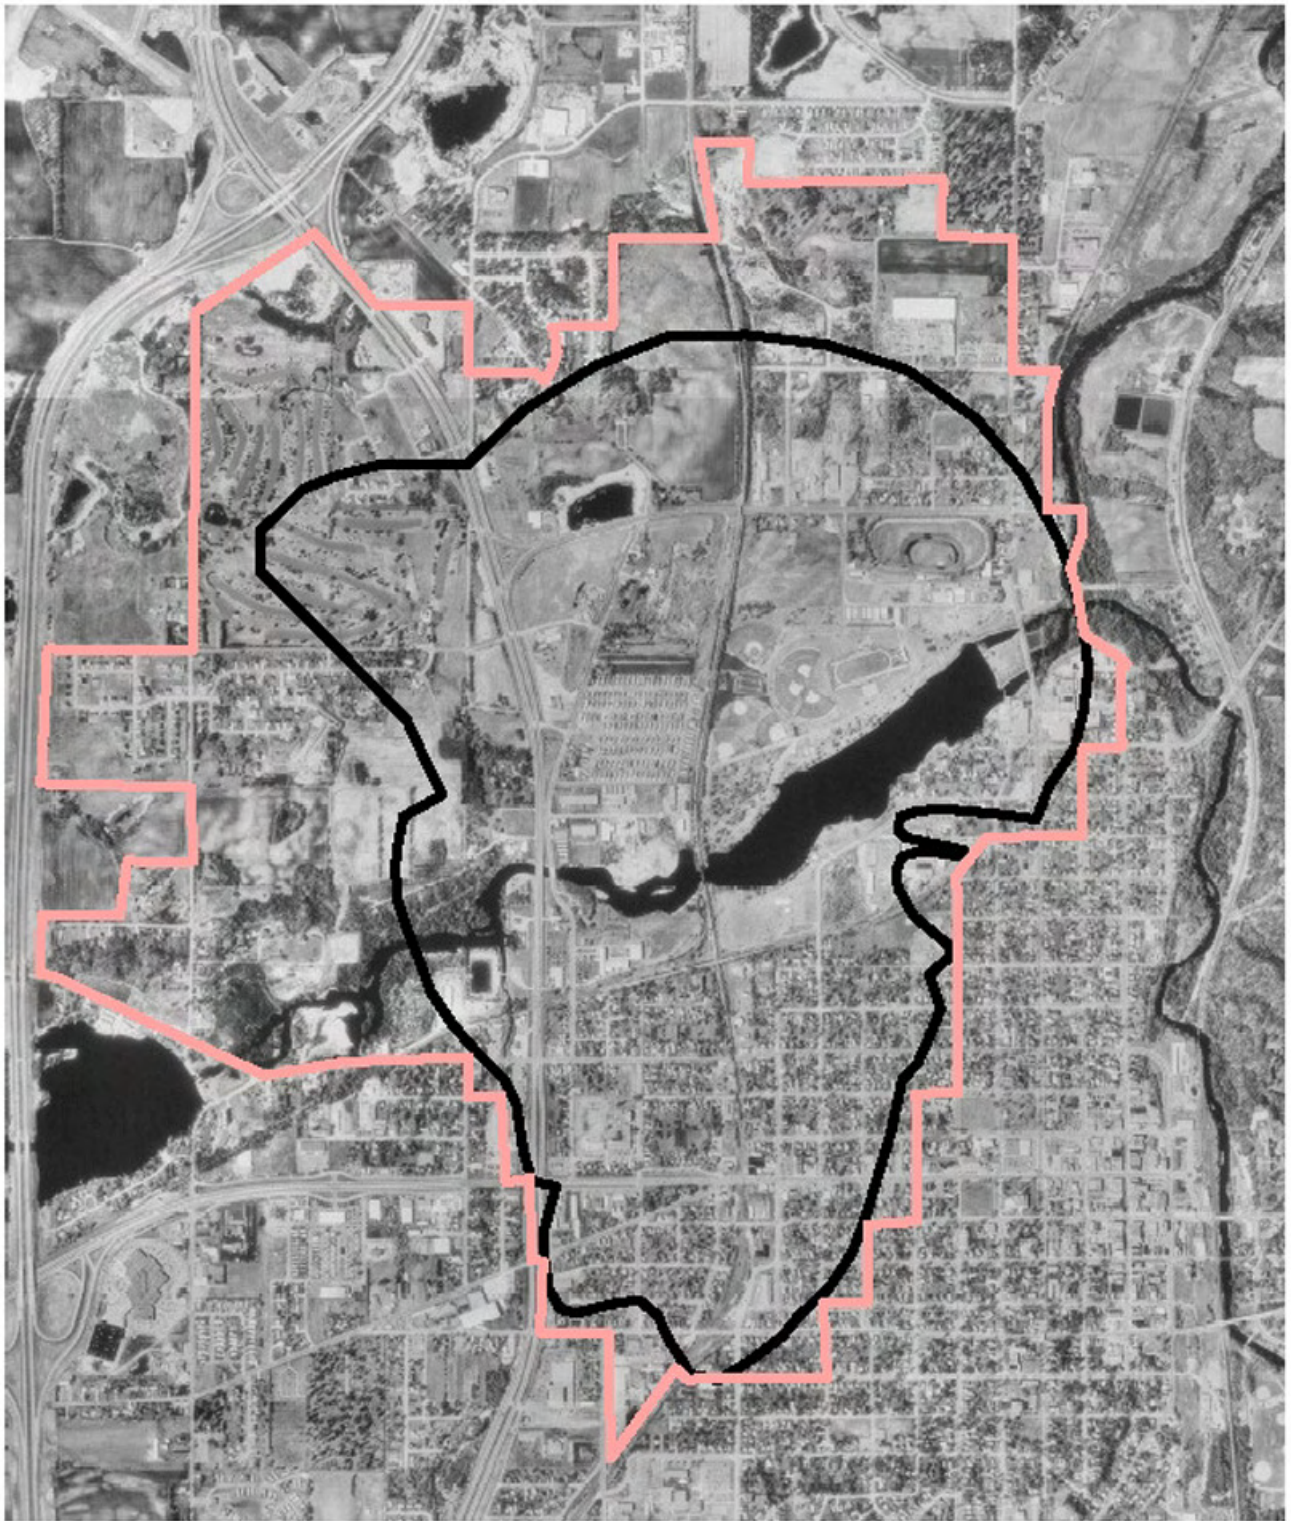


Figure 10

**Drinking Water Supply Management Area (DWSMA) and  
Wellhead Protection Area (WHPA)  
for Farbault Community Wells**

-  DWSMA
-  WHPA

0.3      0      0.3      0.6 Miles



Source: MDH 2003b