




United States  
Environmental Protection  
Agency

## Groundwater Pump and Treat Systems: Summary of Selected Cost and Performance Information at Superfund-financed Sites

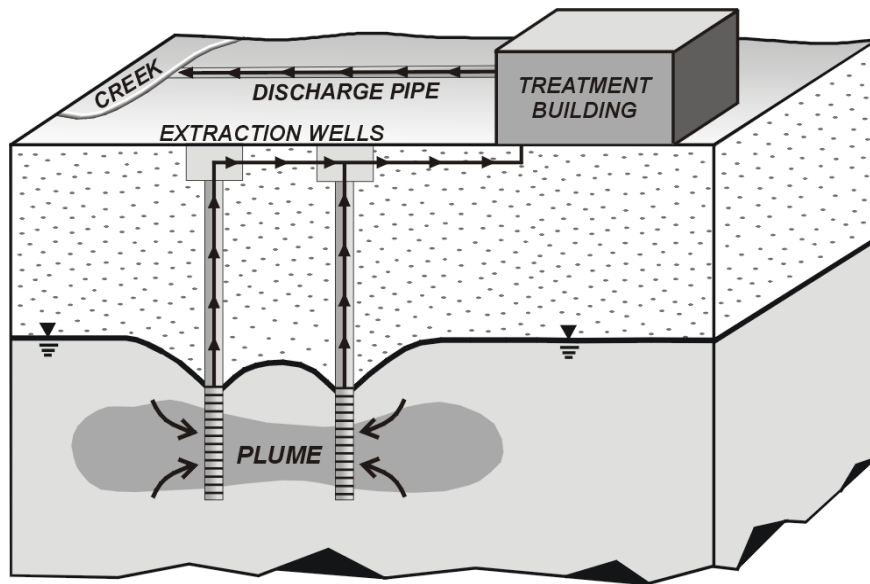

Solid Waste and  
Emergency Response  
(5102G)

EPA 542-R-01-021a  
December 2001  
[clu-in.org](http://clu-in.org)

---

---

## NOTICE

---

Work described herein was performed by GeoTrans, Inc. (GeoTrans) for the U.S. Environmental Protection Agency (U.S. EPA) under Dynamac Contract No. 68-C-99-256, Subcontract No. 91517, Task AD01-117. Mention of trade names or commercial products does not constitute endorsement or recommendation for use.

This document, with its appendices (EPA 542-01-021b) or without its appendices (EPA 542-01-021a), may be downloaded from EPA's Clean Up Information (CLUIN) System at <http://www.clu-in.org>. A limited number of hard copies of each version are also available free of charge from the National Service Center for Environmental Publications (NSCEP) at the following address:

U.S. EPA National Service Center for Environmental Publications  
P.O. Box 42419  
Cincinnati, OH 45242-2419  
Phone: (800) 490-9198 or (513) 489-8190  
Fax: (513) 489-8695

---

## PREFACE

---

This report summarizes Phase 1 (the data collection phase) of the Nationwide Fund-lead Pump and Treat Optimization Project. This phase included contacting a project liaison for each of the EPA Regions, identifying the Fund-lead pump-and-treat (P&T) systems in each Region, collecting baseline information about each system through a web-based questionnaire or phone interview, and selecting a total of 20 Fund-lead systems to receive RSEs. Four of the 20 P&T systems (two in Region 4 and two in Region 5) were previously selected and evaluated as part of a demonstration project completed in 2000.

*Data presented in this report reflect estimates provided by site Remedial Project Managers. These estimates may, in some cases, vary from actuality. In addition, the data—including the number, status, and costs of systems—may change over time.*

---

## **ACKNOWLEDGMENTS**

---

The project team is grateful for the help provided by the EPA Project Liaisons from each Region. They were vital in selecting the Fund-lead P&T systems to be evaluated and in facilitating communication between the project team and the Remedial Project Managers (RPMs). The authors also extend sincere thanks to the principal investigators from the U.S. EPA Technology Innovation Office (TIO) and U.S. EPA Office of Emergency and Remedial Response (OERR).

---

## EXECUTIVE SUMMARY

---

This first phase of the Nationwide Fund-lead Pump and Treat Optimization Project successfully identified a total of 88 Fund-lead (EPA-lead and State-lead with Fund money) pump-and-treat (P&T) systems within the Superfund Program. Of the 88 systems identified, 67 are operational and 21 are pre-operational (i.e., the Records of Decisions for the pre-operational systems specify pump-and-treat, but these systems are in the design stage or some other stage prior to full operation). System identification was accomplished through use of online databases and discussions with project liaisons in each Region. The number of Fund-lead P&T systems in a Region ranged from zero in Region 8 to 22 in Region 2.

Remedial Project Managers (RPMs) of the identified systems submitted data and information on their systems through a web-based questionnaire. Phone interviews were utilized in a limited number of cases. A screening methodology using the collected data was applied to prioritize these systems with respect to potential life-cycle savings resulting from optimization. Based on this screening and discussions with the project liaison in each Region, specific systems in each Region were selected to receive Remediation System Evaluations (RSEs). The RSE process was developed by the United States Army Corps of Engineers (USACE) to evaluate a remediation system and provide recommendations to improve effectiveness and reduce costs. Including the demonstration optimization project conducted in 2000, a total of 20 Fund-lead P&T systems were selected to receive RSEs.

This report identifies the 88 Fund-lead P&T systems, summarizes the information submitted by the RPMs, and presents the screening and selection of those systems to receive RSEs.

*Data presented in this report reflect estimates provided by site Remedial Project Managers. These estimates may, in some cases, vary from actuality. In addition, the data—including the number, status, and costs of systems—may change over time.*

The following summaries result from the estimated cost data and system projections provided by the RPMs:

- The estimated average annual operation and maintenance (O&M) cost for a Fund-lead P&T system (based on those 79 systems providing cost data) is approximately \$570,000 and the median cost is \$350,000. The discrepancy between these two statistics is due to a small number of systems with relatively high O&M costs.
- Based on the 79 systems that provided cost information, the estimated total annual O&M cost for operating the Fund-lead P&T systems in 2002 is approximately \$38 million, with EPA incurring approximately \$32.5 million of the total annual cost and the associated States incurring the remaining \$5.5 million.
- Based on the 79 systems that provided cost information, the estimated future cost for Long-term Remedial Action (LTRA) O&M for all of these systems exceeds \$210 million with discounting (i.e., net present value)\* and exceeds \$270 million without discounting. LTRA refers to the first 10 years of operation of a groundwater or surface water restoration action. During this period,

\*Net present value reflects the discounted or reduced cost of future expenditures due to interest gained between the present and the time of the expenditure. A discount rate of 5% is assumed. Please see Section 4.0 for more information on discounting and net present value as they apply to the presented costs.

EPA typically funds 90% of the cost and the associated State funds 10% of the costs. These percentages translate directly to the presented costs; therefore, the Superfund is expected to pay approximately \$189 million (\$243 million without discounting) and the States are expected to pay approximately \$21 million (\$27 million without discounting).

- Based on the 79 systems that provided cost information, the estimated future cost for O&M of Fund-lead P&T systems until remediation completion is achieved is approximately \$470 million with discounting (net-present value) and \$790 million without discounting. (These estimates of future O&M costs are based on the annual costs of systems and expected durations of systems as specified by the site managers. For some systems where expected system duration is unknown, a value of 30 years may have been used as a default value for this parameter. While the practice of using 30 years as a default was prevalent in the past, more recent EPA guidance on feasibility study preparation recommends that 30 years not be used as a default.)
- 13 of the 79 systems that provided costs account for approximately 50% of the total reported annual O&M costs.

A total of 26 States reportedly have Fund-lead P&T systems. Upon completion of the 10-year LTRA period each system will be transferred to its associated State and that State will assume 100% of the remaining O&M costs. For systems where restoration is not a goal (i.e., containment and water supply systems) the systems are typically transferred to the States after one year. The collected data suggest that the States will incur between approximately \$250 million with discounting or \$520 million without discounting in post-LTRA O&M costs for Fund-lead P&T systems that reported annual O&M costs. Furthermore, the data suggest that the following five States will likely incur 78% of these post-LTRA O&M costs:

- New Jersey (27.6%)
- Massachusetts (22.6%)
- New York (9.7%)
- Pennsylvania (9.6%)
- Michigan (8.4%)

In addition to cost information, the following statistics about the Fund-lead P&T systems were also gleaned from the information reported by the system RPMs:

- 40 of 67 operating systems are reported to be controlling plume migration.
- 60 of the 67 operating systems have groundwater restoration as a goal but 21 of that 60 do not have estimates of the progress toward that restoration. Of the 39 systems that have both groundwater restoration as a goal and an estimate of progress toward restoration, 7 are estimated to have made more than 80% progress toward restoration.
- 52 of the 88 systems have three or more primary contaminants of concern, and chlorinated solvents are the most prevalent contaminants as they are addressed by 56 of the 88 systems.
- 35 of the 88 Fund-lead P&T systems are associated with sites where non-aqueous phase liquid (NAPL) has either been observed or suspected.

- Carbon adsorption and air stripping are the most prevalent treatment processes (carbon adsorption is used at 50 of the 88 systems and air stripping is used at 41).
- Based on 64 of 88 systems where RPMs were able to determine costs specifically used for groundwater monitoring, Fund-lead P&T systems have, on average, 23 monitoring wells for groundwater sampling that are sampled three to four times per year for an average cost of \$112,000 per year.
- 36 of the 67 operating systems have previously had performance and effectiveness evaluated and found “sufficient” while 7 had performance and effectiveness found “not sufficient” (the remaining systems are either being evaluated, have not been evaluated, or have not provided information regarding previous effectiveness evaluations).

Although the RSE selection process targeted systems in each Region that had effectiveness problems or relatively high operating costs, a number of systems with similar issues still remain, and additional RSEs are recommended to address these remaining systems.



---

## TABLE OF CONTENTS

---

|   |      |
|---|------|
| NOTICE .....  | i    |
| PREFACE .....   | ii   |
| ACKNOWLEDGMENTS .....   | iii  |
| EXECUTIVE SUMMARY .....   | iv   |
| TABLE OF CONTENTS .....   | vii  |
| LIST OF FIGURES .....   | viii |
| LIST OF TABLES .....  | ix   |
| LIST OF APPENDICES .....  | x    |
| 1.0 INTRODUCTION .....  | 1    |
| 1.1 BACKGROUND .....  | 1    |
| 1.2 DEMONSTRATION FUND-LEAD PUMP AND TREAT OPTIMIZATION PROJECT .....             | 1    |
| 1.3 NATIONWIDE FUND-LEAD PUMP AND TREAT OPTIMIZATION PROJECT .....                | 1    |
| 2.0 SYSTEM IDENTIFICATION .....   | 3    |
| 3.0 DATA COLLECTION .....   | 6    |
| 4.0 SUMMARIES OF COLLECTED DATA .....   | 10   |
| 4.1 SUMMARIES OF SYSTEM COSTS AND PROJECTIONS .....                               | 10   |
| 4.2 SUMMARY OF COST DATA AS IT PERTAINS TO THE STATES .....                       | 11   |
| 4.3 STATUS AND PROGRESS OF THE FUND-LEAD P&T SYSTEMS .....                        | 13   |
| 4.4 SYSTEM GOALS .....  | 13   |
| 4.5 CONTAMINANTS OF CONCERN, TREATMENT PROCESSES, AND MONITORING .....            | 13   |
| 4.6 SUMMARY OF PREVIOUS EFFECTIVENESS EVALUATIONS .....                           | 14   |
| 5.0 SYSTEM SCREENING AND PRIORITIZATION WITH RESPECT TO OPTIMIZATION POTENTIAL .. | 43   |
| 6.0 SYSTEM SELECTION .....  | 46   |
| 7.0 CONCLUSIONS AND LESSONS LEARNED .....   | 59   |
| APPENDICES .....  | 63   |

---

## LIST OF FIGURES

---

- [Figure 4-1:](#) Trend of Financial Responsibility of Fund-lead P&T Systems
- [Figure 4-2:](#) Trend of Estimated Annual O&M Costs of Fund-lead P&T Systems
- [Figure 4-3:](#) Status of Fund-lead P&T Systems
- [Figure 4-4:](#) Progress of the 67 Operational Fund-lead P&T Systems
- [Figure 4-5:](#) Treatment Processes at Fund-lead P&T Systems
- [Figure 6-1:](#) Fund-lead P&T Systems Ranked by “Estimated Potential Life-cycle Savings (\$)”
- [Figure 6-2:](#) Fund-lead P&T Systems Ranked by Annual O&M Cost and the Cumulative Distribution of System Annual O&M Costs

---

## LIST OF TABLES

---

|                             |   |
|-----------------------------|---|
| <a href="#">Table 2-1:</a>  | Number of Identified Fund-lead P&T Systems in each Region   |
| <a href="#">Table 4-1:</a>  | Region 1 Fund-lead P&T System Performance and Cost Information  |
| <a href="#">Table 4-2:</a>  | Region 2 Fund-lead P&T System Performance and Cost Information  |
| <a href="#">Table 4-3:</a>  | Region 3 Fund-lead P&T System Performance and Cost Information  |
| <a href="#">Table 4-4:</a>  | Region 4 Fund-lead P&T System Performance and Cost Information  |
| <a href="#">Table 4-5:</a>  | Region 5 Fund-lead P&T System Performance and Cost Information  |
| <a href="#">Table 4-6:</a>  | Region 6 Fund-lead P&T System Performance and Cost Information  |
| <a href="#">Table 4-7:</a>  | Region 7 Fund-lead P&T System Performance and Cost Information  |
| <a href="#">Table 4-8:</a>  | Region 9 Fund-lead P&T system Performance and Cost Information  |
| <a href="#">Table 4-9:</a>  | Region 10 Fund-lead P&T system performance and Cost Information   |
| <a href="#">Table 4-10:</a> | Future O&M Costs of Fund-lead P&T Systems Expected to be Incurred by each State   |
| <a href="#">Table 4-11:</a> | Region 1 Fund-lead P&T System O&M Costs According to State  |
| <a href="#">Table 4-12:</a> | Region 2 Fund-lead P&T System O&M Costs According to State  |
| <a href="#">Table 4-13:</a> | Region 3 Fund-lead P&T System O&M Costs According to State  |
| <a href="#">Table 4-14:</a> | Region 4 Fund-lead P&T System O&M Costs According to State  |
| <a href="#">Table 4-15:</a> | Region 5 Fund-lead P&T System O&M Costs According to State  |
| <a href="#">Table 4-16:</a> | Region 6 Fund-lead P&T System O&M Costs According to State  |
| <a href="#">Table 4-17:</a> | Region 7 Fund-lead P&T System O&M Costs According to State  |
| <a href="#">Table 4-18:</a> | Region 9 Fund-lead P&T System O&M Costs According to State  |
| <a href="#">Table 4-19:</a> | Region 10 Fund-lead P&T System O&M Costs According to State   |
| <a href="#">Table 4-20:</a> | Categories of Contaminants Prevalent at Sites with Fund-lead P&T Systems  |
| <a href="#">Table 5-1:</a>  | Site-Specific Criteria Used to Calculate the “Estimated Potential Life-cycle Savings (%)” from Optimization of each of the Identified Fund-lead P&T Systems (Page 1 of 2) |
| <a href="#">Table 6-1:</a>  | For each Region Systems Selected for RSEs and the “Estimated Potential Life-cycle Savings (\$)” Suggested by Screening Analysis   |
| <a href="#">Table 6-2:</a>  | Fund-lead P&T Systems Ranked in Terms of “Estimated Potential Life-cycle Savings (\$)” as Calculated by the Screening Methodology   |
| <a href="#">Table 6-3:</a>  | Fund-lead P&T Systems Ranked According to Annual O&M Cost   |

---

## **LIST OF APPENDICES**

---

- Appendix A: Information Sheets for each Fund-lead P&T System
- Appendix B: Summary Phase 1 Reports of each Region
- Appendix C: Screening Calculations for each Fund-lead P&T System

---

## 1.0 INTRODUCTION

---

### 1.1 BACKGROUND

As part of an overall commitment toward optimization, U.S. Environmental Protection Agency (EPA) Headquarters continually offers resources and support to the EPA Regions to improve their operating remedies. A large percentage of these remedies are pump-and-treat (P&T) systems designed to restore groundwater, contain contaminant sources, or supply water. Thus, the EPA Technology Innovation Office (TIO) and Office of Emergency and Remedial Response (OERR) have commissioned Remediation System Evaluations (RSEs) for Fund-lead P&T systems in each of the EPA Regions in an effort to optimize their performance.

The Remediation System Evaluation (RSE) concept was developed by the U.S. Army Corps of Engineers (USACE) to improve remedies already in place. An RSE begins with the formation of a team of experts including experienced engineers and hydrogeologists. Once a system has been selected for an RSE, the team reviews site-related documents, visits the site to tour the facility and interview the site managers, and compiles a report to document findings and any recommendations to improve the remedy. Recommendations typically fall into the following categories:

- recommendations to improve system effectiveness;
- recommendations to reduce operation and maintenance (O&M) costs;
- recommendations for technical improvement; and
- recommendations to gain site close out.

### 1.2 DEMONSTRATION FUND-LEAD PUMP AND TREAT OPTIMIZATION PROJECT

A demonstration optimization project of Fund-lead pump and treat systems conducted in Regions 4 and 5 identified a total of 28 planned or operating pump-and-treat (P&T) systems that are Fund-lead (or state-lead with Superfund financing). On average, those systems cost approximately \$300,000 per year per site for operations and maintenance (O&M). Extrapolation of these results suggested that 140 such systems might exist through the nation at a total estimated O&M cost of \$4 million per year. Many of these systems are anticipated to operate for decades with costs split between Superfund and the individual states. For the first 10 years of operation of most Fund-lead sites, the Superfund Program pays for 90% of the O&M costs and the State pays the remaining 10%. The State then assumes 100% of the costs incurred after the initial 10 year period.

In addition to identifying the Fund-lead P&T systems, the pilot optimization study also included Remediation System Evaluations (RSEs) of four P&T systems. These four evaluations resulted in a number of recommendations to improve effectiveness and/or reduce O&M costs for each of the systems. Thus, the results of this pilot study highlighted the benefits of optimizing Fund-lead systems.

### 1.3 NATIONWIDE FUND-LEAD PUMP AND TREAT OPTIMIZATION PROJECT

Based in part on the results of the demonstration project described above, *OSWER Directive No. 9200.0-33 (Transmittal of Final FY00 - FY01 Superfund Reforms Strategy, dated July 7,2000)*

<http://www.epa.gov/superfund/programs/reforms/docs/strat00.pdf> outlined a commitment to optimize the Fund-lead P&T systems. To achieve that goal, a Nationwide RSE Optimization Project was commissioned to accomplish the following tasks:

- identify the Fund-lead P&T systems in each of the EPA Regions;
- gather baseline data and information on these identified systems;
- prioritize the systems in terms of optimization potential;
- select 16 additional systems to receive RSEs;
- conduct these RSEs; and
- follow up with EPA project managers to track and facilitate implementation of resulting recommendations.

This report summarizes Phase 1 of this project, which entails the first four of these six elements.

---

## 2.0 SYSTEM IDENTIFICATION

---

The first step of the project involved determining the number of Fund-lead P&T systems in each EPA Region and identifying key aspects of those systems for assessing optimization potential. For this project, a Fund-lead P&T system must meet the following criteria:

- pump-and-treat (sometimes referred to as groundwater extraction and treatment) must be identified as a remedy in the Record of Decision (ROD) for the site;
- the system must be either EPA-lead or State-lead with funding from the Superfund Program; and
- the system must be operational or pre-operational (i.e., pre-design, design, being installed, or installed but not yet operating). It should be noted that, consistent with the first criteria, “pre-design” refers to systems that have RODs specifying pump and treat but that have not begun the design process.

Thus, this project does not include Fund-lead P&T systems that are no longer operating due to a change in remedy or Fund-lead P&T systems that have been fully transferred to States or responsible parties. In some cases, sites were identified where a P&T system will likely not be installed even though it is specified in the ROD. Such systems are included as Fund-lead P&T systems in this project unless the ROD already has been changed. In addition to systems not meeting the above criteria, Fund-lead well-head treatment systems in Region 9 and a Fund-lead NAPL (non-aqueous phase liquid) extraction system in Region 8 were not included in the project.

During the demonstration project in Region 4 and Region 5, it was initially hoped that the Fund-lead P&T systems could be easily identified by an on-line search of the Superfund Hazardous Waste Sites:

<http://www.epa.gov/superfund/sites/query/advquery.htm>

However, it was quickly determined that no set of search criteria would specifically yield the Fund-lead P&T systems. Therefore, an initial set of sites was developed with the following query:

| Category                   | Entry   | Display | Count |
|----------------------------|---|---------|-------|
| Site Name                  | “blank”   | T       |       |
| State/Territory/EPA Region | Region 1 (example)  | T       |       |
| Activity Type              | Remedial Design<br>Construction Completion<br>Remedial Action           |         | T     |
| Activity Lead              | EPA Fund-financed<br>State, Fund-financed<br>Tribal-lead, Fund-financed | T       |       |
| Contaminated Media         | Groundwater   |         | T     |
| Site Listing Narrative     |   | T       |       |
| Site Fact Sheet            |   | T       |       |
| Site Cleanup Decision      |   | T       |       |

ROD abstracts for these sites were reviewed and those sites without existing or planned P&T systems were removed from the list.

During that process it became evident that isolating Fund-lead P&T systems was not straightforward. One complication is that the on-line databases are not completely up-to-date, and some systems that are Fund-lead at one point in time become “PRP-lead” once responsible parties are defined and/or consent decrees are put in place. As a result, the project liaisons for each Region were asked to identify the Fund-lead or Fund-financed P&T systems in their Regions, which they typically did by interviewing the branch chiefs and/or individual Remedial Project Managers (RPMs). The project liaisons were able to quickly remove sites from the initial list because there was no P&T system (existing or planned) or because the system was no longer Fund-lead. In some cases, the project liaisons also added systems that did not appear on the initial list. In rare cases the on-line databases identified Fund-lead P&T systems not identified by the EPA project liaison.

The identified systems are presented in table format in Section 4.0; however, the following table summarizes for each Region the number of operational and pre-operational (i.e., pre-design, design, being installed, or installed but not yet operating) Fund-lead P&T systems.



**Table 2-1: Number of Identified Fund-lead P&T Systems in each Region**

| <b>Region</b> | <b># of Pre-operational Fund-lead P&amp;T Systems</b> | <b># of Operational Fund-lead P&amp;T Systems</b> | <b>Total</b> |
|---------------|---|---|--------------|
| Region 1      | 1   | 7   | 8            |
| Region 2      | 4   | 18  | 22           |
| Region 3      | 2   | 10  | 12           |
| Region 4      | 3   | 7   | 10           |
| Region 5      | 3   | 12  | 15           |
| Region 6      | 3   | 6   | 9            |
| Region 7      | 2   | 1   | 3            |
| Region 8      | 0   | 0   | 0            |
| Region 9      | 2   | 2   | 4            |
| Region 10     | 1   | 4   | 5            |
| <b>Total</b>  | <b>21</b>   | <b>67</b>   | <b>88</b>    |

*Presented data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of sites, may change over time.*

Notes:

1. Fund-lead refers to systems where oversight is provided by the EPA or by a State with financial support from Superfund.
2. Pump-and-treat (P&T) systems are those systems in which the extraction of groundwater and subsequent treatment is specified in the Record of Decision (ROD). In this study, systems designed for water supply in Region 9 and a non-aqueous phase liquid (NAPL) extraction system in Region 8 were not included.
3. Pre-operational P&T systems refer to those systems that are pre-design, design, being installed, or installed but not yet operating. The systems must have RODs specifying P&T.
4. Operational P&T systems are those that currently are operating or have operated and are shutdown temporarily.
5. The demonstration project yielded 14 operational and 4 pre-operational P&T systems for Region 5. Information collected during the nationwide effort determined that site enforcement had changed for three sites in Region 5. The above chart reflects the updated information.

---

### 3.0 DATA COLLECTION

---

Once the Fund-lead P&T systems were identified, a web-based questionnaire, accessed from the EPA-TIO webpage, was completed for each system by the EPA or State project manager for the associated site. The questionnaire required responses to the following items or questions.

1. Site or system name, location, and CERCLIS number
2. Name and contact information of the individual that completed the questionnaire
3. Is the site Fund-lead (or State-lead and financed by Superfund) with a ROD and a P&T system that currently exists or is planned?  
**Explanation:** If the answer to this question is “no”, then the system is no longer considered for this project.
4. EPA Remedial Project Manager (RPM) name and contact information
5. State Manager or Regulator name and contact information
6. Contractor name and contact information
7. Site lead or management (EPA/Fund-lead or State-lead financed by Superfund)
8. The date the Record of Decision (ROD) for the remedy was signed
9. The date of most recent ROD modification, if any
10. Type of ROD (for an interim remedy or for a final remedy)
11. Status of P&T system  
**Explanation:** One of the following responses could be selected:
  - pre-design
  - design
  - designed/not installed
  - being installed
  - installed
  - operational
  - completed

It should be noted that a system classified as “pre-design” must have a ROD that specifies P&T. In addition, for the purposes of data analysis, “pre-operational” refers to those classifications in the above list that precede operational.
12. Primary goal of the P&T system  
**Explanation:** One of the following responses could be selected:
  - restoration
  - containment
  - both restoration and containment
  - water supply

13. Primary contaminants of concern
14. Presence or absence of contamination as a non-aqueous phase liquid (NAPL)
15. Approximate annual O&M costs  
**Explanation:** This is an approximate (i.e., plus or minus 25%) value of annual O&M costs (\$/yr) including monitoring and analysis costs. Typical components of annual O&M costs include labor, electricity, materials, discharge fees, analytical costs, consulting costs, etc.
16. Portion of that cost used for monitoring  
**Explanation:** Of the approximate annual O&M cost (\$/yr), this cost is the portion costs associated with long-term groundwater monitoring of the aquifer (labor associated with sample collection and data reduction, analytical costs, etc.). It should not include process monitoring of the above-ground treatment components, or monitoring associated with discharge of treated water.
17. An approximate representative pumping rate in gallons per minute (gpm)
18. Number of extraction wells (not including injection wells, drains, or trenches)
19. The date (month and year) when construction of the systems was completed
20. The date (month and year) when the system became operational and functional
21. The date (month and year) when the system is expected to be transitioned to the State  
**Explanation:** For Fund-lead remedies of surface or groundwater where restoration is the goal, EPA typically manages the site and funds 90% of the cost (versus 10% from the State) for the first 10 years after the site becomes operational and functional. This period is known as a Long-term Remedial Action (LTRA). After this 10-year period the site is fully transitioned to the State, and the State is responsible for site management and 100% of the funding.
22. The date (month and year) the remedial action is expected to be complete  
**Explanation:** This estimate for system shut-off date is subject to great uncertainty. An estimate of 30 years from the date the system became operational and functional is often used for financial reasons and may not represent operational projections. Other estimates may be taken directly from the Record of Decision (ROD), and given that a ROD is written before operation of a system, this estimate may not reflect operation data.
23. Approximate amount of system downtime per year  
**Explanation:** The estimated number of weeks per year that the system does not operate as anticipated.

24. Types of above-ground treatment processes  
**Explanation:** This item includes above-ground treatment processes only. It does not include in-situ processes. One or more of the following processes could be selected.

|                      |                   |
|----------------------|-------------------|
| metals precipitation | filtration        |
| air stripping        | ion exchange      |
| biological treatment | reverse osmosis   |
| UV oxidation         | off-gas treatment |
| carbon adsorption    | other/not sure    |

25. Number of groundwater monitoring wells regularly monitored

26. Frequency of groundwater monitoring (i.e., annually, semi-annually, quarterly, etc.)

27. Assessment of plume migration control

**Explanation:** Based on current information, if any portion of the plume is continuing to migrate beyond the current plume extent in a manner that is of concern, the answer is YES. If plume migration is currently controlled, the answer is NO. If current information is not adequate to make this determination, the answer is DON'T KNOW. If plume migration beyond the current plume extent is not a concern, the answer is CONTROLLING PLUME MIGRATION IS NOT A GOAL OF THIS SYSTEM.

28. Progress toward cleanup

**Explanation:** The purpose of this item is to determine if the progress regarding plume restoration, in terms of plume area reduction, is known, and if so, how much progress in terms plume area reduction has been achieved. Note this question is not asking about mass removal, but instead is asking about plume area. One of the following descriptions could be chosen:

- A small portion (e.g., less than 20%) of the original plume area has been restored to required cleanup levels.
- A “significant” portion of the original plume area (e.g., more than about 20%) has been restored to required cleanup levels.
- Most of the original plume area (e.g., more than about 80%) has been restored to required cleanup levels.
- Don't know
- Aquifer restoration is not a goal of this system.

29. Result of previous (if any) evaluations of performance and effectiveness

**Explanation:** According to the Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA) and the National Contingency Plan (NCP), a 5-year review must be conducted for all remedial actions that do not allow unlimited use and unrestricted exposure. The purpose of these reviews is to ensure that the remedies are protective of human health and the environment and therefore include a statement regarding the effectiveness and performance of the system. This item refers to 5-year reviews or other such evaluations but does not refer to the RSEs conducted as part of this project. One of three choices could be selected in response to this item:

- Performance/effectiveness has not been adequately evaluated.
- Performance/effectiveness has been evaluated, and is not sufficient.
- Performance/effectiveness is sufficient, further evaluation should be prioritized based on potential cost savings that maintain equivalent effectiveness.

30. Degree of difficulty (socially or politically) in implementing recommendations

**Explanation:** Answers to this item could range from “little difficulty expected for minor or major changes” to “severe difficulty expected for minor or major changes”.

31. Other comments

In cases where RPMs had technical difficulty with the questionnaire, information was gathered via a phone interview with the RPM or the State project manager. In addition, phone interviews were used for this nationwide project to confirm or update the information gathered during the demonstration project from RPMs in Regions 4 and 5. Information sheets with the information and data for each system are provided as Appendix A. Summary information and data for each Region were provided in the form of Region-specific summary reports, which are included as Appendix B.

---

## 4.0 SUMMARIES OF COLLECTED DATA

---

### *A note on discounting (net present value) as it applies to the reported estimates of future costs*

Because funds not spent at present can be invested a rate that exceeds inflation, current funds can yield additional money for future expenditures thereby making present-day dollars worth more than future dollars. As a result, future costs are often discounted and reported in net present value (NPV).

The net present value of a series of annual future costs with discounting in all but the first year is determined with the following relationship:

$$C_{NPV} = \sum_{i=1}^n \frac{c_A}{(1 + D)^{i-1}}$$

where:

- $C_{NPV}$  = NPV of all of the annual costs incurred between the present and  $n$  years from the present
- $c_A$  = annual costs incurred each year between the present and  $n$  years from the present
- $D$  = discount rate (e.g., use 0.05 for 5%)

The actual discount rate ( $D$ ) is a function of inflation, investment rates, and other opportunity costs associated with present and future value of money. Complications in calculating net-present value can include formulation of the discount rate with or without inflation, variation in the discount rate over time, and a change in annual costs over time. A full explanation of the discount rate is beyond the scope of this document. The reader is referred to the following references for a detailed explanation.

- Damodaran, Aswath, 1994. *Damodaran on Valuation*, John Wiley & Sons.
- Ross, Stephen A., Randolph W. Westerfield, and Bradford D. Jordan, 1995. *Fundamentals of Corporate Finance, 3rd edition*, Irwin Publishing.

For the future cost estimates discussed herein, a discount rate of 5% is applied and assumed constant.

### 4.1 SUMMARIES OF SYSTEM COSTS AND PROJECTIONS

[Tables 4-1](#) through [4-9](#) present the following summary information for each Region (except Region 8, which had no Fund-lead P&T systems):

- the result of previous evaluations with respect to performance and effectiveness (see item 29 in Section 3.0);
- the estimated time remaining in the LTRA period (see item 21 in Section 3.0);
- the estimated time remaining until remediation is complete (see item 22 in Section 3.0);
- the annual O&M cost for each system (see item 15 in Section 3.0);
- the expected future cost (in net present value) to be incurred by Superfund for LTRA O&M;

- the expected future cost (in net present value) of O&M remaining to be incurred until remediation is complete; and
- the systems selected for RSEs in **bold**.

In these tables, net-present value is calculated with a 5% discount rate, with no discounting in the first year. Compiling information from [Table 4-1](#) through [Table 4-9](#) yields the following results regarding system O&M costs:

- The estimated average annual O&M cost of a system (based on the 79 systems providing cost data) is approximately \$570,000 and the median is \$350,000. This discrepancy is due to a small number of systems with relatively high O&M costs.
- The estimated total annual O&M cost for operating the Fund-lead P&T systems in 2002 is approximately \$38 million, with EPA incurring approximately \$32.5 million of the total annual cost and the associated States incurring the remaining \$5.5 million.
- The estimated future cost for LTRA O&M at all of these systems exceeds \$210 million with discounting (i.e., net present value) and exceeds \$270 million without discounting. For each system, Superfund is expected to pay 90% of the O&M cost and the associated State is expected to pay 10%. These percentages translate directly to the presented costs; therefore, the Superfund is expected to pay approximately \$189 million (\$243 million without discounting) and the States are expected to pay \$21 million (\$27 million without discounting).
- The estimated future cost to reach remediation completion for all Fund-lead P&T systems is approximately \$470 million with discounting (i.e., net present value) and \$790 million without discounting. (These estimates of future O&M costs are based on the annual costs of systems and expected durations of systems as specified by the site managers. For some systems where expected system duration is unknown, a value of 30 years may have been used as a default value for this parameter. While the practice of using 30 years as a default was prevalent in the past, more recent EPA guidance on feasibility study preparation recommends that 30 years not be used as a default.)

#### **4.2 SUMMARY OF COST DATA AS IT PERTAINS TO THE STATES**

Assuming no viable parties are found for these 88 Fund-lead P&T systems, the States will eventually assume both management and funding responsibility for the systems. [Figures 4-1](#) and [4-2](#) show projected trends of agency financial responsibility and annual costs from 2001 through 2015. These trends are best estimates based on the data provided by the site RPMs. Furthermore, because the actual O&M costs and site enforcement may change with time, these projected trends may also change.

[Figure 4-1](#) shows two projected trends between 2001 and 2015 for 78 Fund-lead P&T systems (the 10 systems with unknown costs or transition dates are excluded). The first trend is the number of Fund-lead P&T systems funded 90% by EPA and 10% by the States. The second trend is the number of Fund-lead P&T systems that are the full responsibility of the States. When counting the number of systems for a particular year, if the system transfer from the EPA to the State occurs before July, then the system is counted as a State system. If the system transfer from EPA to the State occurs after July, then the system is counted as an EPA system.

[Figure 4-2](#) also shows two trends between 2001 and 2015 for the same 78 systems. The first trend is the

total annual cost of Fund-lead P&T systems assumed by the EPA. This cost is 90% of the O&M costs of the Fund-lead P&T systems. The second trend is the total annual cost of Fund-lead systems assumed by the States. This cost is 10% of the O&M costs of Fund-lead P&T systems before transition to the State and 100% of the cost subsequent to the transition. When calculating the costs of systems for a particular year, if the system transfer from the EPA to the State occurs before July, then the State assumes the cost for that year. If the system transfer from EPA to the State occurs after July, then the EPA assumes the cost for that year.

[Table 4-10](#) provides a list of the States that currently have operational or pre-operational Fund-lead P&T systems. It also provides the number of Fund-lead P&T systems in each State and the expected future costs (based on the estimates provided) each State is likely to incur from future O&M of these systems. These future costs are provided both with discounting (net present value) and without discounting. Discounted costs assume a 5% discount rate with no discounting in the first year. The expected future costs are calculated based on the following information:

- the current annual O&M estimates for each system (see item 15 in Section 3.0);
- the estimated date of transition to the State (see item 21 in Section 3.0); and
- the estimated date the remedy will be complete (see item 22 in Section 3.0).

An analysis of the data in [Table 4-10](#) shows that a total of 26 States currently have operational or pre-operational Fund-lead P&T systems. The estimated total post-LTRA O&M costs expected to be incurred by all of the States ranges from approximately \$250 million with discounting to \$520 million without discounting. Approximately 78% of these costs, however, will be incurred by the following five the States:

- New Jersey (27.6%)
- Massachusetts (22.6%)
- New York (9.7%)
- Pennsylvania (9.6%)
- Michigan (8.4%)

It should be noted that the expected future costs to be incurred by the States are only estimates and are subject to variation. This variation may result from a number of reasons:

- the estimated annual O&M costs will likely change in the future;
- the estimated dates, especially the dates the remedies are expected to be complete, may vary significantly from the actual dates;
- the expected future costs do not include the cost of aquifer monitoring subsequent to remedy completion. Additional Fund-lead P&T systems may arise in the future and eventually be transitioned to the States; and
- the responsible parties at some of the current Fund-lead P&T systems may assume the financial burden for their systems.



The Fund-lead P&T systems in each Region and the associated costs are listed according to State in [Table 4-11](#) through [Table 4-19](#). For each system, the table provides the date of transition to the State, the estimated annual O&M cost, and the expected future O&M cost (with and without discounting) to be assumed by the State.

#### **4.3 STATUS AND PROGRESS OF THE FUND-LEAD P&T SYSTEMS**

The collected data can be used to categorize the 88 Fund-lead P&T systems according to their status and/or progress. The status may range from the “pre-design” to “operational” as described in item 11 of Section 3.0, and the progress of systems with restoration as a goal may range from less than 20% progress toward restoration to more than 80% progress toward restoration as described in item 28 in Section 3.0.

[Figure 4-3](#) groups the 88 Fund-lead systems according to their status (i.e., pre-design, design, designed/not installed, being installed, installed but not operational, or operational). Of the 88 systems, 67 are operational systems. As shown in [Figure 4-4](#), 60 of the 67 operating systems are reported to have groundwater restoration as a goal, but 21 of that 60 do not have estimates of the progress toward that restoration. Of the 39 systems that have both groundwater restoration as a goal and an estimate of progress toward restoration, 20 are estimated to have made less than 20% progress toward restoration and 7 are estimated to have made more than 80% progress toward restoration. The remaining 12 systems are estimated to have made between 20% and 80% progress toward restoration. Those systems that report less than 20% restoration have operated, on average, for approximately 4 years. Those systems that report 20% to 80% restoration have operated, on average, for approximately 6 years. Finally, those systems that report more than 80% restoration have operated, on average, for 7 years.

In addition to progress toward restoration, the submitted information (not shown in a figure) indicate that 40 of the 67 operating systems are reportedly controlling migration of the plume.

#### **4.4 SYSTEM GOALS**

The majority of the systems have aquifer restoration specified in the ROD as a remedy objective. During data collection for this project, the remedy goal was not ascertained for two systems. Of the remaining systems, one has public water supply as a goal (restoration may also be a goal) and seven have containment as the only goal. Aquifer restoration is the primary goal for 22 of the systems and 56 of the systems have both containment and restoration as primary goals.

#### **4.5 CONTAMINANTS OF CONCERN, TREATMENT PROCESSES, AND MONITORING**

The collected data show that more than three contaminants of concern are identified for 52 of the 88 Fund-lead P&T systems. The prevalence of certain categories of contaminants, as identified by the system RPMs, are highlighted in [Table 4-20](#). Chlorinated solvents such as tetrachlorethylene (PCE) represent the most prevalent contaminant category identified by RPMs with this contaminant category addressed by 56 of the 88 systems.

Non-aqueous phase liquids (NAPLs) (see item 14 in Section 3.0), if present in the subsurface, will act as continuing sources of some contaminants. The collected data indicate that 35 of the 88 Fund-lead P&T systems are associated with sites where NAPL has either been observed or is suspected. The collected data also indicate that 38 of the Fund-lead P&T systems are associated with sites where NAPL is not present. The presence of NAPL at sites for the remaining 15 systems is not known.

Many of the P&T systems use multiple treatment processes to remove these contaminants from the extracted water. Of the 88 systems, 32 are reported to have three or more treatment processes. [Figure 4-5](#) shows the number of systems that use each of the 10 treatment processes (see item 24 in Section 3.0). Carbon adsorption and air stripping are the most prevalent treatment processes. These two statistics correlate with the prevalence of chlorinated solvents as identified contaminants of concern, because these two treatment processes are commonly used to address those contaminants.


The collected data include the number of monitoring wells, the frequency of monitoring, and costs associated with monitoring (see items 25, 26, and 16 in Section 3.0). As identified in the collected data, the number of monitoring wells associated with a Fund-lead P&T system ranges from 3 to 80 with an average of approximately 23 wells per system (based on 79 of 88 systems where RPMs provided non-zero responses). The minimum sampling frequency (other than no sampling) is once per year whereas the maximum sampling frequency is once per week. On average, monitoring wells at the Fund-lead P&T systems are sampled between 3 and 4 times per year, and on average there are more than 80 samples of groundwater collected per Fund-lead P&T system in a year. As identified by the RPM, monitoring costs range from as little as \$5,000 per year to as much as \$800,000 per year with an average of approximately \$112,000 per year (based on 64 of 88 systems where RPMs were able to determine costs specifically used for groundwater monitoring).

#### **4.6 SUMMARY OF PREVIOUS EFFECTIVENESS EVALUATIONS**

According to the Comprehensive Environmental Response, Compensation, and Liability Act (CERCLA) and the National Contingency Plan (NCP), a 5-year review must be conducted for all remedial actions that do not allow unlimited use and unrestricted exposure. The purpose of these 5-year reviews is to ensure that the remedies are protective of human health and the environment. They therefore include a statement regarding the effectiveness and performance of the system. [Tables 4-1](#) through [4-9](#) provide the results of 5-year reviews or other such evaluations, if they have been conducted, at each site. It should be emphasized that these are not the results of RSEs conducted as part of this project. They are the findings from 5-year reviews or similar evaluations that were conducted at these sites prior to this Nationwide Optimization Project and reported by the RPM as part of this survey. The following points summarize these results.

- 36 of the 67 operating systems are reported to have had performance and effectiveness evaluated and found to be sufficient;
- 7 of the 67 operating systems are reported to have had performance and effectiveness evaluated and found to be not sufficient;
- 22 of the 67 operating systems reportedly are either currently being evaluated or have not been evaluated with respect to effectiveness; and
- the evaluation status of two of the systems was not determined.

**Figure 4-1: Trend of Financial Responsibility of Fund-lead P&T Systems**

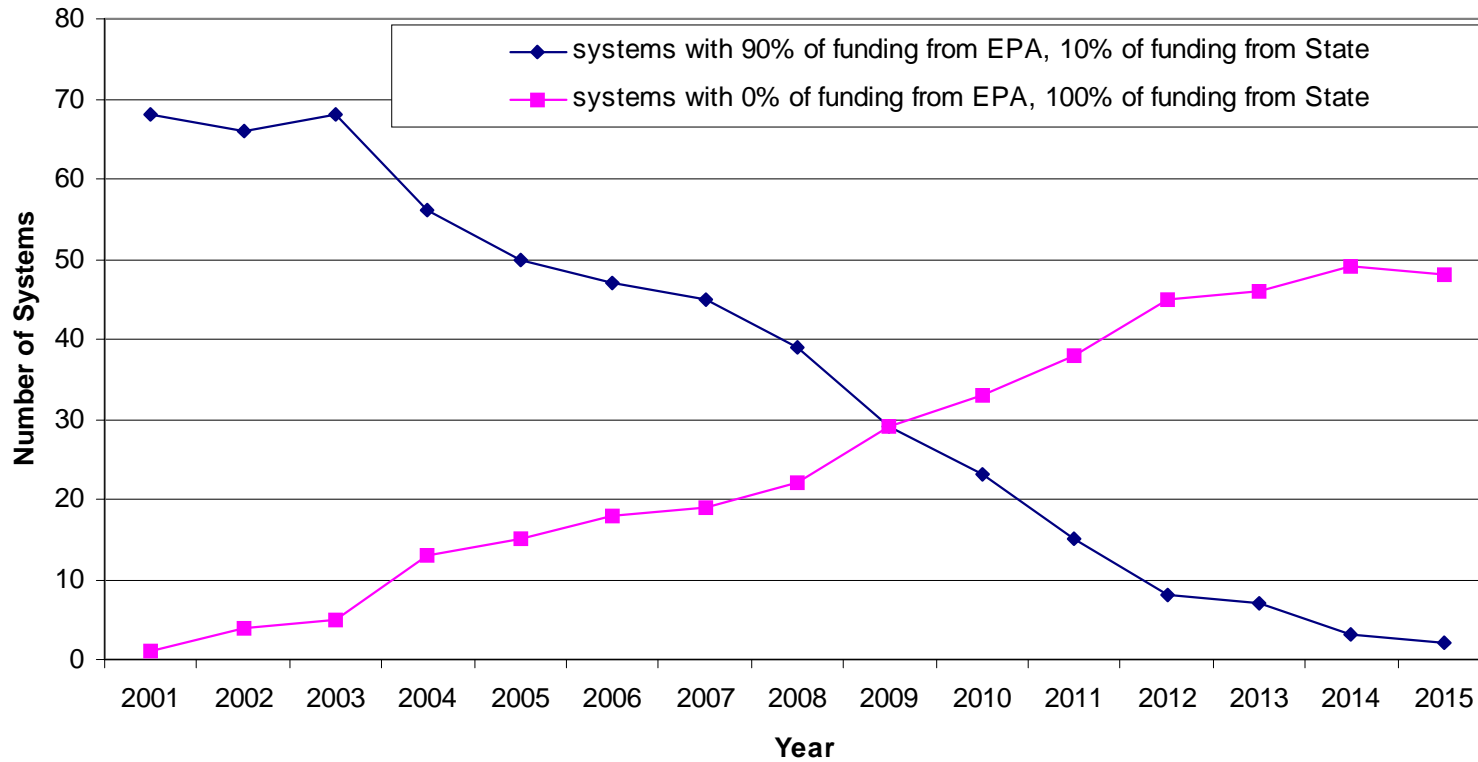


*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems refers to systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. This chart only shows the trends between 2001 and 2015. Existing systems and new systems are expected to operate beyond 2015.

**Figure 4-2: Trend of Estimated Annual O&M Costs of Fund-lead P&T Systems**

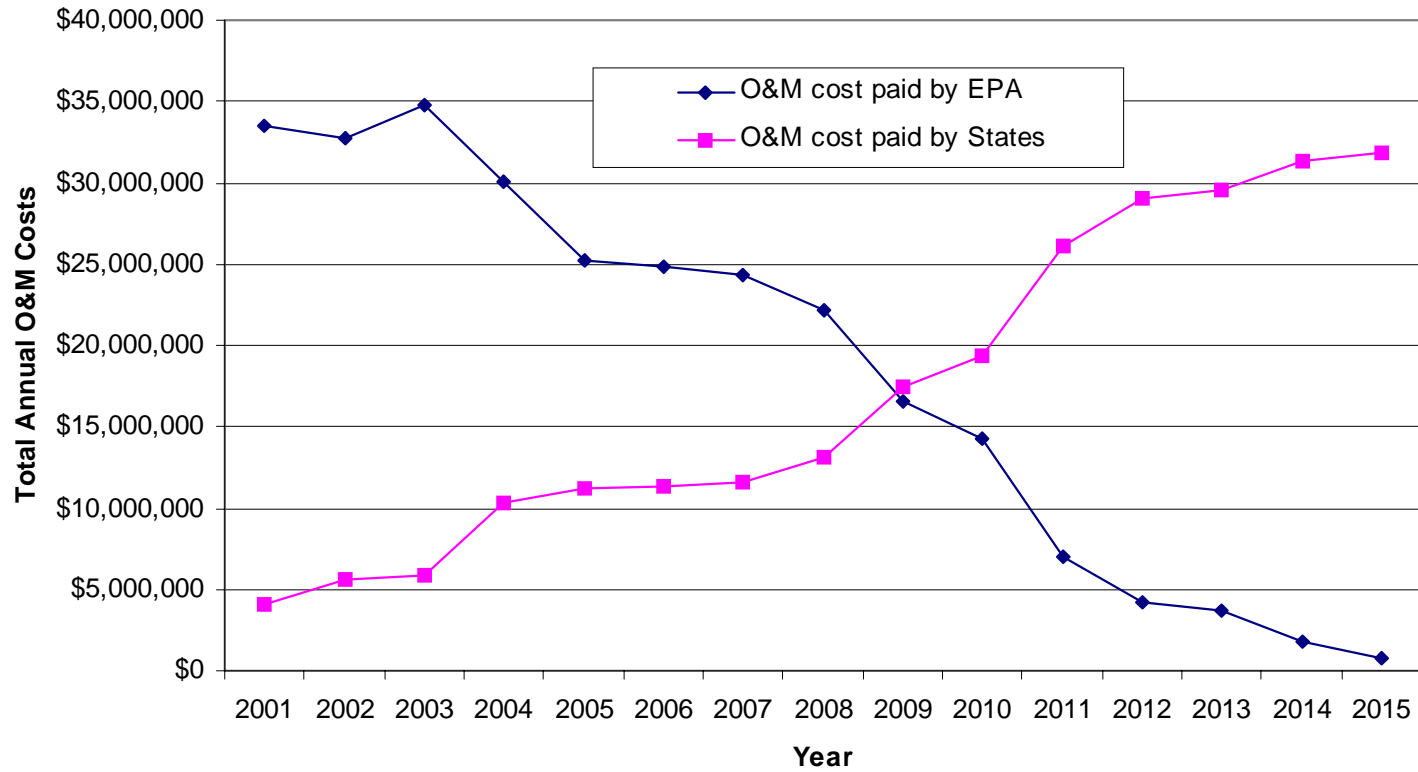


*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

**Notes:**

1. Fund-lead P&T systems refers to systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
3. This chart only shows the trends between 2001 and 2015. Existing systems and new systems are expected to operate beyond 2015.

**Figure 4-3: Status of Fund-lead P&T Systems**

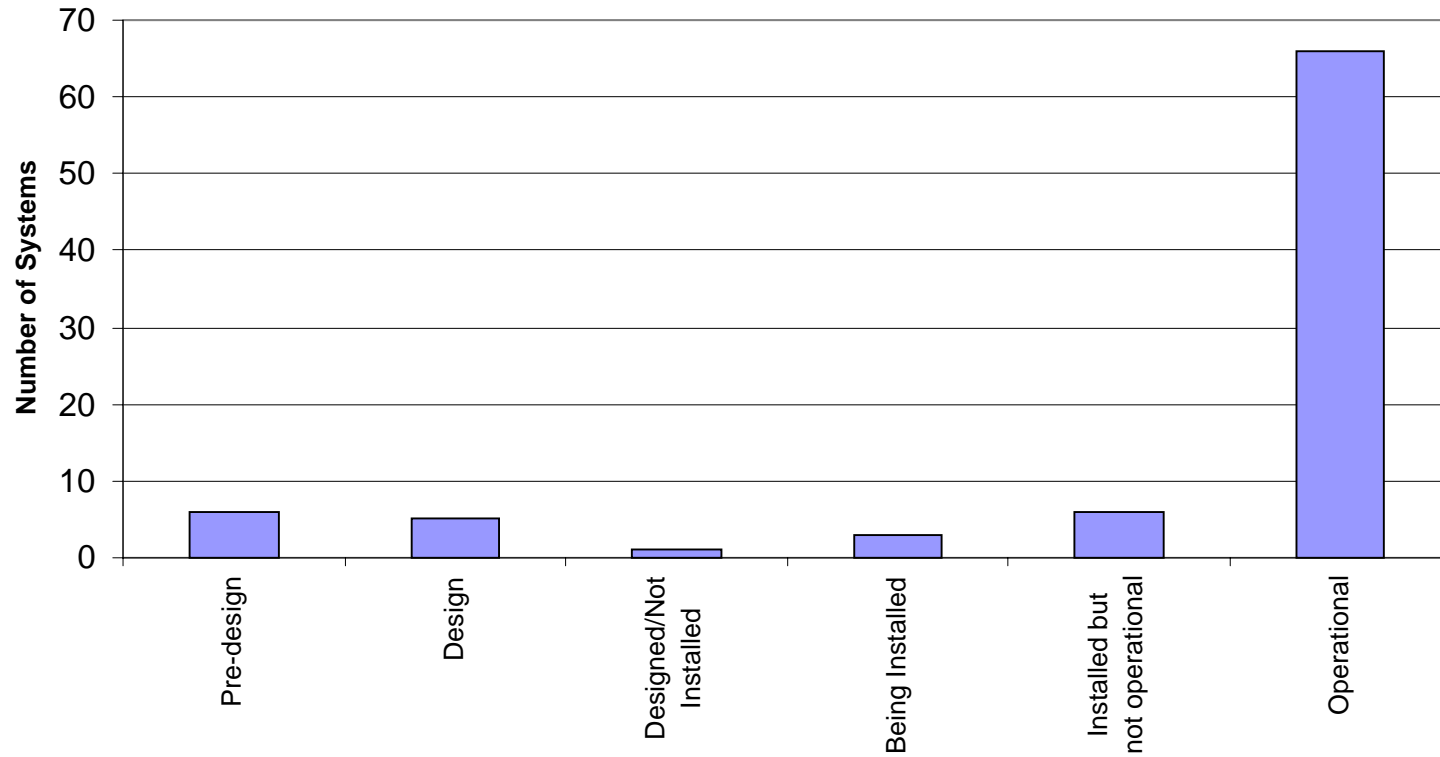


*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems are those systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Pre-designed Fund-lead P&T systems refer to those systems that have P&T specified in the Record of Decision but are not yet in the design stage.

**Figure 4-4: Progress of the 67 Operational Fund-lead P&T Systems**

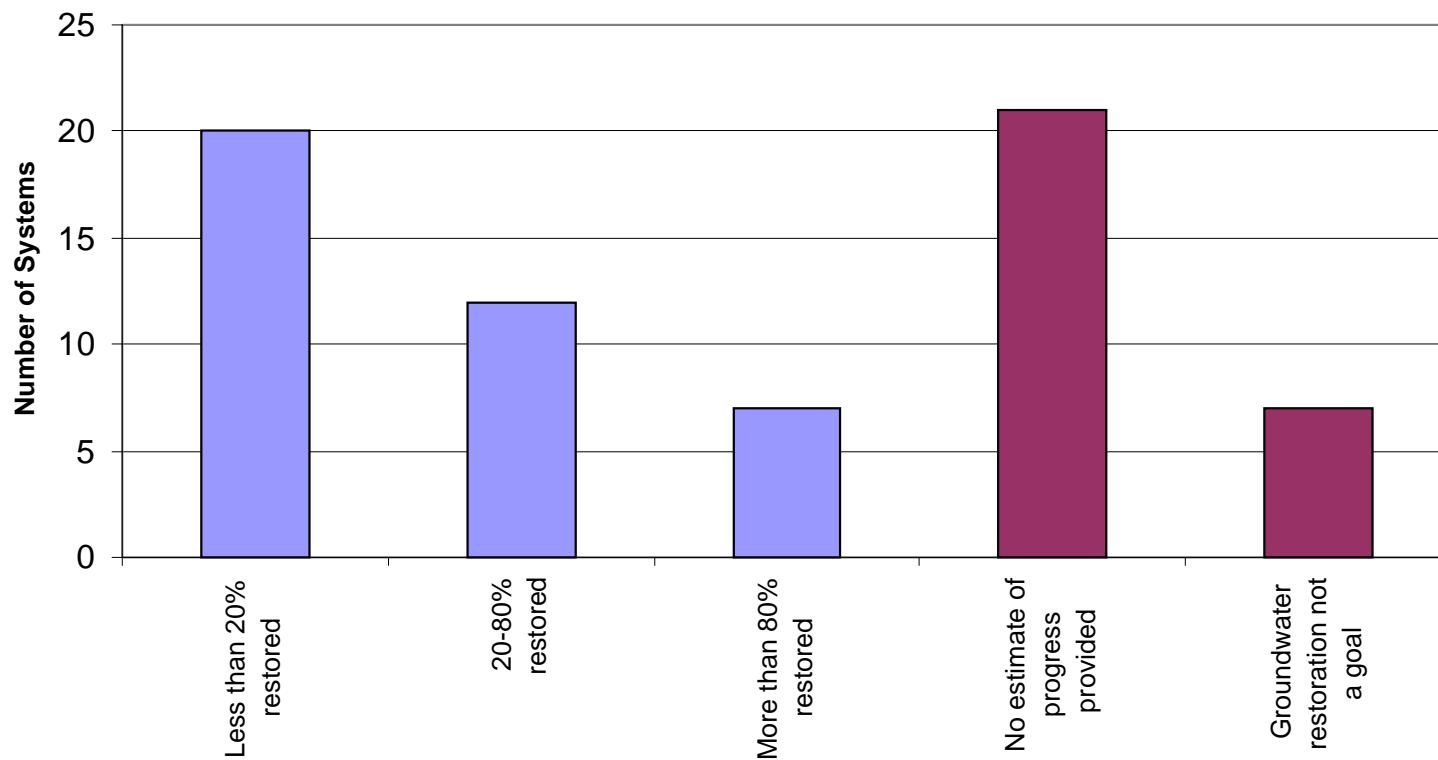


*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems are those systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.

**Figure 4-5: Distribution of Treatment Processes at Fund-lead P&T Systems**

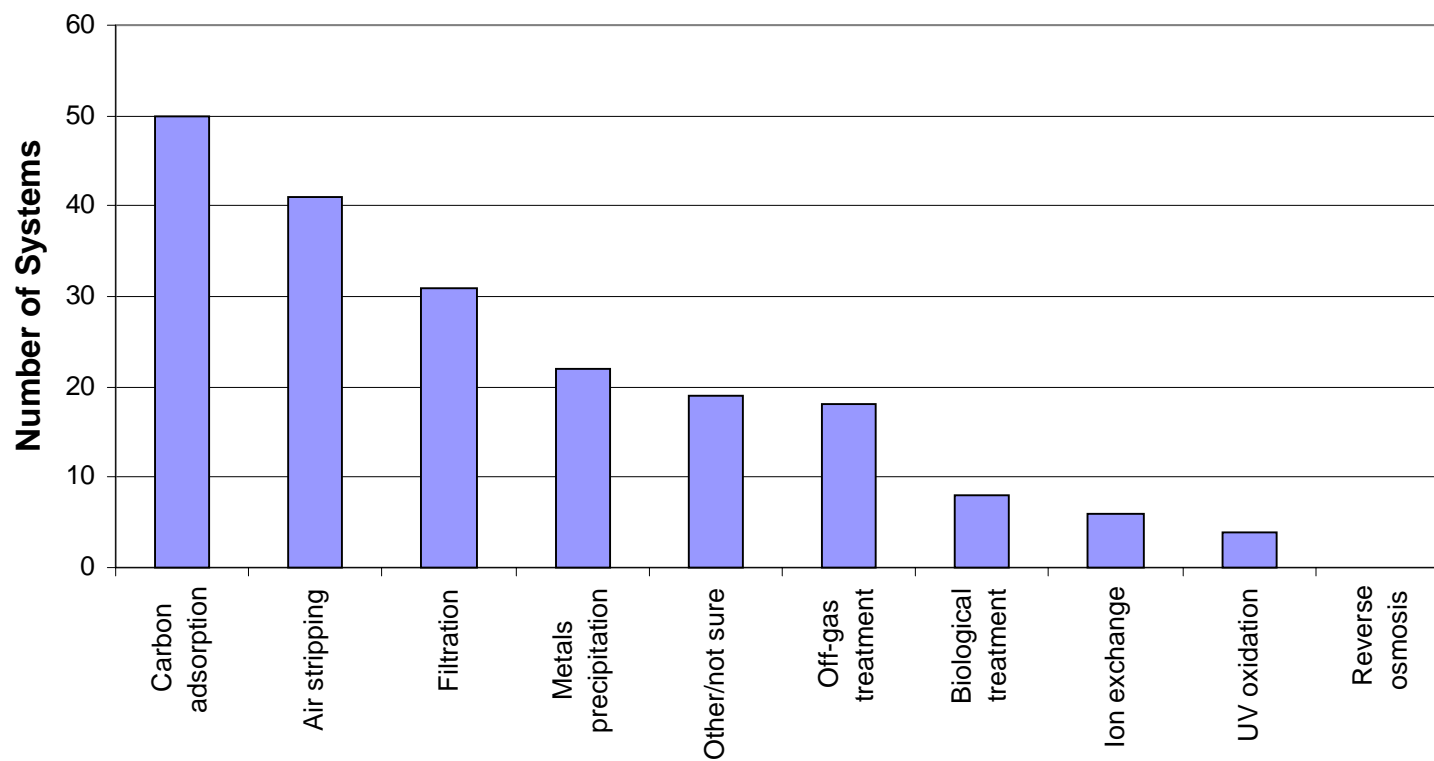

*Data reflect information provided by site Remedial Project Managers between February and May 2001. This information—including the number of systems, system status, and types of treatment processes—may change over time.*

Notes:

1. Fund-lead P&T systems are those systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Individual systems may have multiple treatment processes.
3. The treatment processes listed correspond to those shown in item 24 of Section 3.0.

**Table 4-1: Region 1 Fund-lead P&T System Performance and Cost Information**

| Site                           | Performance & Effectiveness | Estimated Remaining Time in LTRA (yrs) | Estimated Duration (yrs) | Annual O&M (\$/yr) | Expected Remaining Cost for LTRA O&M | Expected Total Remaining O&M Cost |
|--------------------------------|-----------------------------|--|--------------------------|--------------------|--------------------------------------|-----------------------------------|
| <b>Operational Systems</b>     |                             |  |                          |                    |                                      |                                   |
| <b>Baird and McGuire</b>       | Sufficient                  | 2.25                                   | 21.3                     | \$3,500K           | \$7.6M                               | \$47.5M                           |
| Charles George Landfill        | Not Evaluated               | 7.7                                    | 26.7                     | \$450K             | \$3.0M                               | \$6.9M                            |
| Groveland Wells                | Sufficient                  | 9.3                                    | 29.3                     | \$500K             | \$3.8M                               | \$8.0M                            |
| Kearsarge Metallurgical        | Sufficient                  | 1.7                                    | 3.7                      | \$250K             | \$0.4M                               | \$0.9M                            |
| Keefe                          | Sufficient                  | 1.7                                    | 1.7                      | \$200K             | \$0.3M                               | \$0.3M                            |
| <b>Savage Well</b>             | Not Evaluated               | 7.2                                    | 7.2                      | \$500K             | \$3.1M                               | \$3.1M                            |
| <b>Silresim Chemical</b>       | Not Sufficient              | 5.7                                    | 15.9                     | \$1,400K           | \$7.1M                               | \$15.9M                           |
| <b>Pre-operational Systems</b> |                             |  |                          |                    |                                      |                                   |
| Eastern Surplus                | Not Evaluated               | 9.7                                    | 5.7                      | \$200K             | \$1.0M                               | \$1.0M                            |
|                                |                             |  | <b>Total</b>             | \$7.0M             | \$26.3M                              | \$83.6M                           |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems: systems where pump and treat (groundwater extraction and treatment) is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Descriptions of "Performance and Effectiveness" refer to results of previous evaluations such as the 5-year reviews and not from RSEs conducted as part of this project.
4. Long-term Remedial Action (LTRA): the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. "Estimated Time Remaining in LTRA" and "Expected Duration" are calculated by determining the number of years between January 1, 2002 and time frame estimates provided by the site Remedial Project Managers. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL.
6. Reported annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
7. Expected costs are shown in net present value, calculated with a 5% discount rate with no discounting in the first year.
8. For Eastern Surplus, collected data indicate that remedy completion is expected prior to the end of LTRA. Expected remaining costs for Superfund do not exceed the expected total remaining costs.



**Table 4-2: Region 2 Fund-lead P&T System Performance and Cost Information (Page 1 of 3)**

| Site                          | Performance & Effectiveness | Estimated Remaining Time in LTRA (yrs) | Estimated Duration (yrs) | Annual O&M (\$/yr) | Expected Remaining Cost for LTRA O&M | Expected Total Remaining O&M Cost |
|-------------------------------|-----------------------------|--|--------------------------|--------------------|--------------------------------------|-----------------------------------|
| <b>Operational Systems</b>    |                             |  |                          |                    |                                      |                                   |
| American Thermostat           | Sufficient                  | 6.8                                    | 26.7                     | \$1,175K           | \$6.9M                               | \$18.0M                           |
| Bog Creek                     | Sufficient                  | 2.7                                    | 22.9                     | \$460K             | \$1.2M                               | \$6.5M                            |
| <b>Brewster Well Field</b>    | Not Evaluated               | 5.8                                    | 5.8                      | \$400K             | \$2.1M                               | \$2.1M                            |
| Circuitron                    | Sufficient                  | 8.4                                    | 1.4                      | \$480K             | \$0.7M                               | \$0.7M                            |
| <b>Claremont Polychemical</b> | Not Evaluated               | 8.1                                    | 18.1                     | \$740K             | \$5.1M                               | \$9.1M                            |
| Combe Fill South              | Not Sufficient              | 6.7                                    | 26.7                     | \$920K             | \$5.4M                               | \$14.1M                           |
| Garden State Cleaners         | Not Evaluated               | 7.8                                    | 27.8                     | \$500K             | \$3.3M                               | \$7.8M                            |
| Higgins Farm                  | Not Evaluated               | 7.0                                    | 26.7                     | \$1,000K           | \$6.1M                               | \$15.3M                           |
| Islip Municipal Landfill      | Sufficient                  | 4.7                                    | 1.0                      | \$225K             | \$0.2M                               | \$0.2M                            |
| Lang Property                 | Sufficient                  | 3.75                                   | 2.75                     | \$700K             | \$1.9M                               | \$1.9M                            |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems: systems where pump and treat (groundwater extraction and treatment) is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Descriptions of "Performance and Effectiveness" refer to results of previous evaluations such as the 5-year reviews and not from RSEs conducted as part of this project.
4. Long-term Remedial Action (LTRA): the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. "Estimated Time Remaining in LTRA" and "Expected Duration" are calculated by determining the number of years between January 1, 2002 and time frame estimates provided by the site Remedial Project Managers. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL.
6. Reported annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
7. Expected costs are shown in net present value, calculated with a 5% discount rate with no discounting in the first year.
8. For Circuitron, Islip Municipal Landfill, Lang Property, and SMS Instruments, collected data indicate that remedy completion is expected prior to the end of LTRA. Expected remaining costs for Superfund do not exceed the expected total remaining costs.
9. The Army Corps of Engineers conducted an RSE of Lipari Landfill prior to this project.
10. The "Estimated Time Remaining in LTRA" exceeds 10 years for Lipari Landfill because this remedy is part of a source control action.

**Table 4-2: Region 2 Fund-lead P&T System Performance and Cost Information (Page 2 of 3)**

| Site                                   | Performance & Effectiveness | Estimated Remaining Time in LTRA (yrs) | Estimated Duration (yrs) | Annual O&M (\$/yr) | Expected Remaining Cost for LTRA O&M | Expected Total Remaining O&M Cost |
|--|-----------------------------|--|--------------------------|--------------------|--------------------------------------|-----------------------------------|
| <b>Operational Systems (continued)</b> |                             |  |                          |                    |                                      |                                   |
| Lipari Landfill                        | Sufficient                  | 17.8                                   | 2.9                      | \$2,500K           | \$7.0M                               | \$7.0M                            |
| <b>Mattiace Petrochemical</b>          | Sufficient                  | 7.2                                    | 27.6                     | \$700K             | \$4.3M                               | \$10.9M                           |
| Mohonk Road                            | Not Evaluated               | 9.5                                    | 29.5                     | Unknown            | Unknown                              | Unknown                           |
| SMS Instruments                        | Sufficient                  | 3.4                                    | 2.2                      | \$400K             | \$1.3M                               | \$0.8M                            |
| Syncon Resins                          | Not Sufficient              | 0.0                                    | 26.7                     | \$350K             | \$0.0M                               | \$5.4M                            |
| Vestal Water Supply                    | Sufficient                  | 3.2                                    | 13.2                     | \$180K             | \$0.5M                               | \$1.8M                            |
| Vineland Chemical                      | Not Evaluated               | 9.4                                    | 29.4                     | \$4,000K           | \$30.9M                              | \$64.0M                           |
| Williams Property                      | Sufficient                  | 0.0                                    | 0.0                      | \$350K             | \$0.0M                               | \$0.0M                            |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems: systems where pump and treat (groundwater extraction and treatment) is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Descriptions of "Performance and Effectiveness" refer to results of previous evaluations such as the 5-year reviews and not from RSEs conducted as part of this project.
4. Long-term Remedial Action (LTRA): the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. "Estimated Time Remaining in LTRA" and "Expected Duration" are calculated by determining the number of years between January 1, 2002 and time frame estimates provided by the site Remedial Project Managers. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL.
6. Reported annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
7. Expected costs are shown in net present value, calculated with a 5% discount rate with no discounting in the first year.
8. For Circuitron, Islip Municipal Landfill, Lang Property, and SMS Instruments, collected data indicate that remedy completion is expected prior to the end of LTRA. Expected remaining costs for Superfund do not exceed the expected total remaining costs.
9. The Army Corps of Engineers conducted an RSE of Lipari Landfill prior to this project.
10. The "Estimated Time Remaining in LTRA" exceeds 10 years for Lipari Landfill because this remedy is part of a source control action.

**Table 4-2: Region 2 Fund-lead P&T System Performance and Cost Information (Page 3 of 3)**

| Site                           | Performance & Effectiveness | Estimated Remaining Time in LTRA (yrs) | Estimated Duration (yrs) | Annual O&M (\$/yr) | Expected Remaining Cost for LTRA O&M | Expected Total Remaining O&M Cost |
|--------------------------------|-----------------------------|--|--------------------------|--------------------|--------------------------------------|-----------------------------------|
| <b>Pre-operational Systems</b> |                             |  |                          |                    |                                      |                                   |
| Dover Municipal Well 4         | Not Evaluated               | 10.0                                   | Unknown                  | Unknown            | Unknown                              | Unknown                           |
| Metal TEC/Aerosystems          | Not Evaluated               | Unknown                                | Unknown                  | Unknown            | Unknown                              | Unknown                           |
| Montgomery Township/Rocky Hill | Not Evaluated               | 10.0                                   | 30.0                     | \$400K             | \$2.6M                               | \$5.8M                            |
| Stanton Cleaners               | Not Evaluated               | 9.7                                    | 19.7                     | \$270K             | \$2.1M                               | \$3.5M                            |
|                                |                             |  | <b>Total</b>             | >\$17.5M           | >\$81.1M                             | >\$174.9M                         |

Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.

Notes:

1. Fund-lead P&T systems: systems where pump and treat (groundwater extraction and treatment) is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Descriptions of "Performance and Effectiveness" refer to results of previous evaluations such as the 5-year reviews and not from RSEs conducted as part of this project.
4. Long-term Remedial Action (LTRA): the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. "Estimated Time Remaining in LTRA" and "Expected Duration" are calculated by determining the number of years between January 1, 2002 and time frame estimates provided by the site Remedial Project Managers. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL.
6. Reported annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
7. Expected costs are shown in net present value, calculated with a 5% discount rate with no discounting in the first year.
8. For Circuitron, Islip Municipal Landfill, Lang Property, and SMS Instruments, collected data indicate that remedy completion is expected prior to the end of LTRA. Expected remaining costs for Superfund do not exceed the expected total remaining costs.
9. The Army Corps of Engineers conducted an RSE of Lipari Landfill prior to this project.
10. The "Estimated Time Remaining in LTRA" exceeds 10 years for Lipari Landfill because this remedy is part of a source control action.

**Table 4-3: Region 3 Fund-lead P&T System Performance and Cost Information**

| Site                            | Performance & Effectiveness | Estimated Remaining Time in LTRA (yrs) | Estimated Duration (yrs) | Annual O&M (\$/yr) | Expected Remaining Cost for LTRA O&M | Expected Total Remaining O&M Cost |
|---------------------------------|-----------------------------|--|--------------------------|--------------------|--------------------------------------|-----------------------------------|
| <b>Operational Systems</b>      |                             |  |                          |                    |                                      |                                   |
| AIW Frank                       | Sufficient                  | 9.7                                    | 29.7                     | \$180K             | \$1.4M                               | \$2.9M                            |
| Berks Sand Pit                  | Sufficient                  | 3.1                                    | 1.1                      | \$150K             | \$0.2M                               | \$0.2M                            |
| Butz Landfill                   | Not Evaluated               | 9.3                                    | 29.3                     | \$250K             | \$1.9M                               | \$4.0M                            |
| Croydon TCE                     | Sufficient                  | 3.2                                    | 23.2                     | \$200K             | \$0.6M                               | \$2.8M                            |
| CryoChem                        | Sufficient                  | 6.4                                    | 8.4                      | \$125K             | \$0.7M                               | \$0.9M                            |
| Greenwood Chemical              | Not Evaluated               | 9.8                                    | 18.9                     | \$400K             | \$3.2M                               | \$5.1M                            |
| <b>Hellertown Manufacturing</b> | Not Sufficient              | 4.7                                    | 24.7                     | \$350K             | \$1.5M                               | \$5.1M                            |
| North Penn Area 1               | Not Evaluated               | 6.7                                    | 16.7                     | \$100K             | \$0.6M                               | \$1.2M                            |
| <b>Raymark</b>                  | Not Evaluated               | 2.0                                    | 12.0                     | \$156K             | \$0.3M                               | \$1.4M                            |
| Saunders Supply                 | Not Evaluated               | 7.3                                    | 6.3                      | \$80K              | \$0.4M                               | \$0.4M                            |
| <b>Pre-operational Systems</b>  |                             |  |                          |                    |                                      |                                   |
| Havertown PCP                   | Not Evaluated               | 10.0                                   | 31.0                     | \$1,000K           | \$7.9M                               | \$16.1M                           |
| North Penn Area 6               | Not Evaluated               | 10.0                                   | 30.0                     | \$592K             | \$4.0M                               | \$8.7M                            |
|                                 |                             |  | <b>Total</b>             | <b>\$3.6M</b>      | <b>\$22.7M</b>                       | <b>\$48.8M</b>                    |

Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.

Notes:

1. Fund-lead P&T systems: systems where pump and treat (groundwater extraction and treatment) is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Descriptions of "Performance and Effectiveness" refer to results of previous evaluations such as the 5-year reviews and not from RSEs conducted as part of this project.
4. Long-term Remedial Action (LTRA): the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. "Estimated Time Remaining in LTRA" and "Expected Duration" are calculated by determining the number of years between January 1, 2002 and time frame estimates provided by the site Remedial Project Managers. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL.
6. Reported annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
7. Expected costs are shown in net present value, calculated with a 5% discount rate with no discounting in the first year.
8. For Berks Sand Pit and Saunders Supply, collected data indicate that remedy completion is expected prior to the end of LTRA. Expected remaining costs for Superfund do not exceed the expected total remaining costs.

**Table 4-4: Region 4 Fund-lead P&T System Performance and Cost Information**

| Site                             | Performance & Effectiveness | Estimated Remaining Time in LTRA (yrs) | Estimated Duration (yrs) | Annual O&M (\$/yr) | Expected Remaining Cost for LTRA O&M | Expected Total Remaining O&M Cost |
|----------------------------------|-----------------------------|--|--------------------------|--------------------|--------------------------------------|-----------------------------------|
| <b>Operational Systems</b>       |                             |  |                          |                    |                                      |                                   |
| ABC Cleaners                     | Unknown                     | Unknown                                | Unknown                  | Unknown            | Unknown                              | Unknown                           |
| American Creosote Works (DNAPL)  | Not Evaluated               | 1.3                                    | 1.3                      | \$300K             | \$0.4M                               | \$0.4M                            |
| Benfield Industries              | Not Evaluated               | 9.3                                    | 19.3                     | \$30K              | \$0.2M                               | \$0.4M                            |
| <b>Elmore Waste Disposal</b>     | Sufficient                  | 6.7                                    | 16.7                     | \$180K             | \$1.1M                               | \$2.1M                            |
| <b>FCX Statesville</b>           | Sufficient                  | 6.3                                    | 6.3                      | \$150K             | \$0.8M                               | \$0.8M                            |
| Miami Drum                       | Unknown                     | 0.7                                    | Unknown                  | \$1,000K           | \$0.7M                               | Unknown                           |
| Palmetto Wood                    | Sufficient                  | 6.3                                    | 6.3                      | \$300K             | \$1.7M                               | \$1.7M                            |
| <b>Pre-operational Systems</b>   |                             |  |                          |                    |                                      |                                   |
| American Creosote Works (solute) | Not Evaluated               | 10.0                                   | 5.0                      | \$452K             | \$0.9M                               | \$0.9M                            |
| Cape Fear Wood Preserving        | Not Evaluated               | 9.8                                    | 7.3                      | \$40K              | \$0.2M                               | \$0.2M                            |
| Coleman Evans Wood Preserving    | Not Evaluated               | Unknown                                | Unknown                  | Unknown            | Unknown                              | Unknown                           |
|                                  |                             |  | <b>Total</b>             | <b>&gt;\$2.5M</b>  | <b>&gt;\$6.0M</b>                    | <b>\$7.2M</b>                     |

Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.

Notes:

1. Fund-lead P&T systems: systems where pump and treat (groundwater extraction and treatment) is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Descriptions of "Performance and Effectiveness" refer to results of previous evaluations such as the 5-year reviews and not from RSEs conducted as part of this project.
4. Long-term Remedial Action (LTRA): the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. "Estimated Time Remaining in LTRA" and "Expected Duration" are calculated by determining the number of years between January 1, 2002 and time frame estimates provided by the site Remedial Project Managers. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL.
6. Reported annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
7. Expected costs are shown in net present value, calculated with a 5% discount rate with no discounting in the first year.
8. For American Creosote Works (solute) and Cape Fear Wood Preserving, collected data indicate that remedy completion is expected by the end of LTRA. Expected remaining costs for Superfund do not exceed the expected total remaining costs.
9. The sum of the "Total Expected Remaining Costs" includes the LTRA cost for Miami Drum as it is expected that O&M will continue beyond LTRA.

**Table 4-5: Region 5 Fund-lead P&T System Performance and Cost Information (Page 1 of 2)**

| Site                         | Performance & Effectiveness | Estimated Remaining Time in LTRA (yrs) | Estimated Duration (yrs) | Annual O&M (\$/yr) | Expected Remaining Cost for LTRA O&M | Expected Total Remaining O&M Cost |
|------------------------------|-----------------------------|--|--------------------------|--------------------|--------------------------------------|-----------------------------------|
| <b>Operational Systems</b>   |                             |  |                          |                    |                                      |                                   |
| Arrowhead Refinery           | Sufficient                  | 1.5                                    | 2.2                      | \$70K              | \$0.1M                               | \$0.2M                            |
| Better Brite                 | Sufficient                  | 4.4                                    | 28.3                     | \$36K              | \$0.1M                               | \$0.6M                            |
| Eau Claire                   | Sufficient                  | Unknown                                | Unknown                  | \$175K             | Unknown                              | Unknown                           |
| La Salle                     | Sufficient                  | 2.2                                    | 3.2                      | \$230K             | \$0.5M                               | \$0.7M                            |
| Long Prairie                 | Not Evaluated               | 5.8                                    | 13.8                     | \$300K             | \$1.5M                               | \$3.1M                            |
| <b>MacGillis &amp; Gibbs</b> | Not Evaluated               | 7.8                                    | 27.8                     | \$300K             | \$2.0M                               | \$4.7M                            |
| <b>Oconomowoc</b>            | Sufficient                  | 4.7                                    | 24.7                     | \$471K             | \$2.0M                               | \$6.9M                            |
| Onalaska                     | Sufficient                  | 2.4                                    | 0.5                      | \$200K             | \$0.1M                               | \$0.1M                            |
| <b>Ott/Story</b>             | Not Evaluated               | 8.6                                    | 28.6                     | \$2,400K           | \$17.2M                              | \$37.9M                           |
| U.S. Aviex                   | Sufficient                  | 1.7                                    | 1.7                      | \$300K             | \$0.5M                               | \$0.5M                            |
| Verona Well Field            | Not Evaluated               | 4.4                                    | Indefinite               | \$225K             | \$0.9M                               | Indefinite                        |
| Wash King                    | Not Evaluated               | 9.3                                    | 19.3                     | \$75K              | \$0.6M                               | \$1.0M                            |

Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual value. Data, including the number and status of systems, may change over time.

Notes:

1. Fund-lead P&T systems: systems where pump and treat (groundwater extraction and treatment) is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Descriptions of "Performance and Effectiveness" refer to results of previous evaluations such as the 5-year reviews and not from RSEs conducted as part of this project.
4. Long-term Remedial Action (LTRA): the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. "Estimated Time Remaining in LTRA" and "Expected Duration" are calculated by determining the number of years between January 1, 2002 and time frame estimates provided by the site Remedial Project Managers. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL.
6. Reported annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
7. Expected costs are shown in net present value, calculated with a 5% discount rate with no discounting in the first year.
8. For Onalaska, collected data indicate that remedy completion is expected prior to the end of LTRA. Expected remaining costs for Superfund do not exceed the expected total remaining costs.
9. The sum of "Total Expected Remaining Cost" includes the LTRA cost for Verona Well Field as it is expected that O&M will continue at this system beyond LTRA.

**Table 4-5: Region 5 Fund-lead P&T System Performance and Cost Information (Page 2 of 2)**

| Site                           | Performance & Effectiveness | Estimated Remaining Time in LTRA (yrs) | Estimated Duration (yrs) | Annual O&M (\$/yr) | Expected Remaining Cost for LTRA O&M | Expected Total Remaining O&M Cost |
|--------------------------------|-----------------------------|--|--------------------------|--------------------|--------------------------------------|-----------------------------------|
| <b>Pre-operational Systems</b> |                             |  |                          |                    |                                      |                                   |
| Douglass Road                  | Not Evaluated               | 8.7                                    | 28.3                     | \$120K             | \$0.9M                               | \$1.9M                            |
| Duell and Gardner              | Not Evaluated               | 9.5                                    | 5.5                      | Unknow             | Unknown                              | Unknown                           |
| Peerless Plating               | Sufficient                  | Unknown                                | Unknown                  | \$400K             | Unknown                              | Unknown                           |
|                                |                             |  | <b>Total</b>             | >\$5.3M            | >\$26.4M                             | >\$58.5M                          |

Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.

Notes:

1. Fund-lead P&T systems: systems where pump and treat (groundwater extraction and treatment) is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Descriptions of "Performance and Effectiveness" refer to results of previous evaluations such as the 5-year reviews and not from RSEs conducted as part of this project.
4. Long-term Remedial Action (LTRA): the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. "Estimated Time Remaining in LTRA" and "Expected Duration" are calculated by determining the number of years between January 1, 2002 and time frame estimates provided by the site Remedial Project Managers. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL.
6. Reported annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
7. Expected costs are shown in net present value, calculated with a 5% discount rate with no discounting in the first year.
8. For Onalaska, collected data indicate that remedy completion is expected prior to the end of LTRA. Expected remaining costs for Superfund do not exceed the expected total remaining costs.
9. The sum of "Total Expected Remaining Cost" includes the LTRA cost for Verona Well Field as it is expected that O&M will continue at this system beyond LTRA.

**Table 4-6: Region 6 Fund-lead P&T System Performance and Cost Information**

| Site                           | Performance & Effectiveness | Estimated Remaining Time in LTRA (yrs) | Estimated Duration (yrs) | Annual O&M (\$/yr) | Expected Remaining Cost for LTRA O&M | Expected Total Remaining O&M Cost |
|--------------------------------|-----------------------------|--|--------------------------|--------------------|--------------------------------------|-----------------------------------|
| <b>Operational Systems</b>     |                             |  |                          |                    |                                      |                                   |
| American Creosote Works        | Sufficient                  | 25.1                                   | 25.1                     | \$360K             | \$5.3M                               | \$5.3M                            |
| <b>Bayou Bonfouca</b>          | Sufficient                  | 1.5                                    | 19.5                     | \$402K             | \$0.6M                               | \$5.1M                            |
| Cimarron Mining                | Not Sufficient              | 2.8                                    | Indefinite               | \$1,000K           | \$2.6M                               | Indefinite                        |
| Geneva Industries              | Sufficient                  | 2.0                                    | 2.0                      | \$240K             | \$0.5M                               | \$0.5M                            |
| <b>Midland Products</b>        | Sufficient                  | 2.0                                    | 32.0                     | \$180K             | \$0.4M                               | \$3.0M                            |
| Odessa Chromium #1             | Sufficient                  | 0.0                                    | 0.0                      | \$500K             | \$0M                                 | \$0M                              |
| <b>Pre-operational Systems</b> |                             |  |                          |                    |                                      |                                   |
| City of Perryton Well #2       | Not Evaluated               | 10.0                                   | 20.0                     | \$37K              | \$0.2M                               | \$0.4M                            |
| North Cavalcade                | Not Evaluated               | 0.0                                    | 5.0                      | Unknown            | Unknown                              | Unknown                           |
| Sprague Road                   | Not Evaluated               | 10.0                                   | 25.2                     | \$1,200K           | \$7.8M                               | \$15.8M                           |
|                                |                             |  | <b>Total</b>             | <b>&gt;\$3.9M</b>  | <b>&gt;\$17.4M</b>                   | <b>&gt;\$32.7M</b>                |

Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.

Notes:

1. Fund-lead P&T systems: systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Descriptions of "Performance and Effectiveness" refer to results from previous evaluations such as 5-year reviews and not from RSEs conducted as part of this project.
4. LTRA refers to Long-term Remedial Action, the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. "Estimated Time Remaining in LTRA" and "Expected Duration" are calculated by determining the number of years between January 1, 2002 and time frame estimates provided by the site Remedial Project Managers. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL.
6. Annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
7. Expected costs are presented in net present value, calculated with a 5% discount rate with no discounting in the first year.
8. The sum of "Total Expected Remaining Cost" includes the LTRA cost for Cimarron Mining as it is expected that O&M will continue at this system beyond LTRA.
9. The "Estimated Time Remaining in LTRA" exceeds 10 years for American Creosote Works because this remedy is part of a source control action.



**Table 4-7: Region 7 Fund-lead P&T System Performance and Cost Information**

| Site                                | Performance & Effectiveness | Estimated Remaining Time in LTRA (yrs) | Estimated Duration (yrs) | Annual O&M (\$/yr) | Expected Remaining Cost for LTRA O&M | Expected Total Remaining O&M Cost |
|-------------------------------------|-----------------------------|--|--------------------------|--------------------|--------------------------------------|-----------------------------------|
| <b>Operational Systems</b>          |                             |  |                          |                    |                                      |                                   |
| <b>Cleburn Street Well Site/OU2</b> | Not Evaluated               | 7.9                                    | 17.9                     | \$100K             | \$0.7M                               | \$1.2M                            |
| <b>Pre-operational Systems</b>      |                             |  |                          |                    |                                      |                                   |
| Ace Services                        | Not Evaluated               | 10.0                                   | 12.1                     | \$500K             | \$3.2M                               | \$3.8M                            |
| Valley Park TCE/OU2                 | Not Evaluated               | 0.0                                    | 10.0                     | Unknown            | Unknown                              | Unknown                           |
|                                     |                             |  | <b>Total</b>             | >\$0.6M            | >\$3.9M                              | >\$5.0M                           |

Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.

Notes:

1. Fund-lead P&T systems: systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Descriptions of "Performance and Effectiveness" refer to results from previous evaluations such as 5-year reviews and not from RSEs conducted as part of this project.
4. LTRA refers to Long-term Remedial Action, the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. "Estimated Time Remaining in LTRA" and "Expected Duration" are calculated by determining the number of years between January 1, 2002 and time frame estimates provided by the site Remedial Project Managers. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL.
6. Annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
7. Expected costs are presented in net present value, calculated with a 5% discount rate with no discounting in the first year.

**Table 4-8: Region 9 Fund-lead P&T System Performance and Cost Information**

| Site                           | Performance & Effectiveness | Estimated Remaining Time in LTRA (yrs) | Estimated Duration (yrs) | Annual O&M (\$/yr) | Expected Remaining Cost for LTRA O&M | Expected Total Remaining O&M Cost |
|--------------------------------|-----------------------------|--|--------------------------|--------------------|--------------------------------------|-----------------------------------|
| <b>Operational Systems</b>     |                             |  |                          |                    |                                      |                                   |
| Newmark                        | Not Evaluated               | 6.8                                    | 26.8                     | \$900K             | \$5.3M                               | \$13.8M                           |
| <b>Selma Treating Co.</b>      | Sufficient                  | 6.8                                    | 6.8                      | \$300K             | \$1.8M                               | \$1.8M                            |
| <b>Pre-operational Systems</b> |                             |  |                          |                    |                                      |                                   |
| <b>Modesto</b>                 | Not Evaluated               | 10.0                                   | 20.0                     | \$300K             | \$2.3M                               | \$3.8M                            |
| Muscoy                         | Not Evaluated               | 10.0                                   | 20.0                     | \$1,100K           | \$6.0M                               | \$11.5M                           |
|                                |                             |  | <b>Total</b>             | \$2.6M             | \$15.4M                              | \$30.9M                           |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems: systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Descriptions of "Performance and Effectiveness" refer to results from previous evaluations such as 5-year reviews and not from RSEs conducted as part of this project.
4. LTRA refers to Long-term Remedial Action, the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. "Estimated Time Remaining in LTRA" and "Expected Duration" are calculated by determining the number of years between January 1, 2002 and time frame estimates provided by the site Remedial Project Managers. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL.
6. Annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
7. Expected costs are presented in net present value, calculated with a 5% discount rate with no discounting in the first year.

**Table 4-9: Region 10 Fund-lead P&T System Performance and Cost Information**

| Site  | Performance & Effectiveness | Estimated Remaining Time in LTRA (yrs) | Estimated Duration (yrs) | Annual O&M (\$/yr) | Expected Remaining Cost for LTRA O&M | Expected Total Remaining O&M Cost |
|---|-----------------------------|--|--------------------------|--------------------|--------------------------------------|-----------------------------------|
| <b>Operational Systems</b>                              |                             |  |                          |                    |                                      |                                   |
| Boomsnub/Airco  | Sufficient                  | 9.9                                    | 28.8                     | \$1,000K           | \$8.1M                               | \$15.8M                           |
| <b>Commencement Bay/ South Tacoma Channel, Well 12A</b> | Not Sufficient              | 2.0                                    | 9.0                      | \$300K             | \$0.6M                               | \$2.2M                            |
| <b>McCormick &amp; Baxter</b>                           | Sufficient                  | 4.2                                    | Indefinite               | \$250K             | \$1.0M                               | Indefinite                        |
| Wyckoff/Eagle Harbor                                    | Not Sufficient              | 22.0                                   | Indefinite               | \$500K             | \$6.9M                               | Indefinite                        |
| <b>Pre-operational Systems</b>                          |                             |  |                          |                    |                                      |                                   |
| Bunker Hill   | Not Evaluated               | 10.0                                   | 30.0                     | Unknown            | Unknown                              | Unknown                           |
|   |                             |  | <b>Total</b>             | >\$2.1M            | >\$16.6M                             | >\$25.9M                          |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems: systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Descriptions of "Performance and Effectiveness" refer to results from previous evaluations such as 5-year reviews and not from RSEs conducted as part of this project.
4. LTRA refers to Long-term Remedial Action, the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. "Estimated Time Remaining in LTRA" and "Expected Duration" are calculated by determining the number of years between January 1, 2002 and time frame estimates provided by the site Remedial Project Managers. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL.
6. Annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
7. Expected costs are presented in net present value, calculated with a 5% discount rate with no discounting in the first year.
8. The sum of "Total Expected Remaining Cost" includes the LTRA costs for McCormick & Baxter and Wyckoff/Eagle Harbor as it is expected that O&M will continue at this system beyond LTRA.
9. The "Estimated Time Remaining in LTRA" exceeds 10 years for Wyckoff/Eagle Harbor because this remedy is part of a source control action.

**Table 4-10: Future O&M Costs of Fund-lead P&T Systems Expected to be Incurred by each State after LTRA**

| State          | Number of Systems | Total O&M Cost Expected to be Incurred by State after LTRA |                      |
|----------------|-------------------|--|----------------------|
|                |                   | NPV (Discount Rate of 5%)                                  | No Discounting       |
| Arkansas       | 1                 | \$2.6M   | \$5.4M               |
| California     | 4                 | \$15.5M  | \$32.0M              |
| Florida        | 4                 | Unknown  | Unknown              |
| Idaho          | 1                 | Unknown  | Unknown              |
| Illinois       | 1                 | \$0.2M   | \$0.2M               |
| Indiana        | 1                 | \$1.0M   | \$2.4M               |
| Kansas         | 1                 | \$0.6M   | \$1.0M               |
| Louisiana      | 2                 | \$4.5M   | \$7.2M               |
| Maine          | 1                 | \$0.0M   | \$0.0M               |
| Massachusetts  | 4                 | \$56.8M  | \$99.6M              |
| Michigan       | 6                 | > \$21.1M  | > \$48.8M            |
| Minnesota      | 3                 | \$4.4M   | \$8.4M               |
| Missouri       | 1                 | Unknown  | Unknown              |
| Nebraska       | 1                 | \$0.5M   | \$1.0M               |
| New Hampshire  | 3                 | \$0.5M   | \$0.5M               |
| New Jersey     | 12                | \$69.4M  | \$154.7M             |
| New Mexico     | 1                 | Unknown  | Unknown              |
| New York       | 10                | \$24.4M  | \$49.6M              |
| North Carolina | 4                 | >\$0.2M  | >\$0.3M              |
| Oregon         | 1                 | Unknown  | Unknown              |
| Pennsylvania   | 10                | \$24.2M  | \$56.5M              |
| South Carolina | 2                 | \$1.0M   | \$1.8M               |
| Texas          | 5                 | > \$8.2M   | > \$18.4M            |
| Virginia       | 2                 | \$1.9M   | \$3.6M               |
| Washington     | 3                 | > \$9.3M   | > \$21.0M            |
| Wisconsin      | 4                 | > \$5.4M   | > \$10.3M            |
| <b>Total</b>   | <b>88</b>         | <b>&gt; \$251.7M</b>                                       | <b>&gt; \$522.7M</b> |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems are those systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
3. "Total O&M Cost Expected to be Incurred by State" refers to those costs incurred by the State after the Long-term Remedial Action (LTRA). LTRA is the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
4. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL.

**Table 4-11: Region 1 Fund-lead P&T System O&M Costs According to State**

| Site                     | Expected date of Transition | Annual O&M Cost (\$/yr) | Expected Cost to be Incurred by State after LTRA |                |
|--------------------------|-----------------------------|-------------------------|--|----------------|
|                          |                             |                         | NPV (Discount Rate of 5%)                        | No Discounting |
| <b>Maine</b>             |                             |                         |  |                |
| Eastern Surplus          | 9/2011                      | \$200K                  | \$0.0M   | \$0.0M         |
| <b>Massachusetts</b>     |                             |                         |  |                |
| <b>Baird and McGuire</b> | 4/2004                      | \$3,500K                | \$39.9M  | \$66.5M        |
| Charles George Landfill  | 9/2009                      | \$450K                  | \$3.9M   | \$8.6M         |
| Groveland Wells          | 4/2011                      | \$500K                  | \$4.2M   | \$10.0M        |
| <b>Silresim Chemical</b> | 9/2007                      | \$1,400K                | \$8.8M   | \$14.4M        |
| <b>New Hampshire</b>     |                             |                         |  |                |
| Kearsarge Metallurgical  | 9/2003                      | \$250K                  | \$0.5M   | \$0.5M         |
| Keefe                    | 9/2003                      | \$200K                  | \$0.0M   | \$0.0M         |
| <b>Savage Well</b>       | 3/2009                      | \$500K                  | \$0.0M   | \$0.0M         |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems are those systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
4. "Expected Cost to be Incurred by State" refers to those costs incurred by the State after the Long-term Remedial Action (LTRA). LTRA is the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. For systems where site Remedial Project Managers estimated remedy completion earlier than the end of LTRA, expected costs after LTRA appear as \$0.0M.
6. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL. Therefore, total future cost estimates for some sites could be underestimated.

**Table 4-12: Region 2 Fund-lead P&T System O&M Costs According to State**

| Site                           | Expected date of Transition | Annual O&M Cost (\$/yr) | Expected Cost to be Incurred by State after LTRA |                |
|--------------------------------|-----------------------------|-------------------------|--|----------------|
|                                |                             |                         | NPV (Discount Rate of 5%)                        | No Discounting |
| <b>New Jersey</b>              |                             |                         |  |                |
| Bog Creek                      | 9/2004                      | \$460K                  | \$5.3M   | \$9.3M         |
| Combe Fill South               | 9/2008                      | \$920K                  | \$8.7M   | \$18.4M        |
| Dover Municipal Well 4         | Unknown                     | Unknown                 | \$0.0M   | \$0.0M         |
| Garden State Cleaners          | 10/2009                     | \$500K                  | \$4.5M   | \$10.0M        |
| Higgins Farm                   | 1/2009                      | \$1,000K                | \$9.2M   | \$19.7M        |
| Lang Property                  | 10/2005                     | \$700K                  | \$0.0M   | \$0.0M         |
| Lipari Landfill                | 10/2019                     | \$2,500K                | \$0.0M   | \$0.0M         |
| Metal TEC/Aerosystems          | Unknown                     | Unknown                 | \$0.0M   | \$0.0M         |
| Montgomery Township/Rocky Hill | 9/2013                      | \$400K                  | \$3.2M   | \$8.0M         |
| Syncon Resins                  | 4/2001                      | \$350K                  | \$5.4M   | \$9.3M         |
| Vineland Chemical              | 6/2011                      | \$4,000K                | \$33.1M  | \$80.0M        |
| Williams Property              | 6/2001                      | \$350K                  | \$0.0M   | \$0.0M         |
| <b>New York</b>                |                             |                         |  |                |
| American Thermostat            | 10/2008                     | \$1,175K                | \$11.1M  | \$23.4M        |
| <b>Brewster Well Field</b>     | 10/2007                     | \$400K                  | \$0.0M   | \$0.0M         |
| Circuitron                     | 6/2010                      | \$480K                  | \$0.0M   | \$0.0M         |
| <b>Claremont Polychemical</b>  | 2/2010                      | \$740K                  | \$4.0M   | \$7.4M         |
| Islip Municipal Landfill       | 9/2006                      | \$225K                  | \$0.0M   | \$0.0M         |
| <b>Mattiace Petrochemical</b>  | 3/2009                      | \$700K                  | \$6.6M   | \$14.3M        |
| Mohonk Road                    | 7/2011                      | Unknown                 | \$0.0M   | \$0.0M         |
| SMS Instruments                | 6/2005                      | \$400K                  | \$0.0M   | \$0.0M         |
| Stanton Cleaners               | 9/2011                      | \$270K                  | \$1.4M   | \$2.7M         |
| Vestal Water Supply            | 3/2005                      | \$180K                  | \$1.3M   | \$1.8M         |

Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.

Notes:

1. Fund-lead P&T systems are those systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
4. "Expected Cost to be Incurred by State" refers to those costs incurred by the State after the Long-term Remedial Action (LTRA). LTRA is the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. For systems where site Remedial Project Managers estimated remedy completion earlier than the end of LTRA, expected costs after LTRA appear as \$0.0M.
6. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL. Therefore, total future cost estimates for some sites could be underestimated.

**Table 4-13: Region 3 Fund-lead P&T System O&M Costs According to State**

| Site                            | Expected date of Transition | Annual O&M Cost (\$/yr) | Expected Cost to be Incurred by State after LTRA |                |
|---------------------------------|-----------------------------|-------------------------|--|----------------|
|                                 |                             |                         | NPV (Discount Rate of 5%)                        | No Discounting |
| <b>Pennsylvania</b>             |                             |                         |  |                |
| AIW Frank                       | 9/2011                      | \$180K                  | \$1.5M   | \$3.6M         |
| Berks Sand Pit                  | 2/2005                      | \$150K                  | \$0.0M   | \$0.0M         |
| Butz Landfill                   | 4/2011                      | \$250K                  | \$2.1M   | \$5.0M         |
| Croydon TCE                     | 3/2005                      | \$200K                  | \$2.2M   | \$4.0M         |
| CryoChem                        | 6/2008                      | \$125K                  | \$0.2M   | \$0.3M         |
| <b>Hellertown Manufacturing</b> | 9/2006                      | \$350K                  | \$3.6M   | \$7.0M         |
| North Penn Area 1               | 9/2008                      | \$100K                  | \$0.6M   | \$1.0M         |
| <b>Raymark</b>                  | 1/2004                      | \$156K                  | \$1.1M   | \$1.6M         |
| Havertown PCP                   | 4/2012                      | \$1,000K                | \$8.2M   | \$21.0M        |
| North Penn Area 6               | 6/2013                      | \$592K                  | \$4.7M   | \$11.9M        |
| <b>Virginia</b>                 |                             |                         |  |                |
| Greenwood Chemical              | 11/2011                     | \$400K                  | \$1.9M   | \$3.6M         |
| Saunders Supply                 | 5/2009                      | \$80K                   | \$0.0M   | \$0.0M         |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems are those systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
4. "Expected Cost to be Incurred by State" refers to those costs incurred by the State after the Long-term Remedial Action (LTRA). LTRA is the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. For systems where site Remedial Project Managers estimated remedy completion earlier than the end of LTRA, expected costs after LTRA appear as \$0.0M.
6. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL. Therefore, total future cost estimates for some sites could be underestimated.

**Table 4-14: Region 4 Fund-lead P&T System O&M Costs According to State**

| Site                             | Expected date of Transition | Annual O&M Cost (\$/yr) | Expected Cost to be Incurred by State after LTRA |                |
|----------------------------------|-----------------------------|-------------------------|--|----------------|
|                                  |                             |                         | NPV (Discount Rate of 5%)                        | No Discounting |
| <b>Florida</b>                   |                             |                         |  |                |
| American Creosote Works (DNAPL)  | 5/2003                      | \$300K                  | \$0.0M   | \$0.0M         |
| American Creosote Works (solute) | 9/2014                      | \$452K                  | \$0.0M   | \$0.0M         |
| Coleman Evans Wood Preserving    | Unknown                     | Unknown                 | Unknown  | Unknown        |
| Miami Drum                       | 9/2002                      | \$1,000K                | Unknown  | Unknown        |
| <b>North Carolina</b>            |                             |                         |  |                |
| ABC Cleaners                     | Unknown                     | Unknown                 | Unknown  | Unknown        |
| Benfield Industries              | 5/2011                      | \$30K                   | \$0.2M   | \$0.3M         |
| Cape Fear Wood Preserving        | 10/2011                     | \$40K                   | \$0.0M   | \$0.0M         |
| <b>FCX Statesville</b>           | 5/2008                      | \$150K                  | \$0.0M   | \$0.0M         |
| <b>South Carolina</b>            |                             |                         |  |                |
| <b>Elmore Waste Disposal</b>     | 9/2008                      | \$180K                  | \$1.0M   | \$1.8M         |
| Palmetto Wood                    | 5/2008                      | \$300K                  | \$0.0M   | \$0.0M         |

Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.

Notes:

1. Fund-lead P&T systems are those systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
4. "Expected Cost to be Incurred by State" refers to those costs incurred by the State after the Long-term Remedial Action (LTRA). LTRA is the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. For systems where site Remedial Project Managers estimated remedy completion earlier than the end of LTRA, expected costs after LTRA appear as \$0.0M.
6. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL. Therefore, total future cost estimates for some sites could be underestimated.



**Table 4-15: Region 5 Fund-lead P&T System O&M Costs According to State**

| Site                         | Expected date of Transition | Annual O&M Cost (\$/yr) | Expected Cost to be Incurred by State after LTRA |                |
|------------------------------|-----------------------------|-------------------------|--|----------------|
|                              |                             |                         | NPV (Discount Rate of 5%)                        | No Discounting |
| <b>Illinois</b>              |                             |                         |  |                |
| La Salle                     | 3/2004                      | \$230K                  | \$0.2M   | \$0.2M         |
| <b>Indiana</b>               |                             |                         |  |                |
| Douglass Road                | 9/2010                      | \$120K                  | \$1.0M   | \$2.4M         |
| <b>Michigan</b>              |                             |                         |  |                |
| Duell and Gardner            | 7/2011                      | Unknown                 | Unknown  | \$0.0M         |
| Ott/Story                    | 8/2010                      | \$2,400K                | \$20.7M  | \$48.0M        |
| Peerless Plating             | Unknown                     | \$400K                  | Unknown  | \$0.0M         |
| U.S. Aviex                   | 9/2003                      | \$300K                  | \$0.0M   | \$0.0M         |
| Verona                       | 6/2006                      | \$225K                  | Unknown  | Unknown        |
| Wash King                    | 4/2011                      | \$75K                   | \$0.4M   | \$0.8M         |
| <b>Minnesota</b>             |                             |                         |  |                |
| Arrowhead Refinery           | 7/2003                      | \$70K                   | \$0.1M   | \$0.1M         |
| Long Prairie                 | 10/2007                     | \$300K                  | \$1.6M   | \$2.4M         |
| <b>MacGillis &amp; Gibbs</b> | 10/2009                     | \$300K                  | \$2.7M   | \$6.0M         |
| <b>Wisconsin</b>             |                             |                         |  |                |
| Better Brite                 | 6/2006                      | \$36K                   | \$0.5M   | \$0.9M         |
| Eau Claire                   | Unknown                     | \$175K                  | Unknown  | Unknown        |
| <b>Oconomowoc</b>            | 9/2006                      | \$471K                  | \$4.9M   | \$9.4M         |
| Onalaska                     | 6/2004                      | \$200K                  | \$0.0M   | \$0.0M         |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems are those systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
4. "Expected Cost to be Incurred by State" refers to those costs incurred by the State after the Long-term Remedial Action (LTRA). LTRA is the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. For systems where site Remedial Project Managers estimated remedy completion earlier than the end of LTRA, expected costs after LTRA appear as \$0.0M.
6. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL. Therefore, total future cost estimates for some sites could be underestimated.

**Table 4-16: Region 6 Fund-lead P&T System O&M Costs According to State**

| Site                     | Expected date of Transition | Annual O&M Cost (\$/yr) | Expected Cost to be Incurred by State after LTRA |                |
|--------------------------|-----------------------------|-------------------------|--|----------------|
|                          |                             |                         | NPV (Discount Rate of 5%)                        | No Discounting |
| <b>Arkansas</b>          |                             |                         |  |                |
| <b>Midland Products</b>  | 1/2004                      | \$180K                  | \$2.6M   | \$5.4M         |
| <b>Louisiana</b>         |                             |                         |  |                |
| American Creosote Works  | 2/2027                      | \$360K                  | \$0.0M   | \$0.0M         |
| <b>Bayou Bonfouca</b>    | 7/2003                      | \$402K                  | \$4.5M   | \$7.2M         |
| <b>New Mexico</b>        |                             |                         |  |                |
| Cimarron Mining          | 10/2004                     | \$1,000K                | Unknown  | Unknown        |
| <b>Texas</b>             |                             |                         |  |                |
| City of Perryton Well #2 | 8/2013                      | \$37K                   | \$0.2M   | \$0.4M         |
| Geneva Industries        | 1/2004                      | \$240K                  | \$0.0M   | \$0.0M         |
| North Cavalcade          | 12/2005                     | Unknown                 | Unknown  | Unknown        |
| Odessa Chromium #1       | 12/2001                     | \$500K                  | \$0.0M   | \$0.0M         |
| Sprague Road             | 9/2013                      | \$1,200K                | \$8.0M   | \$18.0M        |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems are those systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
4. "Expected Cost to be Incurred by State" refers to those costs incurred by the State after the Long-term Remedial Action (LTRA). LTRA is the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. For systems where site Remedial Project Managers estimated remedy completion earlier than the end of LTRA, expected costs after LTRA appear as \$0.0M.
6. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL. Therefore, total future cost estimates for some sites could be underestimated.

**Table 4-17: Region 7 Fund-lead P&T System O&M Costs According to State**

| Site                                | Expected date of Transition | Annual O&M Cost (\$/yr) | Expected Cost to be Incurred by State after LTRA |                |
|-------------------------------------|-----------------------------|-------------------------|--|----------------|
|                                     |                             |                         | NPV (Discount Rate of 5%)                        | No Discounting |
| <b>Kansas</b>                       |                             |                         |  |                |
| Ace Services                        | 9/2013                      | \$500K                  | \$0.6M   | \$1.0M         |
| <b>Missouri</b>                     |                             |                         |  |                |
| Valley Park TCE/OU2                 | 1/2006                      | Unknown                 | Unknown  | Unknown        |
| <b>Nebraska</b>                     |                             |                         |  |                |
| <b>Cleburn Street Well Site/OU2</b> | 12/2009                     | \$100K                  | \$0.5M   | \$1.0M         |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems are those systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
4. "Expected Cost to be Incurred by State" refers to those costs incurred by the State after the Long-term Remedial Action (LTRA). LTRA is the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. For systems where site Remedial Project Managers estimated remedy completion earlier than the end of LTRA, expected costs after LTRA appear as \$0.0M.
6. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL. Therefore, total future cost estimates for some sites could be underestimated.

**Table 4-18: Region 9 Fund-lead P&T System O&M Costs According to State**

| Site                      | Expected date of Transition | Annual O&M Cost (\$/yr) | Expected Cost to be Incurred by State after LTRA |                |
|---------------------------|-----------------------------|-------------------------|--|----------------|
|                           |                             |                         | NPV (Discount Rate of 5%)                        | No Discounting |
| <b>California</b>         |                             |                         |  |                |
| <b>Modesto</b>            | 5/2012                      | \$300K                  | \$1.5M   | \$3.0M         |
| Muscoy                    | 10/2014                     | \$1,100K                | \$5.5M   | \$11.0M        |
| Newmark                   | 10/2008                     | \$900K                  | \$8.5M   | \$18.0M        |
| <b>Selma Treating Co.</b> | 10/2008                     | \$300K                  | \$0.0M   | \$0.0M         |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems are those systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
4. "Expected Cost to be Incurred by State" refers to those costs incurred by the State after the Long-term Remedial Action (LTRA). LTRA is the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. For systems where site Remedial Project Managers estimated remedy completion earlier than the end of LTRA, expected costs after LTRA appear as \$0.0M.
6. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL. Therefore, total future cost estimates for some sites could be underestimated.

**Table 4-19: Region 10 Fund-lead P&T System O&M Costs According to State**

| Site   | Expected date of Transition | Annual O&M Cost (\$/yr) | Expected Cost to be Incurred by State after LTRA |                |
|--|-----------------------------|-------------------------|--|----------------|
|  |                             |                         | NPV (Discount Rate of 5%)                        | No Discounting |
| <b>Idaho</b>   |                             |                         |  |                |
| Bunker Hill  | 12/2030                     | Unknown                 | Unknown  | Unknown        |
| <b>Oregon</b>  |                             |                         |  |                |
| <b>McCormick &amp; Baxter</b>                          | 3/2006                      | \$250K                  | Unknown  | Unknown        |
| <b>Washington</b>                                      |                             |                         |  |                |
| Boomsnub/Airco   | 12/2011                     | \$1,000K                | \$7.7M   | \$18.9M        |
| <b>Commencement Bay/South Tacoma Channel, Well 12A</b> | 1/2004                      | \$300K                  | \$1.6M   | \$2.1M         |
| Wyckoff/Eagle Harbor                                   | 1/2024                      | \$500K                  | Unknown  | Unknown        |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems are those systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Systems that appear in bold were selected for Remediation System Evaluations (RSEs).
3. Annual O&M costs are estimates and include such components as labor, utilities, materials, analytical costs, etc.
4. "Expected Cost to be Incurred by State" refers to those costs incurred by the State after the Long-term Remedial Action (LTRA). LTRA is the first 10 years of operation and function of a Superfund restoration action for surface or groundwater. Operation and maintenance costs of the remedy are 90% funded by Superfund and 10% funded by the associated State during this time period. Thereafter, 100% of the costs are assumed by the States.
5. For systems where site Remedial Project Managers estimated remedy completion earlier than the end of LTRA, expected costs after LTRA appear as \$0.0M.
6. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL. Therefore, total future cost estimates for some sites could be underestimated.

**Table 4-20: Categories of Contaminants Prevalent at Sites with Fund-lead P&T Systems**

| Contaminant Category   | Number of Systems that Address that Contaminant Category |
|--|--|
| Chlorinated solvents and degradation products: <ul style="list-style-type: none"> <li>• tetrachloroethylene (PCE)</li> <li>• trichloroethylene (TCE)</li> <li>• dichloroethylene (DCE)</li> <li>• trichloroethane (TCA)</li> <li>• dichloroethane (DCA)</li> <li>• methylene chloride</li> <li>• vinyl chloride</li> </ul> | 56 of 88 systems   |
| BTEX (one or more of the following): <ul style="list-style-type: none"> <li>• benzene</li> <li>• toluene</li> <li>• ethylbenzene</li> <li>• xylene</li> </ul>  | 19 of 88 systems   |
| Metals <ul style="list-style-type: none"> <li>• Arsenic</li> <li>• Cadmium</li> <li>• Chromium</li> <li>• other metals</li> </ul>  | 22 of 88 systems   |
| Polyaromatic hydrocarbons (PAHs): <ul style="list-style-type: none"> <li>• anthracene</li> <li>• benzo(a)pyrene</li> <li>• benzo(k)fluoranthene</li> <li>• fluoranthene</li> <li>• naphthalene</li> <li>• other PAHs</li> </ul>  | 17 of 88 systems   |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actuality. Data, including the number and status of systems and contaminants of concern, may change over time.*

Notes:

1. Fund-lead P&T systems are those systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Individual systems may address more than one contaminant.
3. Presented data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates, including the number and status of systems and contaminants of concern, may change over time.

---

## 5.0 SYSTEM SCREENING AND PRIORITIZATION WITH RESPECT TO OPTIMIZATION POTENTIAL

---

A simple spreadsheet screening process was developed and implemented by the project team for assessing the optimization potential of each Fund-lead P&T system. The screening process consists of the following steps:

- calculate the “Baseline Present Value (\$)” of the system by multiplying the annual cost by the estimated system duration, and including a discount rate (5%) to account for the future value of money;
- assume that a typical RSE will save 20% of the annual cost of the system;
- determine site-specific “Estimated Potential Reduction in Life-cycle Costs (%)” from an RSE by adjusting the assumed 20% savings according to site-specific factors that increase or decrease the likelihood that savings will be identified by the RSE process; and
- determine “Estimated Potential Life-cycle Savings (\$)” from an RSE by multiplying the “Baseline Present Value (\$)” by the “Estimated Potential Reduction in Life Cycle Costs (%)”, and subtracting the approximate cost of a RSE evaluation (\$25,000).

The factors that were used to calculate the site-specific “Estimated Potential Reduction in Life-cycle Costs (%)” (starting from the assumed 20% value) are listed in [Table 5-1](#). The base savings value of 20%, and the subsequent adjustment factors, were determined by consensus of the project team based on the assumption that, on average, all systems can benefit from optimization and more complex systems would have greater opportunity for improvement. For each item, a “blank” response was allowed, and did not impact the calculations. A positive adjustment was made to “Estimated Potential Reduction in Life-cycle Costs (%)” for items that would increase the optimization potential (e.g., many wells, high pumping rate, many above-ground treatment processes), and a negative adjustment was made to “Estimated Potential Reduction in Life-cycle Costs (%)” for items that would decrease the optimization potential (e.g., few pumping wells, short system duration). The “Estimated Potential Reduction in Life-cycle Costs (%)” was not allowed to be less than 5%, and not allowed to be greater than 45%. The purpose of this step was to identify systems with the highest potential for cost reduction and those most likely to benefit from optimization. All potential cost savings are estimates and are intended to be used primarily for prioritizing systems.

Summaries of the screening calculations are included in the screening summary reports for each Region, which are provided as Appendix B. The actual screening calculations for each system are presented in Appendix C. Note that these calculation are all based on estimates provided by the RPMs, and in some cases the “Estimated Potential Savings (\$)” is negative, indicating that the estimated potential savings from an RSE are not anticipated to offset the cost of the RSE itself.

**Table 5-1: Site-Specific Criteria Used to Calculate the “Estimated Potential Life-cycle Savings (%)” from Optimization of each of the Identified Fund-lead P&T Systems (Page 1 of 2)**

Result of performance and effectiveness evaluation (item 29, Section 3.0)

|       |  |
|-------|--|
| +0.0% | default for blank value  |
| +2.5% | performance & effectiveness not evaluated                      |
| +5.0% | performance & effectiveness evaluated and found not sufficient |
| -2.5% | performance & effectiveness evaluated and found sufficient     |

Number of pumping wells (item 18, Section 3.0)

|       |                               |
|-------|-------------------------------|
| +0.0% | default for blank value       |
| +0.0% | no wells (e.g., drains, etc.) |
| -5.0% | 1 to 2 wells                  |
| -2.5% | 3 to 4 wells                  |
| +0.0% | 5 to 9 wells                  |
| +2.5% | 10 or more wells              |

Pumping rate (item 17, Section 3.0)

|       |                         |
|-------|-------------------------|
| +0.0% | default for blank value |
| -5.0% | <10 gpm                 |
| -2.5% | 10 to 99.99 gpm         |
| +0.0% | 100 to 500 gpm          |
| +2.5% | >500 gpm                |

Down time per year (item 23, Section 3.0)

|       |                         |
|-------|-------------------------|
| +0.0% | default for blank value |
| +0.0% | <2 wks                  |
| +2.5% | 2.00 - 3.99 wks         |
| +5.0% | 4 wks or more           |

Number of above-ground treatment processes (item 24, Section 3.0)

|       |                         |
|-------|-------------------------|
| +0.0% | default for blank value |
| -2.5% | 0 or 1 processes        |
| +0.0% | 2 processes             |
| +2.5% | 3 processes             |
| +5.0% | 4 processes             |

Groundwater monitoring (number wells x events per year)  
(items 25-26, Section 3.0)

|       |                         |
|-------|-------------------------|
| +0.0% | default for blank value |
| -2.5% | <25                     |
| +0.0% | 25 to 49                |
| +2.5% | 50 to 74                |
| +5.0% | >75                     |

Expected duration (item 22, Section 3.0)

|        |                         |
|--------|-------------------------|
| +0.0%  | default for blank value |
| -20.0% | <2 yrs                  |
| -15.0% | 2.00 - 4.99yrs          |
| -5.0%  | 5.00 - 9.99 yrs         |
| -2.5%  | 10.00 - 19.99 yrs       |
| +0.0%  | 20 yrs or more          |



**Table 5-1: Site-Specific Criteria Used to Calculate the “Estimated Potential Life-cycle Savings (%)” from Optimization of each of the Identified Fund-lead P&T Systems (Page 1 of 2)**

Difficulty in making minor changes to system due to political/social factors (item 30, Section 3.0)

|        |                              |
|--------|------------------------------|
| -5.0%  | default for blank value      |
| -10.0% | severe difficulty expected   |
| -5.0%  | moderate difficulty expected |
| +0.0%  | little difficulty expected   |

---

## 6.0 SYSTEM SELECTION

---

The intent of the project was to select two operational Fund-lead P&T systems in each Region to receive RSEs. However, the site-identification process demonstrated that Region 7 had only one operational Fund-lead P&T system and Region 8 had none. As a result, these extra three RSEs were allocated to other Regions.

The selection of systems was based on satisfying most of the following factors:

- system is operating (required)
- Region agreed system is suitable for optimization (required)
- system effectiveness is questioned or found not sufficient
- system has high potential for life-cycle cost-savings (\$), based on the screening calculations, relative to other systems
- no major problems identified for potentially implementing RSE recommendations
- RPM request for involvement

For a variety of reasons, including recent optimization or litigation, some of the systems with the highest potential for life-cycle savings in a Region were not selected for RSEs. Narratives describing the system selection for each Region are included in the Regional summary screening reports included in Appendix B. [Table 6-1](#) lists for each Region the systems selected to receive RSEs and the “Estimated Potential Savings (\$)” from system optimization.


[Table 6-2](#) ranks each Fund-lead P&T system according to “Estimated Potential Life-cycle Savings (\$)” as calculated by the screening methodology. In addition, the systems that were selected for RSEs appear in **bold**. A graphical representation of this table is presented in [Figure 6-1](#). Three of the top four ranked systems were selected for RSEs. Out of 20 total RSEs, 14 of them were allocated to a system that is ranked in the top 44 systems (top 50%). Summing the “Estimated Potential Life-cycle Savings (\$)” of the systems selected for RSEs, the screening methodology suggests a total potential savings of approximately \$48 million. The methodology also suggests approximately \$134 million could be saved if RSEs are conducted at all 68 of the systems that indicate a positive “Estimated Potential Life-cycle Savings (\$)”.

Because the screening methodology is sensitive to the estimated duration of the P&T systems and this estimated duration could vary significantly from actuality, it is of significant interest to rank the systems according to estimated annual O&M costs. This ranking is provided in [Table 6-3](#) and shown graphically in [Figure 6-2](#). [Figure 6-2](#) also shows the cumulative contribution of the systems to the total annual cost. It appears that 13 of the systems account for over 50% of the annual O&M costs of all systems combined. Regarding these thirteen systems, the following issues should be noted:

- three are selected to receive RSEs;
- one has previously received an RSE (by USACE);

- one has recently received an outside optimization evaluation;
- three are pre-operational and were therefore not selected to receive RSEs; and
- the remaining five were deemed inappropriate by the Regions for outside evaluations.

**Figure 6-1: Fund-lead P&T Systems Ranked by "Estimated Potential Life-cycle Savings (\$)"**

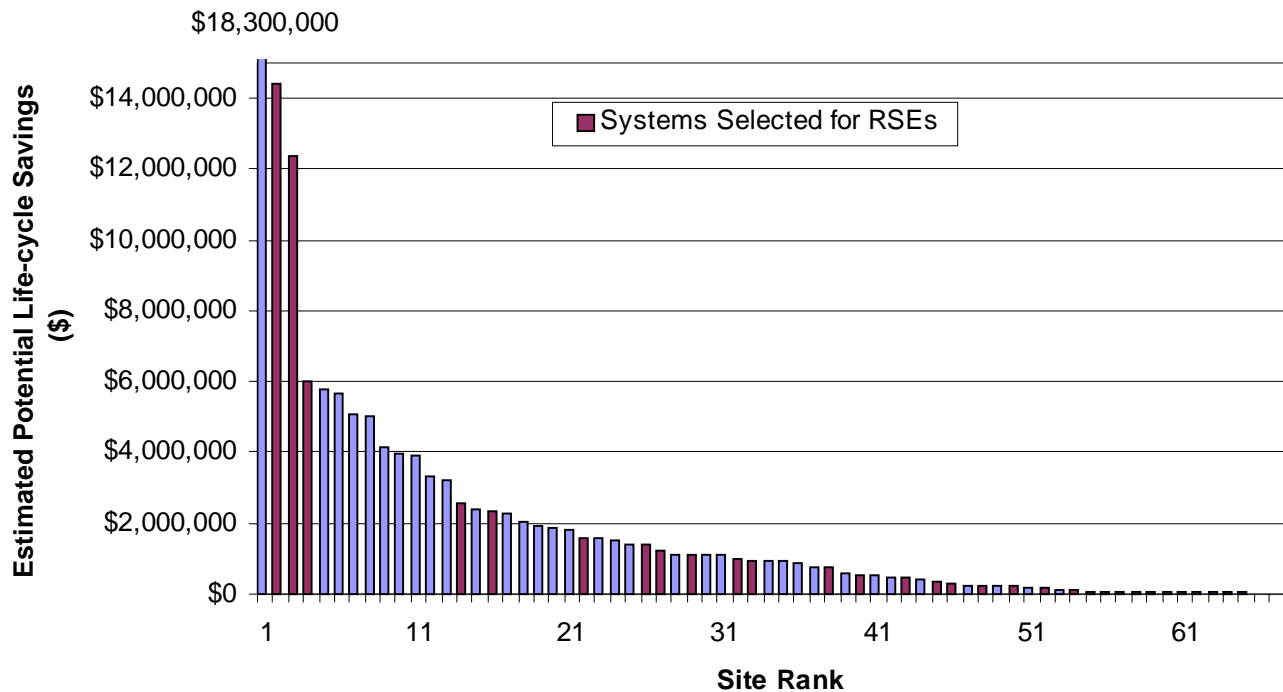


Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.

Notes:

1. Fund-lead P&T systems refers to systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. "Estimated Potential Life-cycle Savings (\$)" is calculated based on the screening methodology summarized in Section 5.0 and Table 5-1. The screening calculations for each system are presented in Appendix C and summarized in Appendix B.
3. Values are shown for the 68 systems with positive "Estimated Potential Life-cycle Savings (\$)". This parameter was less than zero for 12 systems and could not be calculated for 8 systems because of incomplete cost data.
4. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL. Therefore, life-cycle costs and life-cycle cost savings could be underestimated for some sites.
5. Cost information was reported for 79 of the 88 Fund-lead P&T systems. Costs for the remaining 9 systems are shown as \$0 in this figure.

**Figure 6-2: Fund-lead P&T Systems Ranked by Annual O&M Cost and the Cumulative Distribution of System Annual O&M Costs**

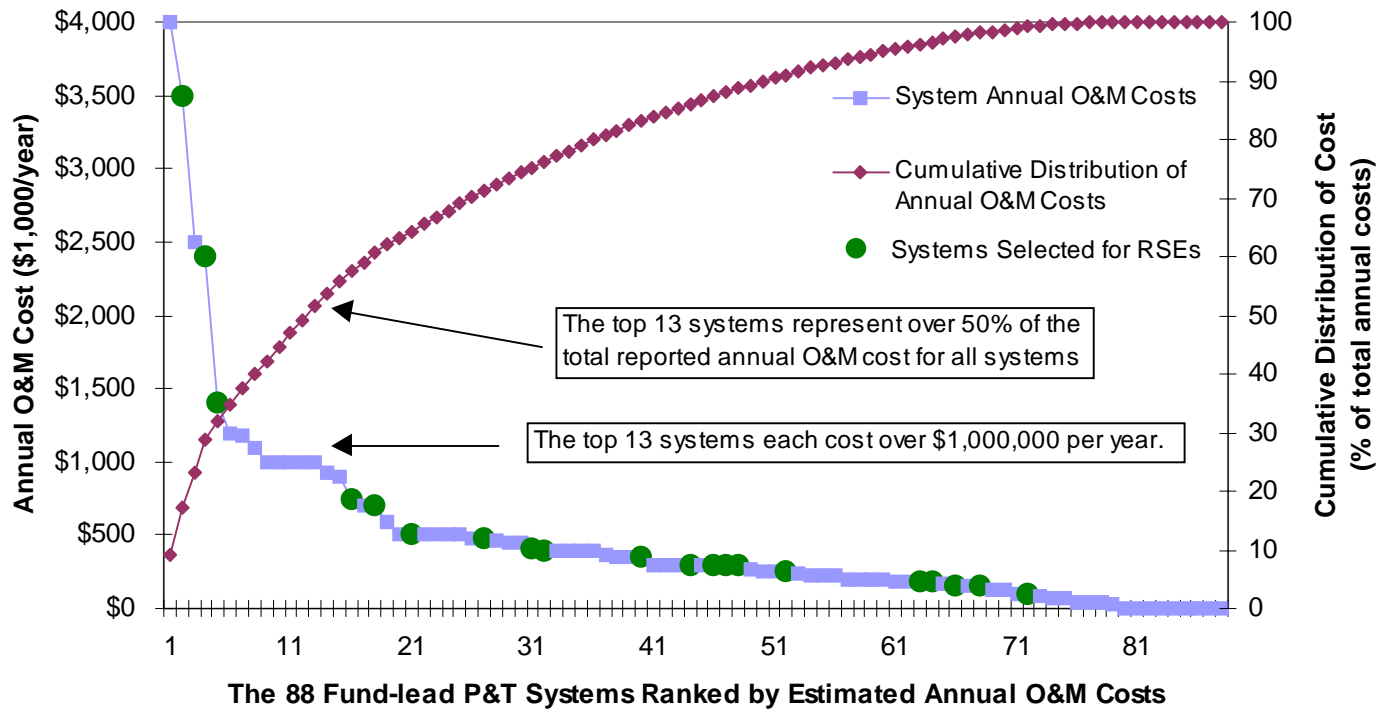

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

**Notes:**

1. Fund-lead P&T systems refers to systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Annual operation and maintenance (O&M) costs are estimates and include such items as labor, utilities, materials, analytical work, etc.
3. Cost information was reported for 79 of the 88 Fund-lead P&T systems. Costs for the remaining 9 systems are shown as \$0 in this figure.

**Table 6-1: For each Region Systems Selected for RSEs and the “Estimated Potential Life-cycle Savings (\$)” Suggested by Screening Analysis**

| <b>Region</b> | <b>Number of Systems Selected</b>                     | <b>Estimated Potential Life-cycle Savings (\$)***</b> |
|---------------|---|---|
| Region 1      | Baird and McGuire                                     | \$12,402,549  |
|               | Savage Municipal Water Supply Well                    | \$934,042   |
|               | Silresim Chemical Corp.                               | \$6,025,600   |
| Region 2      | Claremont Polychemical                                | \$2,578,700   |
|               | Mattiace Petrochemical                                | \$2,357,411   |
|               | Brewster Well Field                                   | \$317,513   |
| Region 3      | Hellertown Manufacturing                              | \$979,619   |
|               | Raymark   | \$216,640   |
| Region 4      | Elmore Waste Disposal (RSE demonstration project)     | \$375,872   |
|               | FCX Statesville (RSE demonstration project)           | \$134,513   |
| Region 5      | MacGillis and Gibbs (RSE demonstration project)       | \$1,399,624   |
|               | Oconomowoc Electroplating (RSE demonstration project) | \$1,590,721   |
|               | Ott/Story   | \$14,418,502  |
| Region 6      | Bayou Bonfouca  | \$1,233,790   |
|               | Midland Products                                      | \$528,408   |
| Region 7      | Cleburn St. Well                                      | \$179,042   |
| Region 8      | —   | —   |
| Region 9      | Modesto   | \$730,227   |
|               | Selma Pressure Treating                               | \$261,332   |
| Region 10     | Commencement Bay/South Tacoma Channel, Well 12A       | \$465,677   |
|               | McCormick and Baxter                                  | \$1,127,934   |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems refers to systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. “Estimated Potential Life-cycle Savings (\$)” is calculated based on the screening methodology summarized in Section 5.0 and Table 5-1. The screening calculations for each system are presented in Appendix C and summarized in Appendix B.
3. Modesto is classified as a pre-operational system; however, it will have changed status and have operated for two months prior to the RSE visit.

**Table 6-2: Fund-lead P&T Systems Ranked in Terms of “Estimated Potential Life-cycle Savings (\$)” as Calculated by the Screening Methodology (Page 1 of 4)**

| <b>Rank</b> | <b>Site name</b>                                    | <b>Region</b> | <b>Estimated Potential Reduction in Life-cycle Costs</b> | <b>Estimated Potential Life-cycle Savings (\$)</b> |
|-------------|---|---------------|--|--|
| 1           | Vineland Chemical Co.                               | 2             | 30.0%  | \$18,266,000                                       |
| 2           | Ott/Story/Cordova Chem Co.                          | 5             | 40.0%  | \$14,419,000                                       |
| 3           | Baird & McGuire Superfund Site                      | 1             | 27.5%  | \$12,403,000                                       |
| 4           | Silresim Chemical Corp.                             | 1             | 40.0%  | \$6,026,000  |
| 5           | Higgins Farm  | 2             | 40.0%  | \$5,799,000  |
| 6           | Sprague Road Ground Water Plume                     | 6             | 32.5%  | \$5,653,000  |
| 7           | Combe Fill South Landfill                           | 2             | 38.0%  | \$5,065,000  |
| 8           | American Thermostat                                 | 2             | 29.5%  | \$5,022,000  |
| 9           | Boomsnub/Airco / Site-Wide Ground Water OU          | 10            | 27.5%  | \$4,124,000  |
| 10          | Muscoy  | 9             | 27.0%  | \$3,959,000  |
| 11          | Havertown PCP OU2                                   | 3             | 25.5%  | \$3,895,000  |
| 12          | Newmark   | 9             | 25.5%  | \$3,322,000  |
| 13          | North Penn Area 6                                   | 3             | 35.5%  | \$3,211,000  |
| 14          | Claremont Polychemical                              | 2             | 30.0%  | \$2,579,000  |
| 15          | Garden State Cleaners/South Jersey Clothing Company | 2             | 32.5%  | \$2,383,000  |
| 16          | Mattiace Petrochemical                              | 2             | 23.0%  | \$2,357,000  |
| 17          | Cimarron Mining                                     | 6             | 15.0%  | \$2,281,000  |
| 18          | Groveland Wells Superfund Site                      | 1             | 27.5%  | \$2,066,000  |
| 19          | Wyckoff/Eagle Harbor Superfund Site                 | 10            | 25.5%  | \$1,935,000  |
| 20          | Montgomery Township/Rocky Hill                      | 2             | 30.5%  | \$1,850,000  |
| 21          | Bog Creek Farm LTRA                                 | 2             | 30.0%  | \$1,833,000  |
| 22          | Oconomowoc Electroplating                           | 5             | 24.5%  | \$1,591,000  |
| 23          | Ace Services  | 7             | 32.5%  | \$1,557,000  |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems refers to systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. “Estimated Potential Life-cycle Savings (\$)” is calculated based on the screening methodology summarized in Section 5.0 and Table 5-1. The screening calculations for each system are presented in Appendix C and summarized in Appendix B.
3. For a variety of reasons, including recent optimization or litigation, some of the systems with the highest potential for life-cycle savings in a Region were not selected for RSEs. Narratives describing the system selection for each Region are included the Regional summary screening reports included in Appendix B.
4. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL. Therefore, life-cycle costs and life-cycle cost savings could be underestimated for some sites.

**Table 6-2: Fund-lead P&T Systems Ranked in Terms of “Estimated Potential Life-cycle Savings (\$)” as Calculated by the Screening Methodology (Page 2 of 4)**

| Rank      | Site name  | Region    | Estimated Potential Reduction in Life-cycle Costs | Estimated Potential Life-cycle Savings (\$) |
|-----------|--|-----------|---|---|
| 24        | Greenwood Chemical Site                              | 3         | 32.5%   | \$1,538,000                                 |
| 25        | Syncon Resins  | 2         | 28.0%   | \$1,402,000                                 |
| <b>26</b> | <b>MacGillis and Gibbs/Bell Lumber &amp; Pole</b>    | <b>5</b>  | <b>32.0%</b>                                      | <b>\$1,400,000</b>                          |
| <b>27</b> | <b>Bayou Bonfouca</b>                                | <b>6</b>  | <b>25.5%</b>                                      | <b>\$1,234,000</b>                          |
| 28        | Lipari Landfill site                                 | 2         | 17.5%   | \$1,136,000                                 |
| <b>29</b> | <b>McCormick &amp; Baxter Creosoting Co.</b>         | <b>10</b> | <b>30.0%</b>                                      | <b>\$1,128,000</b>                          |
| 30        | Charles George Landfill Superfund Site               | 1         | 17.5%   | \$1,122,000                                 |
| 31        | American Creosote Works                              | 6         | 22.0%   | \$1,094,000                                 |
| <b>32</b> | <b>Hellertown Manufacturing</b>                      | <b>3</b>  | <b>20.5%</b>                                      | <b>\$980,000</b>                            |
| <b>33</b> | <b>Savage Well Municipal Water System</b>            | <b>1</b>  | <b>32.5%</b>                                      | <b>\$934,000</b>                            |
| 34        | Butz Landfill  | 3         | 25.0%   | \$925,000                                   |
| 35        | Stanton Cleaners Area Groundwater Contamination Site | 2         | 28.0%   | \$908,000                                   |
| 36        | Verona Well Field                                    | 5         | 25.5%   | \$857,000                                   |
| 37        | AIW Frank/Mid-County Mustang Site, OU#1              | 3         | 28.0%   | \$746,000                                   |
| <b>38</b> | <b>Modesto Superfund Site</b>                        | <b>9</b>  | <b>20.0%</b>                                      | <b>\$730,000</b>                            |
| 39        | Douglass Road  | 5         | 32.5%   | \$563,000                                   |
| <b>40</b> | <b>Midland Products</b>                              | <b>6</b>  | <b>20.0%</b>                                      | <b>\$528,000</b>                            |
| 41        | Croydon TCE  | 3         | 20.0%   | \$517,000                                   |
| 42        | American Creosote Works (solute)                     | 4         | 17.5%   | \$469,000                                   |
| <b>43</b> | <b>Commencement Bay, South Tacoma Channel, Well</b>  | <b>10</b> | <b>23.0%</b>                                      | <b>\$466,000</b>                            |
| 44        | Long Prairie   | 5         | 15.5%   | \$430,000                                   |
| <b>45</b> | <b>Elmore Waste Disposal</b>                         | <b>4</b>  | <b>20.0%</b>                                      | <b>\$376,000</b>                            |
| <b>46</b> | <b>Brewster Wellfield</b>                            | <b>2</b>  | <b>17.5%</b>                                      | <b>\$318,000</b>                            |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems refers to systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. “Estimated Potential Life-cycle Savings (\$)” is calculated based on the screening methodology summarized in Section 5.0 and Table 5-1. The screening calculations for each system are presented in Appendix C and summarized in Appendix B.
3. For a variety of reasons, including recent optimization or litigation, some of the systems with the highest potential for life-cycle savings in a Region were not selected for RSEs. Narratives describing the system selection for each Region are included the Regional summary screening reports included in Appendix B.
4. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL. Therefore, life-cycle costs and life-cycle cost savings could be underestimated for some sites.



**Table 6-2: Fund-lead P&T Systems Ranked in Terms of “Estimated Potential Life-cycle Savings (\$)” as Calculated by the Screening Methodology (Page 3 of 4)**

| <b>Rank</b> | <b>Site name</b>                               | <b>Region</b> | <b>Estimated Potential Reduction in Life-cycle Costs</b> | <b>Estimated Potential Life-cycle Savings (\$)</b> |
|-------------|--|---------------|--|--|
| 47          | Palmetto Wood                                  | 4             | 18.0%  | \$262,000  |
| <b>48</b>   | <b>Selma Treating Co.</b>                      | <b>9</b>      | <b>17.0%</b>   | <b>\$261,000</b>                                   |
| 49          | Eastern Surplus Company Superfund Site         | 1             | 28.0%  | \$246,000  |
| <b>50</b>   | <b>Raymark</b>                                 | <b>3</b>      | <b>17.5%</b>   | <b>\$217,000</b>                                   |
| 51          | Wash King Laundry                              | 5             | 23.0%  | \$185,000  |
| <b>52</b>   | <b>Cleburn Street Well Site/OU2</b>            | <b>7</b>      | <b>17.5%</b>   | <b>\$179,000</b>                                   |
| 53          | Vestal Water Supply Well 1-1                   | 2             | 10.0%  | \$146,000  |
| <b>54</b>   | <b>FCX Statesville</b>                         | <b>4</b>      | <b>20.0%</b>   | <b>\$135,000</b>                                   |
| 55          | North Penn Area 1                              | 3             | 10.0%  | \$86,000   |
| 56          | Lang Property                                  | 2             | 5.0%   | \$63,000   |
| 57          | City of Perryton Well #2                       | 6             | 17.5%  | \$59,000   |
| 58          | La Salle Electrical Utilities                  | 5             | 12.5%  | \$57,000   |
| 59          | Kearsarge Metallurgical Corp.                  | 1             | 10.0%  | \$57,000   |
| 60          | Saunders Supply Company                        | 3             | 17.0%  | \$47,000   |
| 61          | CryoChem                                       | 3             | 8.0%   | \$42,000   |
| 62          | Better Brite Plating Co. Chrome and Zinc Shops | 5             | 12.0%  | \$40,000   |
| 63          | SMS Instruments                                | 2             | 7.5%   | \$35,000   |
| 64          | Cape Fear Wood Preserving                      | 4             | 22.5%  | \$33,000   |
| 65          | Benfield Industries                            | 4             | 15.0%  | \$30,000   |
| 66          | Circuitron                                     | 2             | 8.0%   | \$26,000   |
| 67          | Geneva Industries                              | 6             | 8.0%   | \$11,000   |
| 68          | American Creosote Works (DNAPL)                | 4             | 7.5%   | \$3,000  |
| 69          | Keefe Environmental Systems                    | 1             | 7.5%   | -\$2,000   |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems refers to systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. “Estimated Potential Life-cycle Savings (\$)” is calculated based on the screening methodology summarized in Section 5.0 and Table 5-1. The screening calculations for each system are presented in Appendix C and summarized in Appendix B.
3. For a variety of reasons, including recent optimization or litigation, some of the systems with the highest potential for life-cycle savings in a Region were not selected for RSEs. Narratives describing the system selection for each Region are included the Regional summary screening reports included in Appendix B.
4. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL. Therefore, life-cycle costs and life-cycle cost savings could be underestimated for some sites.

**Table 6-2: Fund-lead P&T Systems Ranked in Terms of “Estimated Potential Life-cycle Savings (\$)” as Calculated by the Screening Methodology (Page 4 of 4)**

| Rank | Site name                         | Region | Estimated Potential Reduction in Life-cycle Costs | Estimated Potential Life-cycle Savings (\$) |
|------|-----------------------------------|--------|---|---|
| 70   | U.S. Aviex                        | 5      | 5.0%  | -\$2,000                                    |
| 71   | Islip Municipal Landfill          | 2      | 7.5%  | -\$9,000                                    |
| 72   | Berks Sand Pit                    | 3      | 5.0%  | -\$17,000                                   |
| 73   | Arrowhead Refinery                | 5      | 5.0%  | -\$18,000                                   |
| 74   | Onalaska Municipal Landfill       | 5      | 5.0%  | -\$20,000                                   |
| 75   | Williams Property                 | 2      | 5.0%  | -\$25,000                                   |
| 76   | Odessa Chromium #1                | 6      | 5.0%  | -\$25,000                                   |
| 77   | North Cavalcade Superfund Site    | 6      | 27.5%   | -\$25,000                                   |
| 78   | Mohonk Road Industrial Plant Site | 2      | unknown   | unknown                                     |
| 79   | Dover Municipal Well 4            | 2      | unknown   | unknown                                     |
| 80   | Metal TEC/Aerosystems             | 2      | unknown   | unknown                                     |
| 81   | ABC Cleaners                      | 4      | unknown   | unknown                                     |
| 82   | Miami Drum                        | 4      | unknown   | unknown                                     |
| 83   | Coleman Evans Wood Preserving     | 4      | unknown   | unknown                                     |
| 84   | Eau Claire Municipal Well Field   | 5      | unknown   | unknown                                     |
| 85   | Duell and Gardner                 | 5      | unknown   | unknown                                     |
| 86   | Peerless Plating                  | 5      | unknown   | unknown                                     |
| 87   | Valley Park TCE Site - OU2        | 7      | unknown   | unknown                                     |
| 88   | Bunker Hill Superfund Site        | 10     | unknown   | unknown                                     |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems refers to systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. “Estimated Potential Life-cycle Savings (\$)” is calculated based on the screening methodology summarized in Section 5.0 and Table 5-1. The screening calculations for each system are presented in Appendix C and summarized in Appendix B.
3. For a variety of reasons, including recent optimization or litigation, some of the systems with the highest potential for life-cycle savings in a Region were not selected for RSEs. Narratives describing the system selection for each Region are included the Regional summary screening reports included in Appendix B.
4. For some systems where the expected system duration is unknown, a value of 30 years may have been used as a default and may underestimate the expected duration of systems, especially those located at sites with continuing sources of groundwater contamination such as LNAPL and DNAPL. Therefore, life-cycle costs and life-cycle cost savings could be underestimated for some sites.

**Table 6-3: Fund-lead P&T Systems Ranked According to Annual O&M Cost (Page 1 of 4)**

| Rank      | Site name   | Region   | Annual O&M Cost    |
|-----------|---|----------|--------------------|
| 1         | Vineland Chemical Co.                               | 2        | \$4,000,000        |
| <b>2</b>  | <b>Baird &amp; McGuire Superfund Site</b>           | <b>1</b> | <b>\$3,500,000</b> |
| 3         | Lipari Landfill site                                | 2        | \$2,500,000        |
| <b>4</b>  | <b>Ott/Story/Cordova Chem Co.</b>                   | <b>5</b> | <b>\$2,400,000</b> |
| <b>5</b>  | <b>Silresim Chemical Corp.</b>                      | <b>1</b> | <b>\$1,400,000</b> |
| 6         | Sprague Road Ground Water Plume                     | 6        | \$1,200,000        |
| 7         | American Thermostat                                 | 2        | \$1,175,000        |
| 8         | Muscoy  | 9        | \$1,100,000        |
| 9         | Higgins Farm  | 2        | \$1,000,000        |
| 10        | Havertown PCP OU2                                   | 3        | \$1,000,000        |
| 11        | Miami Drum  | 4        | \$1,000,000        |
| 12        | Cimarron Mining                                     | 6        | \$1,000,000        |
| 13        | Boomsnub/Airco                                      | 10       | \$1,000,000        |
| 14        | Combe Fill South Landfill                           | 2        | \$920,000          |
| 15        | Newmark   | 9        | \$900,000          |
| <b>16</b> | <b>Claremont Polychemical Corp.</b>                 | <b>2</b> | <b>\$740,000</b>   |
| 17        | Lang Property Superfund Site                        | 2        | \$700,000          |
| <b>18</b> | <b>Mattiace Petrochemical</b>                       | <b>2</b> | <b>\$700,000</b>   |
| 19        | North Penn Area 6                                   | 3        | \$592,900          |
| 20        | Groveland Wells Superfund Site                      | 1        | \$500,000          |
| <b>21</b> | <b>Savage Well Municipal Water System</b>           | <b>1</b> | <b>\$500,000</b>   |
| 22        | Garden State Cleaners/South Jersey Clothing Company | 2        | \$500,000          |
| 23        | Odessa Chromium #1                                  | 6        | \$500,000          |
| 24        | Ace Services  | 7        | \$500,000          |
| 25        | Wyckoff/Eagle Harbor Superfund Site                 | 10       | \$500,000          |
| 26        | Circuitron  | 2        | \$480,000          |
| <b>27</b> | <b>Oconomowoc Electroplating</b>                    | <b>5</b> | <b>\$471,000</b>   |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems refers to systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Annual operation and maintenance (O&M) costs are estimates and include such items as labor, utilities, materials, analytical work, etc.
3. For a variety of reasons, including recent optimization or litigation, some of the systems with the highest annual O&M costs in a Region were not selected for RSEs. Narratives describing the system selection for each Region are included the Regional summary screening reports included in Appendix B.

**Table 6-3: Fund-lead P&T Systems Ranked According to Annual O&M Cost (Page 2 of 4)**

| <b>Rank</b> | <b>Site name</b>                                     | <b>Region</b> | <b>Annual O&amp;M Cost</b> |
|-------------|--|---------------|----------------------------|
| 28          | Bog Creek Farm LTRA                                  | 2             | \$460,000                  |
| 29          | American Creosote Works (solute)                     | 4             | \$452,000                  |
| 30          | Charles George Landfill Superfund Site               | 1             | \$450,000                  |
| <b>31</b>   | <b>Bayou Bonfouca</b>                                | <b>6</b>      | <b>\$402,000</b>           |
| <b>32</b>   | <b>Brewster Wellfield</b>                            | <b>2</b>      | <b>\$400,000</b>           |
| 33          | SMS Instruments                                      | 2             | \$400,000                  |
| 34          | Montgomery Township/Rocky Hill                       | 2             | \$400,000                  |
| 35          | Greenwood Chemical Site                              | 3             | \$400,000                  |
| 36          | Peerless Plating                                     | 5             | \$400,000                  |
| 37          | American Creosote Works                              | 6             | \$360,000                  |
| 38          | Syncon Resins  | 2             | \$350,000                  |
| 39          | Williams Property                                    | 2             | \$350,000                  |
| <b>40</b>   | <b>Hellertown Manufacturing</b>                      | <b>3</b>      | <b>\$350,000</b>           |
| 41          | American Creosote Works (DNAPL)                      | 4             | \$300,000                  |
| 42          | Palmetto Wood  | 4             | \$300,000                  |
| 43          | Long Prairie Groundwater Contamination               | 5             | \$300,000                  |
| <b>44</b>   | <b>MacGillis and Gibbs/Bell Lumber &amp; Pole</b>    | <b>5</b>      | <b>\$300,000</b>           |
| 45          | U.S. Aviex   | 5             | \$300,000                  |
| <b>46</b>   | <b>Modesto Superfund Site</b>                        | <b>9</b>      | <b>\$300,000</b>           |
| <b>47</b>   | <b>Selma Treating Co.</b>                            | <b>9</b>      | <b>\$300,000</b>           |
| <b>48</b>   | <b>Commencement Bay, South Tacoma Channel, Well</b>  | <b>10</b>     | <b>\$300,000</b>           |
| 49          | Stanton Cleaners Area Groundwater Contamination Site | 2             | \$270,000                  |
| 50          | Kearsarge Metallurgical Corp.                        | 1             | \$250,000                  |
| 51          | Butz Landfill  | 3             | \$250,000                  |
| <b>52</b>   | <b>McCormick &amp; Baxter Creosoting Co.</b>         | <b>10</b>     | <b>\$250,000</b>           |
| 53          | Geneva Industries                                    | 6             | \$240,000                  |
| 54          | La Salle Electrical Utilities                        | 5             | \$230,000                  |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems refers to systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Annual operation and maintenance (O&M) costs are estimates and include such items as labor, utilities, materials, analytical work, etc.
3. For a variety of reasons, including recent optimization or litigation, some of the systems with the highest O&M costs in a Region were not selected for RSEs. Narratives describing the system selection for each Region are included the Regional summary screening reports included in Appendix B.

**Table 6-3: Fund-lead P&T Systems Ranked According to Annual O&M Cost (Page 3 of 4)**

| <b>Rank</b> | <b>Site name</b>                               | <b>Region</b> | <b>Annual O&amp;M Cost</b> |
|-------------|--|---------------|----------------------------|
| 55          | Islip Municipal Landfill                       | 2             | \$225,000                  |
| 56          | Verona Well Field                              | 5             | \$225,000                  |
| 57          | Eastern Surplus Company Superfund Site         | 1             | \$200,000                  |
| 58          | Keefe Environmental Systems                    | 1             | \$200,000                  |
| 59          | Croydon TCE                                    | 3             | \$200,000                  |
| 60          | Onalaska Municipal Landfill                    | 5             | \$200,000                  |
| 61          | Vestal Water Supply Well 1-1                   | 2             | \$180,000                  |
| 62          | AIW Frank/Mid-County Mustang Site, OU#1        | 3             | \$180,000                  |
| <b>63</b>   | <b>Elmore Waste Disposal</b>                   | <b>4</b>      | <b>\$180,000</b>           |
| <b>64</b>   | <b>Midland Products</b>                        | <b>6</b>      | <b>\$180,000</b>           |
| 65          | Eau Claire Municipal Wel Field                 | 5             | \$175,000                  |
| <b>66</b>   | <b>Raymark</b>                                 | <b>3</b>      | <b>\$155,711</b>           |
| 67          | Berks Sand Pit                                 | 3             | \$150,000                  |
| <b>68</b>   | <b>FCX Statesville</b>                         | <b>4</b>      | <b>\$150,000</b>           |
| 69          | CryoChem                                       | 3             | \$125,000                  |
| 70          | Douglass Road                                  | 5             | \$120,000                  |
| 71          | North Penn Area 1                              | 3             | \$100,000                  |
| <b>72</b>   | <b>Cleburn Street Well Site/OU2</b>            | <b>7</b>      | <b>\$100,000</b>           |
| 73          | Saunders Supply Company                        | 3             | \$80,000                   |
| 74          | Wash King Laundry                              | 5             | \$75,000                   |
| 75          | Arrowhead Refinery                             | 5             | \$70,000                   |
| 76          | Cape Fear Wood Preserving                      | 4             | \$40,000                   |
| 77          | City of Perryton Well #2                       | 6             | \$37,000                   |
| 78          | Better Brite Plating Co. Chrome and Zinc Shops | 5             | \$36,000                   |
| 79          | Benfield Industries                            | 4             | \$30,000                   |
| 80          | Mohonk Road Industrial Plant Site              | 2             | unknown                    |
| 81          | Dover Municipal Well 4                         | 2             | unknown                    |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems refers to systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Annual operation and maintenance (O&M) costs are estimates and include such items as labor, utilities, materials, analytical work, etc.
3. For a variety of reasons, including recent optimization or litigation, some of the systems with the highest O&M costs in a Region were not selected for RSEs. Narratives describing the system selection for each Region are included the Regional summary screening reports included in Appendix B.

**Table 6-3: Fund-lead P&T Systems Ranked According to Annual O&M Cost (Page 4 of 4)**

| <b>Rank</b> | <b>Site name</b>               | <b>Region</b> | <b>Annual O&amp;M Cost</b> |
|-------------|--------------------------------|---------------|----------------------------|
| 82          | Metal TEC                      | 2             | unknown                    |
| 83          | ABC Cleaners                   | 4             | unknown                    |
| 84          | Coleman Evans Wood Preserving  | 4             | unknown                    |
| 85          | Duell and Gardner              | 5             | unknown                    |
| 86          | North Cavalcade Superfund Site | 6             | unknown                    |
| 87          | Valley Park TCE Site - OU2     | 7             | unknown                    |
| 88          | Bunker Hill Superfund Site     | 10            | unknown                    |

*Data reflect estimates provided by site Remedial Project Managers between February and May 2001. These estimates may vary from actual values. Data, including the number and status of systems, may change over time.*

Notes:

1. Fund-lead P&T systems refers to systems where groundwater extraction and treatment is specified in the Record of Decision and oversight is provided by the EPA or by a State with financial support from Superfund.
2. Annual operation and maintenance (O&M) costs are estimates and include such items as labor, utilities, materials, analytical work, etc.
3. For a variety of reasons, including recent optimization or litigation, some of the systems with the highest O&M costs in a Region were not selected for RSEs. Narratives describing the system selection for each Region are included the Regional summary screening reports included in Appendix B.

---

## 7.0 CONCLUSIONS AND LESSONS LEARNED

---

This nationwide effort to identify and gather information on Fund-lead P&T systems resulted in an improved understanding of the number of Fund-lead P&T systems, the specifications and performance of these systems, and the estimated costs required to operate and maintain these systems. In total, 88 operational and pre-operational Fund-lead P&T systems were identified, with pre-operational referring to systems that are identified in a ROD and are in a stage of pre-design, design, or installed but not yet operating. Of these 88 systems, 67 are operational and 21 are pre-operational. Annual costs for each system ranged from less than \$100,000 per year to approximately \$4,000,000 per year. The following findings result from the cost information for Fund-lead P&T systems:

- The estimated average annual operation and maintenance (O&M) cost for a Fund-lead P&T system (based on those 79 systems providing cost data) is approximately \$570,000 and the median cost is \$350,000. The discrepancy between these two statistics is due to a small number of systems with relatively high O&M costs.
- Based on the 79 systems that provided cost information, the estimated total annual O&M cost for operating the Fund-lead P&T systems in 2002 is approximately \$38 million, with EPA incurring approximately \$32.5 million of the total annual cost and the associated States incurring the remaining \$5.5 million.
- Based on the 79 systems that provided cost information, the estimated future cost for Long-term Remedial Action (LTRA) O&M for all of these systems exceeds \$210 million with discounting (i.e., net present value) and exceeds \$270 million without discounting. LTRA refers to the first 10 years of operation of a groundwater or surface water restoration action. During this period, EPA typically funds 90% of the cost and the associated State funds 10% of the costs. These percentages translate directly to the presented costs; therefore, the Superfund is expected to pay approximately \$189 million (\$243 million without discounting) and the States are expected to pay approximately \$21 million (\$27 million without discounting).
- Based on the 79 systems that provided cost information, the estimated future cost for O&M of Fund-lead P&T systems until remediation completion is achieved is approximately \$470 million with discounting (net-present value) and \$790 million without discounting. (These estimates of future O&M costs are based on the annual costs of systems and expected durations of systems as specified by the site managers. For some systems where expected system duration is unknown, a value of 30 years may have been used as a default value for this parameter. While the practice of using 30 years as a default was prevalent in the past, more recent EPA guidance on feasibility study preparation recommends that 30 years not be used as a default.)
- 13 of the 79 systems that provided costs account for approximately 50% of the total reported annual O&M costs.

A total of 26 States reportedly have Fund-lead P&T systems. Upon completion of the 10-year LTRA period each system will be transferred to its associated State and that State will assume 100% of the remaining O&M costs. For systems where restoration is not a goal (i.e., containment and water supply

systems) the systems are typically transferred to the States after one year. The collected data suggest that the States will incur between approximately \$250 million with discounting or \$520 million without discounting in post-LTRA O&M costs for Fund-lead P&T systems that reported annual O&M costs. Furthermore, the data suggest that the following five States will likely incur 78% of these post-LTRA O&M costs:

- New Jersey (27.6%)
- Massachusetts (22.6%)
- New York (9.7%)
- Pennsylvania (9.6%)
- Michigan (8.4%)

In addition to cost information, the following statistics about the Fund-lead P&T systems were also gleaned from the information reported by the system RPMs:

- 40 of 67 operating systems are reported to be controlling plume migration.
- 60 of the 67 operating systems have groundwater restoration as a goal but 21 of that 60 do not have estimates of the progress toward that restoration. Of the 39 systems that have both groundwater restoration as a goal and an estimate of progress toward restoration, 7 are estimated to have made more than 80% progress toward restoration.
- 52 of the 88 systems have three or more primary contaminants of concern, and chlorinated solvents are the most prevalent contaminants as they are addressed by 56 of the 88 systems.
- 35 of the 88 Fund-lead P&T systems are associated with sites where non-aqueous phase liquid (NAPL) has either been observed or suspected.
- Carbon adsorption and air stripping are the most prevalent treatment processes (carbon adsorption is used at 50 of the 88 systems and air stripping is used at 41).
- Based on 64 of 88 systems where RPMs were able to determine costs specifically used for groundwater monitoring, Fund-lead P&T systems have, on average, 23 monitoring wells for groundwater sampling that are sampled three to four times per year for an average cost of \$112,000 per year.
- 36 of the 67 operating systems have previously had performance and effectiveness evaluated and found “sufficient” while 7 had performance and effectiveness found “not sufficient” (the remaining systems are either being evaluated, have not been evaluated, or have not provided information regarding previous effectiveness evaluations).



The following items detail lessons learned from this data-collection phase of the Nationwide Remediation System Evaluation (RSE) Optimization Project.

***Additional RSEs should be commissioned***

Although the screening methodology targeted systems in each Region that had effectiveness problems or relatively high operating costs, a number of systems with similar issues were not selected for RSEs. Some of these unselected systems are receiving third-party optimization evaluations not associated with this project. Many of the other unselected systems, however, would benefit from third-party optimization evaluations such as an RSE. Therefore, additional RSEs should be commissioned to optimize some of the remaining Fund-lead systems.

***A central database or other information system for Fund-lead systems (not limited to P&T) should be developed and maintained through annual or semi-annual updates by Remedial Project Managers. Consideration should also be given to extend such a database to include non-Fund-lead systems as well.***

- Identifying all of the Fund-lead P&T systems in each Region was greatly facilitated by the project liaisons in each Region. However, to identify these systems, liaisons were required to interview branch chiefs and individual Remedial Project Managers. A central, up-to-date database would eliminate the need for repeating this interview process in the future. Managers for each site, including sites new to Superfund, should be required to update site information in a central information system (e.g., a database). The database created for this project offers a solid beginning. The data in the current database could be made available to site managers so that they may update it when required rather than reentering all of the information.
- Questions as to the definition of “pump-and-treat” arose repeatedly. In Region 9 well-head treatment systems were not included, and in Region 8, a NAPL-recovery system was not included. Furthermore, soil-vapor-extraction (SVE) systems were also not included. By not including these systems in the study, the total amount of Fund-lead expenditures could not be estimated and these systems were not considered for optimization.
- Within each Region, “fact sheets” are prepared for each system by the system’s Remedial Project Manager (RPMs). As these “fact sheets” are already updated on a regular basis, broadening the required information on each “fact sheet” would make them the primary information source on each system. Because they are written documents, these “fact sheets” are more flexible than databases. First, they are not constrained to single preformatted answers (e.g., a selection from a list or single number) as is typically required for database questionnaires. Second, they can be used for any type of system or site whereas database questionnaires are typically tailored for a specific type of system or site. Future databases for specific projects could be easily generated from these “fact sheets”.
- The CERCLIS database and many resources or databases within each Region are available. Consideration should be given to linking the proposed central database to CERCLIS and these Regional resources.
- Some of the data collected as part of this project may also be relevant for tracking the progress of non-Fund-lead systems. Consideration should be given to collecting information on these systems as well.

***Future web-based questionnaires may need to be more lenient in accepting data.***

A number of RPMs did not complete questionnaires because information required by the web-based survey (i.e., “required fields”) was not available for the specific system. This repeatedly occurred for planned P&T systems for which RPMs did not yet have cost estimates or system specifications. Because these fields were required in order to save the input, information on many systems had to be gathered through phone interviews.

---

## APPENDICES

---

- Appendix A: Information Sheets for each Fund-lead P&T System
- Appendix B: Summary Phase 1 Reports of each Region
- Appendix C: Screening Calculations for each Fund-lead P&T System

These appendices are not included in this document. This document, with its appendices (EPA 542-01-021b) or without its appendices (EPA 542-01-021a), may be downloaded from EPA's Clean Up Information (CLUIN) System at <http://www.clu-in.org>. A limited number of hard copies of each version are also available free of charge from the National Service Center for Environmental Publications (NSCEP) at the following address:

U.S. EPA National Service Center for Environmental Publications  
P.O. Box 42419  
Cincinnati, OH 45242-2419  
Phone: (800) 490-9198 or (513) 489-8190  
Fax: (513) 489-8695

